

SITE DEVELOPMENT PLANS

MCKNIGHT FALLS APARTMENTS - PHII

COMMERCIAL DEVELOPMENT

PREPARED FOR
MCKNIGHT FALLS, LLC

JONESBORO, ARKANSAS
MAY 25, 2017

LOCAL CONTACTS

CITY OF JONESBORO - PLANNING & ZONING DEPARTMENT
300 South Church Street
Jonesboro, AR 72401
PH-870-932-0406

CITY OF JONESBORO - ENGINEERING DEPARTMENT
300 South Church Street
Jonesboro, AR 72401
PH-870-932-2438

CITY OF JONESBORO - FIRE SAFETY DEPARTMENT
3215 East Johnson
Jonesboro, AR 72401
PH-870-932-2428

CITY WATER & LIGHT - ENGINEERING DEPARTMENT
400 East Monroe
Jonesboro, AR 72401
PH-870-930-3320

ARKANSAS STATE HIGHWAY DEPARTMENT - R.O.W. PERMITS
2510 Hwy. 412 West
P.O. BOX 98
Paragould, AR 72451
PH-870-239-9511

ARKANSAS DEPARTMENT OF ENVIRONMENTAL QUALITY
2212 Fowler Ave. - Suite B
Jonesboro, AR 72401 72401
PH-870-935-7221

CENTERPOINT ENTERGY
613 Southwest Drive
Jonesboro, AR 72401
PH-800-555-6322

AT&T
723 South Church
Jonesboro, AR 72401
PH-870-972-7596

RITTER COMMUNICATIONS
2109 Fowler Ave.
Jonesboro, AR 72401
PH-870-336-3421

SUDDENLINK
1520 South Caraway
Jonesboro, AR 72401
PH-870-897-5697

VICINITY MAP





| | |
|----------|---------------------------|
| 1 of 11 | TITLE PAGE |
| 2 of 11 | NOTES AND SPECIFICATIONS |
| 3 of 11 | SWPPP / DEMO |
| 4 of 11 | SITE DIMENSION PLAN |
| 5 of 11 | GRADING AND DRAINAGE PLAN |
| 6 of 11 | OVERALL DRAINAGE PLAN |
| 7 of 11 | SITE UTILITY PLAN |
| 8 of 11 | SWPPP DETAILS |
| 9 of 11 | SITE CONSTRUCTION DETAILS |
| 10 of 11 | WATER DETAILS |
| 11 of 11 | SEWER DETAILS |

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM



PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

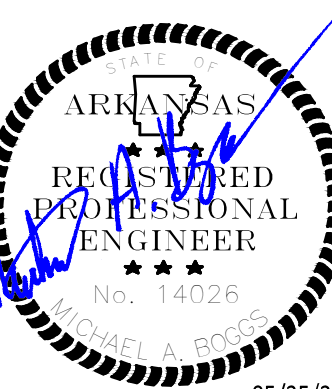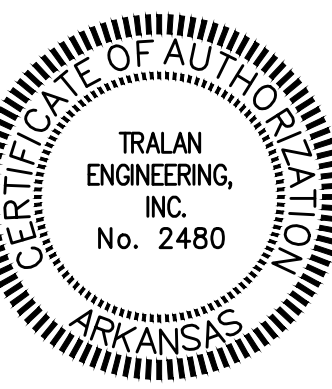

| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |
| | | |

| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | |
| JOB NO.: | 16-080 |
| CAD NO.: | |

TITLE
PAGE

SHEET NUMBER:
1 of 11

SITE INFORMATION

1.

SITE INFORMATION

LEGAL DESCRIPTION/LAND AREA - LOT 2 OF MCKNIGHT FALLS REPLAT

CURRENT ZONING - R-6 LUO

EXISTING USE - VACANT

PROPOSED USE - MULTIFAMILY

BUILDING AREA - 45,090 SQFT

BUILDING AREA COVERAGE - 4.33%

PARKING REQUIRED IS 2.25 SPACES PER 2-BEDROOM UNIT.

PARKING REQUIRED - 2.25 X 69 = 156 SPACES

PARKING AVAILABLE - 188 SPACES

IMPERVIOUS AREA - 128,944 SQFT
2.

ALL DIMENSIONS AND RADII ARE REFERENCED FROM THE BACK OF CURB. ALL RADII NOT LABELED SHALL HAVE A MINIMUM RADIUS OF 5 FEET.
3.

ALL DUMPSTER AREAS SHALL BE SCREENED ON AT LEAST THREE SIDES.

VERTICAL AND HORIZONTAL CONTROL

1.

THE SITE VERTICAL BENCHMARK IS THE CENTER OF AN EXISTING SANITARY SEWER MANHOLE LOCATED APPROXIMATELY 85 FEET NORTH OF THE PROPOSED DRIVE. THE MANHOLE IS LOCATED IN THE EAST EDGE OF KATHLEEN STREET AS SHOWN ON PLANS. ELEV = 248.74'

VERTICAL CONTROL - NAVD 88
2.

HORIZONTAL CONTROL POINT A

N- 546,142.42

E- 1,715,053.75

HORIZONTAL CONTROL POINT B

N- 545,702.37

E- 1,715,046.63

HORIZONTAL CONTROL - AR STATE PLANE GRID NORTH ZONE-NAD 83

LANDSCAPING REQUIREMENTS

1.

AT LEAST ONE (1) TREE & THREE (3), FIVE (5) GALLON SHRUBS SHALL BE PROVIDED FOR EACH UNIT.

69 UNITS

69 UNITS*(1 TREE/1 UNIT) = 69 TREES REQUIRED

69 UNITS*(3 SHRUBS/1 UNIT) = 207 SHRUBS REQUIRED
2.

TREE PLANTING AREAS SHALL BE AT LEAST SEVEN (7) FEET WIDE AND PROTECTED BY RAISED CURBS TO PREVENT DAMAGE BY VEHICLES.
3.

ALL TREES SHALL BE OF ORNAMENTAL, EVERGREEN, OR OF THE LARGE DECIDUOUS TYPE.
4.

LARGE DECIDUOUS TREES SHALL HAVE A MINIMUM HEIGHT OF EIGHT (8) FEET, AND A MINIMUM DIAMETER OF THREE (3) INCHES, MEASURED AT A POINT THAT IS AT LEAST FOUR AND ONE-HALF (4.5) FEET ABOVE THE EXISTING GRADE LEVEL.
5.

ORNAMENTAL TREES SHALL HAVE A MINIMUM HEIGHT OF FOUR (4) FEET.
6.

CONIFERS OR UPRIGHT EVERGREEN TREES SHALL HAVE A MINIMUM HEIGHT, AFTER PLANTING, OF SIX (6) FEET.
7.

ALL LANDSCAPING SHALL BE INSTALLED ACCORDING TO SOUND NURSERY PRACTICES IN A MANNER DESIGNED TO ENCOURAGE VIGOROUS GROWTH.
8.

ALL SEEDING APPLICATIONS SHALL BE CONSTRUCTED IN ACCORDANCE WITH AHTD STANDARD SPECIFICATIONS-2014 EDITION. CONTRACTOR MUST SUBMIT TO THE DESIGN ENGINEER ALL REQUESTED DEVIATIONS FROM THE MATERIALS, PREPARATION TECHNIQUES, AND CONSTRUCTION PRACTICES DESCRIBED IN SECTION 620. ALL GRANTED DEVIATIONS SHALL BE WARRANTED BY THE CONTRACTOR FOR NO LESS THAN YEAR.

WARRANTY DISCLAIMER

THE DESIGNS REPRESENTED IN THESE DOCUMENTS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING. HOWEVER, NEITHER THE ENGINEER NOR ITS PERSONNEL CAN OR DO WARRANT THESE DOCUMENTS AS CONSTRUCTED EXCEPT IN SPECIFIC CASES WHERE THE ENGINEER INSPECTS AND CONTROLS THE PHYSICAL CONSTRUCTION ON A CONTEMPORARY BASIS AT THE SITE.

SAFETY NOTICE TO CONTRACTOR

THE CONTRACTOR SHALL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES. THIS INCLUDES THE SAFETY OF ALL PERSONS AND PROPERTY DURING THE PERFORMANCE OF ALL WORK AND IS NOT LIMITED TO NORMAL WORKING HOURS. ANY CONSTRUCTION OBSERVATION BY THE ENGINEER OF THE CONTRACTOR'S PERFORMANCE IS NOT INTENDED TO INCLUDE REVIEW OF THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES IN, ON, OR NEAR THE CONSTRUCTION SITE.

GENERAL NOTES

1.

CONTRACTOR IS RESPONSIBLE FOR ACQUIRING ALL LOCAL, STATE, AND FEDERAL PERMITS RELATED TO ANY CONSTRUCTION ACTIVITY.
2.

CONSTRUCTION LIMITS ARE TO BE CLEARED BY CONTRACTOR. ALL STUMPS, DEBRIS, ETC., REMAINING WITHIN THE PROJECT LIMITS SHALL BE REMOVED AND DISPOSED OF BY THE CONTRACTOR AT HIS/HER EXPENSE.
3.

CONTRACTOR SHALL KEEP AN ORDERLY WORK SITE AND SHALL DISPOSE OF ALL CONSTRUCTION DEBRIS IN ACCORDANCE WITH ALL LOCAL, STATE, AND/OR FEDERAL REGULATIONS.
4.

BEFORE ANY CLEARING OR EXCAVATIONS ARE MADE, THE CONTRACTOR SHALL CONTACT THE ARKANSAS ONE-CALL AT 811 AT LEAST TWO DAYS PRIOR TO THE COMMENCEMENT OF ANY SAID ACTIVITY.
5.

CONTRACTOR SHALL TAKE ALL PRECAUTIONS NECESSARY TO AVOID DAMAGE TO EXISTING FACILITIES AND/OR ADJACENT PROPERTIES, AND SHALL BE RESPONSIBLE FOR ANY DAMAGE THAT MAY OCCUR.
6.

CONTRACTOR SHALL PROTECT ALL TREES TO REMAIN WITH SUBSTANTIAL FENCING TO THE OUTER DRIP EDGE AND NO GRADING SHALL BE PERFORMED INSIDE THIS AREA.
7.

ACCESS ALONG ROADWAYS SHALL BE MAINTAINED AT ALL TIMES. CONSTRUCTION IN CITY, COUNTY, OR STATE RIGHTS-OF-WAY SHALL BE COORDINATED BY CONTRACTOR WITH THE APPROPRIATE PARTY. ALL WORK ZONE TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE REQUIREMENTS OF THE NATIONAL COOPERATIVE HIGHWAY RESEARCH PROGRAM (NCHRP) REPORT 350.
8.

CONTRACTOR SHALL NOT CONSTRUCT A DRIVEWAY OF ANY TYPE UNTIL THE OWNER HAS SECURED A DRIVEWAY ACCESS PERMIT FROM THE ARKANSAS HIGHWAY AND TRANSPORTATION DEPARTMENT (AHTD) OR THE LOCAL MUNICIPALITY.
9.

THE LOCATIONS AND SIZES OF EXISTING UNDERGROUND UTILITIES SHOWN ARE BASED FIELD MEASUREMENTS AND EXISTING UTILITY MAPS. TRALAN ENGINEERING, INC. MAKES NO GUARANTEE TO THE EXACT LOCATION OF THE UTILITIES SHOWN ON THESE PLANS. LOCATIONS OF UNDERGROUND UTILITIES AND STRUCTURES MAY VARY FROM LOCATIONS SHOWN. NO EXCAVATIONS WERE MADE TO LOCATE BURIED UTILITIES OR STRUCTURES.
10.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CONSTRUCTION STAKEOUT. CONTRACTOR SHALL VERIFY ALL MEASUREMENTS, ELEVATIONS, STATIONS, ETC. BEFORE ORDERING MATERIALS OR PROCEEDING WITH WORK, AND IS RESPONSIBLE FOR SAME. IF ANY DISCREPANCY IN THE PLANS OR SPECIFICATIONS ARISES, THE CONTRACTOR SHALL CONTACT THE OWNER OR THE OWNER'S REPRESENTATIVE BEFORE INITIATING WORK AFFECTED BY THE DISCREPANCY.
11.

THE CONTRACTOR IS CAUTIONED AND SHALL BE RESPONSIBLE FOR NOTIFYING THE OWNER OR OWNER'S REPRESENTATIVE OF ANY ERROR OR OMISSION ON THESE PLANS WHICH MAY CREATE ADDITIONAL WORK OR EXPENSE BY THE CONTRACTOR. A WRITTEN WORK ORDER SHALL BE OBTAINED FROM THE OWNER OR OWNER'S REPRESENTATIVE PRIOR TO PROCEEDING WITH ANY EXTRA WORK WHICH MAY BE CAUSED FROM SUCH ERROR OR OMISSION ON THESE CONSTRUCTION DOCUMENTS.

STANDARD ACCESSIBILITY REQUIREMENTS

1.

HANDICAP ACCESSIBLE SPACES AND ACCESS AISLES SHALL HAVE A MAXIMUM SLOPE OF 2% IN ALL DIRECTIONS.
2.

ALL ACCESSIBLE PARKING SPACES SHALL HAVE A VERTICALLY MOUNTED SIGN SHOWING THE SYMBOL OF ACCESSIBILITY. AT LEAST ONE SPACE MUST HAVE AN ADDITIONAL SIGN "VAN ACCESSIBLE" MOUNTED BELOW THE SIGN OF ACCESSIBILITY. SIGNS SHALL BE LOCATED 60 INCHES MINIMUM ABOVE THE ADJACENT PAVED SURFACE TO THE BOTTOM OF TEXT.
3.

ACCESS AISLES SERVING ACCESSIBLE PARKING SPACES SHALL BE 60 INCHES MINIMUM. ALL VAN ACCESSIBLE SPACES SHALL HAVE ACCESS AISLES THAT ARE 96 INCHES MINIMUM.
4.

HANDICAP ACCESSIBLE ROUTES SHALL HAVE A MAXIMUM CROSS-SLOPE OF 2% AND A MAXIMUM RUNNING SLOPE OF 5%.
5.

HANDICAP ACCESSIBLE RAMPS EXCEEDING 6 INCHES IN RISE (EXCLUDING CURB RAMPS) SHAVE HAVE HANDRAILS ON EACH SIDE BETWEEN 34 INCHES AND 36 INCHES IN HEIGHT, AND EXTEND 12 INCHES BEYOND THE TOP AND BOTTOM OF THE RAMP. HANDRAILS SHALL NOT DIMINISH THE CLEAR AREA REQUIRED FOR TOP AND BOTTOM LANDINGS SERVICING THE RAMPS.
6.

BOTTOM LANDINGS FOR HANDICAP ACCESSIBLE RAMPS SERVING REQUIRED EXITS SHALL BE 5 FT X 5 FT MINIMUM.
7.

ALL SIDEWALKS MUST BE AT LEAST 36 INCHES WIDE.
8.

HANDICAP ACCESSIBLE RAMPS SHALL NOT EXCEED A 1:12 SLOPE.

STORMWATER POLLUTION PREVENTION PLAN NOTES

1.

ALL EROSION AND SEDIMENT CONTROL MEASURES PRESENTED ON THESE CONSTRUCTION DOCUMENTS AND IN THE STORM WATER POLLUTION PREVENTION PLAN SHALL BE INSTALLED AS SOON AS PRACTICAL.
2.

TRAFFIC THAT EXITS THE CONSTRUCTION SITE MUST USE THE CONSTRUCTION EXIT. ANY SEDIMENT THAT IS TRACKED OFF-SITE MUST BE REMOVED IMMEDIATELY.
3.

THE CONCRETE TRUCK WASHOUT AREA MUST BE CONFINED TO THE LOCATION SHOWN ON THESE DOCUMENTS. CONCRETE WASHOUT SHALL NOT BE DISCHARGED FREELY ON THE SITE OR INTO ANY STORM WATER SYSTEM.
4.

A TEMPORARY SANITARY FACILITY MUST BE PLACED ONSITE. THE EXACT LOCATION SHALL BE COORDINATED WITH THE OWNER OR OWNER'S REPRESENTATIVE.
5.

ALL SWPPP DOCUMENTS MUST BE UPDATED IMMEDIATELY IF ANY CHANGE ARE DURING CONSTRUCTION. ALL CHANGES MUST ME APPROVED BY THE OWNER OR THE OWNER'S REPRESENTATIVE.
6.

CONTROL MEASURES MUST BE WELL MAINTAINED DURING ALL CONSTRUCTION ACTIVITIES TO ENSURE MINIMAL OFF-SITE ACCUMULATION OF SEDIMENT. A QUALIFIED PERSON MUST INSPECT EVERY CONTROL MEASURES AT LEAST ONCE EVERY SEVEN DAYS. ALL DEFICIENCIES SHALL BE REPAIRED WITHIN THREE DAYS OF DISCOVERY, UNLESS OTHERWISE DIRECTED BY STATE OR LOCAL OFFICIALS.
7.

DISTURBED PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITY WILL STOP FOR AT LEAST 21 DAYS SHALL BE SEEDED WITHIN 14 DAYS.
8.

CONTRACTOR WILL BE RESPONSIBLE FOR REMOVING SEDIMENT COLLECTED IN ANY DETENTION/RENTION POND OR STORM SEWER SYSTEM AFTER THE SITE HAS BEEN FULLY STABILIZED.
9.

ALL TEMPORARY CONTROL MEASURES SHALL BE DISPOSED OF WITHIN 30 DAYS AFTER FINAL STABILIZATION. FINAL STABILIZATION HAS OCCURRED WHEN ALL DISTURBANCE ACTIVITIES HAS CEASED AND A UNIFORM PERENNIAL VEGETATIVE COVER WITH A DENSITY OF 80% HAS BEEN ESTABLISHED ON ALL UNPAVED AREAS.

GRADING AND DRAINAGE NOTES

1.

ALL SUBGRADE STRUCTURAL FILL SHALL BE PLACED IN UNIFORM HORIZONTAL LIFTS NOT EXCEEDING 8 INCHES IN LOOSE THICKNESS AND COMPACTED WITH SUITABLE EQUIPMENT TO ACHIEVE 95% STANDARD PROCTOR (ASTM D698) AT 2% BELOW TO 3% ABOVE OPTIMUM MOISTURE CONTENT. STRUCTURAL FILL MATERIALS SHALL HAVE A PLASTICITY INDEX BETWEEN 5 AND 25 AND A LIQUID LIMIT NOT EXCEEDING 50. ALL FILL MATERIAL SHALL BE LESS THAN 3" IN DIAMETER.
2.

ALL BASE MATERIAL SHALL BE COMPACTED TO 98% MODIFIED PROCTOR (ASTM D1557).
3.

ASPHALT SURFACE COURSE MATERIALS SHALL BE CONSTRUCTED IN ACCORDANCE WITH AHTD STANDARD SPECIFICATIONS-2014 EDITION. ALL PARKING LOTS SHALL BE CONSTRUCTED UTILIZING THE 3/8" ASPHALT CONCRETE HOT MIX SURFACE COURSE DESIGN REQUIREMENTS AS SHOWN IN SECTION 407 & 409. CONTRACTOR SHALL MEET THE CONSTRUCTION REQUIREMENTS AND ACCEPTANCE CRITERIA IN SECTION 410. ASPHALT CONCRETE PAVEMENTS SHALL NOT BE APPLIED WHEN THE SURFACE TEMPERATURE IS BELOW 40 DEGREES (F), WHEN THERE IS FROST IN THE BASE MATERIAL, OR ANY OTHER TIME WHEN WEATHER CONDITIONS ARE UNSUITABLE.
4.

ALL CONCRETE CURB AND GUTTER SECTIONS SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 3000 PSI.
5.

ALL SIDEWALK, DRIVING, PARKING, AND DUMPSTER AREAS SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 4000 PSI AND REINFORCED WITH MASTERFIBER MAC 2200 CB AT AN APPLICATION RATE OF 3 LB/CU. YD. AN EQUIVALENT REINFORCEMENT PRODUCT SUCH AS WELDED WIRE MESH (GALVANIZED FLAT SHEETS ONLY) OR REBAR MATS MAY BE USED, BUT MUST BE APPROVED BY DESIGN ENGINEER. ALL WELED WIRE MESH AND REBAR MATS SHALL BE PLACED ON CHAIRS OR BAR SUPPORTS AT INTERVALS NECESSARY FOR PROPER REINFORCEMENT PLACEMENT. THE MAXIMUM FLY ASH CONTENT IN THE CONCRETE SHALL NOT EXCEED 10% OF THE TOTAL CEMENTITIOUS MATERIAL. THE TOTAL TARGETED AIR CONTENT SHALL BE 5% (PLUS OR MINUS 1%) AS DETERMINED BY ASTM C173/C173M. MAXIMUM SLUMP SHALL BE 5 INCHES AS DETERMINED BY ASTM C143. MAXIMUM WATER-TO-CEMENT RATIO SHALL BE 0.45.
6.

A WHITE-PIGMENTED MEMBRANE-FORMING CURING COMPOUND MEETING ASTM C409, TYPE II, CLASS A REQUIREMENTS SHALL BE APPLIED ON ALL CONCRETE SURFACES. THE APPLICATION RATE SPECIFIED BY THE MANUFACTURER SHALL BE USED UNLESS SITE CONDITIONS WARRANT EXTRA COVERAGE. A SECOND APPLICATION AT A 90 DEGREE OFFSET IS RECOMMENDED ON WINDY DAYS OR WHENEVER A SINGLE APPLICATION RESULTS IN COVERAGE THAT IS NOT UNIFORM. THE MINIMUM APPLICATION RATE SHALL NEVER BE LESS THAN 200 SQ FT/GAL.
7.

HOT AND COLD WEATHER WARRANT SPECIAL PRECAUTIONS WHEN PLACING, FINISHING, AND PROTECTING CONCRETE AGAINST THE EFFECTS OF WEATHER. DURING HOT WEATHER THE CONTRACTOR MUST COMPLY WITH ACI 305.1 AND DURING COLD WEATHER ACI 306.1.
8.

CONTRACTOR IS CAUTIONED TO NOT PREMATURELY FINISH OR OVERWORK THE SURFACE OF EXTERIOR AIR-ENTRAINED CONCRETE WHICH MAY LEAD TO SURFACE DELAMINATION.
9.

ALL CONCRETE PAVEMENT AND SIDEWALKS SHALL HAVE A LIGHT BROOM FINISH THAT IS PERPENDICULAR TO THE PAVEMENT DIRECTION.
10.

THE MAXIMUM CONTRACTION JOINT SPACING OF ANY CONCRETE PANEL SHALL BE 30 TIMES THE THICKNESS OF THE SLAB. IN NO CASE SHALL THE SPACING EXCEED 15 FEET. JOINT PATTERNS SHOULD DIVIDE ALL PAVEMENT SECTIONS INTO APPROXIMATELY SQUARE PANELS. THE LENGTH OF ANY PANEL SHALL NEVER BE MORE THAN 25% GREATER THAN ITS WIDTH. ALL JOINTS SHALL BE CONSTRUCTED TO A MINIMUM DEPTH OF ½ THE THICKNESS OF THE SLAB. TRAVERSE JOINTS SHALL BE CONSTRUCTED BEFORE ANY LONGITUDINAL JOINT.
11.

ALL CURB AND GUTTER SECTIONS SHALL HAVE CONTRACTION JOINTS CONSTRUCTED AT A MAXIMUM SPACING OF 15 FT.
12.

ISOLATION (EXPANSION) JOINTS ARE REQUIRED WHERE CURB AND PAVEMENTS ABUT BUILDINGS, FOUNDATIONS, EXISTING PAVEMENTS, MANHOLES AND OTHER FIXED OBJECTS.
13.

ALL CONCRETE ISOLATION JOINTS SHALL BE SEALED IN ACCORDANCE WITH ACI 504R.
14.

STORM SEWER MANHOLES SHALL BE PRE-CAST OR POURED IN PLACE CONCRETE. REFER TO GRADING AND DRAINAGE PLAN FOR MANHOLE SIZE AND SHAPE. CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 4000 PSI. ALL MANHOLE RING AND COVERS SHALL BE 24" DIAMETER GRAY CAST IRON (DEETER 2018-A OR EQUIVALENT).
15.

ALL DRAINAGE PIPE SHALL BE CLASS III REINFORCED CONCRETE PIPE, UNLESS NOTED OTHERWISE. CONTRACTOR MAY BID ANOTHER EQUIVALENT PIPE MATERIAL EXCEPT UNDER PUBLIC ROAD CROSSINGS. ALL EQUIVALENT PIPES SHALL BE APPROVED BY THE OWNER OR OWNER'S REPRESENTATIVE AND HAVE A MINIMUM MANNING'S ROUGHNESS COEFFICIENT ("N") OF 0.013.
16.

THE MINIMUM BARREL SPACING ON MULTIPLE PARALLEL PIPE RUNS SHALL BE IN CONFORMANCE WITH THE BELOW TABLE:

| DIAMETER | SPACING |
|--------------|-------------------|
| 12" TO 24" | 12" |
| 24" TO 72" | 1/2 PIPE DIAMETER |
| 72" AND OVER | 36" |
17.

CONTRACTOR SHALL FAMILIARIZE HIMSELF/HERSELF WITH THE GRADES SHOWN ON THESE CONSTRUCTION DOCUMENTS. ALL COMBINATION CURB AND GUTTER SECTIONS SHALL HAVE THE GUTTER PORTION PITCHED IN THE SAME DIRECTION OF THE INTENDED FLOW.
18.

CONTRACTOR SHALL MAINTAIN POSITIVE DRAINAGE IN CONFORMANCE WITH THE GRADES AND SLOPES SHOWN ON THESE CONSTRUCTION DOCUMENTS THROUGHOUT ALL SITE GRADING AND EXCAVATING ACTIVITIES.

PAINTED PAVEMENT MARKINGS

1.

PARKING LOT/STREET MARKINGS, CROSSWALKS, ARROWS, SYMBOLS AND CURB MARKINGS SHALL COMPLY WITH THE DETAILS DEPICTED ON THESE DOCUMENTS AND IN ACCORDANCE WITH THE FEDERAL HIGHWAY ADMINISTRATION-MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES FOR STREETS AND HIGHWAYS (MUTCD).
2.

ALL MARKING PAINT MATERIAL SHALL BE ON THE MASTER PAINTERS INSTITUTE APPROVED LIST FOR TRAFFIC MARKING PAINT (MPI #97). STREET AND PARKING STRIPES SHALL BE WHITE OR YELLOW AS SHOWN ON CONSTRUCTION DOCUMENTS. CROSSWALKS, ARROWS, AND SYMBOLS SHALL BE WHITE.
3.

CONTRACTOR SHALL ALLOW NEW PAVEMENT SURFACES TO CURE FOR A PERIOD OF NOT LESS THAN 14 DAYS BEFORE APPLICATION OF MARKING MATERIALS.
4.

CONTRACTOR SHALL CLEAN SURFACES THOROUGHLY PRIOR TO INSTALLATION AND BEGIN MARKING AS SOON AS PRACTICAL.
5.

PAINT MARKINGS SHALL NOT BE APPLIED IF THE TEMPERATURE OF THE SURFACE TO BE PAINTED OR THE ATMOSPHERE IS LESS THAN 50 DEGREES (F) OR MORE THAN 95 DEGREES (F).
6.

CONTRACTOR SHALL UNIFORMLY APPLY ALL PAINTED MARKINGS TO THE COLORS, LENGTHS, AND WIDTHS AS INDICATED ON THESE CONSTRUCTION DOCUMENTS. PAINT SHALL BE APPLIED IN ONE COAT WITH A WET FILM THICKNESS OF 0.015" MINIMUM AND A WIDTH TOLERANCE OF PLUS OR MINUS 1/8".
7.

ALL ARROWS AND SYMBOLS SHALL UTILIZE A SUITABLE TEMPLATE THAT WILL PROVIDE A PAVEMENT MARKING WITH TRUE, SHARP EDGES AND ENDS.
8.

CONTRACTOR SHALL PROVIDE ANY BARRICADES, WARNING SIGNS, AND FLAGS AS NECESSARY TO PREVENT TRAFFIC FROM CROSSING NEWLY PAINTED MARKINGS.
9.

ANY DEFECTIVE MARKING SHALL BE REMOVED IN MANNER TO AVOID DAMAGE TO THE SURFACE TO WHICH THE MARKING WAS APPLIED AND REPLACED AT NO ADDITIONAL COST TO THE OWNER.

WATER-SEWER UTILITY NOTES

1.

ALL MATERIALS USED FOR THE CONSTRUCTION OF THE PROPOSED IMPROVEMENTS SHALL MEET LOCAL UTILITY DISTRICT/MUNICIPALITY SPECIFICATIONS AND BE INSTALLED IN CONFORMANCE WITH DETAILS SHOWN HEREON.
2.

ALL WORKED PERFORMED ON THIS PROJECT ASSOCIATED WITH THE WATER OR SEWER SYSTEM SHALL COMPLY WITH THE RECOMMENDED STANDARDS FOR WATER WORKS (TEN STATE STANDARDS) AND THE ARKANSAS BOARD OF HEALTH RULES AND REGULATIONS PERTAINING TO PUBLIC WATER SYSTEM AS DESIGNED AND SHOWN HEREON.
3.

WATER MAINS AND SANITARY SEWER SHALL BE CONSTRUCTED AS FAR APART AS PRACTICABLE, AND SHALL BE SEPARATED BY UNDISTURBED AND COMPACTED EARTH. A MINIMUM HORIZONTAL DISTANCE OF 10 FEET SHOULD BE MAINTAINED BETWEEN WATER LINES AND SEWER LINES OR OTHER SOURCES OF CONTAMINATION. WATER LINES AND SEWER LINES SHALL NOT BE LAID IN THE SAME TRENCH EXCEPT ON THE WRITTEN APPROVAL OF THE ARKANSAS DEPARTMENT OF HEALTH AND HUMAN SERVICES. WATER MAINS IN CLOSE PROXIMITY TO SEWER MAINS MUST BE PLACED SO THAT THE BOTTOM OF THE WATER LINE WILL BE AT LEAST 18 INCHES ABOVE THE TOP OF THE SEWER LINE AT ITS HIGHEST POINT. IF THIS DISTANCE MUST UNAVOIDABLY BE REDUCED, THE WATER LINE OR SEWER LINE MUST BE ENCASED IN WATERTIGHT PIPE WITH SEALED WATER TIGHT ENDS EXTENDING AT LEAST TEN FEET EITHER SIDE OF THE CROSSING. ANY JOINT IN THE ENCASEMENT PIPE IS TO BE MECHANICALLY RESTRAINED. THE ENCASEMENT PIPE MAY BE VENTED TO THE SURFACE IF CARRYING WATER OR SEWER UNDER PRESSURE. WHERE A WATER LINE MUST UNAVOIDABLY PASS BENEATH THE SEWER LINE, AT LEAST 18 INCHES OF SEPARATION MUST BE MAINTAINED BETWEEN THE OUTSIDE OF THE TWO PIPES IN ADDITION TO THE PRECEDING ENCASEMENT REQUIREMENTS. EXCEPTIONS TO THIS MUST BE APPROVED IN WRITING BY ARKANSAS DEPARTMENT OF HEALTH.
4.

SOLID 12 GAUGE LOCATER WIRE SHALL BE INSTALLED WITH MARKERS EVERY 750 FEET AND BEHIND EACH FIRE HYDRANT.
5.

ARKANSAS STATE LICENSING LAW FOR COMMERCIAL CONTRACTORS ACT 150 OF 1965 AND ACT 162 OF 1987 (AS AMENDED) REQUIRES THE INSTALLATION CONTRACTOR TO HAVE A CONTRACTORS LICENSES CLASSIFICATION OF MUNICIPAL AND UTILITY CONSTRUCTION.
6.

ALL SEWER SERVICE LATERALS FROM THE MAIN TO THE PROPERTY LINE SHALL NOT BE ASSEMBLED WITH GLUED JOINTS.
7.

ALL SEWER SERVICE LINES SHALL MEET WITH THE REQUIREMENTS OF THE ARKANSAS STATE PLUMBING CODE AND OTHER LOCAL PLUMBING CODES (IF APPLICABLE).
8.

ALL PIPE TRENCHES THAT LIE UNDER PAVEMENT SHALL BE BACK FILLED WITH CLASS 8 LIMESTONE COMPACTED TO 98% MODIFIED PROCTOR (ASTM D1557) TO 1 FOOT ABOVE THE PIPE AND FLOWABLE FILL PLACED TO WITHIN 1 FOOT BELOW THE DESIGN SUBGRADE.
9.

ALL PIPE TRENCHES NOT UNDER PAVEMENT SHALL BE BACKFILLED WITH NATIVE SOIL PLACED IN UNIFORM HORIZONTAL LIFTS NOT EXCEEDING 8 INCHES IN LOOSE THICKNESS AND COMPACTED WITH SUITABLE EQUIPMENT TO ACHIEVE 95% STANDARD PROCTOR (ASTM D698) AT 2% BELOW TO 3% ABOVE OPTIMUM MOISTURE CONTENT.
10.

SANITARY SEWER MANHOLES SHALL BE PRE-CAST CONCRETE WITH A MINIMUM INTERIOR DIAMETER OF 48 INCHES AND A WALL THICKNESS OF 5 INCHES. THE CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 4000 PSI. ALL MANHOLE RING AND COVERS SHALL BE 24" DIAMETER GRAY CAST IRON (EAST JORDAN IRON WORKS - EJ 1348 OR EQUIVALENT).
11.

ALL GRAVITY SEWER MAINS AND SERVICE LATERAL SHALL BE LAID IN STRAIGHT ALIGNMENT AT NO LESS THAN THE MINIMUM GRADE FOR THE PIPE SIZE AS FOLLOWS:

| | | | |
|----------|-------|----------|--------|
| 4 INCH: | 1.00% | 18 INCH: | 0.12% |
| 6 INCH: | 0.60% | 21 INCH: | 0.10% |
| 8 INCH: | 0.40% | 24 INCH: | 0.08% |
| 12 INCH: | 0.22% | 30 INCH: | 0.058% |
| 15 INCH: | 0.15% | 42 INCH: | 0.037% |
12.

ALL SOLID ENCASEMENT PIPE SHALL BE FABRICATED FROM PLATE CONFORMING TO CURRENT ASTM DESIGNATION A 36. DIMENSIONS SHALL CONFORM TO THE FOLLOWING, EXCEPT WHEN THE STATE HIGHWAY DEPARTMENT OR RAILROAD COMPANIES REQUIRE A THICKER WALL.

| NOMINAL CARRIER DIAMETER | OUTSIDE DIAMETER ENCASEMENT | WALL THICKNESS THICKNESS |
|--------------------------|-----------------------------|--------------------------|
| 24" | 36" | ¾" |
| 20" | 30" | ¾" |
| 16" | 24" | ¾" |
| 12" | 20" | ¾" |
| 8" | 16" | ¾" |
| 4" TO 6" | 12" | ¾" |
13.

ALL SEWER SERVICE LINES MUST BE CONSTRUCTED AT A MINIMUM DISTANCE OF 10 FT FROM THE SIDE PROPERTY LINES.
14.

ALL SEWER MAIN PIPE SHALL BE SDR 26 PVC, UNLESS OTHERWISE NOTED.
15.

ALL WATER MAIN PIPE SHALL BE C900 DR-18 PVC, UNLESS OTHERWISE NOTED.

QUALITY ASSURANCE TESTING

1.

AN AIR LEAKAGE TESTS SHALL BE PERFORMED ON ALL WATER MAINS AND SHALL BE PERFORMED PRIOR TO STERILIZATION OPERATIONS. THE TEST PERIOD SHALL LAST AT LEAST TWO HOURS IN DURATION. TEST PRESSURE SHALL BE 1.5 TIMES THE CALCULATED WORKING PRESSURE OF THE MAIN, BUT NOT LESS THAN 100 PSI. THE LINE WILL NOT BE ACCEPTED UNLESS OR UNTIL THE TOTAL IS LESS THAN THAT SPECIFIED IN AWWA C600-10 FOR DUCTILE IRON AND AWWA C605-13 FOR PVC PIPE.
2.

ALL WATER MAINS SHALL BE DISINFECTED IN ACCORDANCE WITH THE STANDARDS OF AWWA D651-14. ANY NEW CONSTRUCTION OR REPAIRED WATER MAIN MUST BE THOROUGHLY CLEANED (FLUSHED), DISINFECTED, AND TESTED FOR BACTERIOLOGICAL QUALITY BEFORE IT CAN BE PLACED IN SERVICE. FOLLOWING A CONTACT PERIOD OF NOT LESS THAN 24 HOURS, THE CHLORINATED WATER SHALL BE FLUSHED FROM THE SYSTEM, AND THE SYSTEM FILLED WITH WATER OF NORMAL CHLORINE CONTENT. SAMPLES OF WATER THEN SHALL BE TAKEN ON TWO CONSECUTIVE DAYS FROM THE LINES AND DELIVERED TO CERTIFIED WATER TESTING LABORATORY FOR BACTERIAL ANALYSIS. THIS PROCESS SHALL BE CONTINUED UNTIL THE SAMPLES SHOW THE WATER IS SAFE FOR DOMESTIC USE. ALL VALVES IN SECTIONS OF LINES BEING STERILIZED SHALL BE OPENED AND CLOSED AT LEAST TWICE DURING THE STERILIZATION PERIOD. FLUSHING DEVICES SHOULD BE SIZED TO PROVIDE FLOWS WHICH WILL GIVE A VELOCITY OF AT LEAST 2.5 FEET PER SECOND IN THE WATER MAIN BEING FLUSHED. NO FLUSHING DEVICE SHALL BE DIRECTLY CONNECTED TO ANY SEWER MAIN.
3.

A LOW PRESSURE AIR TEST SHALL BE PERFORMED ON ALL PVC SANITARY SEWER MAINS PER ASTM F1417.
4.

SANITARY SEWER MAINS SHALL BE TESTED WITH A MANDREL FOR DEFLECTION AFTER THE FINAL BACKFILL HAS BEEN IN PLACE FOR AT LEAST 30 DAYS. DEFLECTION SHALL NOT EXCEED 5% OF THE PIPE DIAMETER IN ACCORDANCE ASTM D3034-16. THE TEST SHALL BE PERFORMED WITHOUT MECHANICAL PULLING DEVICES.
5.

ALL SANITARY SEWER MANHOLES SHALL BE VACUUM TESTED AFTER BACKFILL PER ASTM C1244-11.
6.

COMPACTION DENSITY TESTS FOR ALL SUBGRADE MATERIAL, BASE MATERIAL, AND TRENCH BACKFILL MATERIAL SHALL BE PERFORMED IN ACCORDANCE WITH ASTM D6938. THE TESTING FREQUENCY PER COMPACTED LIFT SHALL BE AS DESCRIBED BELOW. A MINIMUM OF TWO TESTS ARE REQUIRED IF THE AREA BEING TESTED ONLY WARRANTS ONE TEST PER THE BELOW REQUIREMENTS.

PARKING LOTS - ONE TEST EVERY 1,000 SQUARE FEET

ROADWAYS - ONE TEST EVERY 500 FEET (PER LANE)

TRENCHES - ONE TEST EVERY 500 FEET OR MINIMUM OF ONE BETWEEN MANHOLE STRUCTURES
7.

A PROOF ROLL OF THE SUBGRADE AND BASE MATERIALS SHALL BE PERFORMED PRIOR TO THE PLACEMENT OF CURB AND GUTTER, BASE MATERIAL, AND FLEXIBLE OR RIGID PAVEMENT, AS APPLICABLE. ALL TESTS SHALL BE PERFORMED UNDER THE DIRECTION OF THE DESIGN ENGINEER. ALL PROOF ROLL TESTS WILL BE PERFORMED WITH A RUBBER-TIRE TANDEM-AXLE DUMP TRUCK WITH A MINIMUM GROSS WEIGHT OF 45,000 POUNDS UNLESS OTHERWISE APPROVED IN WRITING BY THE DESIGN ENGINEER. A CURRENT CERTIFIED WEIGHT TICKET MUST BE PROVIDED AT TIME OF PROOF ROLL TEST TO VERIFY LOADING CRITERIA. PROOF ROLLED MATERIAL SHALL SHOW NO SIGNIFICANT SIGNS OF MOVEMENT DURING PROOF ROLLING AS DETERMINED BY THE DESIGN ENGINEER.
8.


AN INDEPENDENT TESTING AGENCY SHALL PERFORM FIELD QUALITY CONTROL TESTS FOR ALL CONCRETE PAVEMENTS AND SIDEWALKS. THE TESTING AGENCY SHALL MOLD AND CURE FOUR CONCRETE TEST CYLINDERS FOR EACH COMPRESSIVE STRENGTH TEST. TEST SAMPLES SHALL BE TAKEN EVERY 50 CUBIC YARDS OR LESS FOR EACH CLASS OF CONCRETE POURED EACH DAY. A SLUMP TEST, AIR TEST, AND TEMPERATURE TEST SHALL BE PERFORMED AND RECORDED FOR EACH SET OF TEST CYLINDERS.

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM



PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

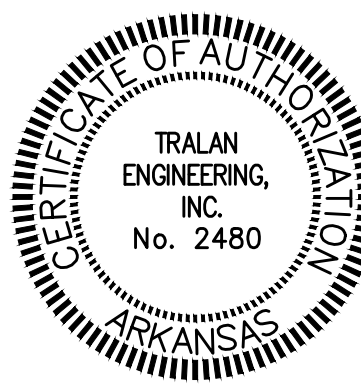


| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |
| | | |



| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/27/2017 |
| SCALE: | |
| JOB NO.: | 16-080 |
| CAD NO.: | |

NOTES &
SPECIFICATIONS

SHEET NUMBER:
2 of 11


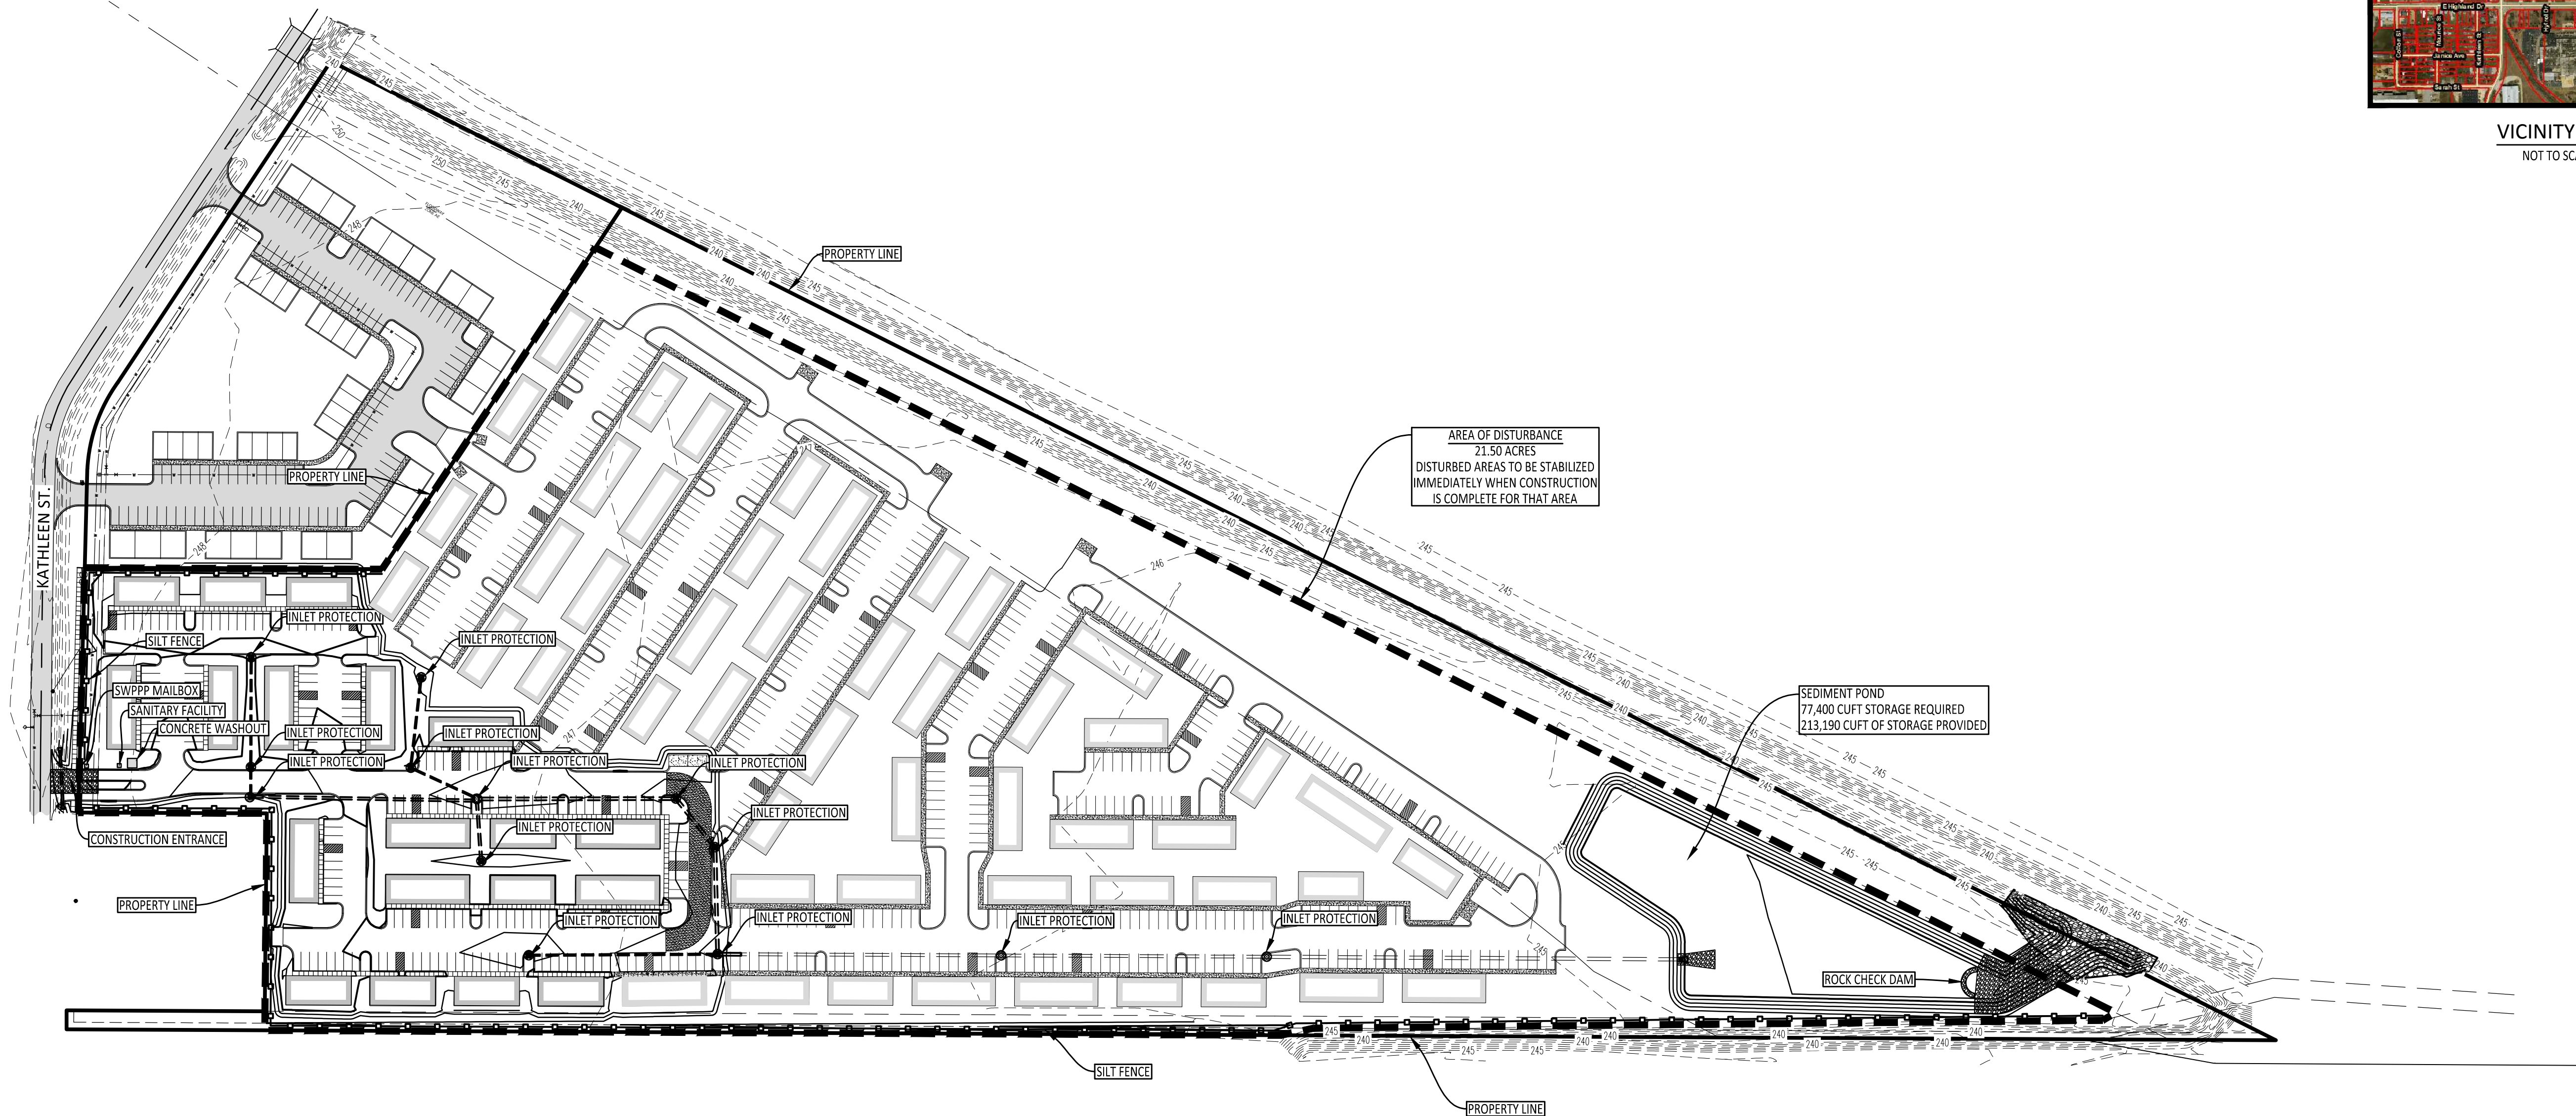


VICINITY MAP
NOT TO SCALE

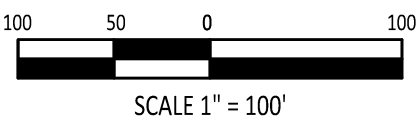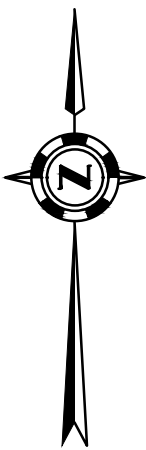

PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

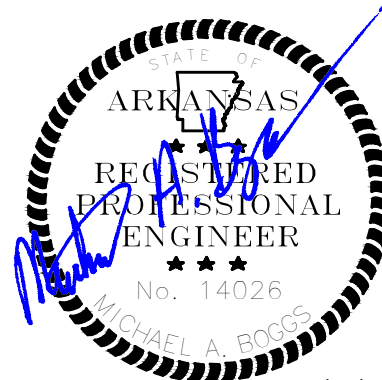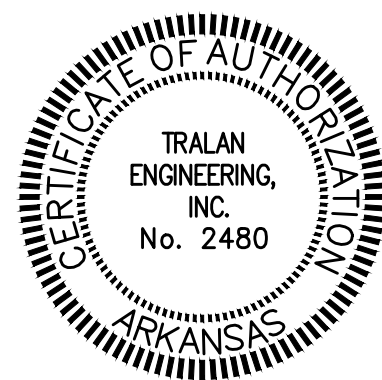

| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |


| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | 1" = 100' |
| JOB NO.: | 16-080 |
| CAD NO.: | |

SWPPP / DEMO
PLAN


SHEET NUMBER:
3 of **11**

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM




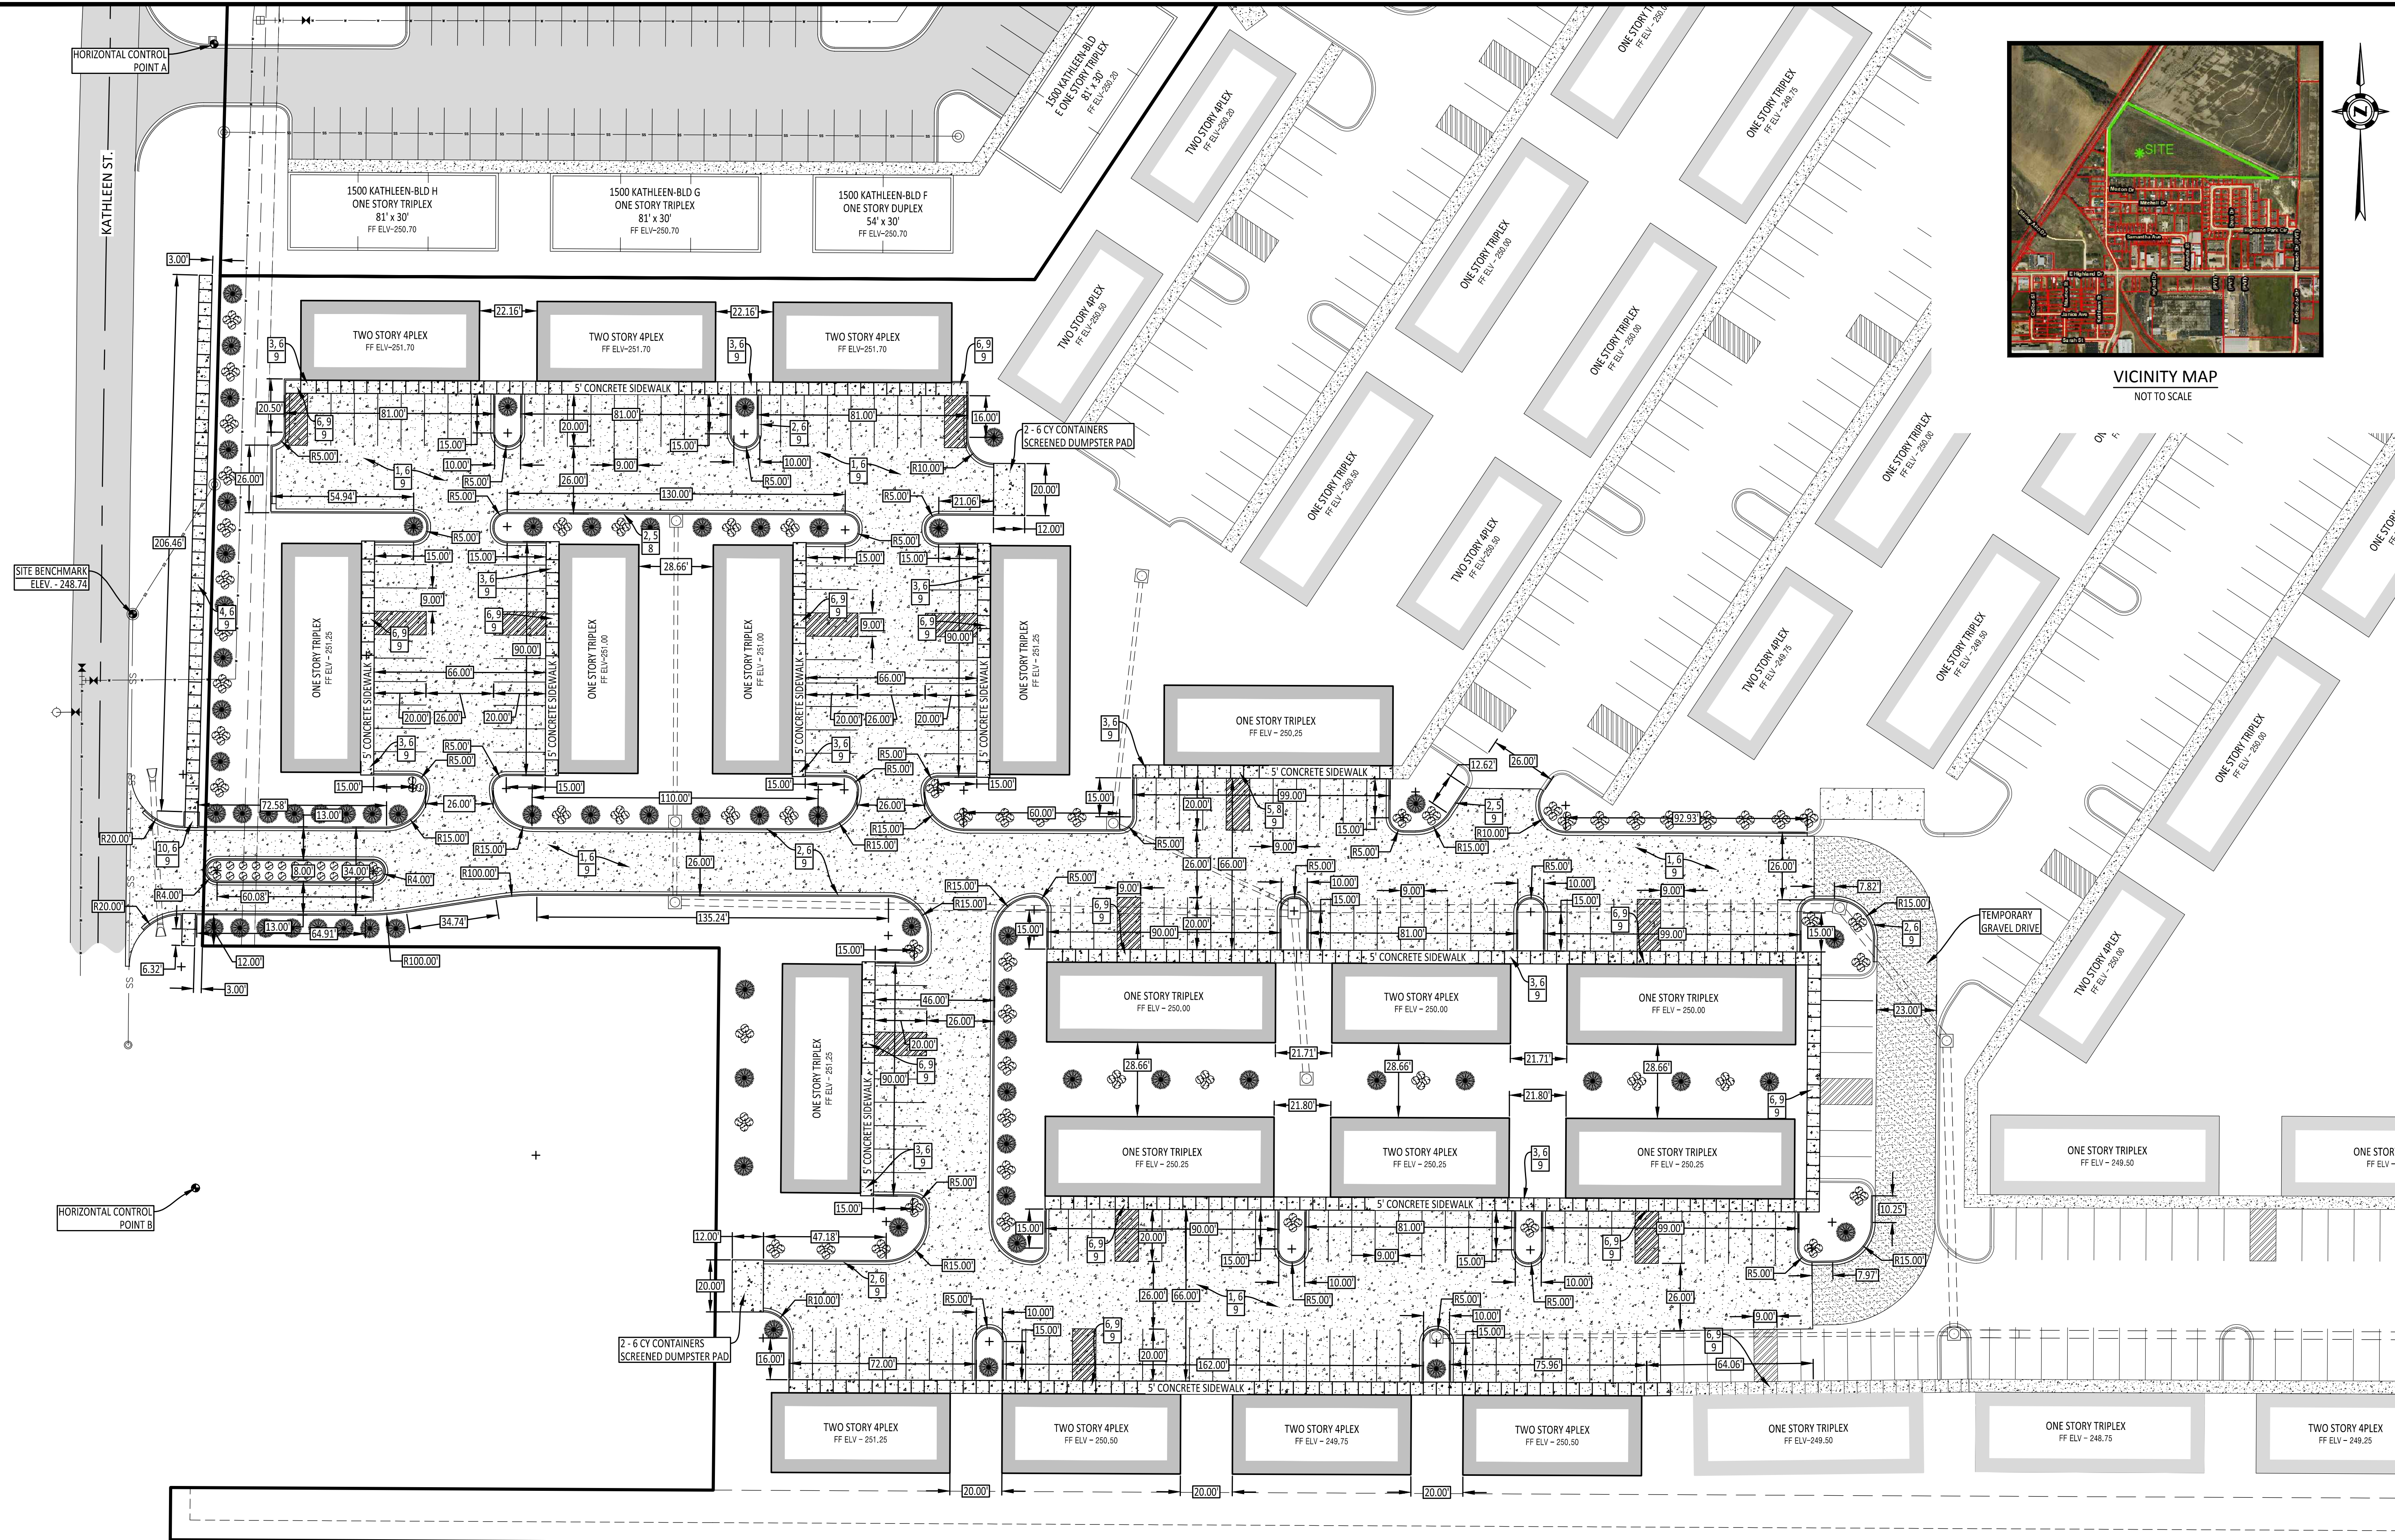


VICINITY MAP
NOT TO SCALE



PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

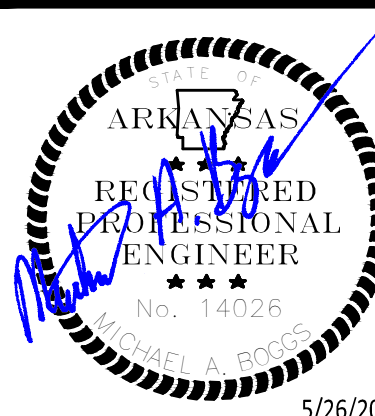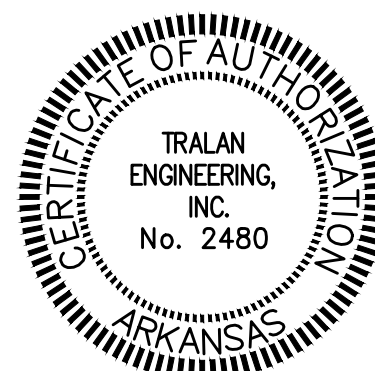

| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |


| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | 1" = 30' |
| JOB NO.: | 16-080 |
| CAD NO.: | |

SITE DIMENSION
PLAN



SHEET NUMBER:
4 of 11

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN
ENGINEERING

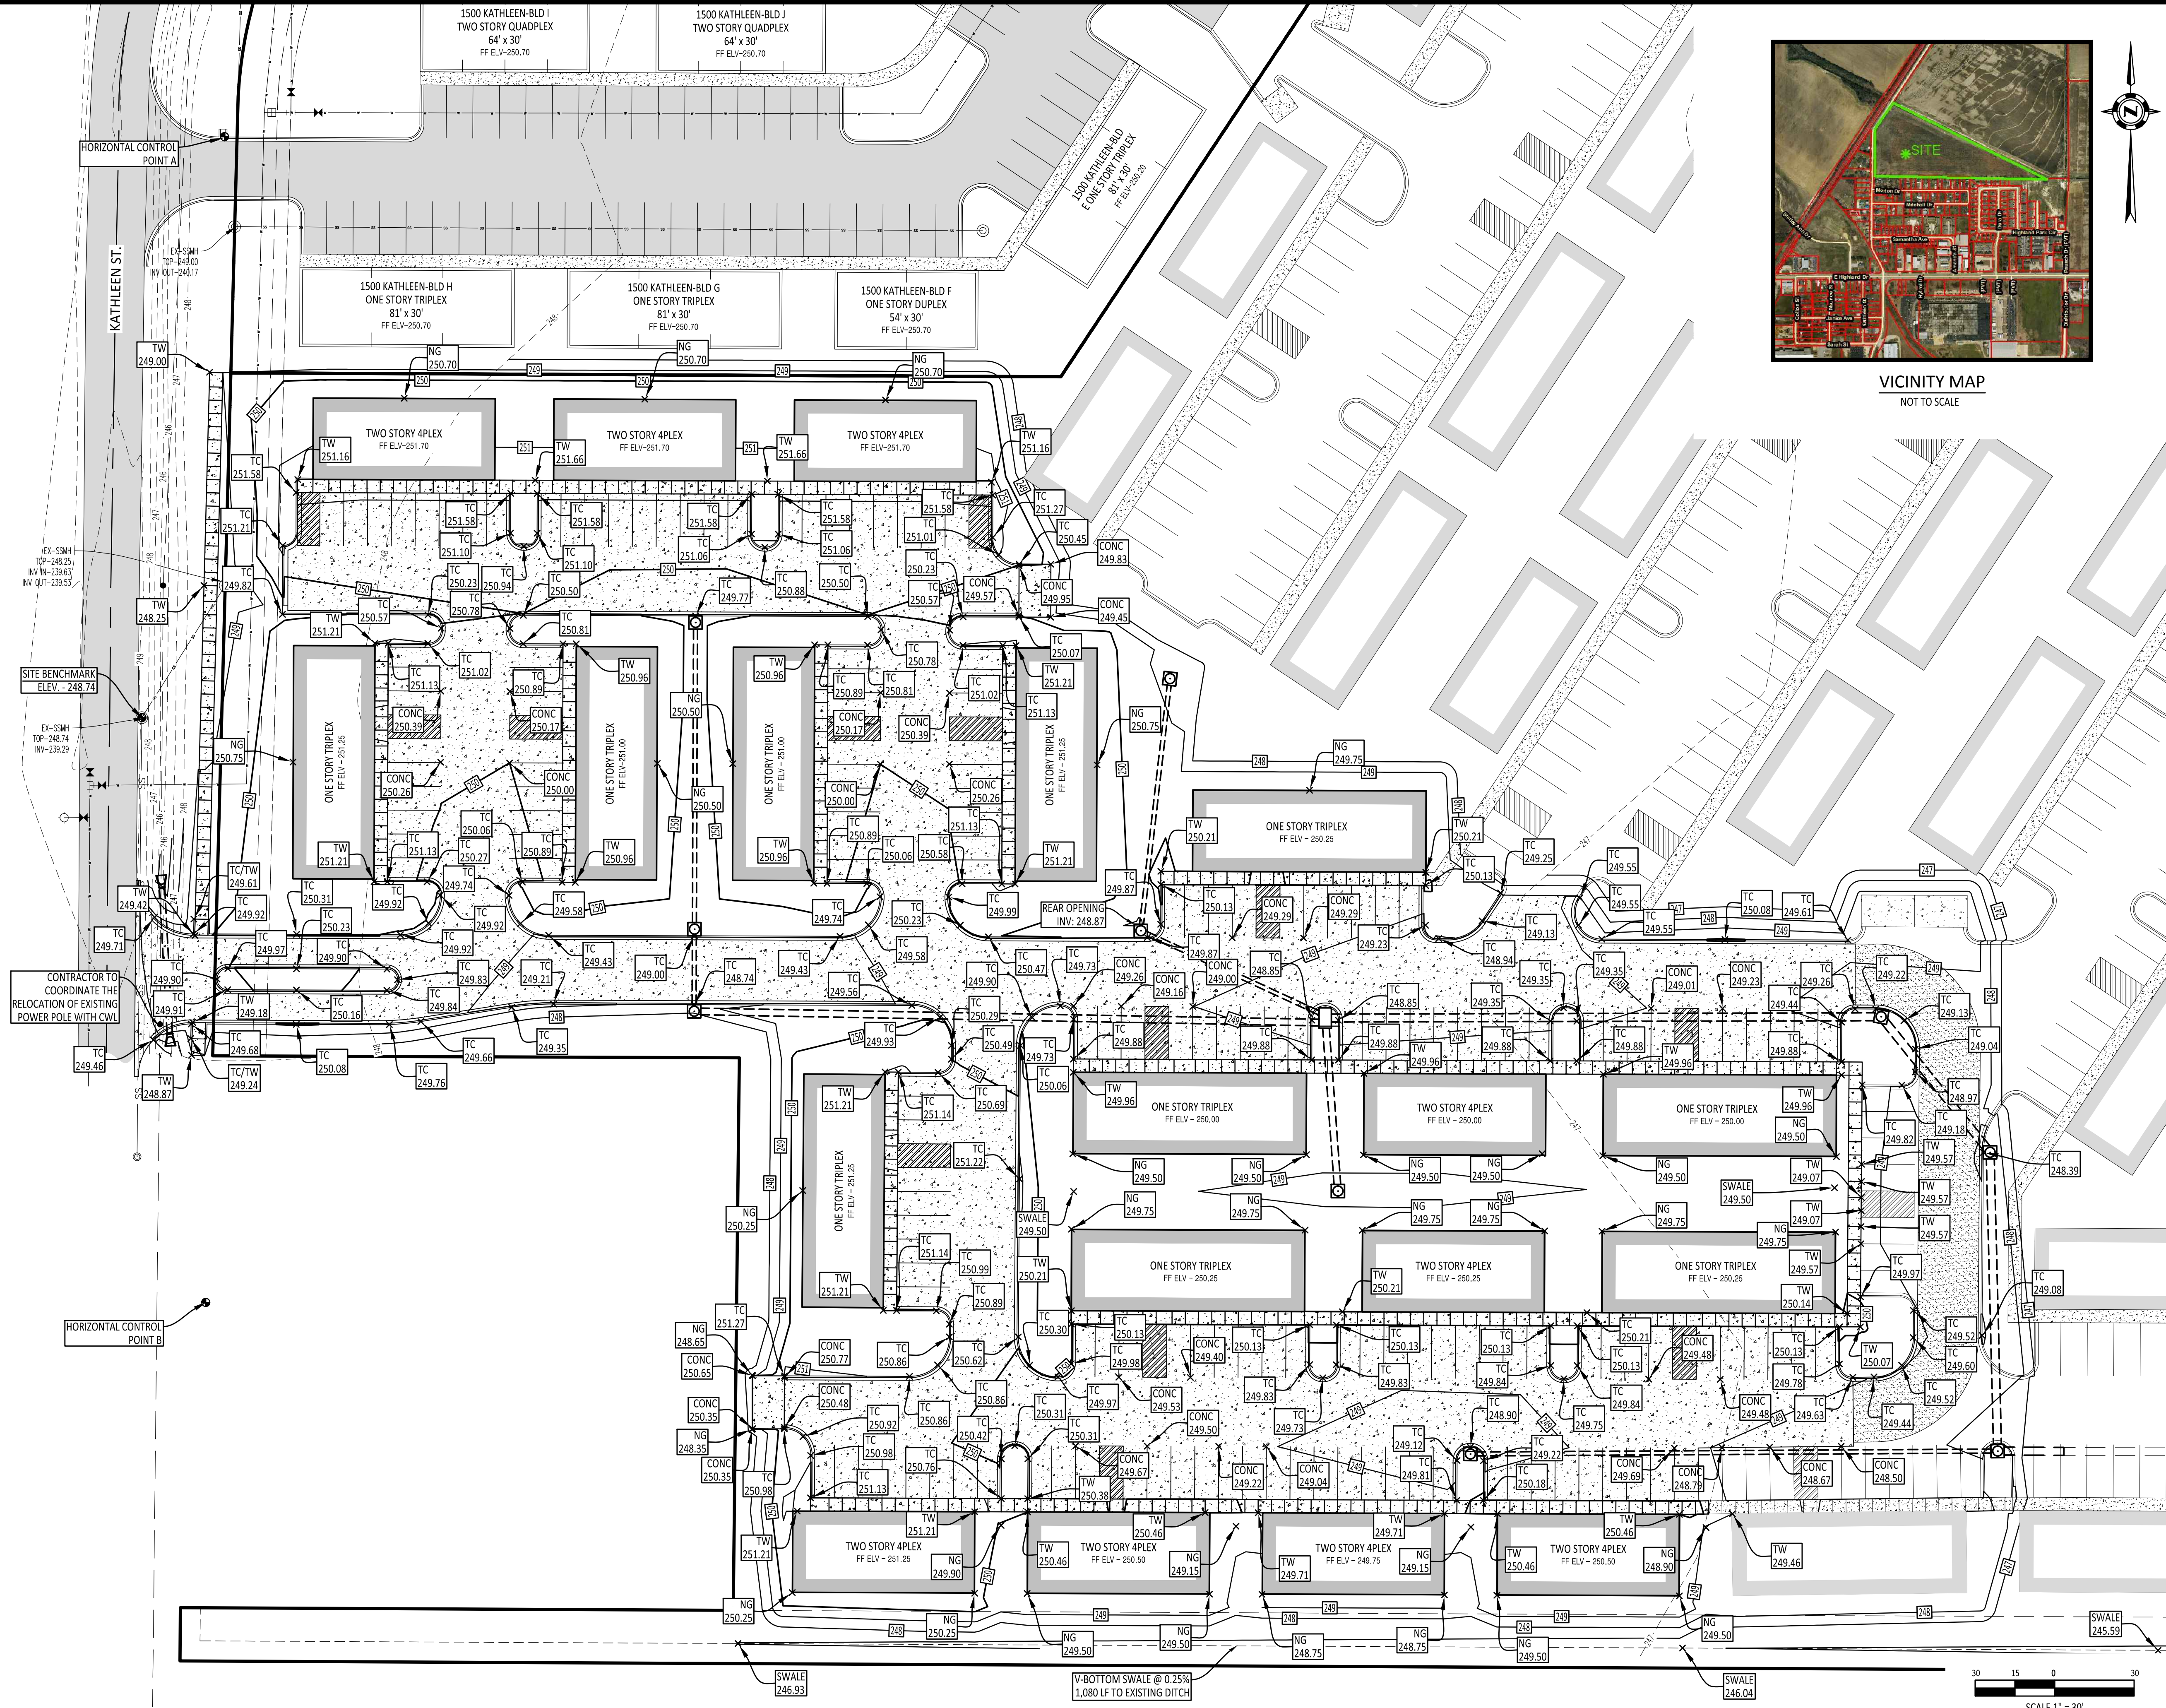

VICINITY MAP
NOT TO SCALE


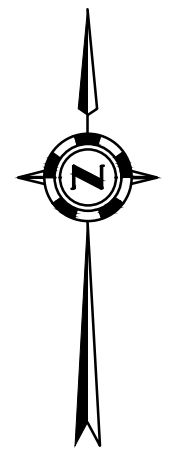


COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN ENGINEERING

PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

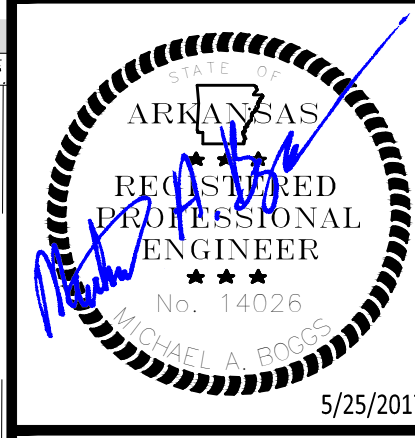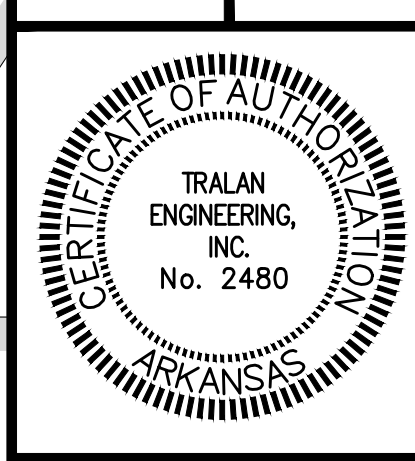


| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |

| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | 1" = 30' |
| JOB NO.: | 16-080 |
| CAD NO.: | |

GRADING & DRAINAGE
PLAN


SHEET NUMBER:
5 of **11**

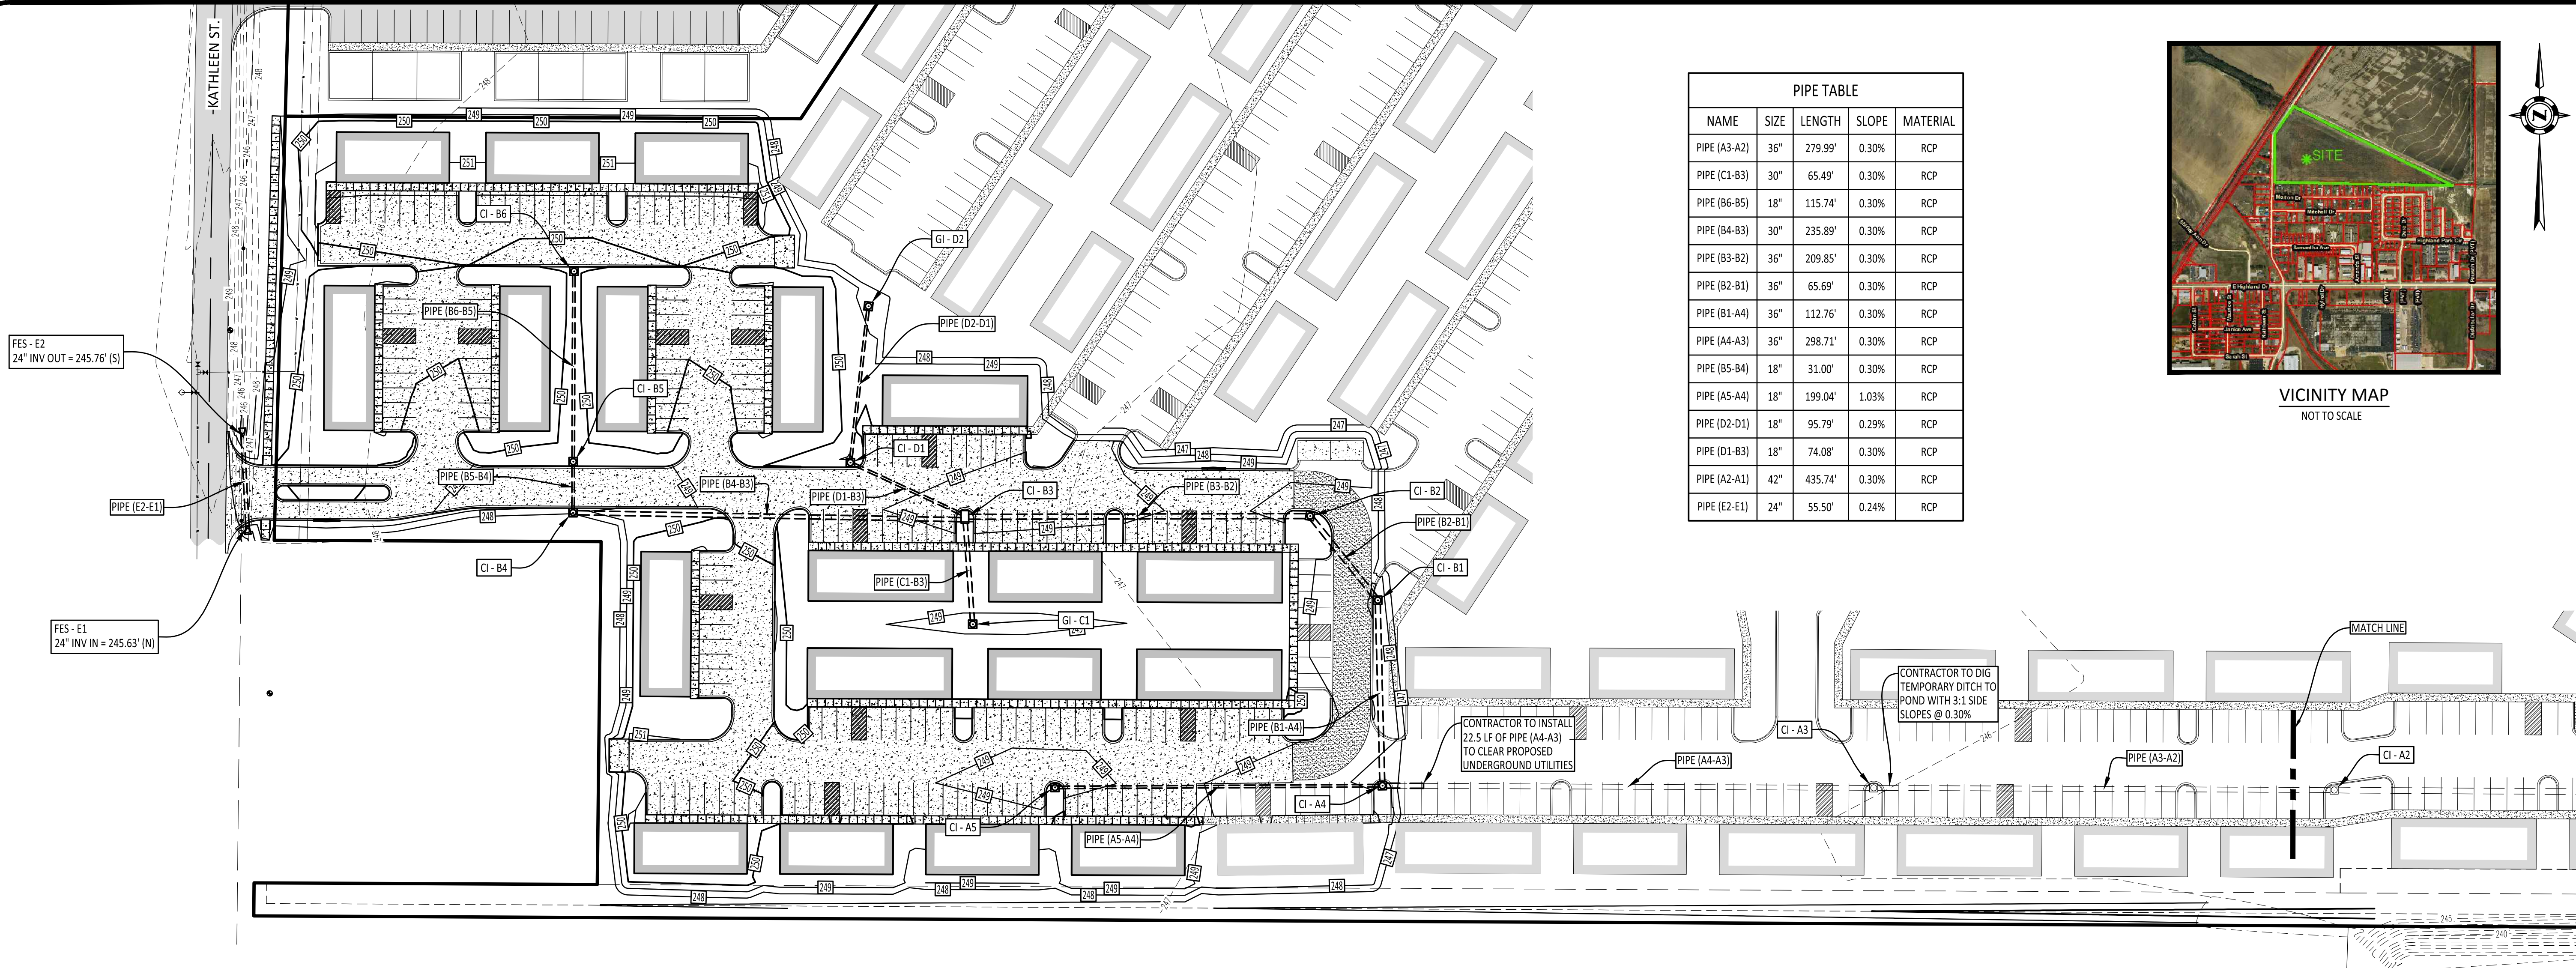

| PIPE TABLE | | | | |
|--------------|------|---------|-------|----------|
| NAME | SIZE | LENGTH | SLOPE | MATERIAL |
| PIPE (A3-A2) | 36" | 279.99' | 0.30% | RCP |
| PIPE (C1-B3) | 30" | 65.49' | 0.30% | RCP |
| PIPE (B6-B5) | 18" | 115.74' | 0.30% | RCP |
| PIPE (B4-B3) | 30" | 235.89' | 0.30% | RCP |
| PIPE (B3-B2) | 36" | 209.85' | 0.30% | RCP |
| PIPE (B2-B1) | 36" | 65.69' | 0.30% | RCP |
| PIPE (B1-A4) | 36" | 112.76' | 0.30% | RCP |
| PIPE (A4-A3) | 36" | 298.71' | 0.30% | RCP |
| PIPE (B5-B4) | 18" | 31.00' | 0.30% | RCP |
| PIPE (A5-A4) | 18" | 199.04' | 1.03% | RCP |
| PIPE (D2-D1) | 18" | 95.79' | 0.29% | RCP |
| PIPE (D1-B3) | 18" | 74.08' | 0.30% | RCP |
| PIPE (A2-A1) | 42" | 435.74' | 0.30% | RCP |
| PIPE (E2-E1) | 24" | 55.50' | 0.24% | RCP |




VICINITY MAP
NOT TO SCALE

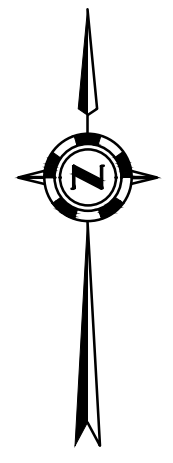

| STRUCTURE TABLE | | | |
|-------------------------|--|--|--------------|
| STRUCTURE NAME | DETAILS | PIPES IN | PIPES OUT |
| CI - A2 SQ = 5' X 5' | RIM = 246.50' 36" INV IN = 240.89' (W) 42" INV OUT = 240.34' (E) DEPTH = 6.16' | PIPE (A3-A2) | PIPE (A2-A1) |
| CI - A3 SQ = 5' X 5' | RIM = 247.50' 36" INV IN = 241.73' (W) 36" INV OUT = 241.73' (E) DEPTH = 5.77' | PIPE (A4-A3) | PIPE (A3-A2) |
| CI - A4 SQ = 5' X 5' | RIM = 248.27' 36" INV IN = 242.63' (N) 18" INV IN = 244.07' (W) 36" INV OUT = 242.63' (E) DEPTH = 5.64' | PIPE (B1-A4) PIPE (A5-A4) | PIPE (A4-A3) |
| CI - A5 SQ = 5' X 5' | RIM = 249.42' 18" INV OUT = 246.12' (E) DEPTH = 3.30' | | PIPE (A5-A4) |
| CI - B1 SQ = 5' X 5' | RIM = 248.39' 36" INV IN = 242.97' (NW) 36" INV OUT = 242.97' (S) DEPTH = 5.42' | PIPE (B2-B1) | PIPE (B1-A4) |
| CI - B2 SQ = 5' X 5' | RIM = 249.22' 36" INV IN = 243.16' (W) 36" INV OUT = 243.16' (SE) DEPTH = 6.05' | PIPE (B3-B2) | PIPE (B2-B1) |
| CI - B3 SQ = 4' X 7' | RIM = 248.50' 30" INV IN = 244.22' (S) 30" INV IN = 244.23' (W) 18" INV IN = 245.23' (NW) 36" INV OUT = 243.79' (E) DEPTH = 4.71' | PIPE (C1-B3) PIPE (B4-B3) PIPE (D1-B3) | PIPE (B3-B2) |
| CI - B4 SQ = 4' X 4' | RIM = 248.74' 18" INV IN = 245.93' (E) 30" INV OUT = 244.93' (E) DEPTH = 3.81' | PIPE (B5-B4) | PIPE (B4-B3) |

| STRUCTURE TABLE | | | |
|----------------------------|--|--------------|--------------|
| STRUCTURE NAME | DETAILS | PIPES IN | PIPES OUT |
| CI - B5 SQ = 4' X 4' | RIM = 249.00' 18" INV IN = 246.02' (N) 18" INV OUT = 246.02' (S) DEPTH = 2.98' | PIPE (B6-B5) | PIPE (B5-B4) |
| CI - B6 SQ = 4' X 4' | RIM = 249.77' 18" INV OUT = 246.37' (S) DEPTH = 3.40' | | PIPE (B6-B5) |
| CI - D1 SQ = 5' X 5' | RIM = 249.87' 18" INV IN = 245.46' (N) 18" INV OUT = 245.46' (SE) DEPTH = 4.41' | PIPE (D2-D1) | PIPE (D1-B3) |
| FES - A1 SQ = ??? X ??? | RIM = 242.99' 42" INV IN = 239.03' (W) DEPTH = ??? | PIPE (A2-A1) | |
| FES - E1 SQ = ??? X ??? | RIM = 247.96' 24" INV IN = 245.63' (N) DEPTH = ??? | PIPE (E2-E1) | |
| FES - E2 SQ = ??? X ??? | RIM = 248.10' 24" INV OUT = 245.76' (S) DEPTH = ??? | | PIPE (E2-E1) |
| GI - C1 SQ = 5' X 5' | RIM = 248.67' 30" INV OUT = 244.42' (N) DEPTH = 4.25' | | PIPE (C1-B3) |
| GI - D2 SQ = 5' X 5' | RIM = 248.50' 18" INV OUT = 245.73' (S) DEPTH = 2.77' | | PIPE (D2-D1) |

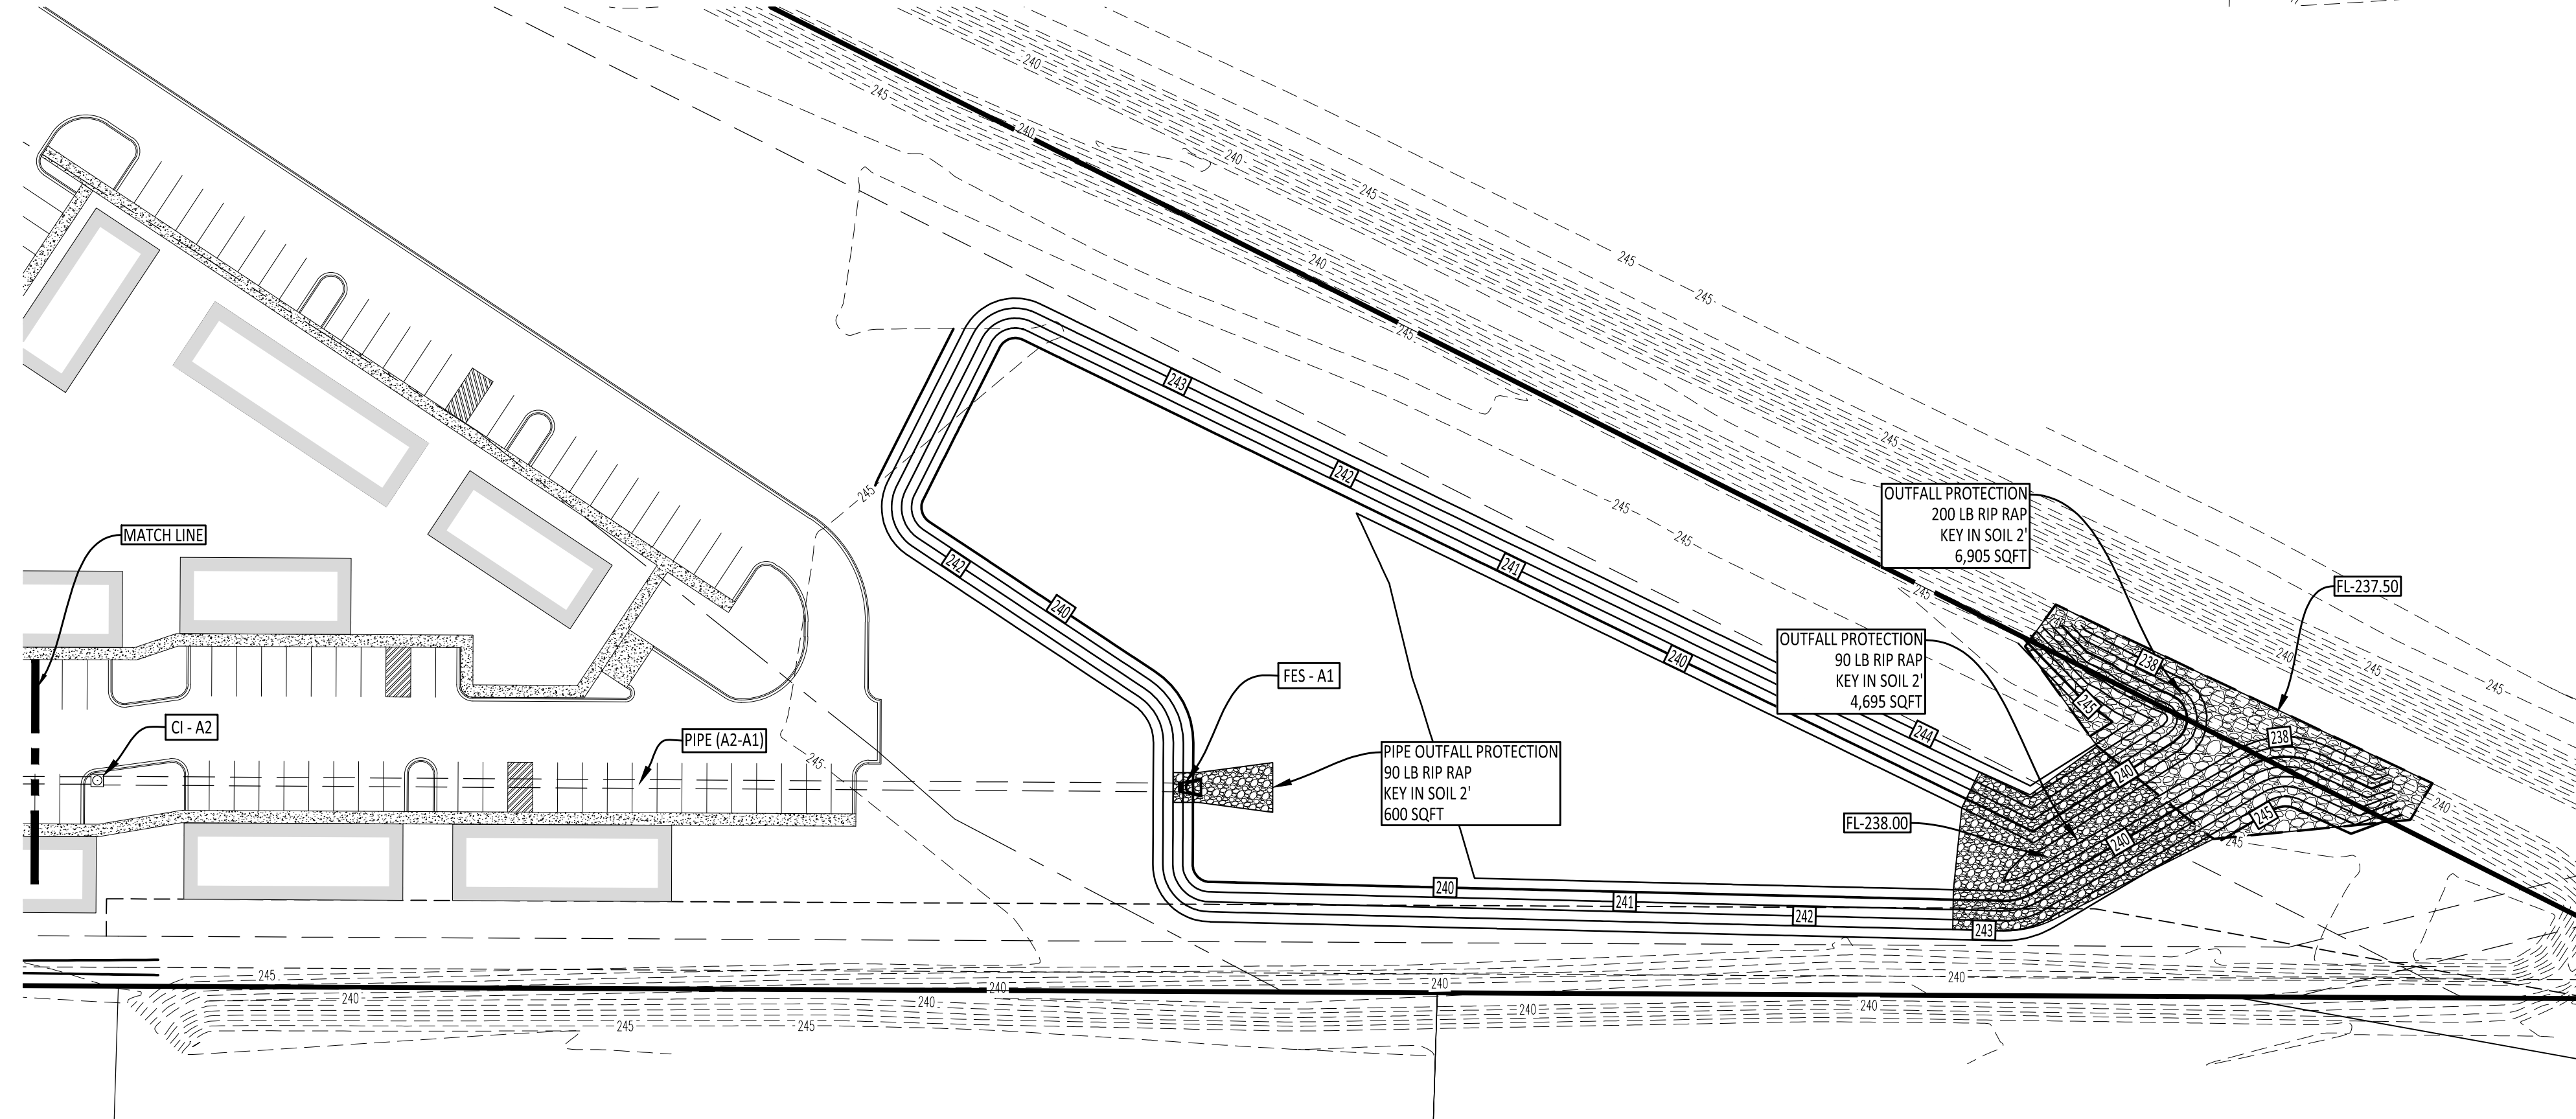

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN ENGINEERING

PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC


CERTIFICATE OF AUTHORIZATION
TRALAN ENGINEERING, INC.
No. 2480
ARKANSAS NOTARY PUBLIC

ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 14026
MICHAEL A. ROOPE
5/25/2017



| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |

| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | 1" = 50' |
| JOB NO.: | 16-080 |
| CAD NO.: | |

| OVERALL DRAINAGE PLAN | |
|--|--|
| SHEET NUMBER: 6 of 11 | |

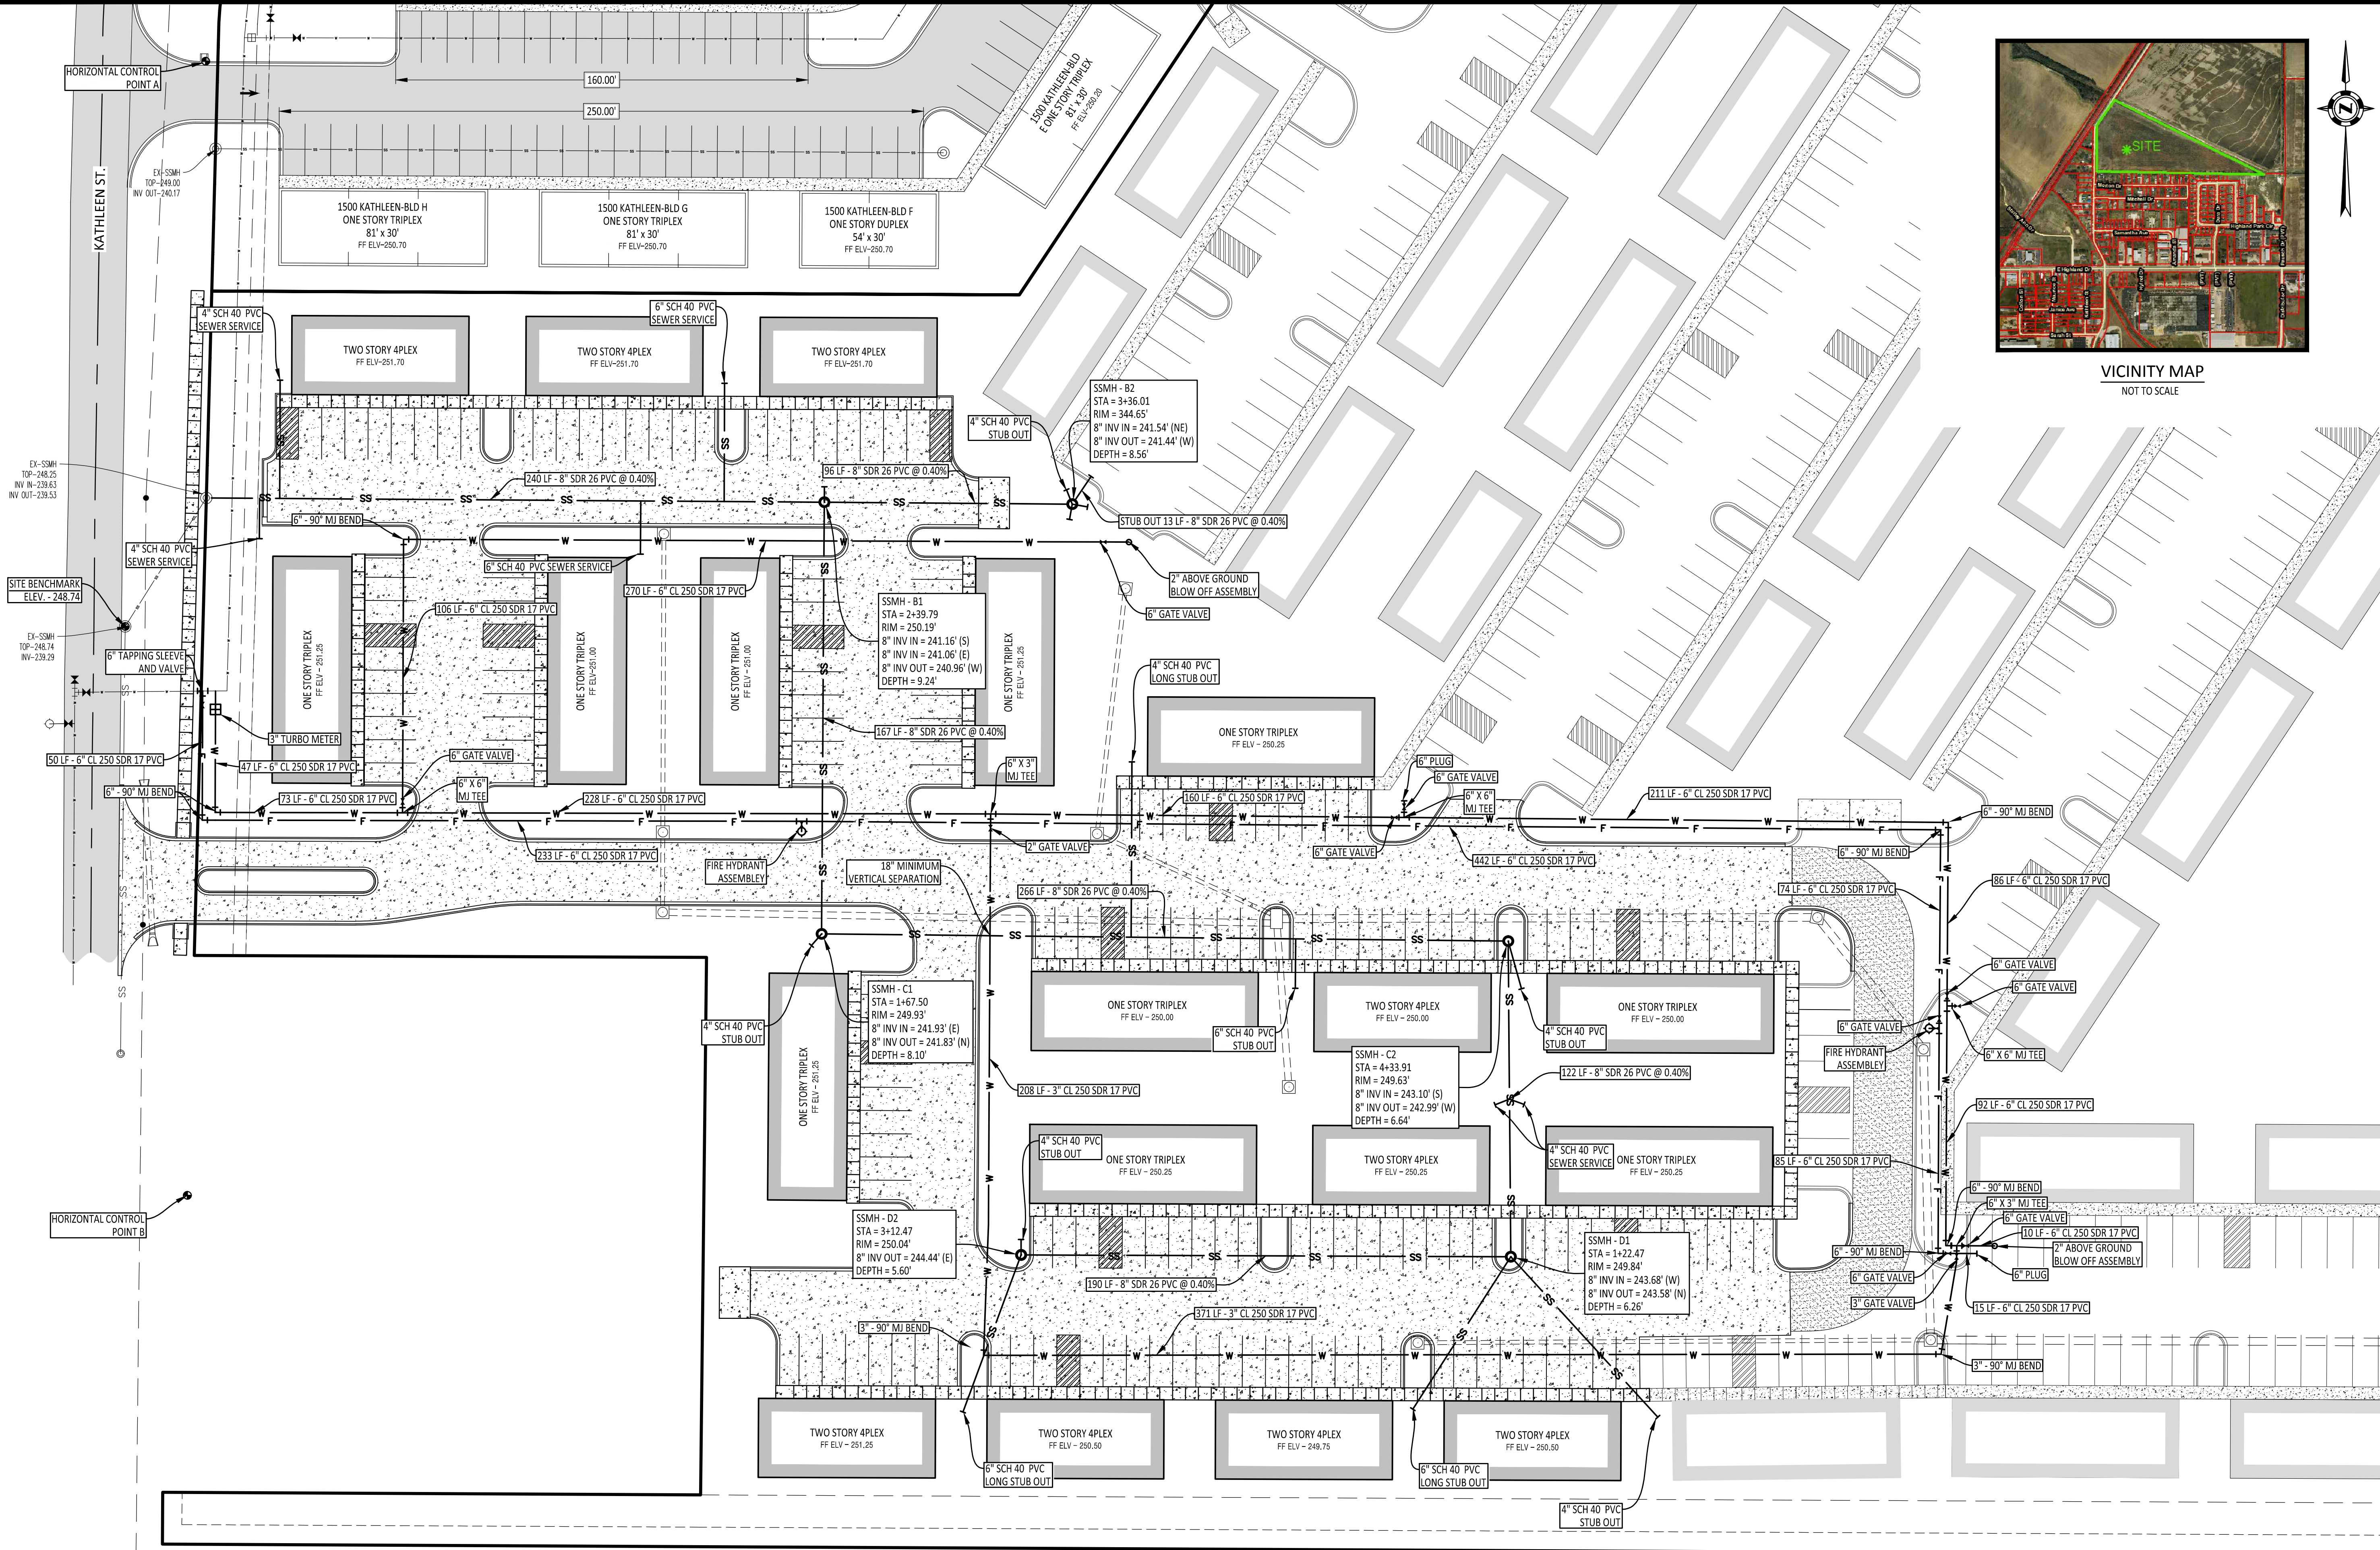

VICINITY MAP
NOT TO SCALE


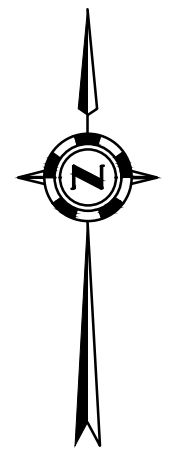


COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN ENGINEERING

PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

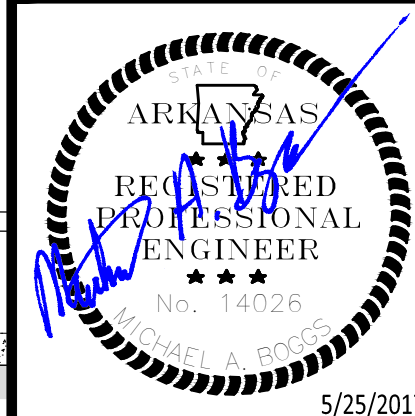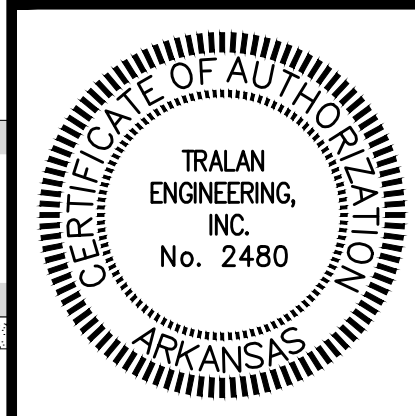


| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |

| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | 1" = 30' |
| JOB NO.: | 16-080 |
| CAD NO.: | |


SITE UTILITY
PLAN

SHEET NUMBER:
7 of **11**

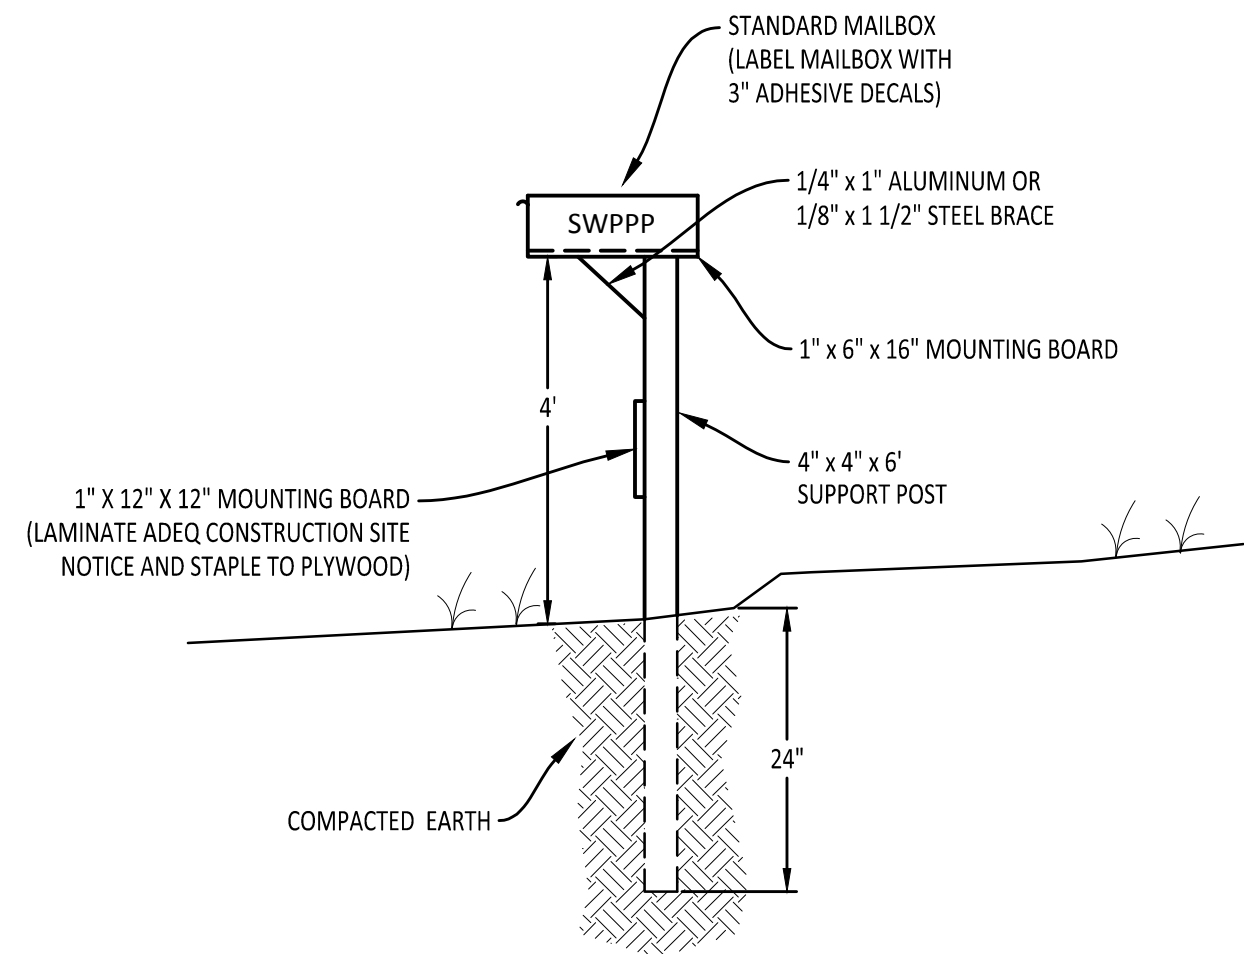

SWPPP MAILBOX

1

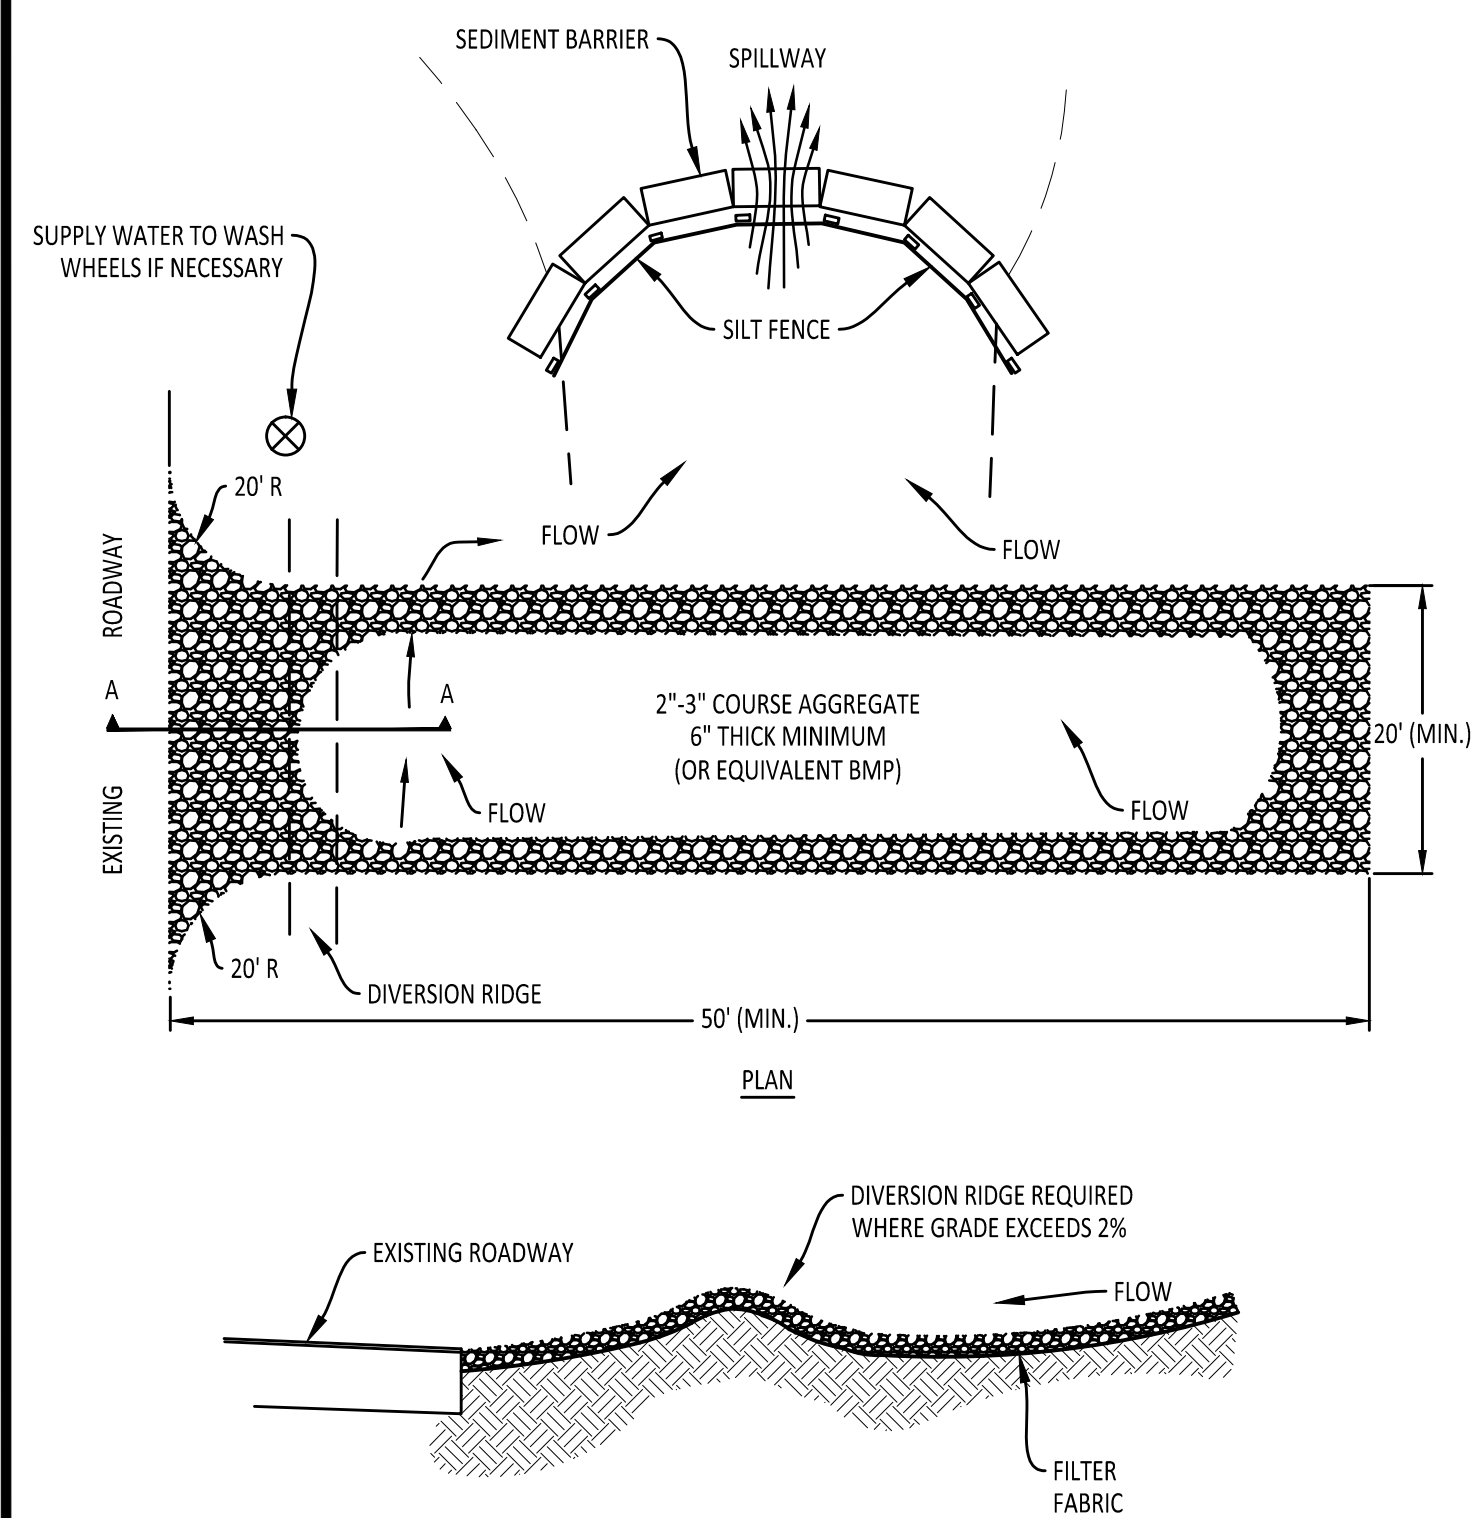


NOTES:

1. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE TOP DRESSING, REPAIR AND/OR CLEANING OF ANY MEASURES USED TO TRAP SEDIMENT.
2. WHEN NECESSARY, WHEELS SHALL BE CLEANED PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY.
3. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.
4. USE SANDBAGS, STRAW BALES OR OTHER APPROVED METHODS TO CHANNEL RUNOFF TO BASIN AS REQUIRED. WHEN STRAW BALES ARE USED IN THIS APPLICATION A SILT FENCE IS TO BE INCLUDED AS SHOWN ON THE UPSTREAM SIDE OF THE SEDIMENT BARRIER.

CONSTRUCTION EXIT
W/ DIVERSION BERM

2

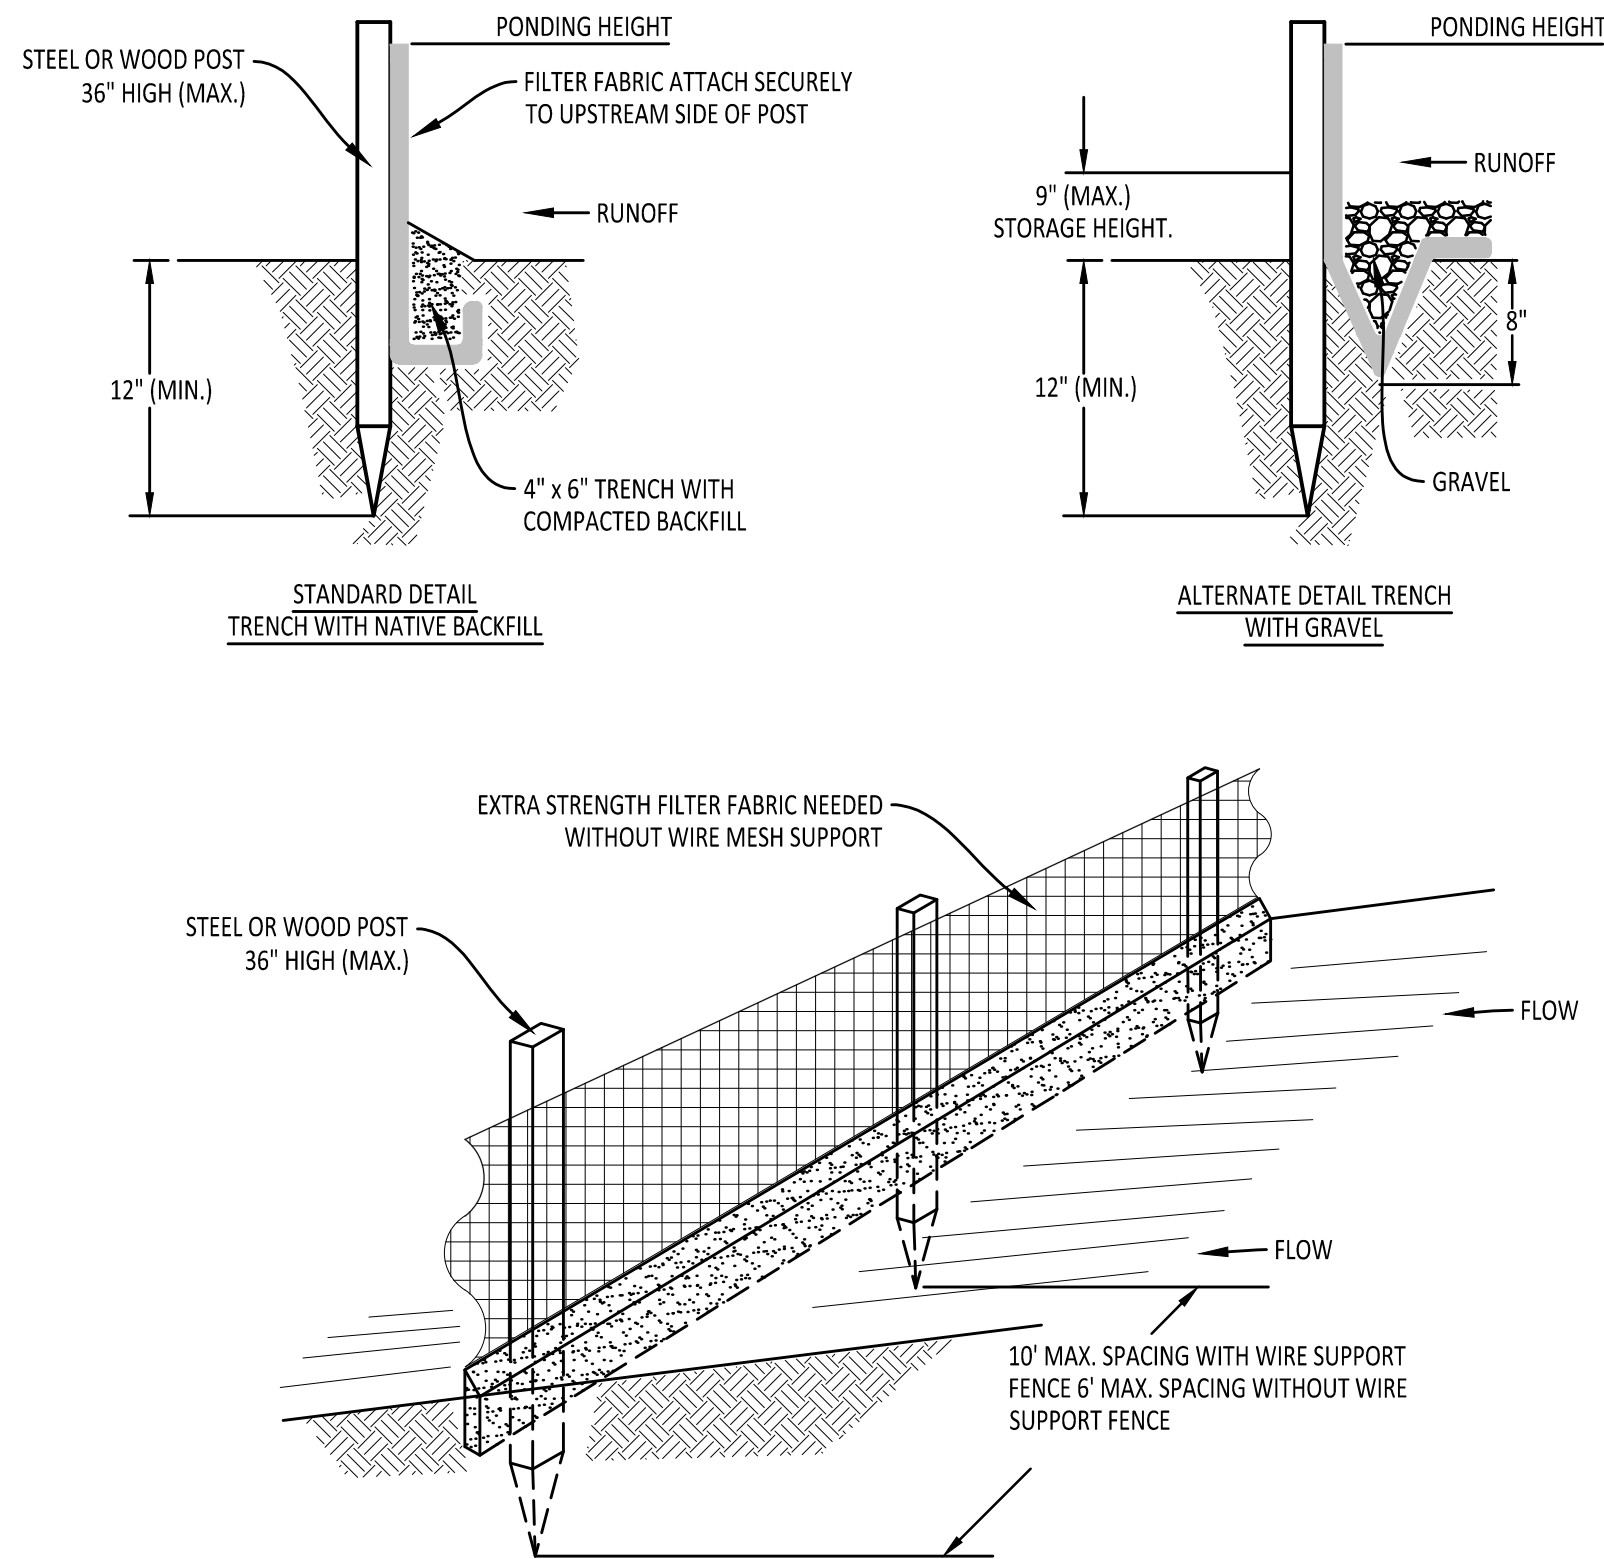


NOTES:

1. INSPECT AND REPAIR FENCE AFTER EACH STORM EVENT AND REMOVE SEDIMENT WHEN NECESSARY.
2. REMOVED SEDIMENT SHALL BE DEPOSITED TO AN AREA THAT WILL NOT CONTRIBUTE SEDIMENT OFF-SITE AND CAN BE PERMANENTLY STABILIZED.
3. SILT FENCE SHALL BE PLACED ON SLOPE CONTOURS TO MAXIMIZE PONDING EFFICIENCY.

SILT FENCE

3

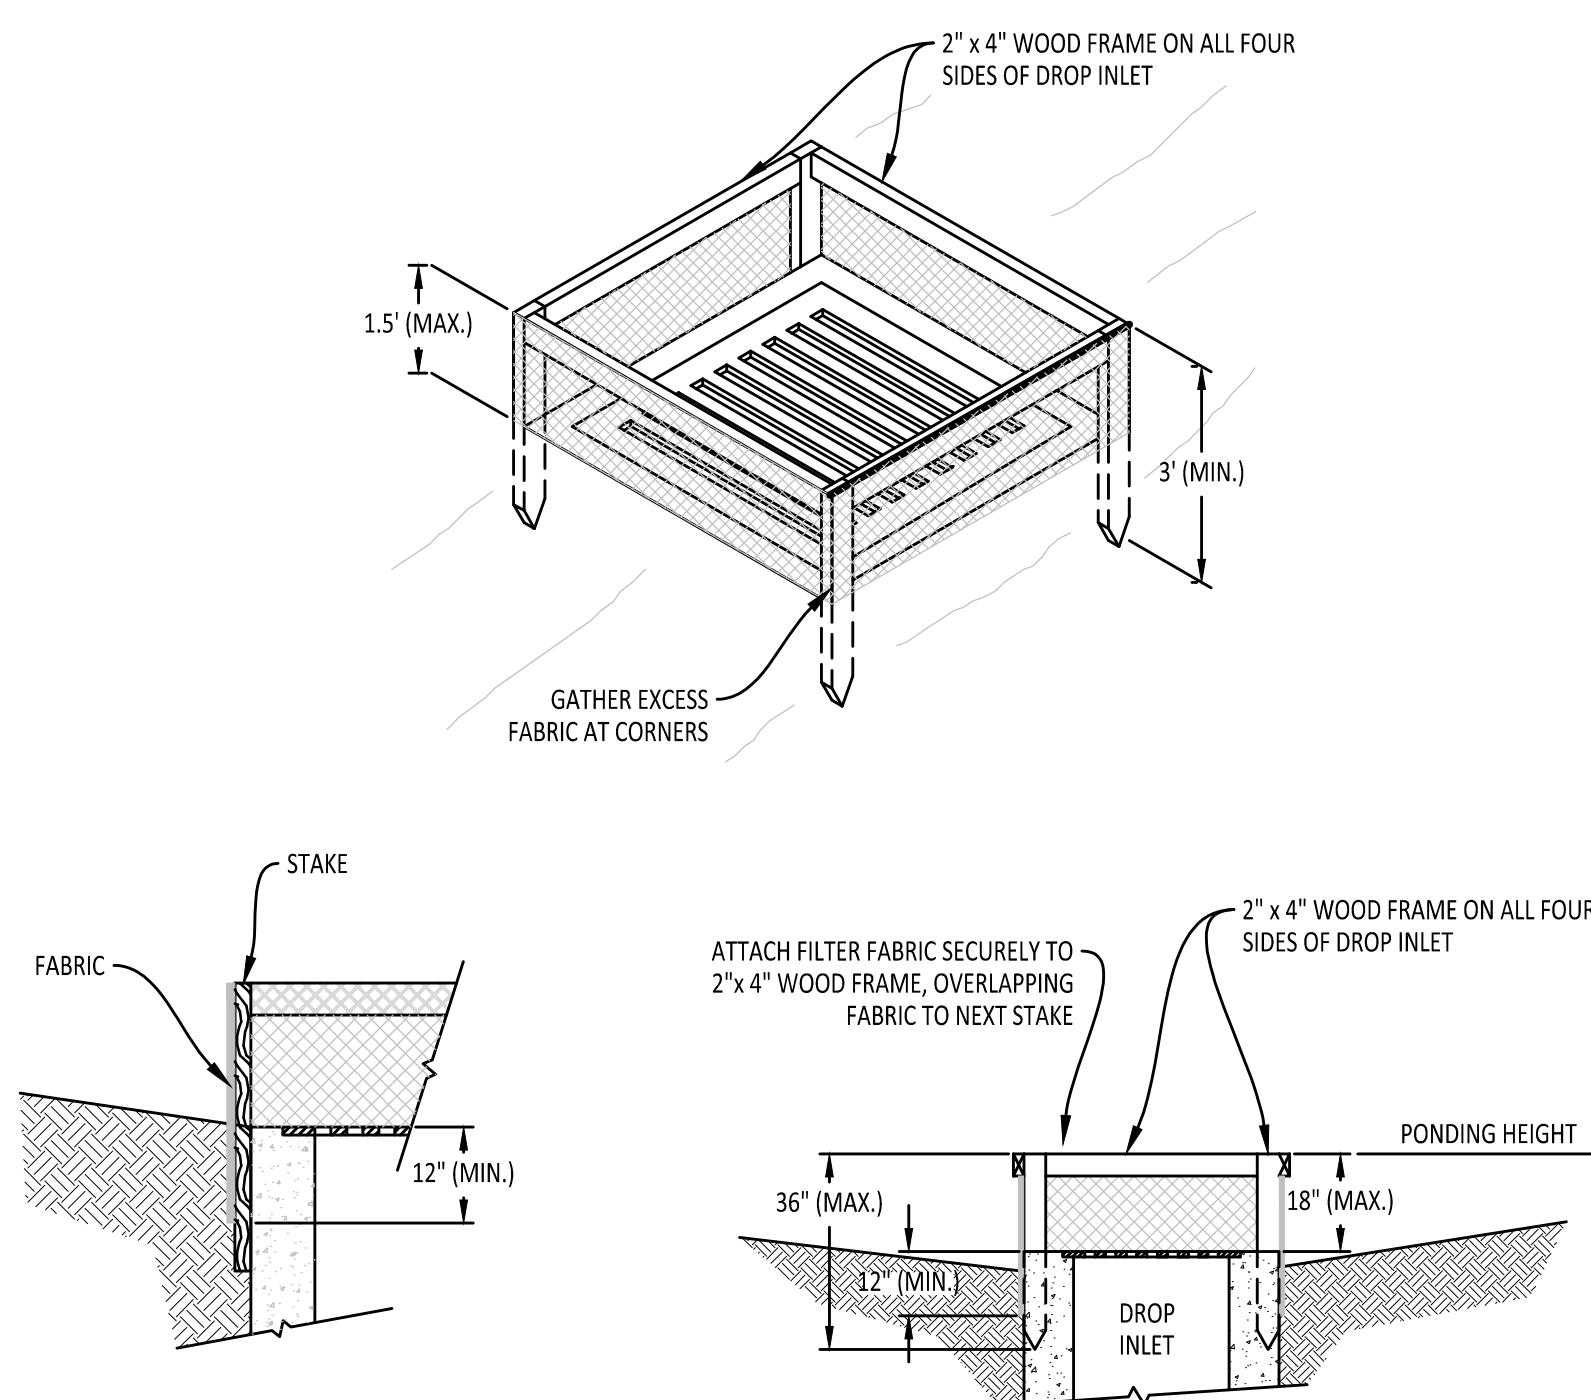


NOTES:

1. DROP INLET SEDIMENT BARRIERS ARE TO BE USED FOR SMALL, NEARLY LEVEL DRAINAGE AREAS. (LESS THAN 5%)
2. USE 2"x 4" WOOD OR EQUIVALENT METAL STAKES. (3 FT. MIN. LENGTH)
3. INSTALL 2"x 4" WOOD TOP FRAME TO INSURE STABILITY.
4. THE TOP OF THE FRAME (PONDING HEIGHT) MUST BE WELL BELOW THE GROUND ELEVATION DOWNSLOPE TO PREVENT RUNOFF FROM BYPASSING THE INLET. A TEMPORARY DIKE MAY BE NECESSARY ON THE DOWNSLOPE SIDE OF THE STRUCTURE.


SEDIMENT BARRIER AT DROP INLET

4

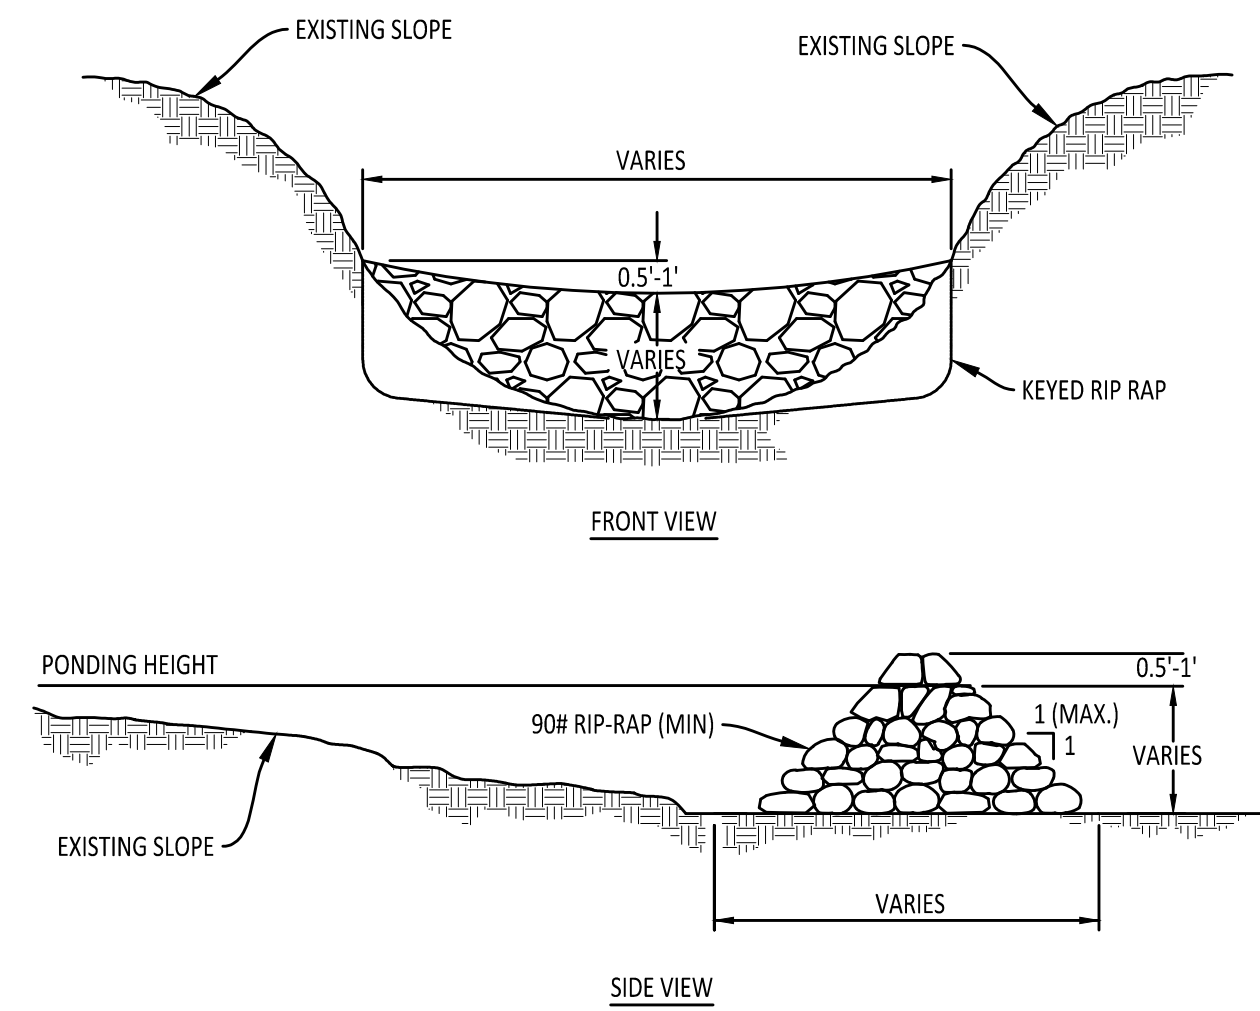

RIP RAP CHECK DAM

5

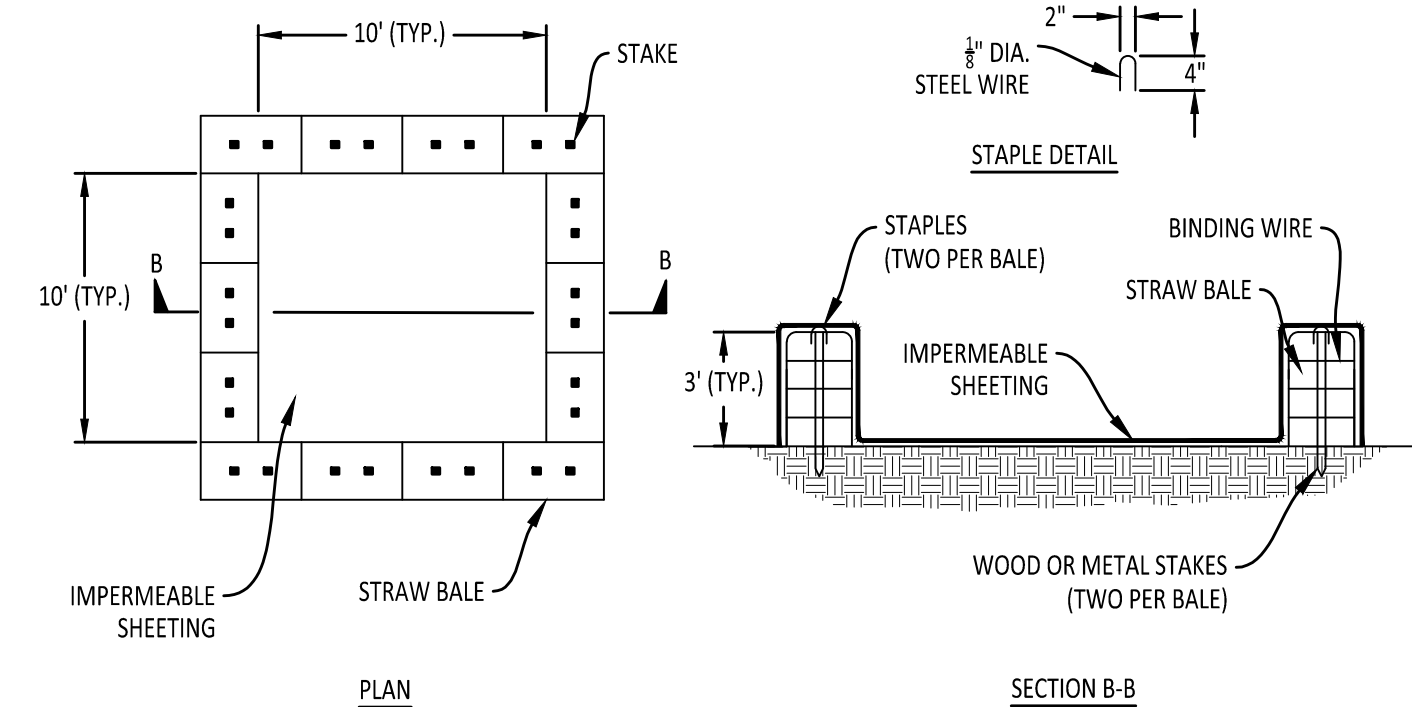


NOTES:

1. LOCATE WASHOUT STRUCTURE A MINIMUM OF 50 FEET AWAY FROM OPEN CHANNELS, STORM DRAIN INLETS, SENSITIVE AREAS, WETLANDS, BUFFERS AND WATER COURSES AND AWAY FROM CONSTRUCTION TRAFFIC.
2. SIZE WASHOUT STRUCTURE FOR VOLUME NECESSARY TO CONTAIN WASH WATER AND SOLIDS AND MAINTAIN AT LEAST 4 INCHES OF FREEBOARD. TYPICAL DIMENSIONS ARE 10 FEET X 10 FEET X 3 FEET DEEP.
3. PREPARE SOIL BASE FREE OF ROCKS OR OTHER DEBRIS THAT MAY CAUSE TEARS OR HOLES IN THE LINER. FOR LINER, USE 10 MIL OR THICKER UV RESISTANT, IMPERMEABLE SHEETING, FREE OF HOLES AND TEARS OR OTHER DEFECTS THAT COMPROMISE IMPERMEABILITY OF THE MATERIAL.
4. PROVIDE A SIGN FOR THE WASHOUT IN CLOSE PROXIMITY TO THE FACILITY.
5. KEEP CONCRETE WASHOUT STRUCTURE WATER TIGHT. REPLACE IMPERMEABLE LINER IF DAMAGED (E.G., RIPPED OR PUNCTURED). EMPTY OR REPLACE WASHOUT STRUCTURE THAT IS 75 PERCENT FULL, AND DISPOSE OF ACCUMULATED MATERIAL PROPERLY. DO NOT REUSE PLASTIC LINER. WET-VACUUM STORED LIQUIDS THAT HAVE NOT EVAPORATED AND DISPOSE OF IN AN APPROVED MANNER. PRIOR TO FORECASTED RAINSTORMS, REMOVE LIQUIDS OR COVER STRUCTURE TO PREVENT OVERFLOWS. REMOVE HARDENED SOLIDS, WHOLE OR BROKEN UP, FOR DISPOSAL OR RECYCLING. MAINTAIN RUNOFF DIVERSION AROUND EXCAVATED WASHOUT STRUCTURE UNTIL STRUCTURE IS REMOVED.


CONCRETE WASHOUT

6

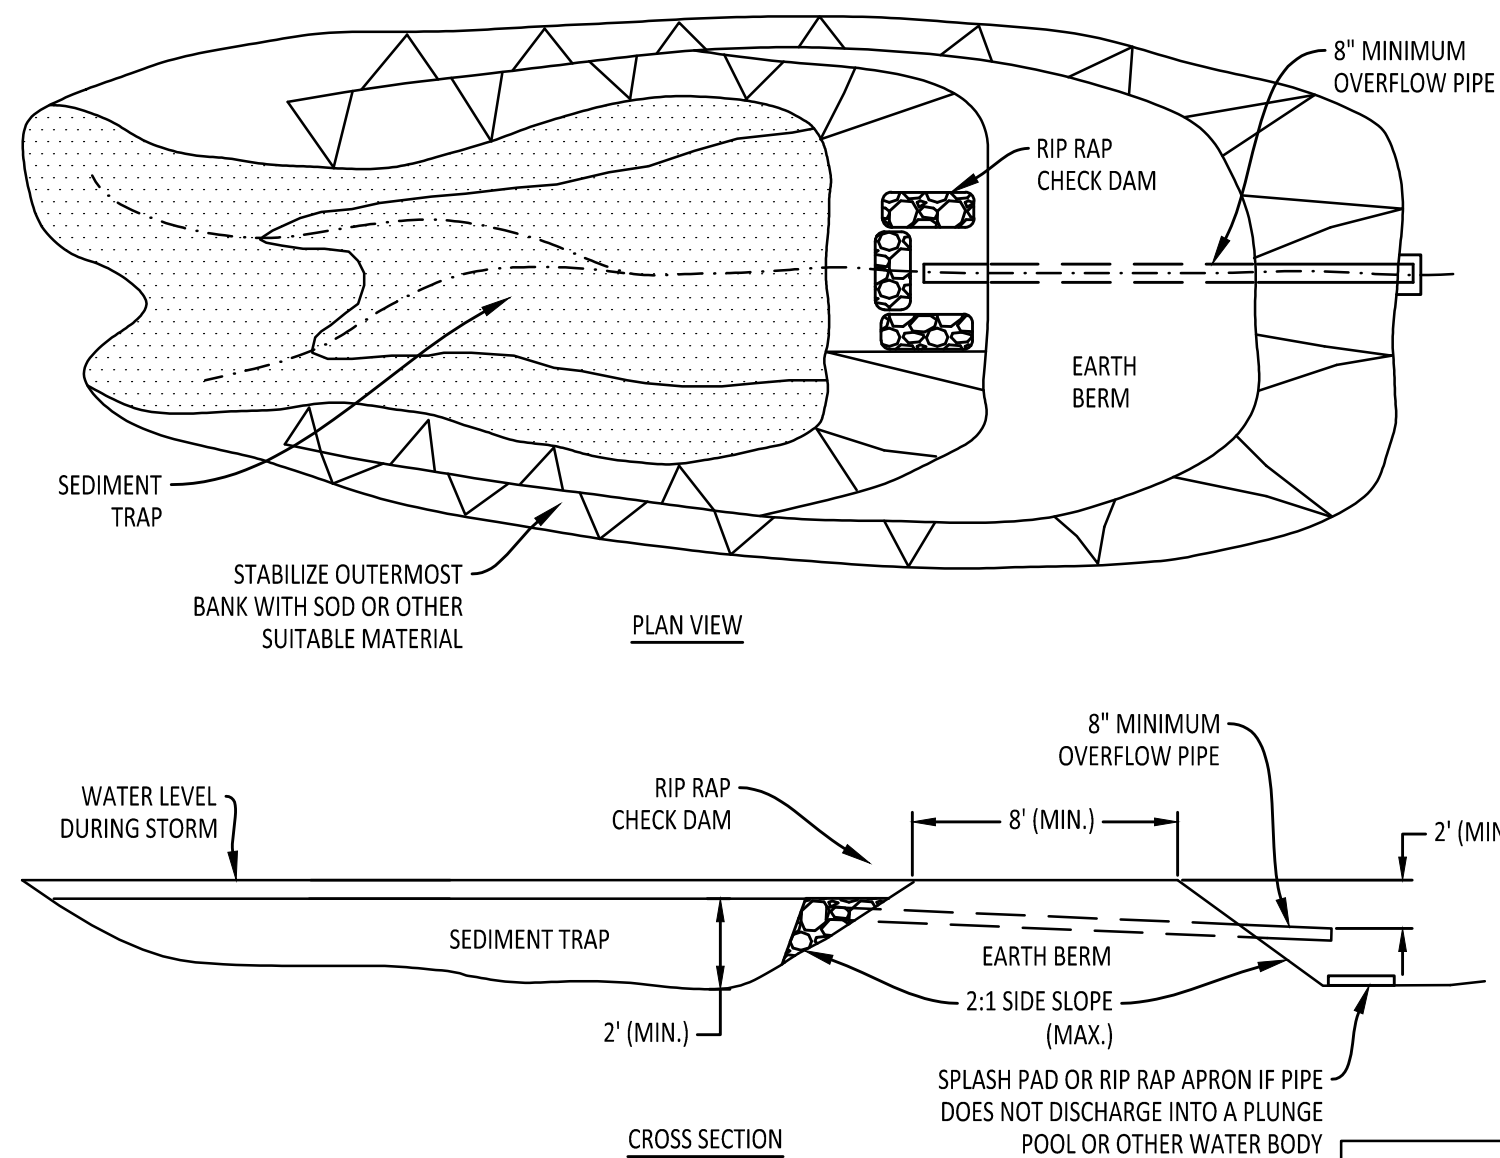


EROSION CONTROL SEDIMENT BASIN

7

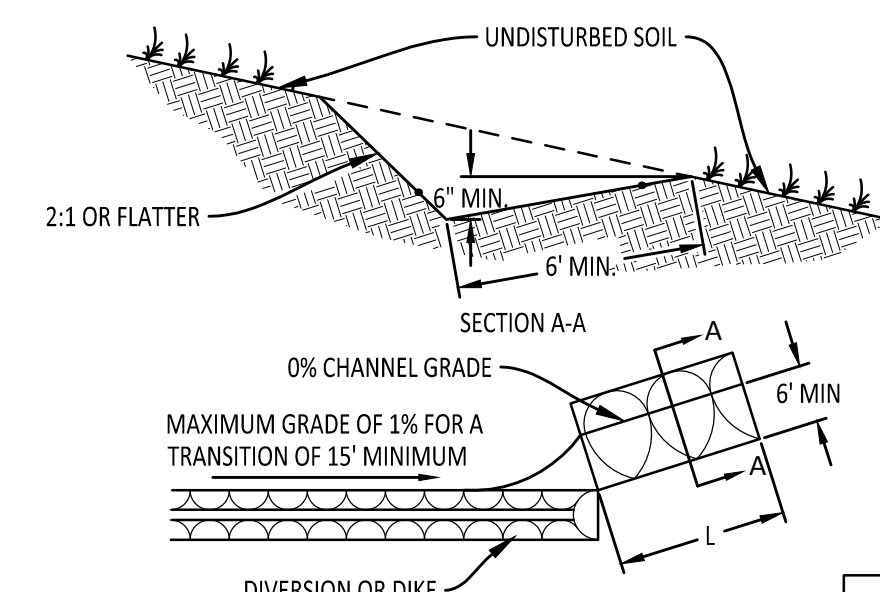



LEVEL SPREADER

8

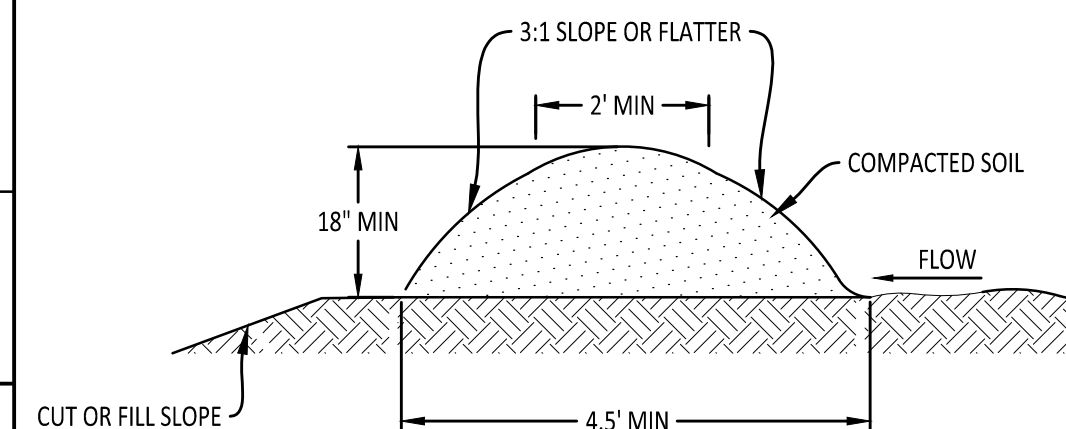

TEMPORARY DIVERSION DIKE

9

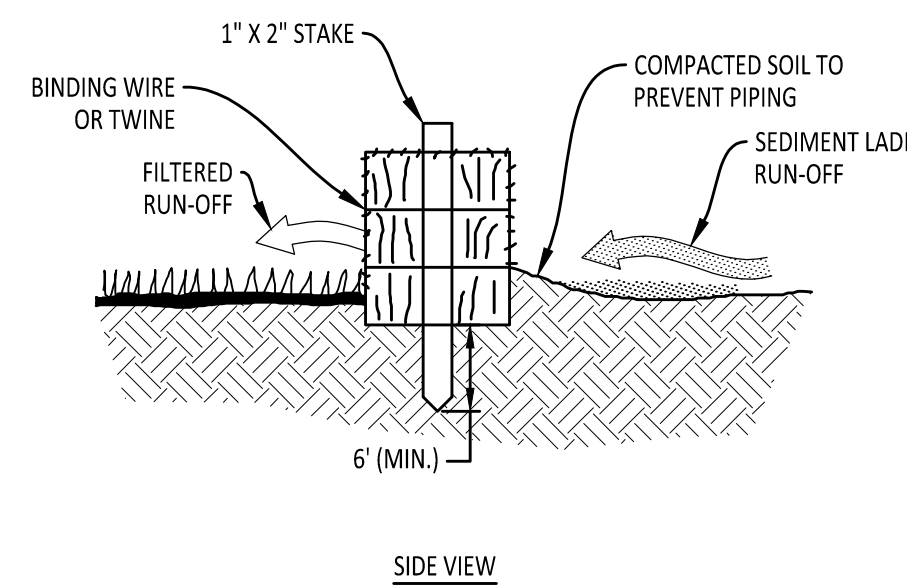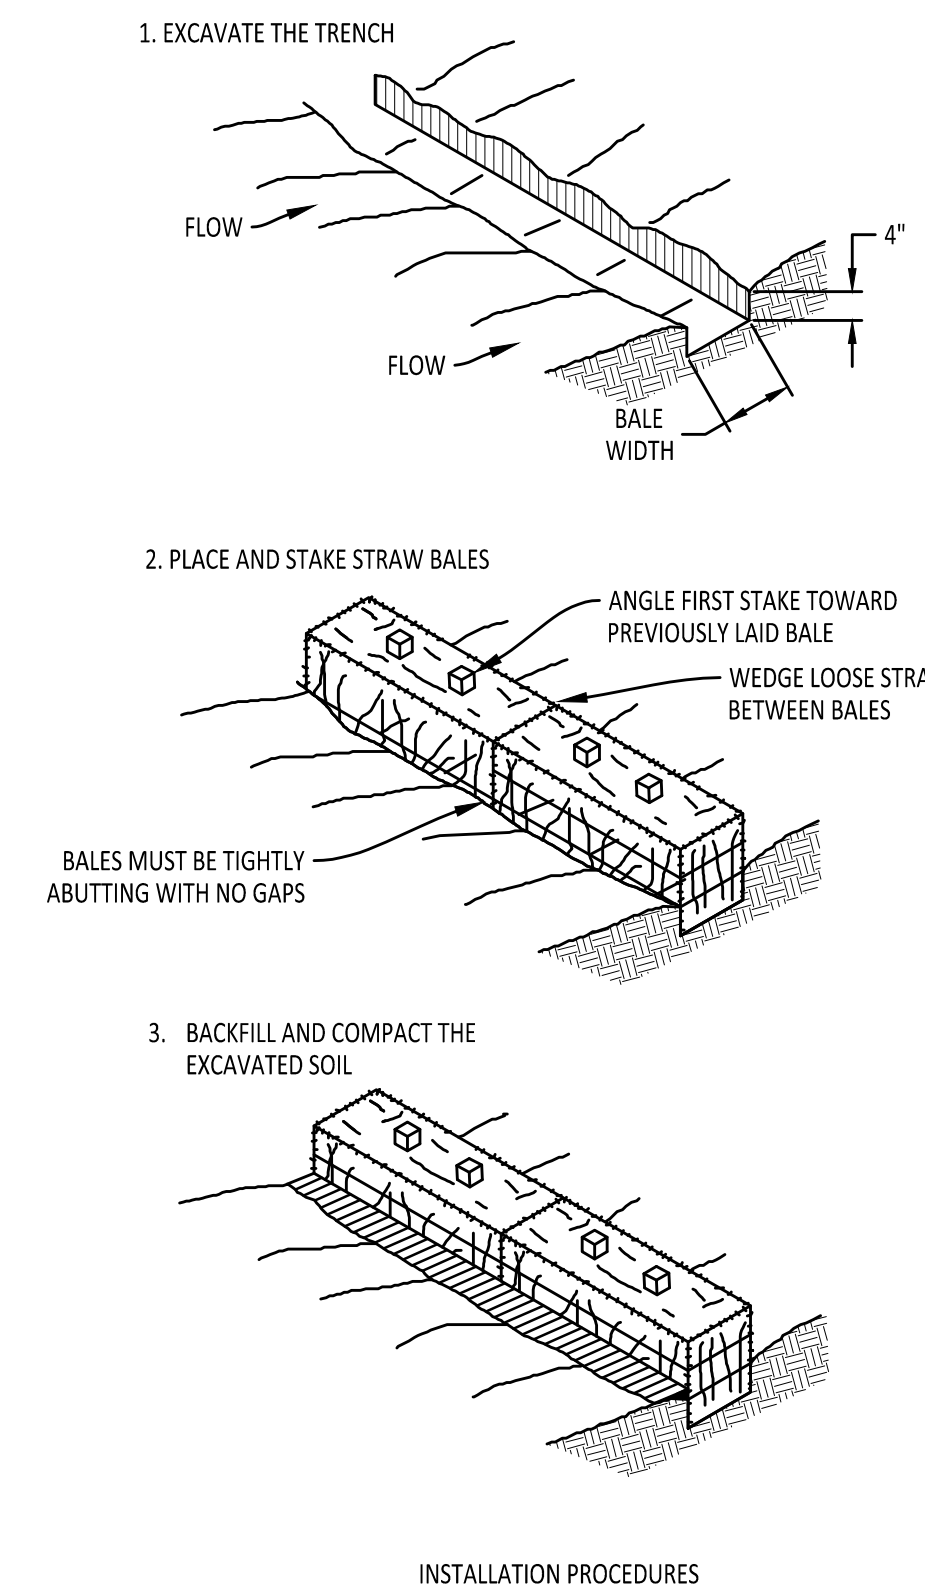

STRAW BALE BARRIER



10

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN
ENGINEERING

PROJECT: MCKNIGHT FALLS APARTMENTS - PHII


CLIENT: MCKNIGHT FALLS, LLC

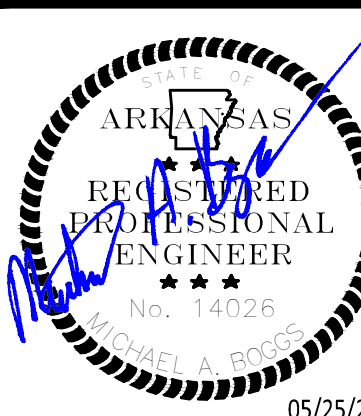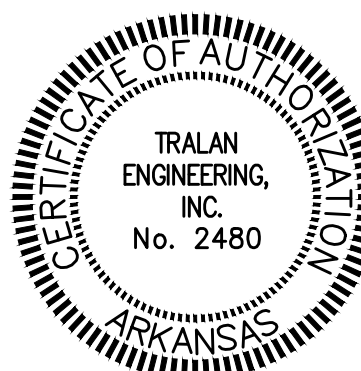

| REVISIONS | | |
|---------------|-----------|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |
| | | |
| DRAWING INFO. | | |
| DRAWN BY: | MAB | |
| DATE: | 5/25/2017 | |
| SCALE: | | |
| JOB NO.: | 16-080 | |
| CAD NO.: | | |


SWPPP
DETAILS

SHEET NUMBER:
8 of **11**

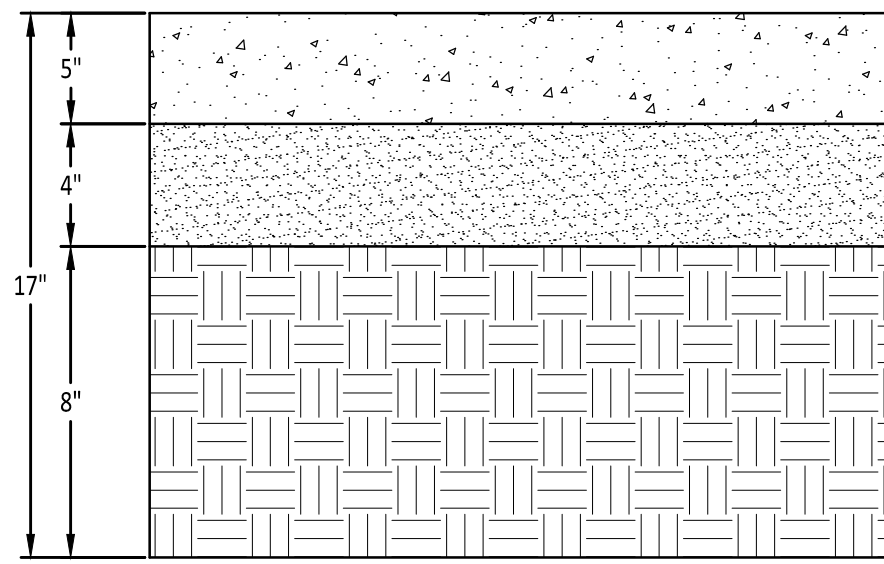


CONCRETE PAVING SECTION
N.T.S.

NOTE:
CONSTRUCT CONTRACTION JOINTS ON A MAXIMUM OF 15' CENTERS EACH WAY.
PROVIDE EXPANSION JOINTS WHERE PAVEMENT ABUTTS CURB AND SIDEWALKS.

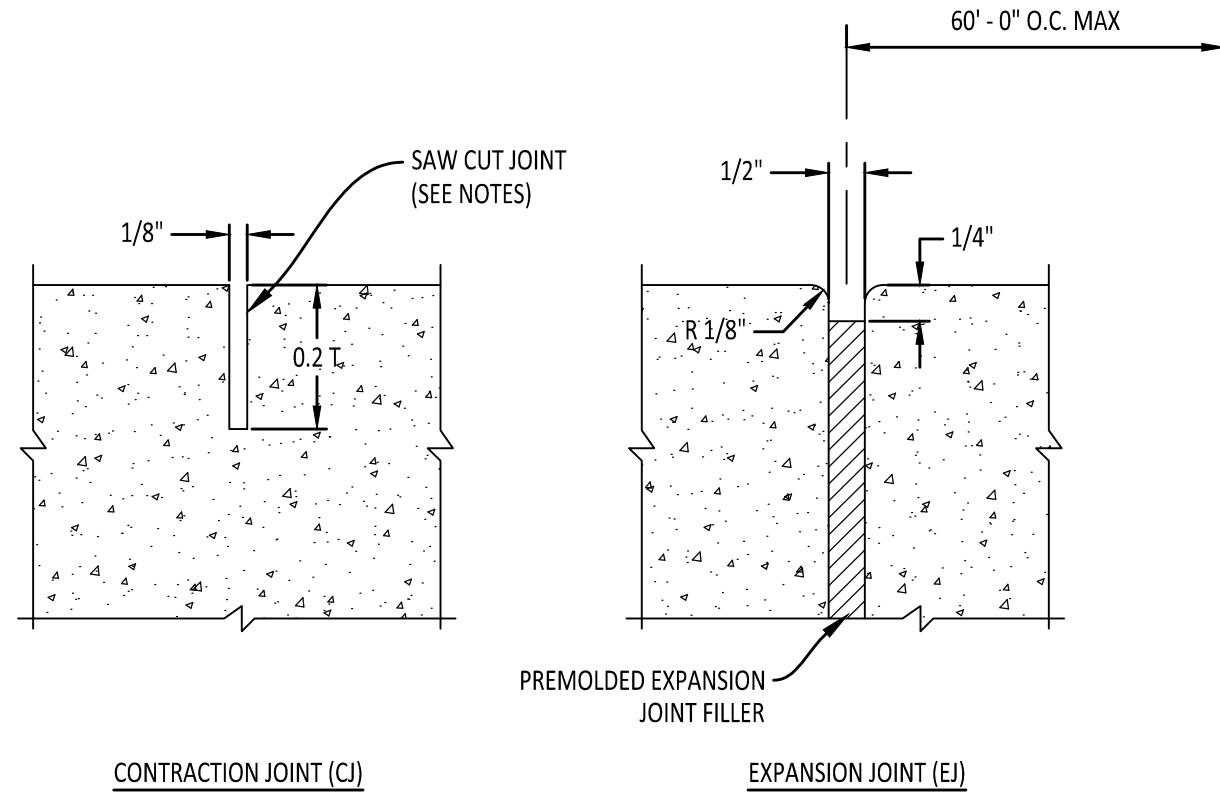


CONSTRUCTION JOINT DETAILS
N.T.S.


- NOTE:
1. PROVIDE EXPANSION JOINT WHERE CONCRETE ABUTTS EXISTING CONCRETE, SUCH AS CURB AND NEXT TO STRUCTURES AND DRIVEWAYS.
 2. JOINT SPACING ON CURBS TO BE MAXIMUM 15'.
 3. JOINT SPACING ON SIDEWALKS TO BE EQUAL TO THE SIDEWALK WIDTH.

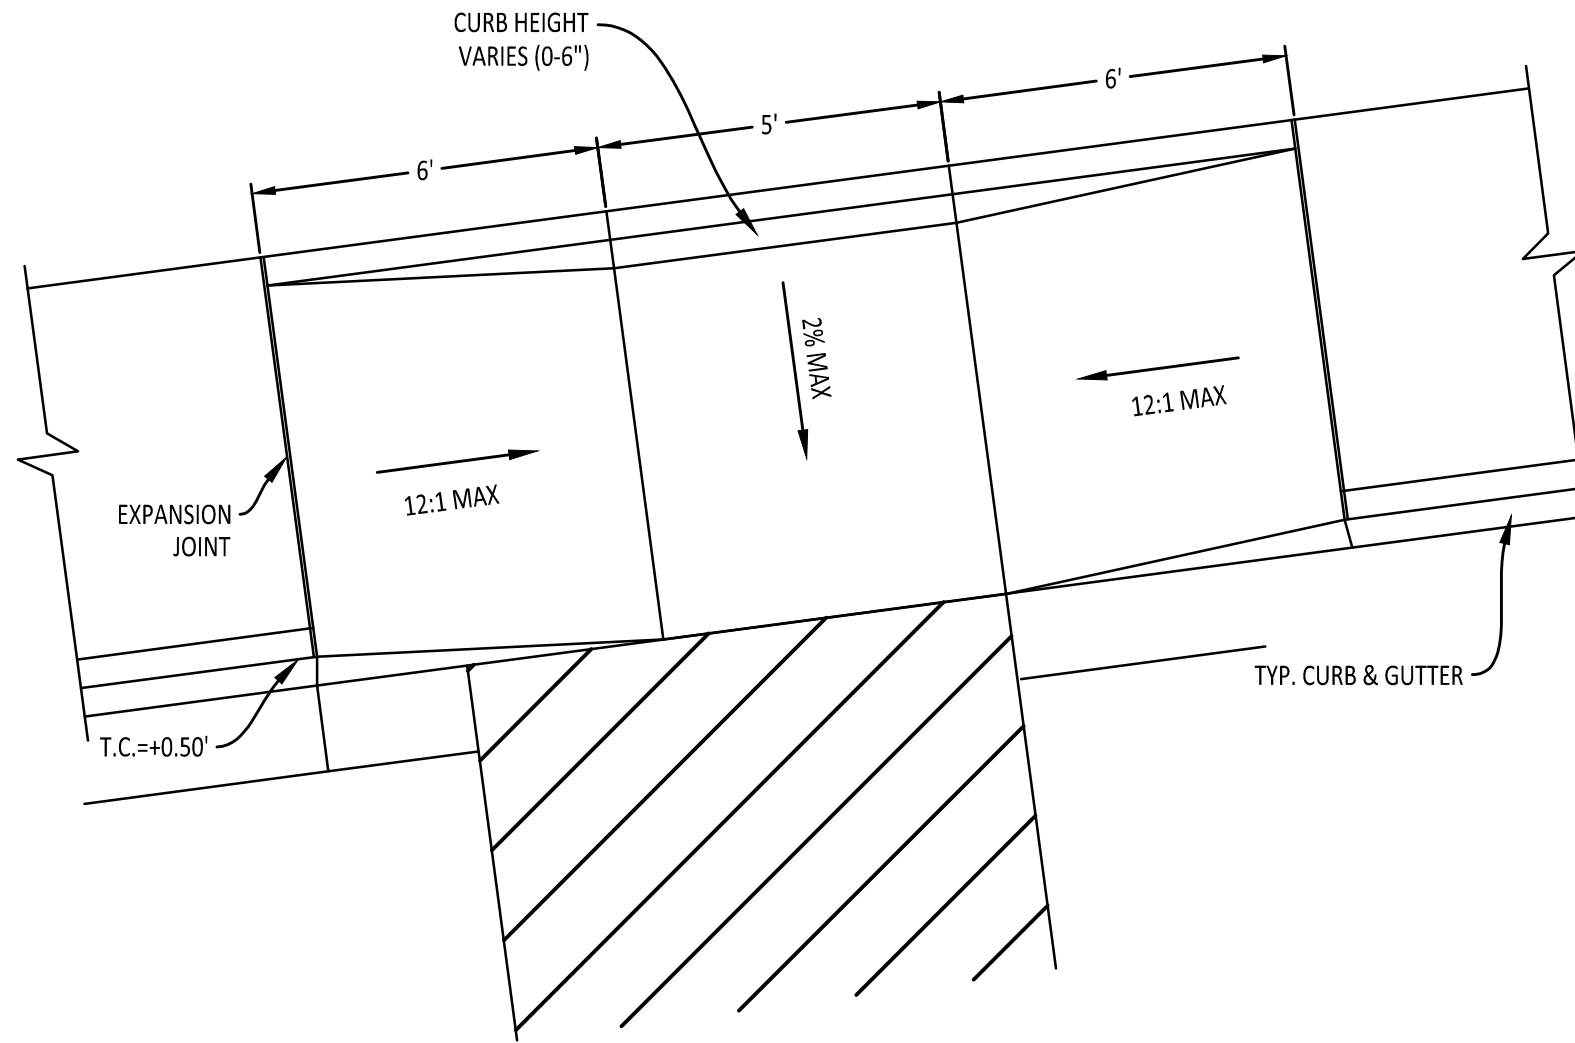

TYPE E - ACCESS RAMP

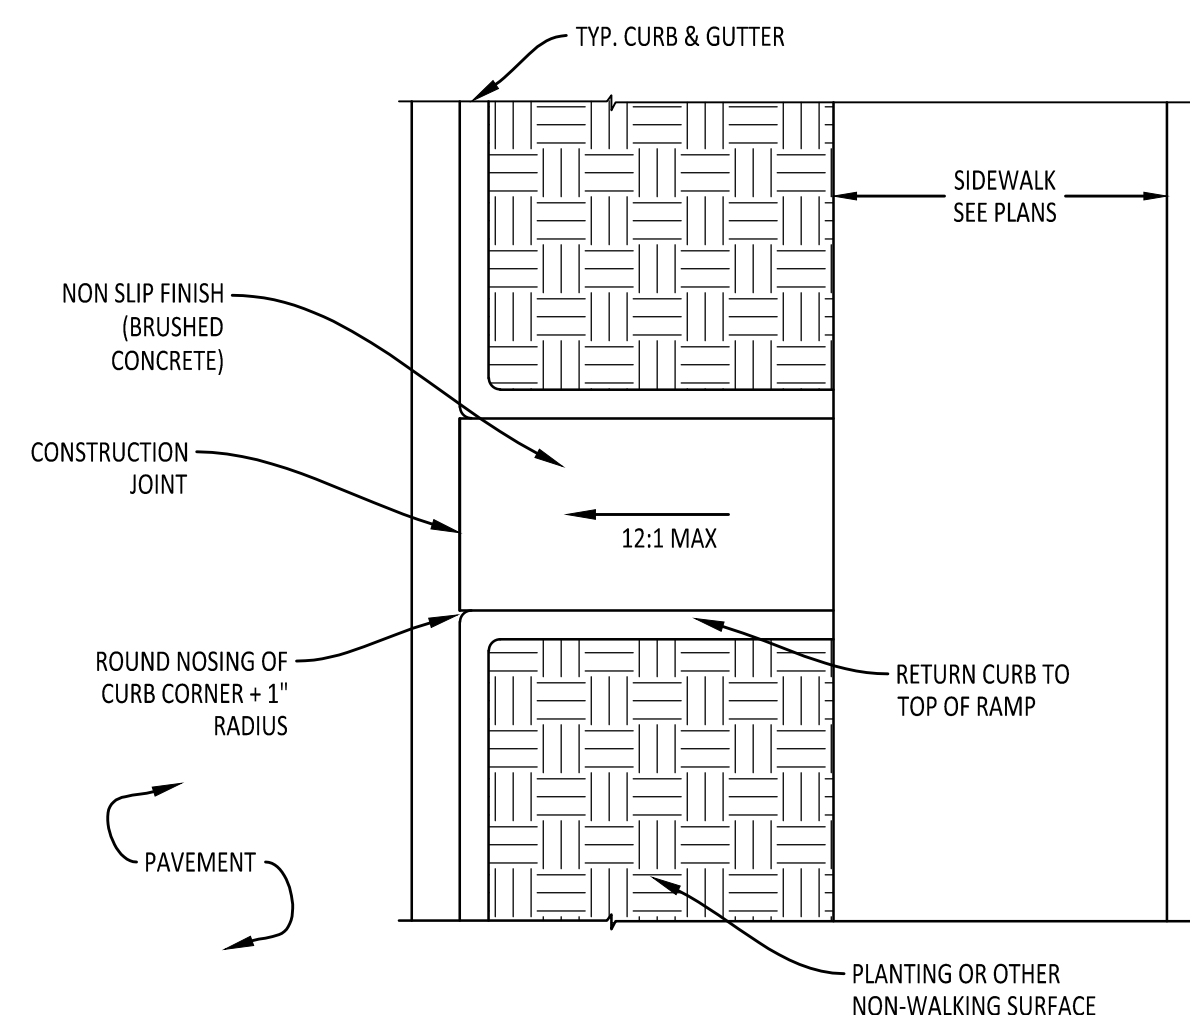


TYPE "B" ACCESS RAMP
N.T.S.

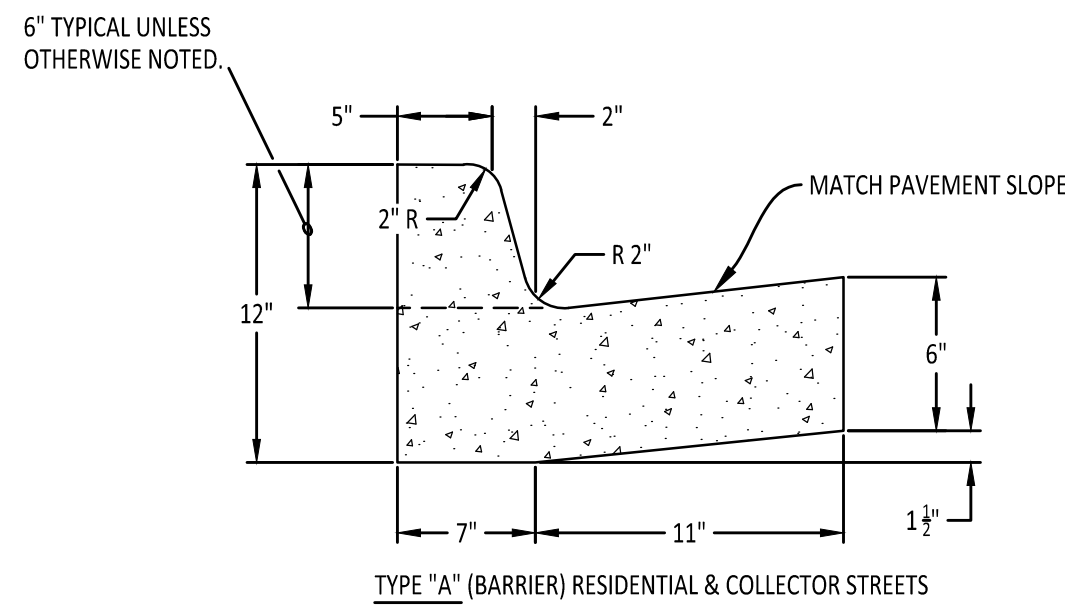


COMBINATION CURB AND GUTTER
N.T.S.


NOTE:
CONTRACTION JOINTS SHALL BE CONSTRUCTED EVERY FIFTEEN FEET.
EXPANSION JOINTS SHALL BE CONSTRUCTED AT FIXED STRUCTURAL OBJECTS, SUCH AS DRAINAGE INLETS AND SIDEWALKS.

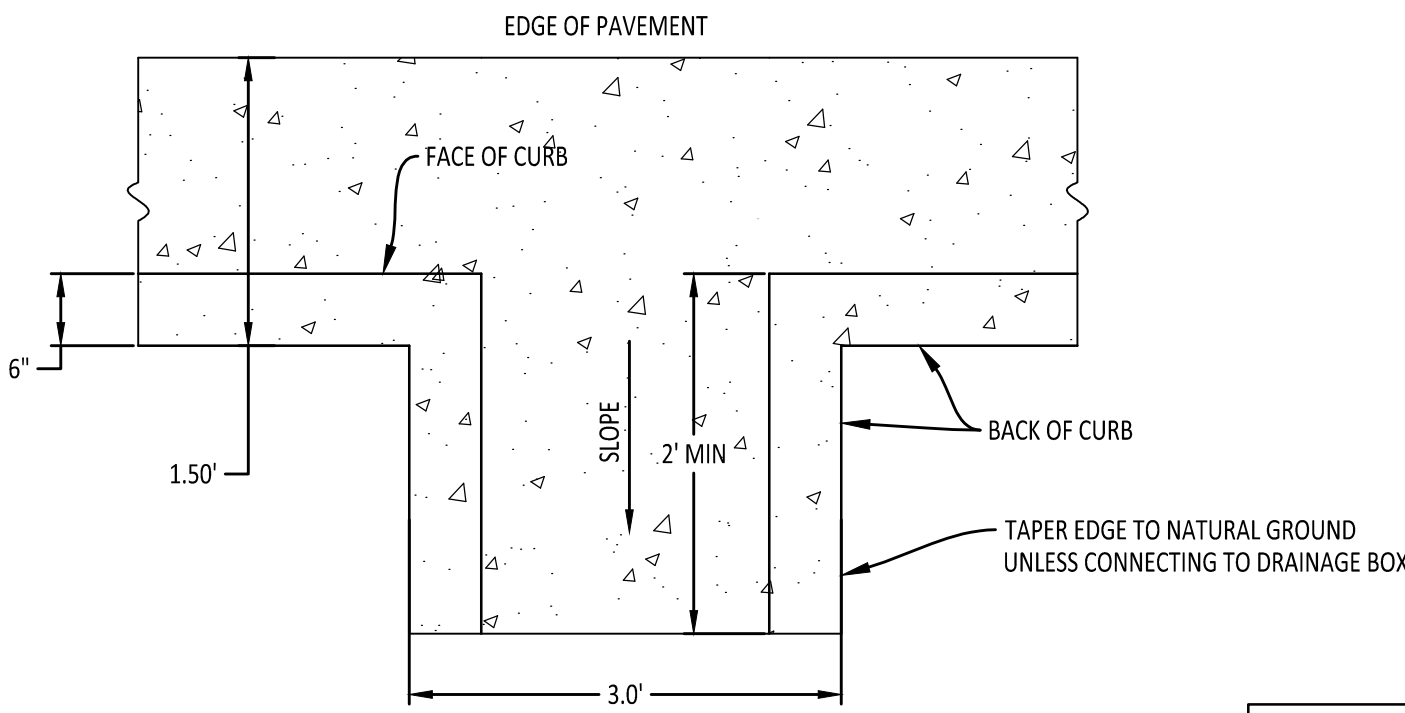

CURB CUT/FLUME
N.T.S.

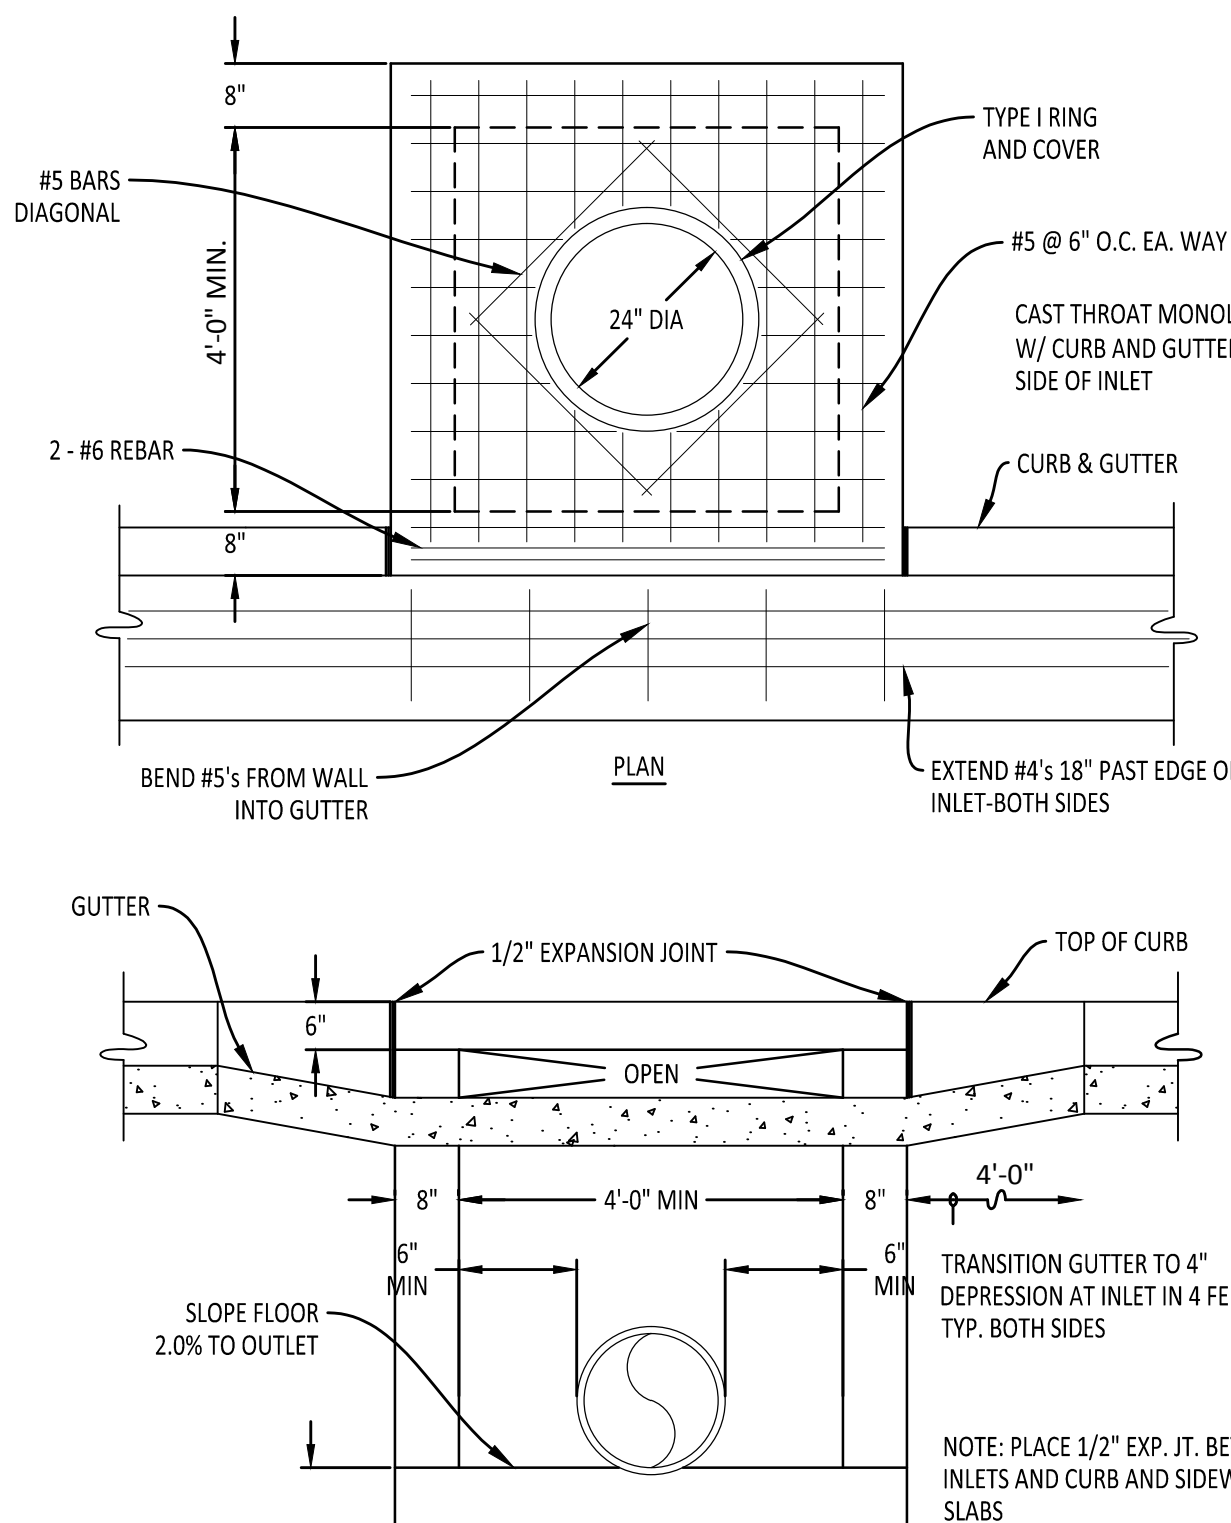


CURB INLET DETAIL
N.T.S.

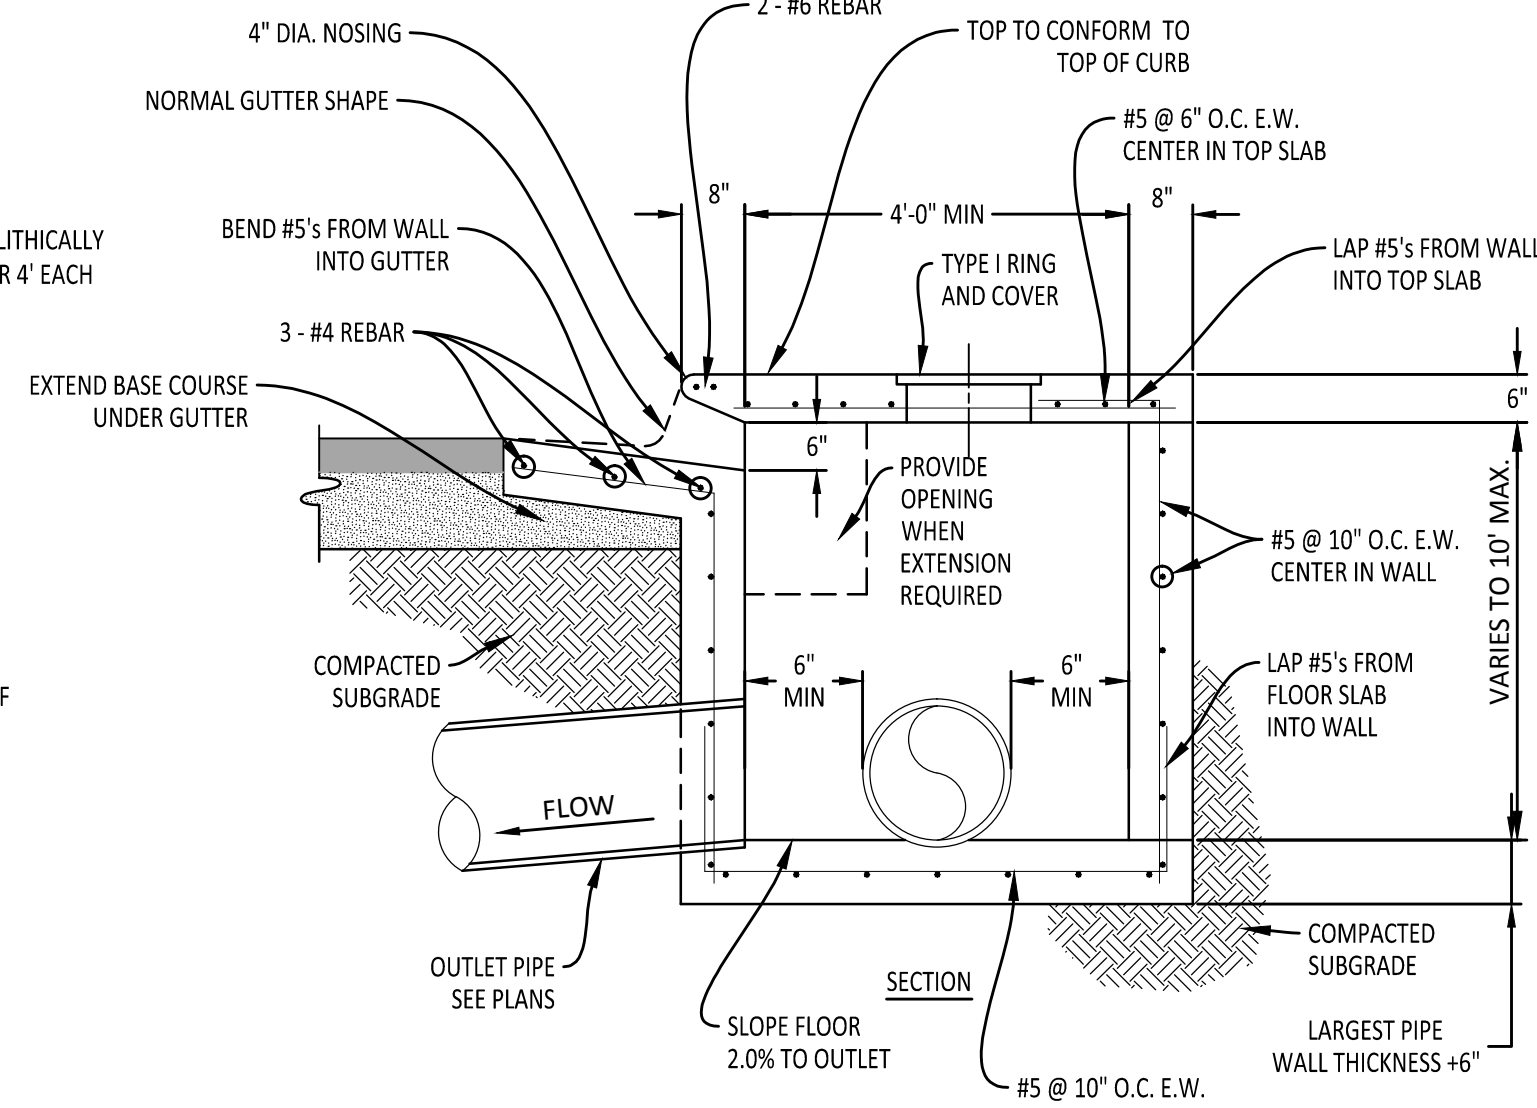


NOTE:
INLETS MORE THAN 3'-0" DEEP SHALL HAVE STANDARD MANHOLE STEPS PLACED AT 15" O.C. - MANHOLE FRAME AND COVER SHALL BE PLACED ADJACENT TO THE WALL WITH THE STEPS.


AS APPROVED BY ENGINEER, WALLS MAY BE 8" BLOCK WITH 1/2" MORTAR. FILL CELLS WITH CONCRETE AND WITH #4 @ 16" O.C. MINIMUM DISTANCE FROM WALL TO PIPE SHALL BE 8" IF BLOCK WALLS ARE CONSTRUCTED.

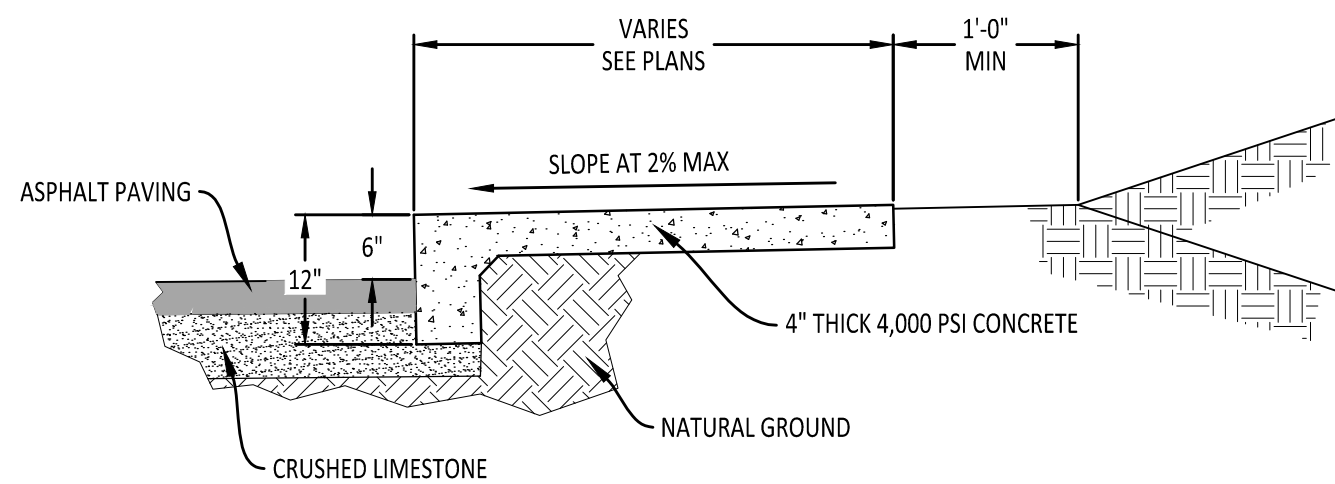



SIDEWALK AT ASPHALT PAVING
N.T.S.

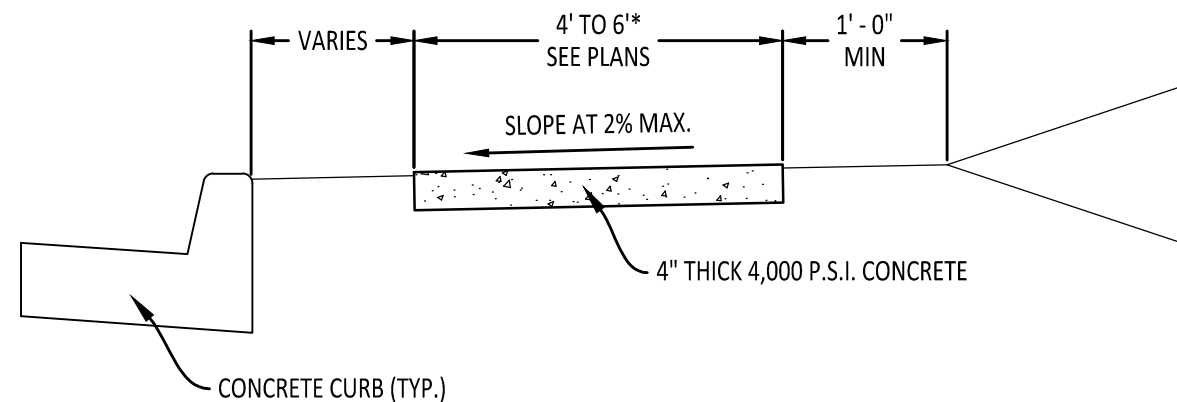

TYPICAL SIDEWALK SECTION
N.T.S.

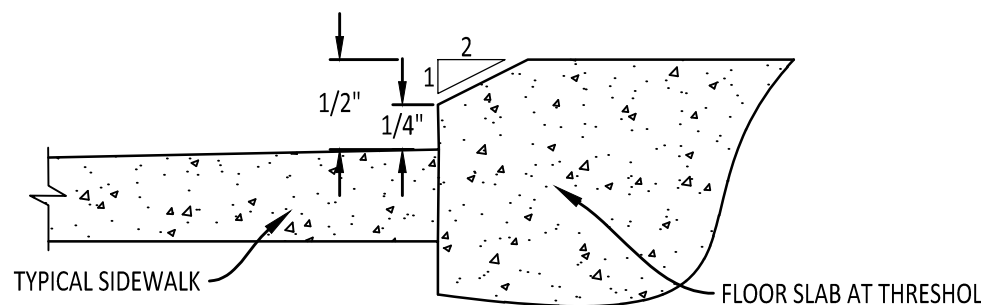


ADA BEVELED SIDEWALK TO DOORWAY
N.T.S.

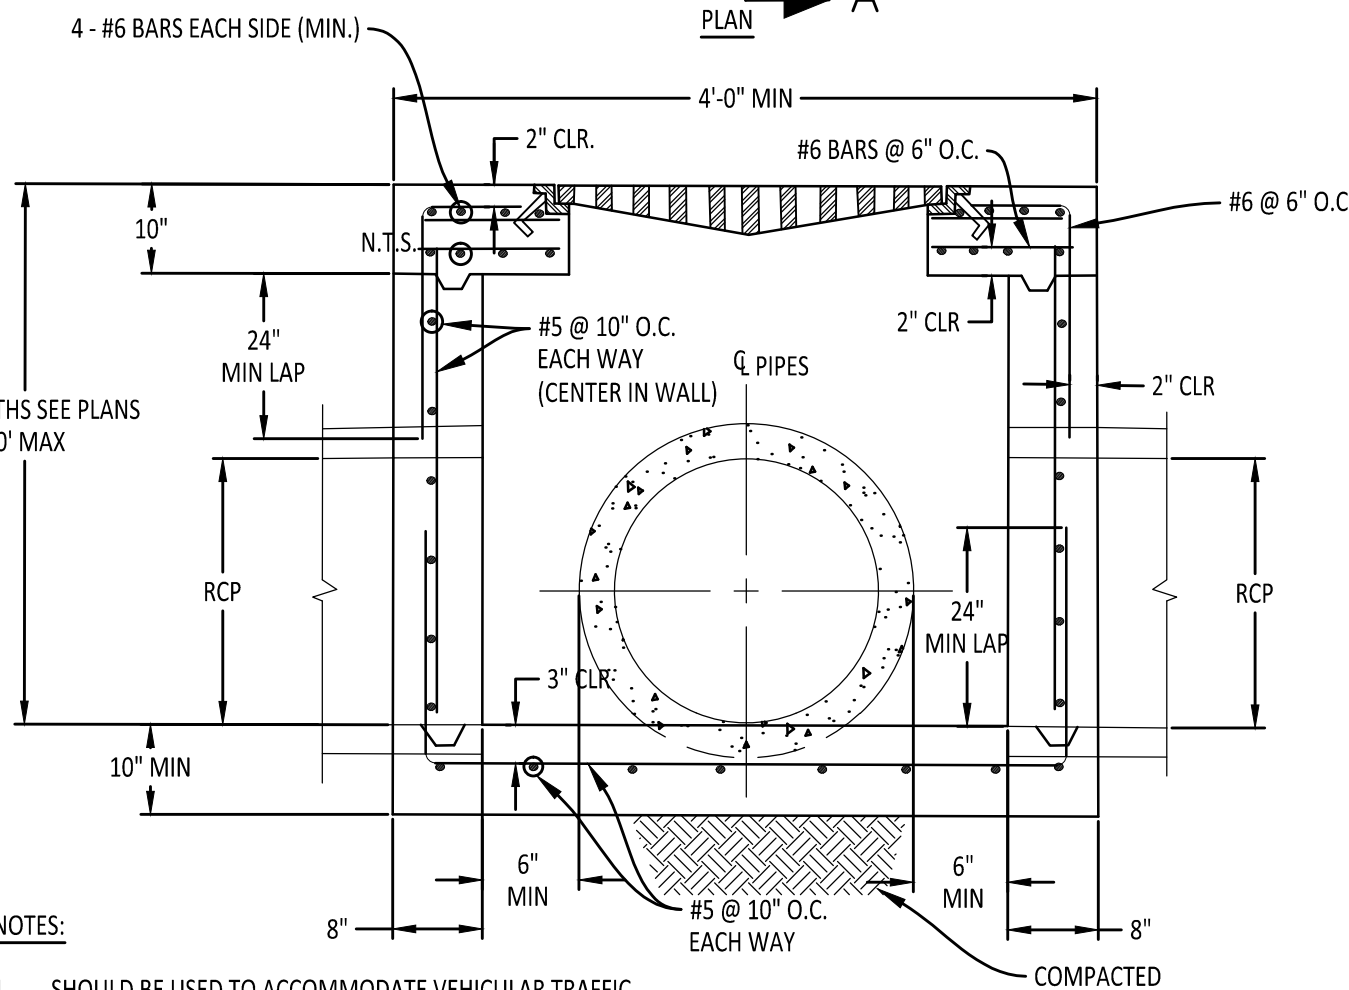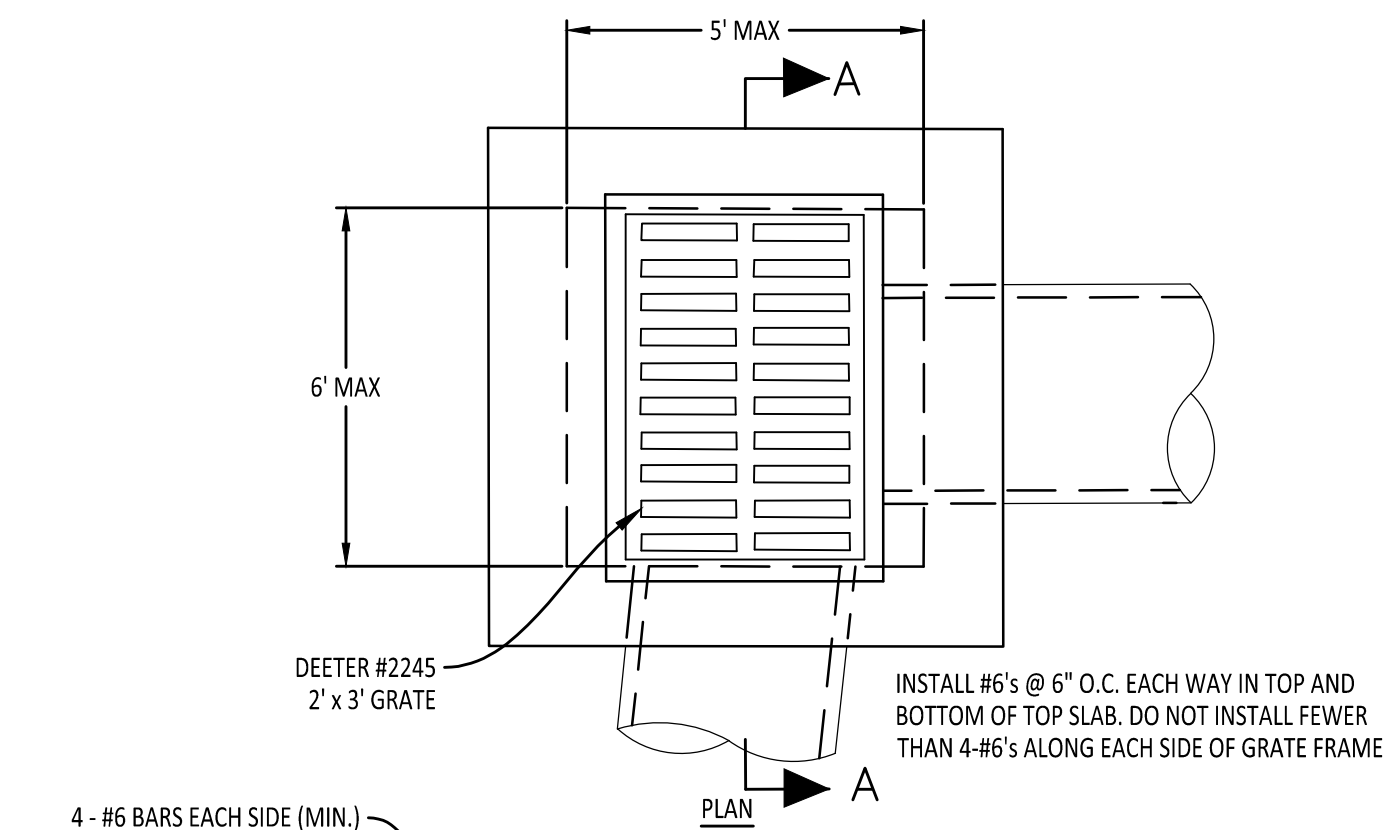

- NOTES:
1. SHOULD BE USED TO ACCOMMODATE VEHICULAR TRAFFIC. JUNCTION BOXES MORE THAN 3 FEET DEEP SHALL HAVE STANDARD MANHOLE STEPS PLACED @ 15" O.C.
 2. SEE REINFORCING DETAIL FOR OPENING IN WALL OR SLAB.

SECTION "A-A" - GRATE INLET - HEAVY
N.T.S.

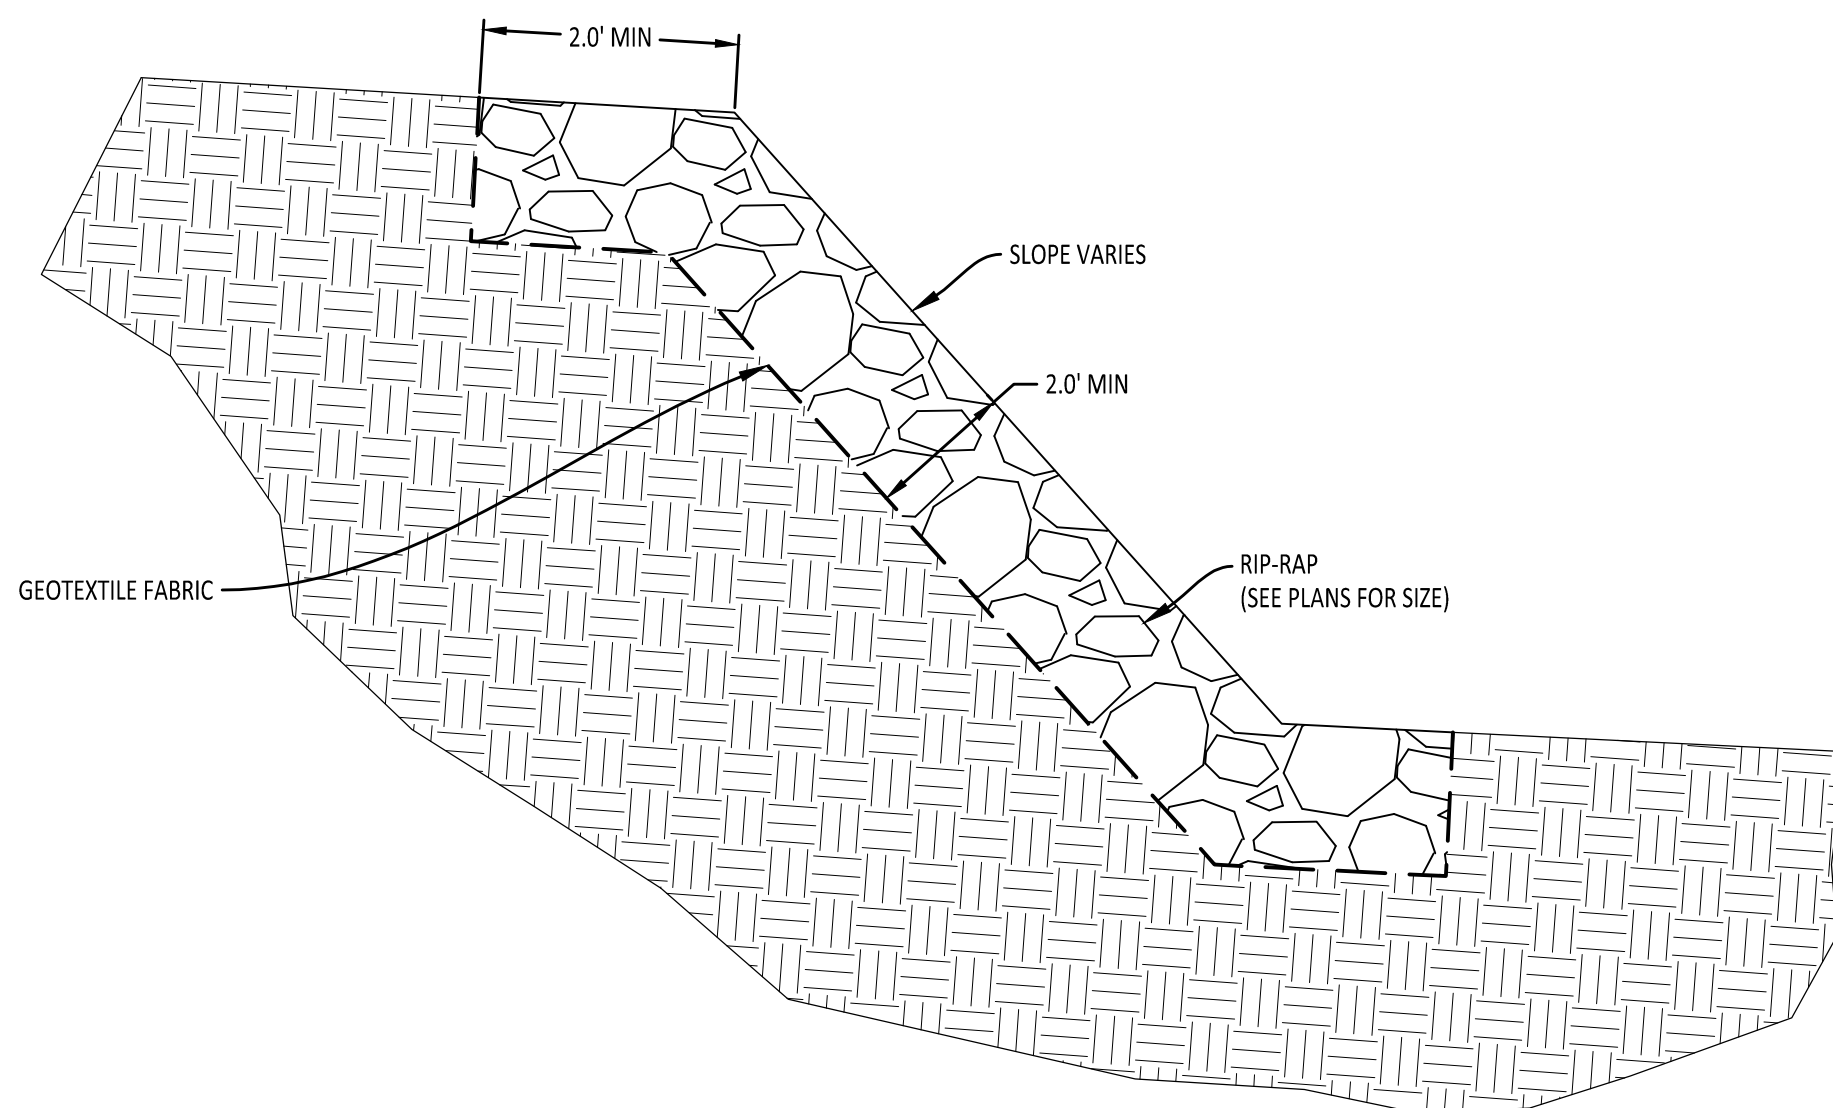



RIP RAP SLOPE DETAIL
N.T.S.

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENGINEERING.COM

TRALAN
ENGINEERING

PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

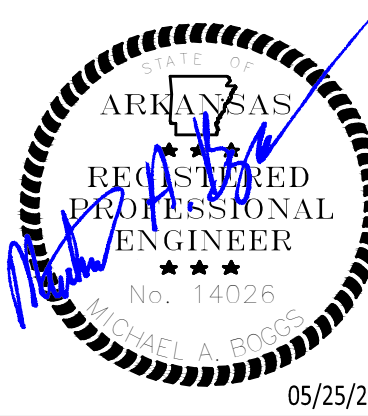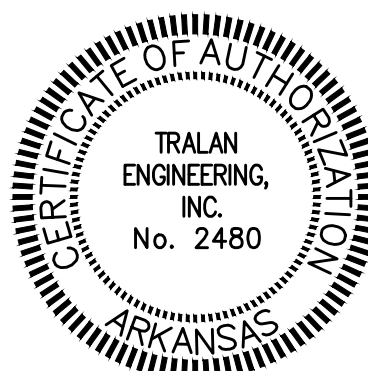


| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |

| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | |
| JOB NO.: | 16-080 |
| CAD NO.: | |

SITE CONSTRUCTION
DETAILS

SHEET NUMBER:
9 of **11**

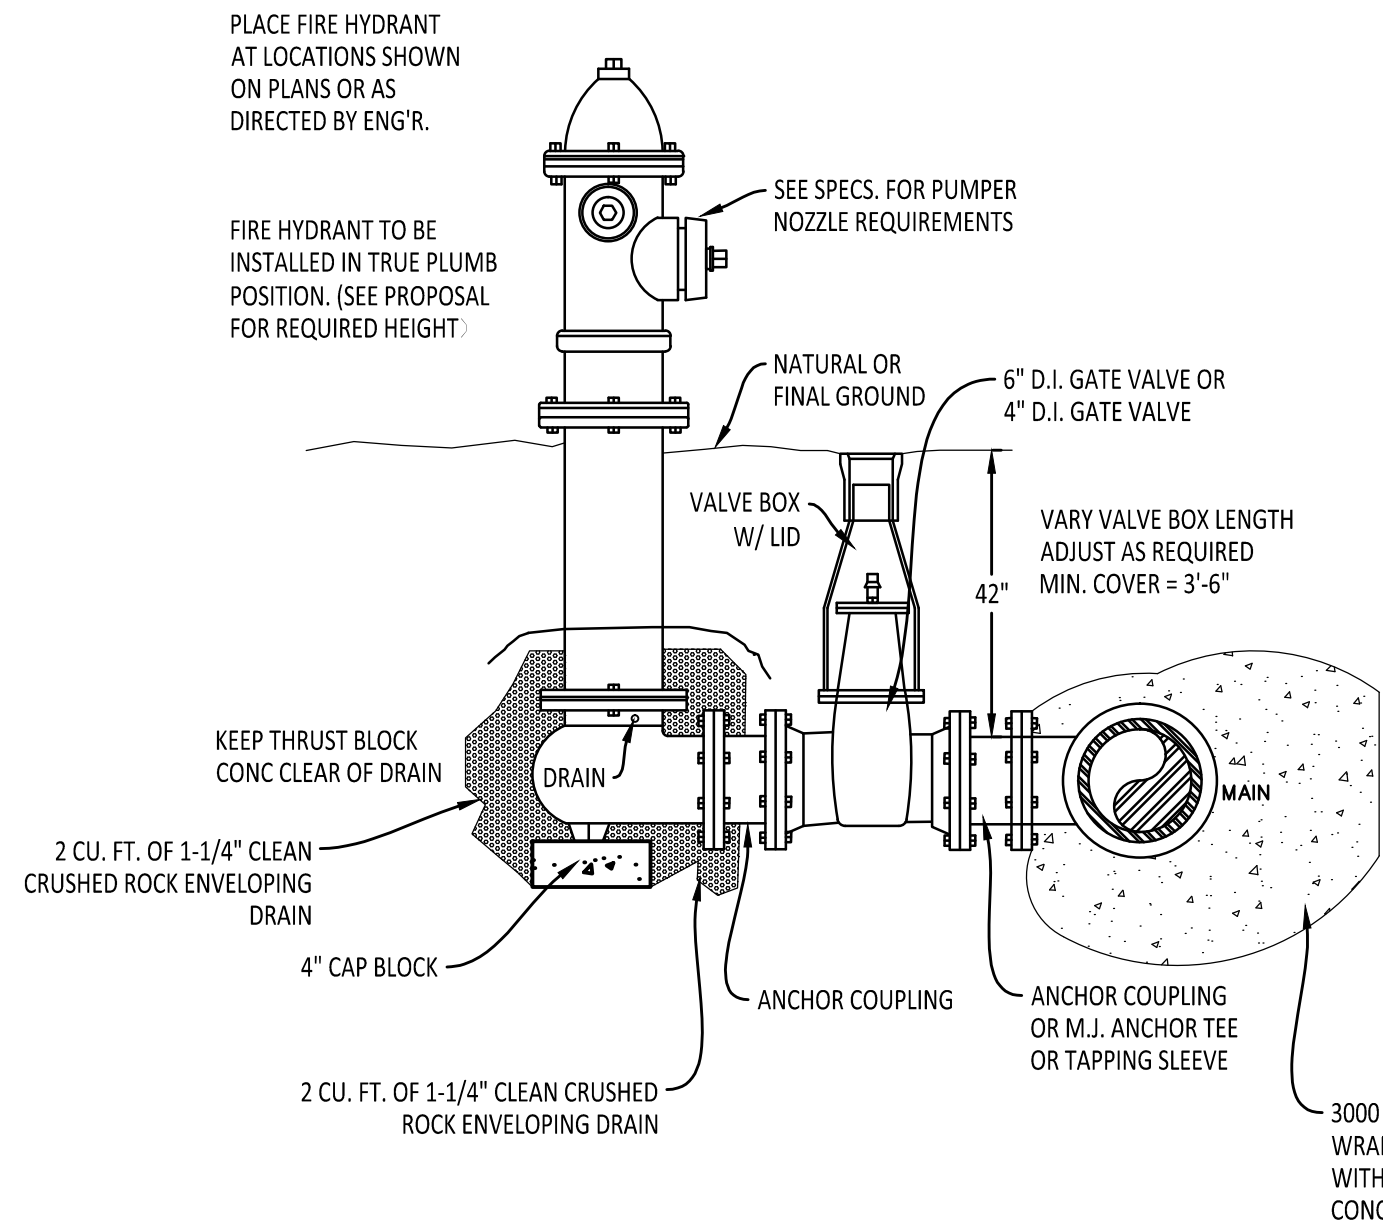



NOTES:
(1) PROVIDE TWO (2) MECHANICAL JOINT ANCHORING COUPLINGS VALVE BOXES AND TEES WITHIN CITY LIMITS.
(2) CWL WILL PROVIDE FIRE HYDRANTS, ANCHORING COUPLINGS, VALVES,

FIRE HYDRANT DETAIL WITH ANCHOR COUPLING


N.T.S.

FIRE HYDRANT SHALL BE MULLER TYPE ONLY



- THREE SPUD HYDRANT #A-423, 5-1/4" MAIN VALVE OPENING, 3 WAY, 2- 2 1/2" HOSE NOZZLES, 1-4 1/2" PUMPER NOZZLE, 4'0" BURY, 6" M.J. SHOE PENTAGON NUT OPEN LEFT NST.
- TWO SPUD HYDRANT #A-422, 5-1/4" MAIN VALVE OPENING, 2 WAY, 2- 2 1/2" HOSE NOZZLES, 4'0" BURY, 6" M.J. SHOE PENTAGON NUT OPEN LEFT NST.
- TWO SPUD HYDRANT #A-420, 4-1/2" MAIN VALVE OPENING, 2 WAY, 2- 2 1/2" HOSE NOZZLES, 4'0" BURY, 4" M.J. SHOE PENTAGON NUT OPEN LEFT NST. THIS IS TO BE USED ON 4" MAINS.

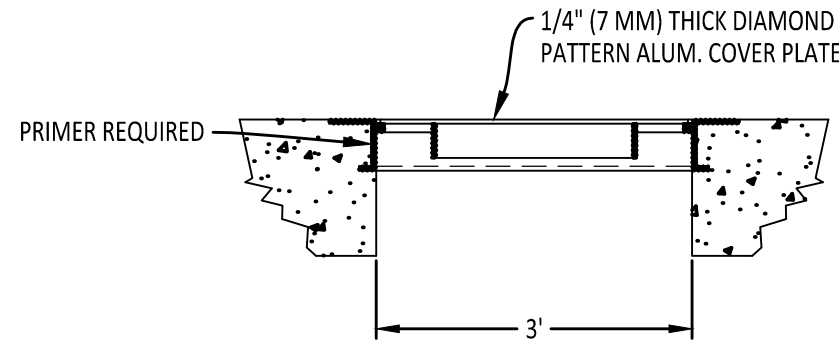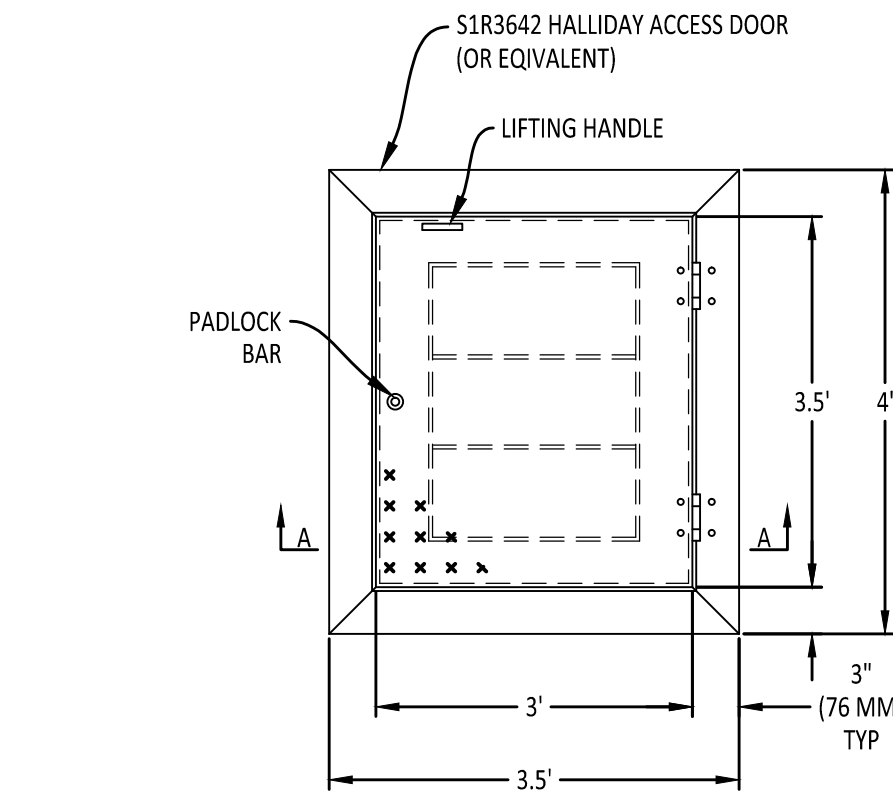

SECTION A-A

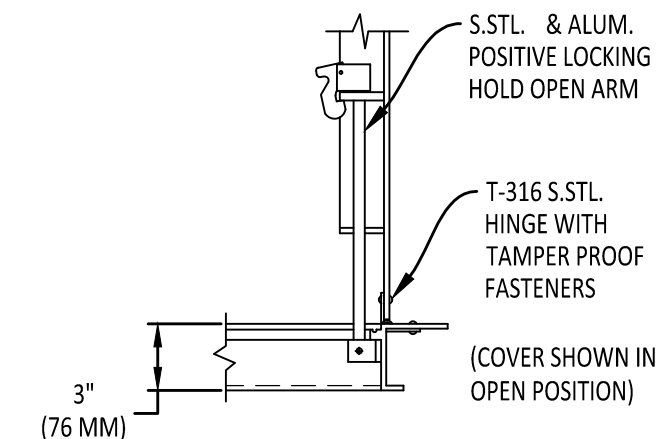


DETAIL

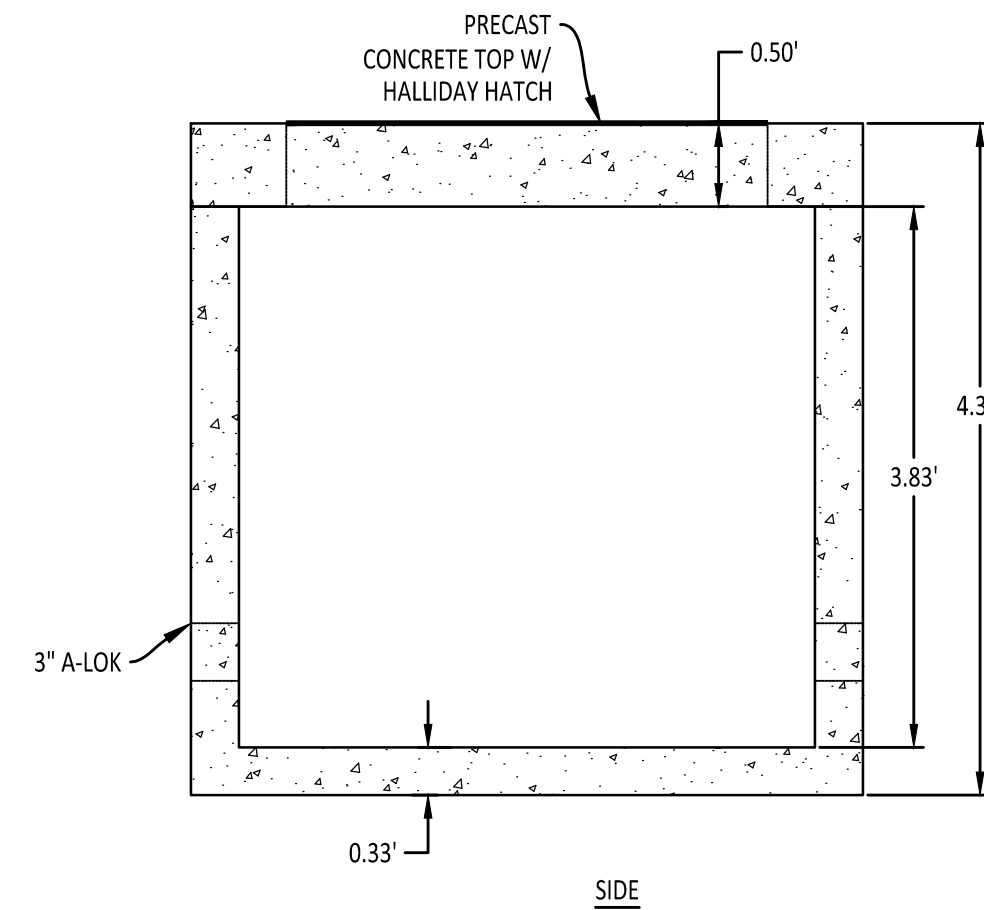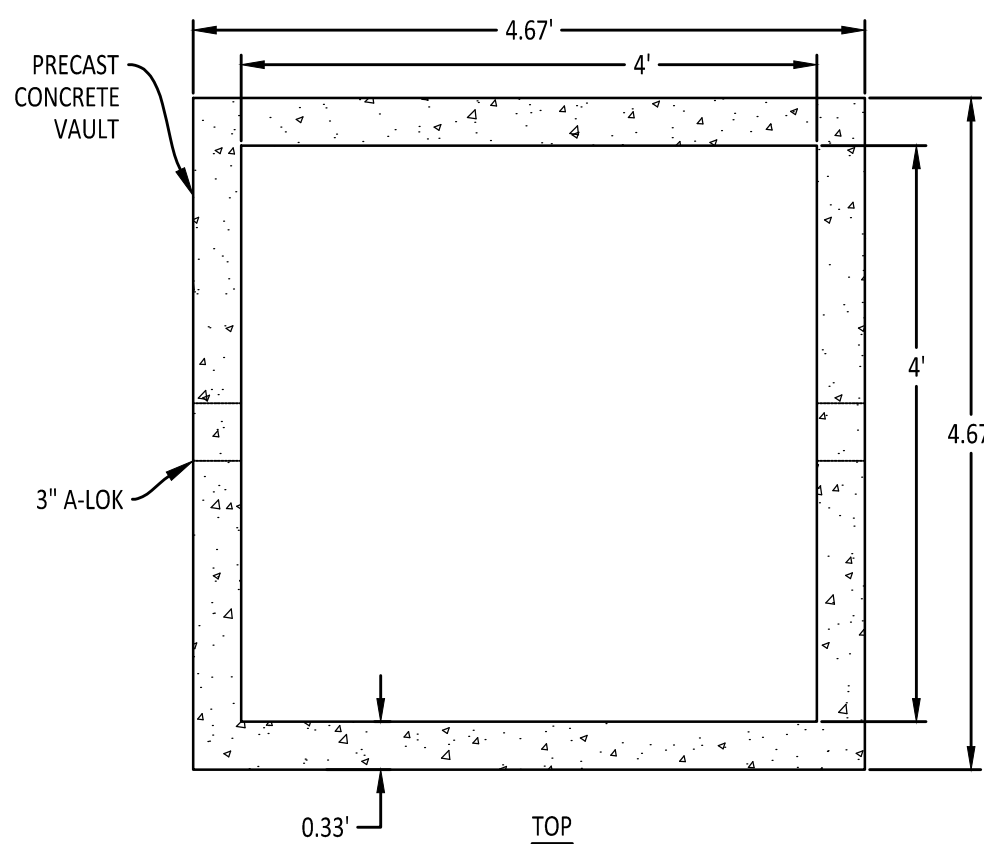


3" METER BOX AND COVER

N.T.S.

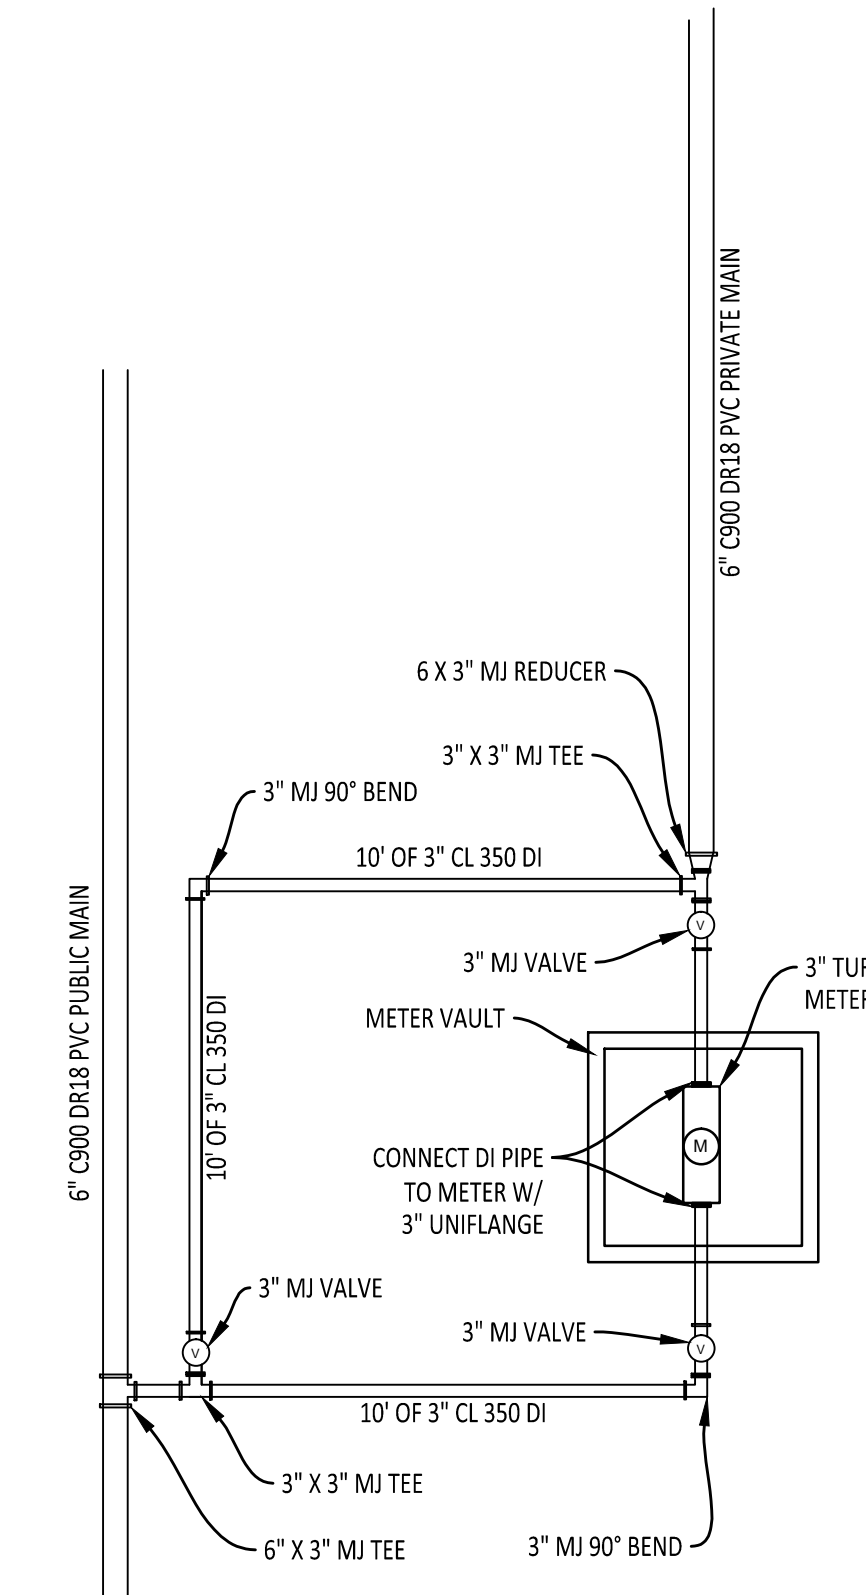


3" BADGER RECORDALL TURBO METER ASSEMBLY

N.T.S.

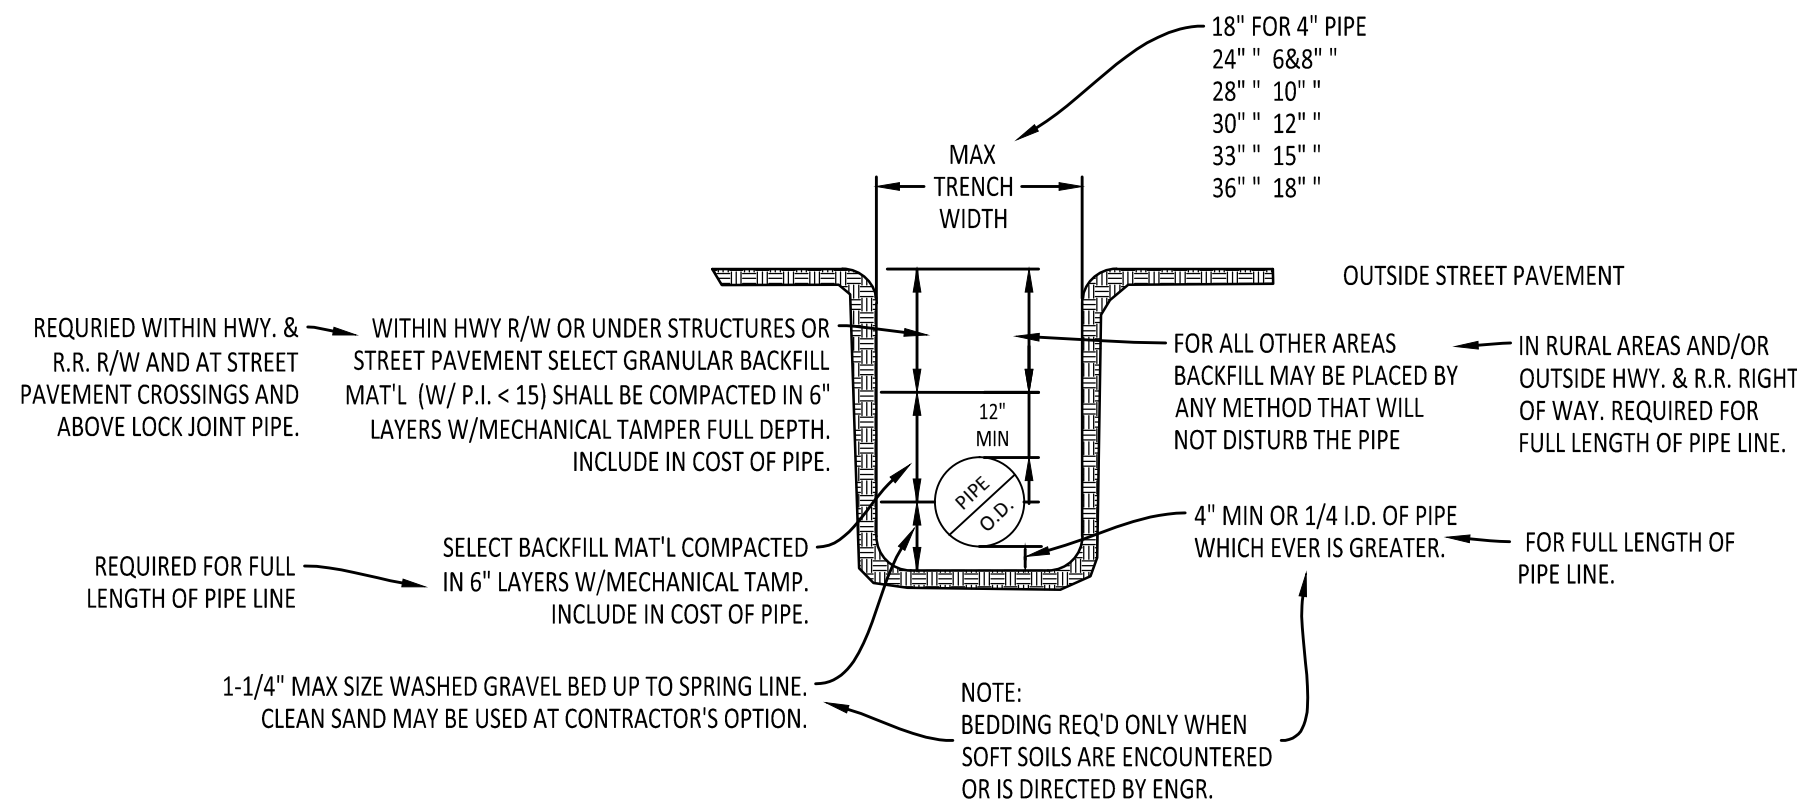


TYPICAL WATER PIPE BEDDING AND BACKFILL DETAIL

N.T.S.

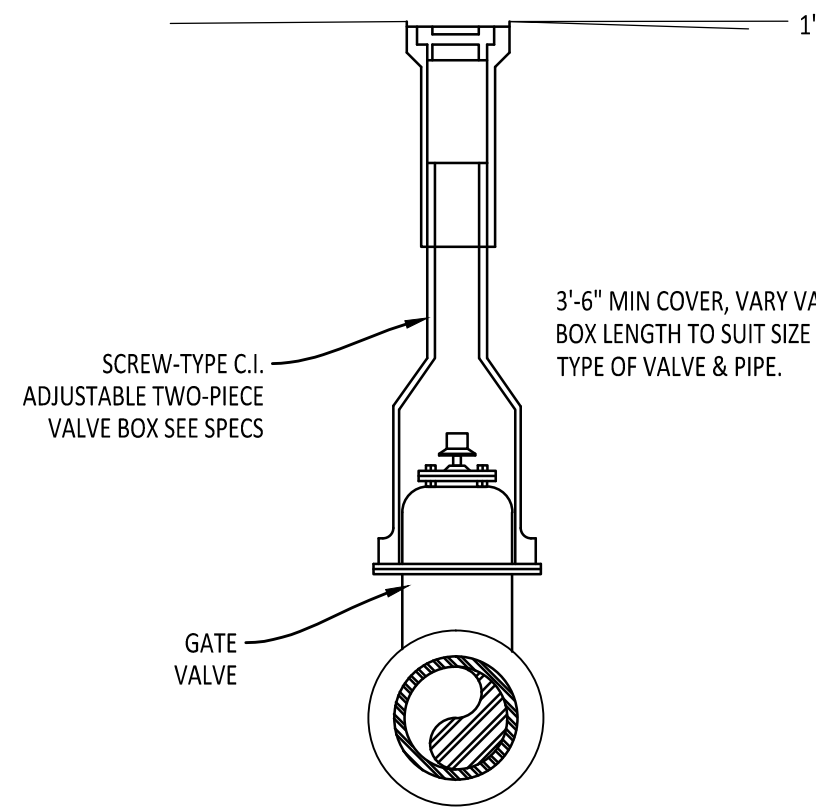


VALVE BOX DETAIL

N.T.S.

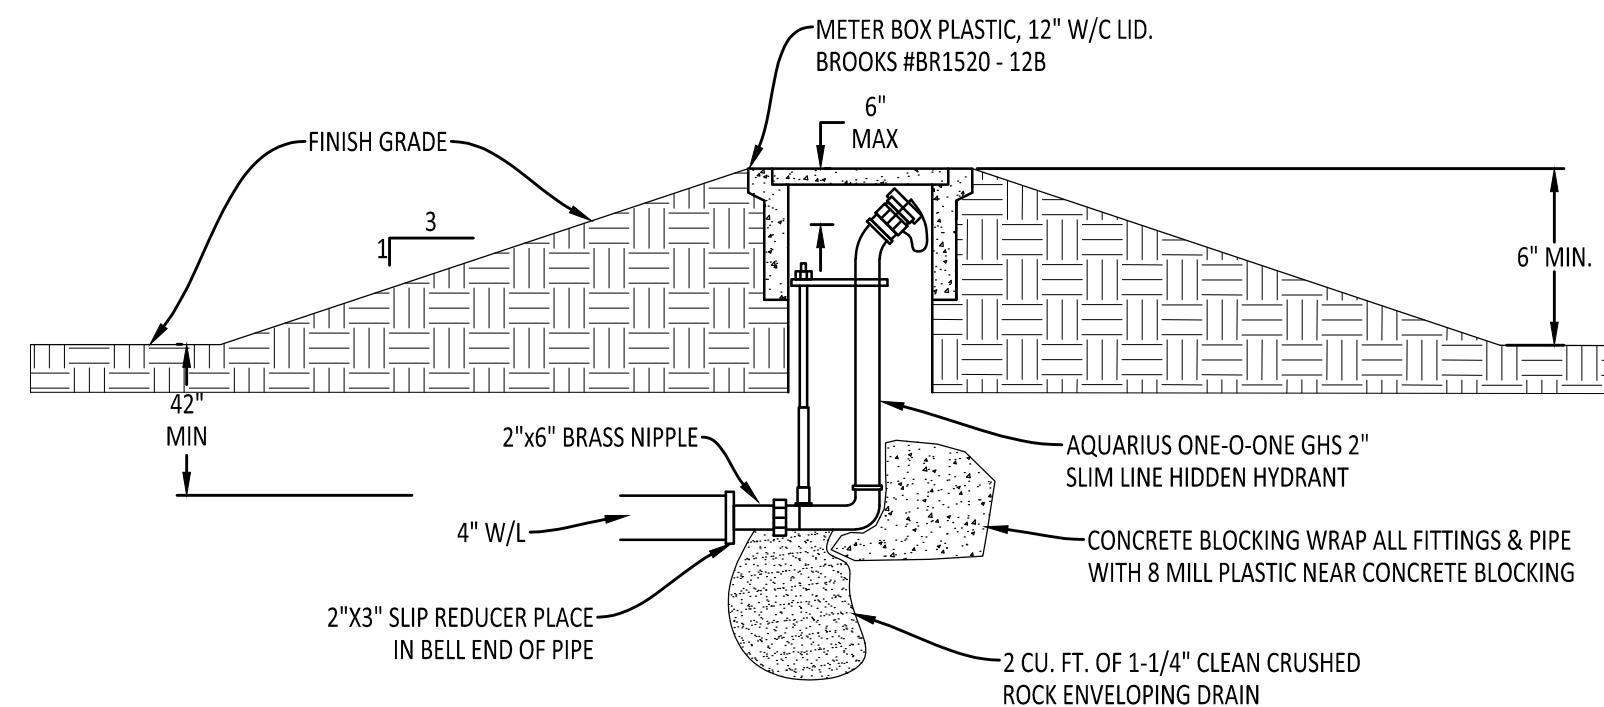

UNDERGROUND WASHOUT ASSEMBLY FOR COVES AND DEAD END LINES WITH NO FUTURE EXTENSION


N.T.S.

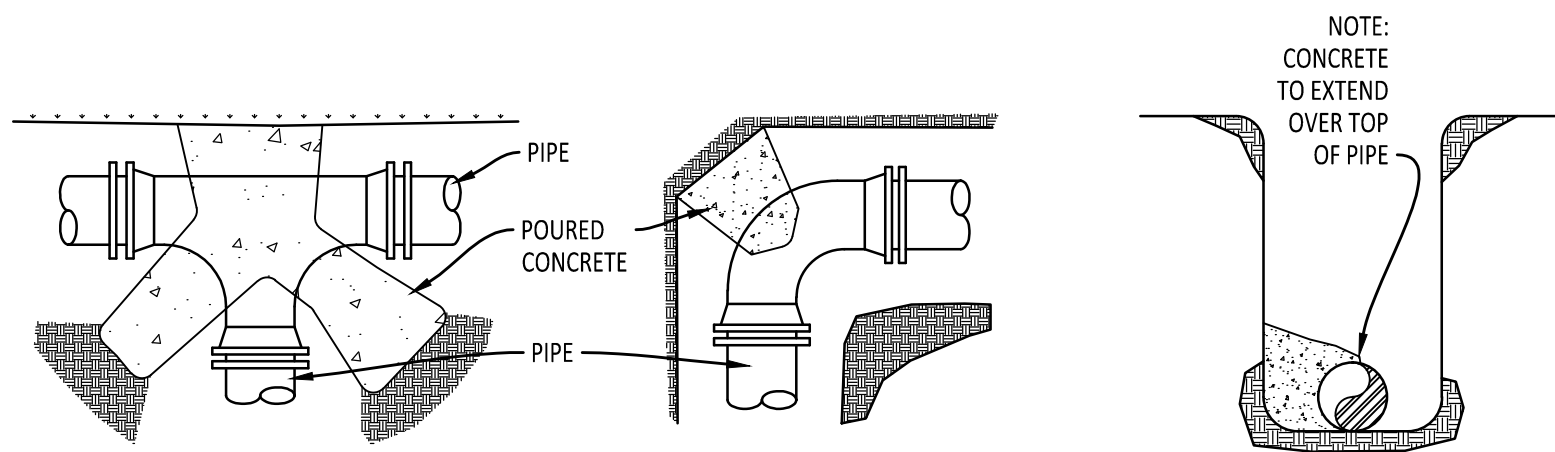

THRUST BLOCK DETAIL


N.T.S.

- NOTES:
1. ALL BLOCKING SHALL BE AGAINST UNDISTURBED HAND DUG SOIL.
 2. WHERE SOIL CONDITIONS MAKE IT NECESSARY TO POUR CONCRETE BLOCKING OVER JOINTS. THE ENDS OF THE ADJACENT PIPES MUST HAVE A BRACE BLOCK TO RESIST MOVEMENT OF THESE JOINTS.
 3. ALL FITTINGS & PIPE SHALL BE COVERED WITH 8 MILL PLASTIC WHEN BLOCKING TO PREVENT BONDING OF CONCRETE.
 4. WHERE SHEAR IS HIGH PROPER REINFORCING MUST BE INSTALLED INTO THE BLOCKING AS DIRECTED BY ENGINEER.
 5. COVER SHALL BE A MINIMUM OF 3" BELOW NATURAL GRADE.
 6. CLEARANCE FROM OIL & GAS COMPANIES LINES SHALL BE A MINIMUM OF 18".
 7. THRUST BLOCKING DIMENSIONS SHALL BE 150% OF THE THRUST CALCULATED FROM THE FORMULA (THRUST=2 AP SINØ; WHERE A=PIPE END AREA, P=PRESSURE PRODUCED BY PUMPING LIQUID, & Ø=ANGLE OF BEND TO BE BLOCKED) AND SOIL BEARING CAPACITY OF 1500 PSF.
 8. ALL CONCRETE SHALL BE 3000 PSI AT 28 DAY STRENGTH.

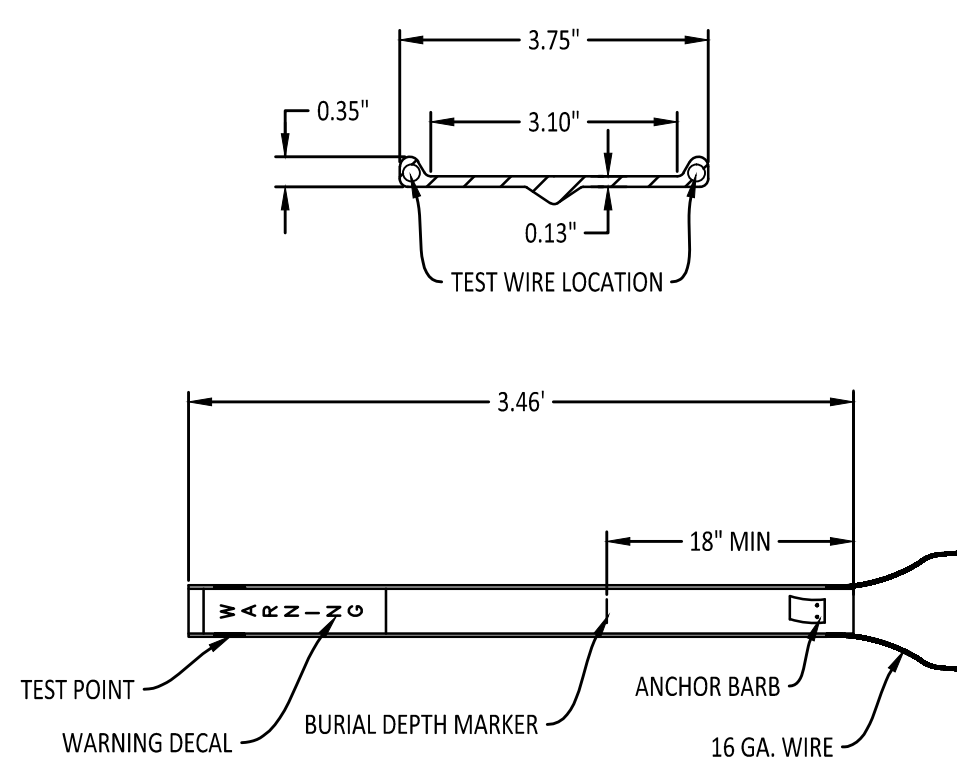

WATER LINE & FORCE MAIN MARKER DETAIL

N.T.S.

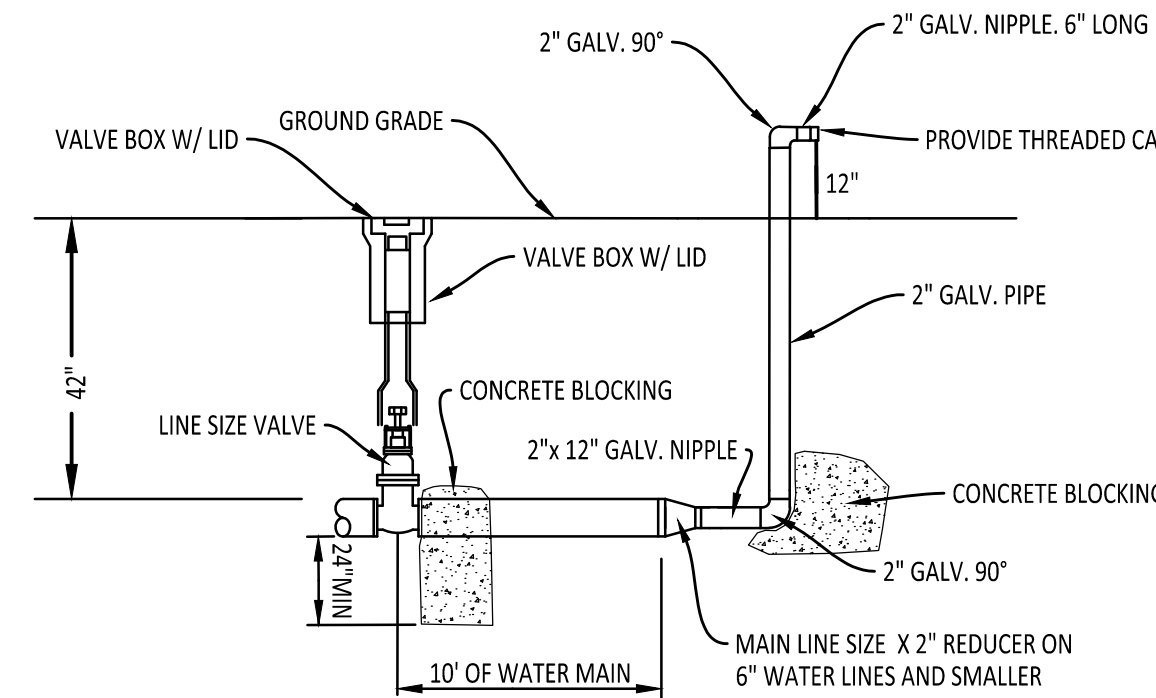

2" B.O. ASSEMBLY FOR 6" OR SMALLER LINES WITH FUTURE EXPANSION

NOTE: ALL 2" GALVANIZED PIPE AND FITTINGS ARE TO BE SCH 40

BLOW-OFF ASSEMBLY DETAIL



N.T.S.

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN ENGINEERING

PROJECT: MCKNIGHT FALLS APARTMENTS - PHII

CLIENT: MCKNIGHT FALLS, LLC

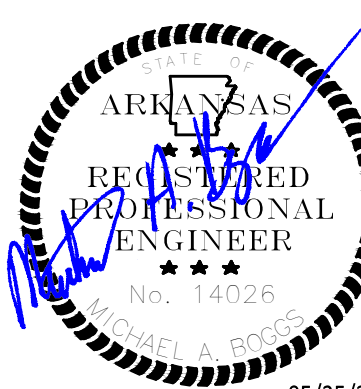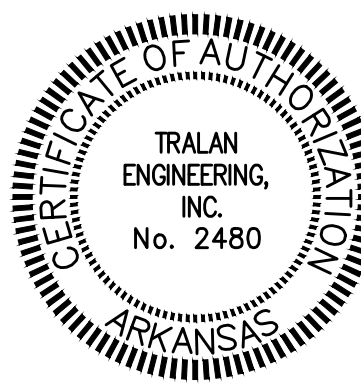

| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |
| | | |


| DRAWING INFO. | |
|---------------|-----------|
| DRAWN BY: | MAB |
| DATE: | 5/25/2017 |
| SCALE: | 16-080 |
| JOB NO.: | 16-080 |
| CAD NO.: | |

CWL WATER DETAILS

SHEET NUMBER:
10 of 11


NOTES TYPICAL TO ALL MANHOLES:

- MANHOLE BASES TO BE 4000 PSI, 28 DAY STRENGTH, LIMESTONE MIX CONCRETE. ON UNDISTURBED SUB-GRADE OR ON COMPACTED SELECT FILL MATERIAL AS AUTHORIZED.
- MANHOLE SIDEWALL MATERIAL TO BE CONCRETE IN ACCORDANCE WITH PROPOSAL FORM REQUIREMENTS.
 - 4" I.D. FOR SEWER SIZES 6" THRU 24"
 - 5" I.D. FOR SEWER SIZES 24" THRU 30"
 - 6" I.D. FOR SEWER SIZES 36" THRU 42"
- SET MANHOLE TOPS AS FOLLOWS:
 - IN STREETS, ROADS, HIGHWAYS, AND OTHER PAVED AREAS: FLUSH WITH FINISHED PAVING GRADE.
 - UNDEVELOPED AREAS, SUCH AS FIELDS, WOODS, ETC.: 12" ABOVE GROUND.
 - OTHER AREAS: 1" ABOVE GROUND.
- MANHOLE FRAMES SHALL HAVE MIN. OPENING OF 22" DIA.

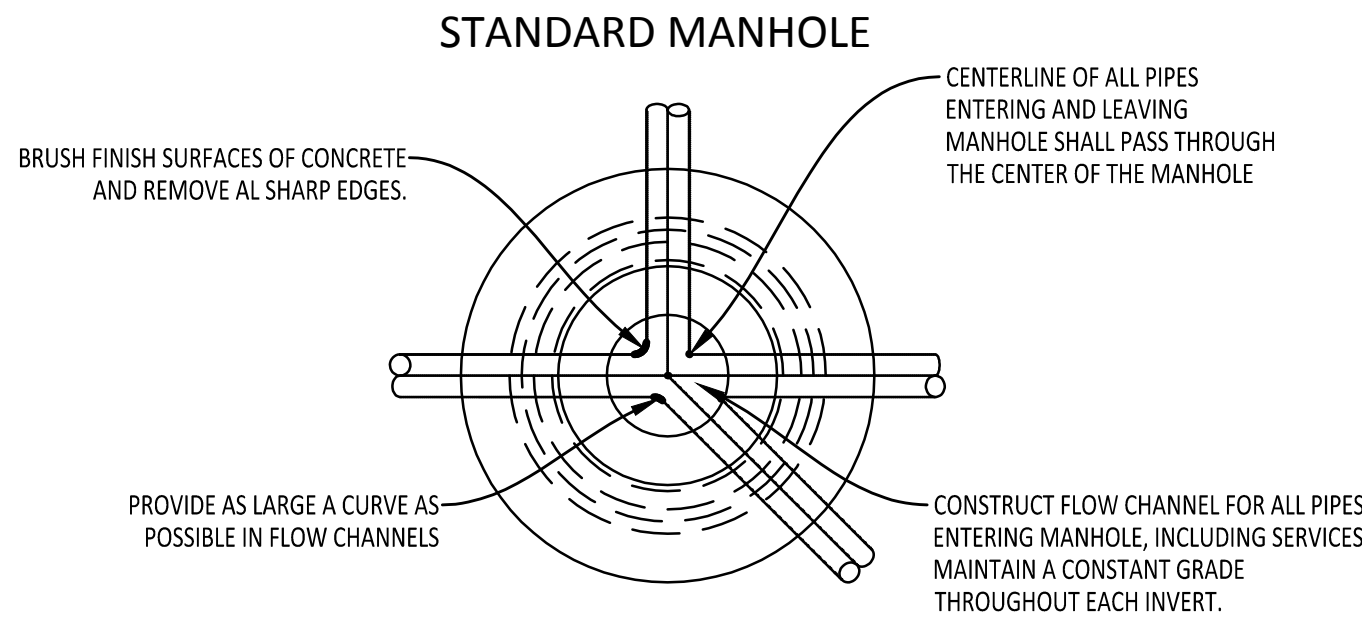


PLAN
N.T.S.

MANHOLE DETAILS

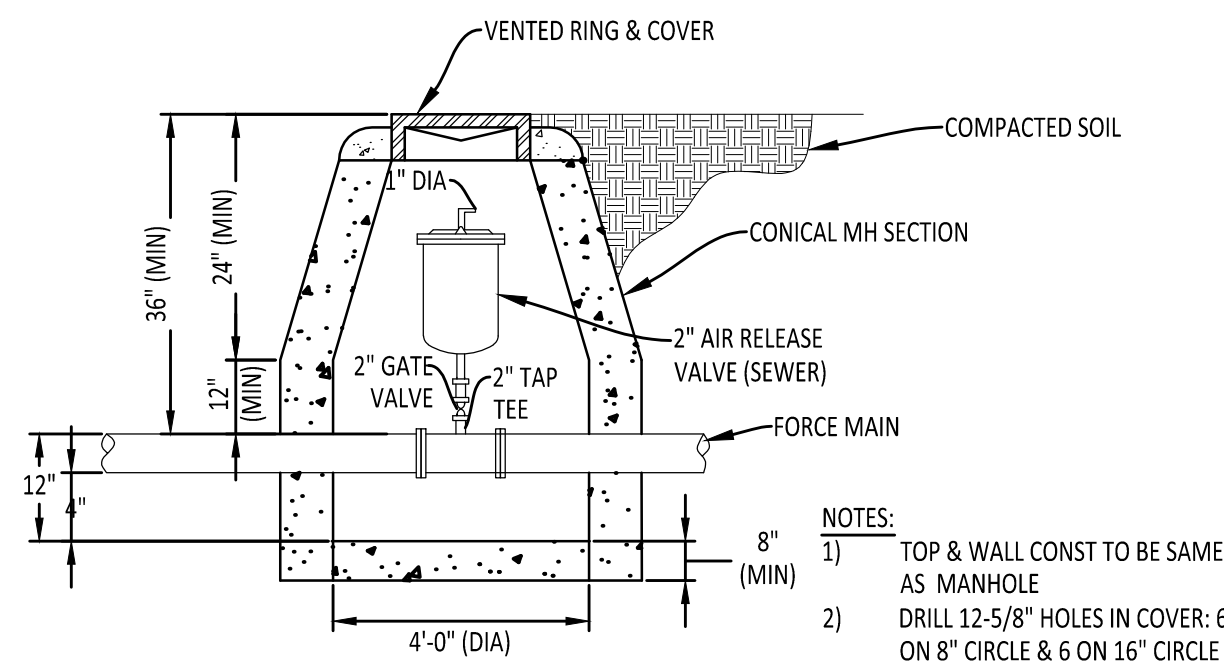

AIR/VACUUM RELEASE
VALVE DETAIL

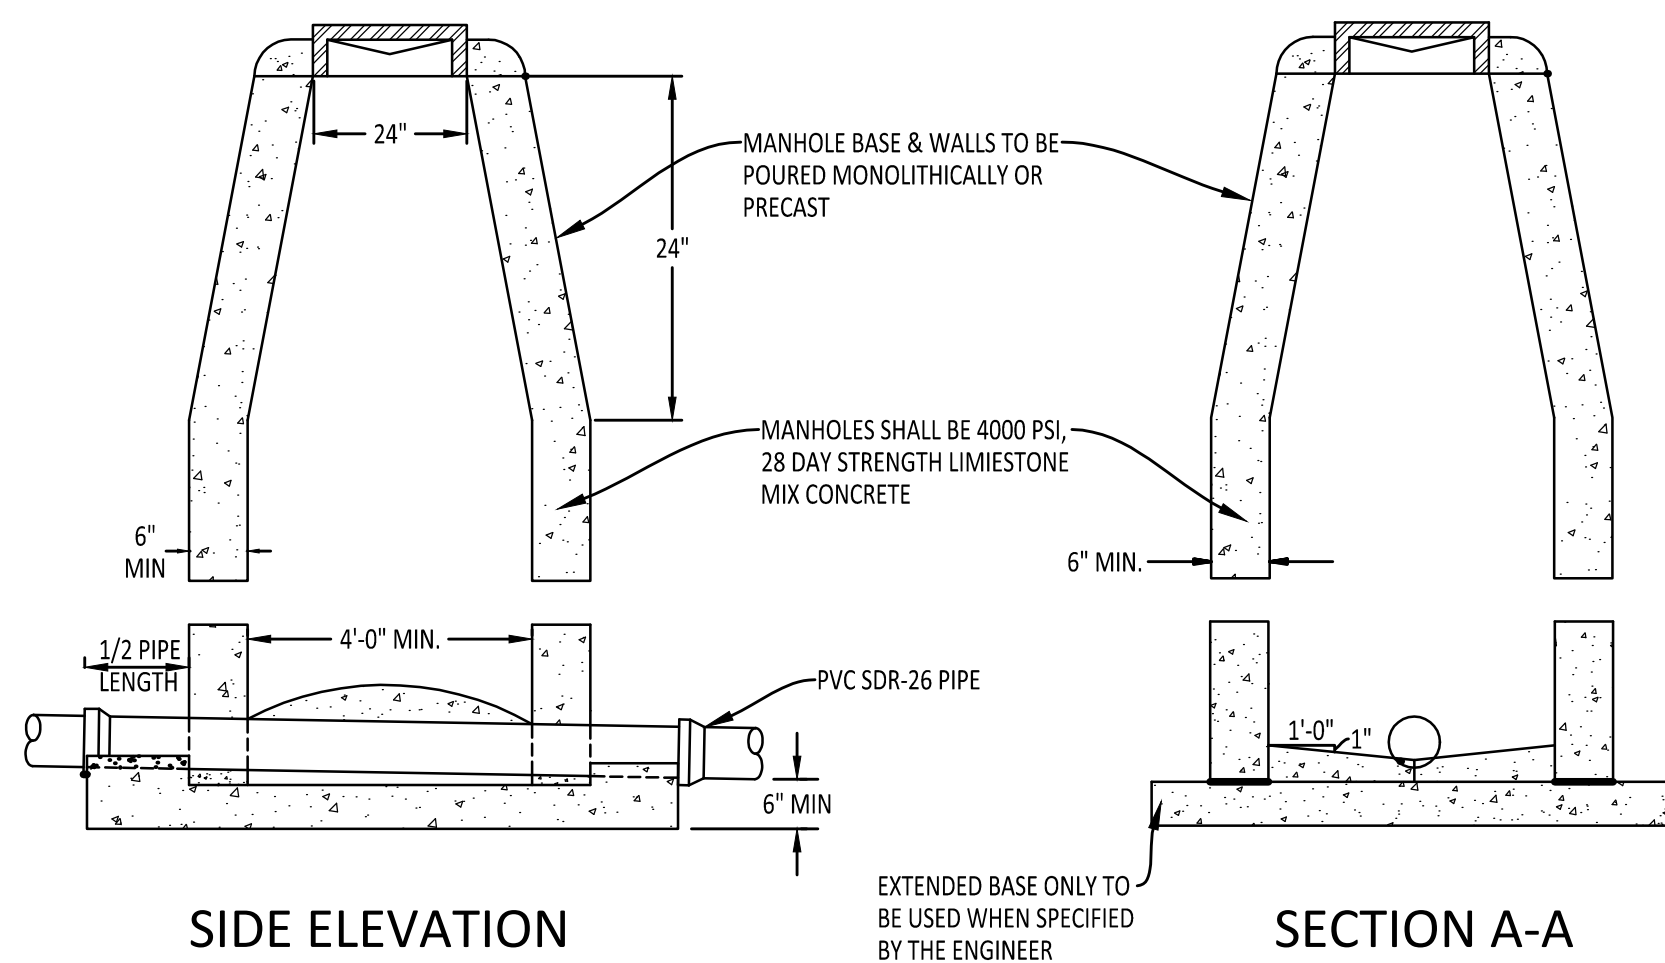


STANDARD MANHOLE

NOTE: MANHOLES SHALL BE PRECAST W/ NEOPRENE GASKETS AS APPROVED BY ENGINEER AND/OR UTILITY COMPANY

NOTES:


- COARSE AGGREGATE SHALL BE MECHANICALLY TAMPED WHEN USED.
- PIPE IN TRENCH SHALL BE PLACED ON NO LESS THAN 4" OF CLASS 8 (3/4" MINUS) LIMESTONE. ALL OVER EXCAVATION SHALL BE COMPACTED BACK TO GRADE W/ BEDDING MATERIAL.
- PVC PIPE SHALL BE SDR-26 AND INSTALLED IN ACCORDANCE WITH UNI-BELL PVC PIPE ASSOCIATION'S RECOMMENDATIONS FOR CONSTRUCTION.

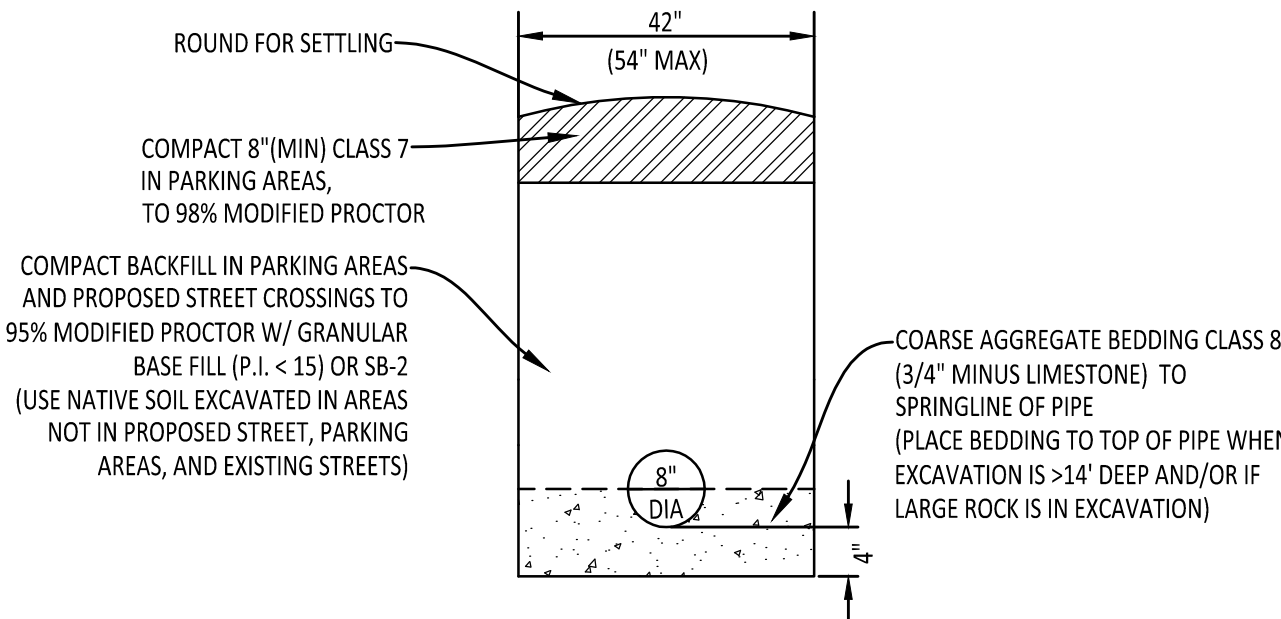

NON-EXISTING STREET LOCATIONS


NOTE:

- CONTRACTOR SHALL OBTAIN A STREET CROSSING PERMIT FROM THE CITY OF JONESBORO PRIOR TO CUTTING STREET.
- EXCAVATED MATERIAL SHALL BE REMOVED AND DISPOSED OF BY THE CONTRACTOR
- THIS REPAIR DETAIL IS REQUIRED FOR ALL EXCAVATION WITHIN 5' OF PAVED EDGE AND ALL TRANSVERSE EXCAVATIONS TO EXTEND 3' BEYOND PAVED EDGE.

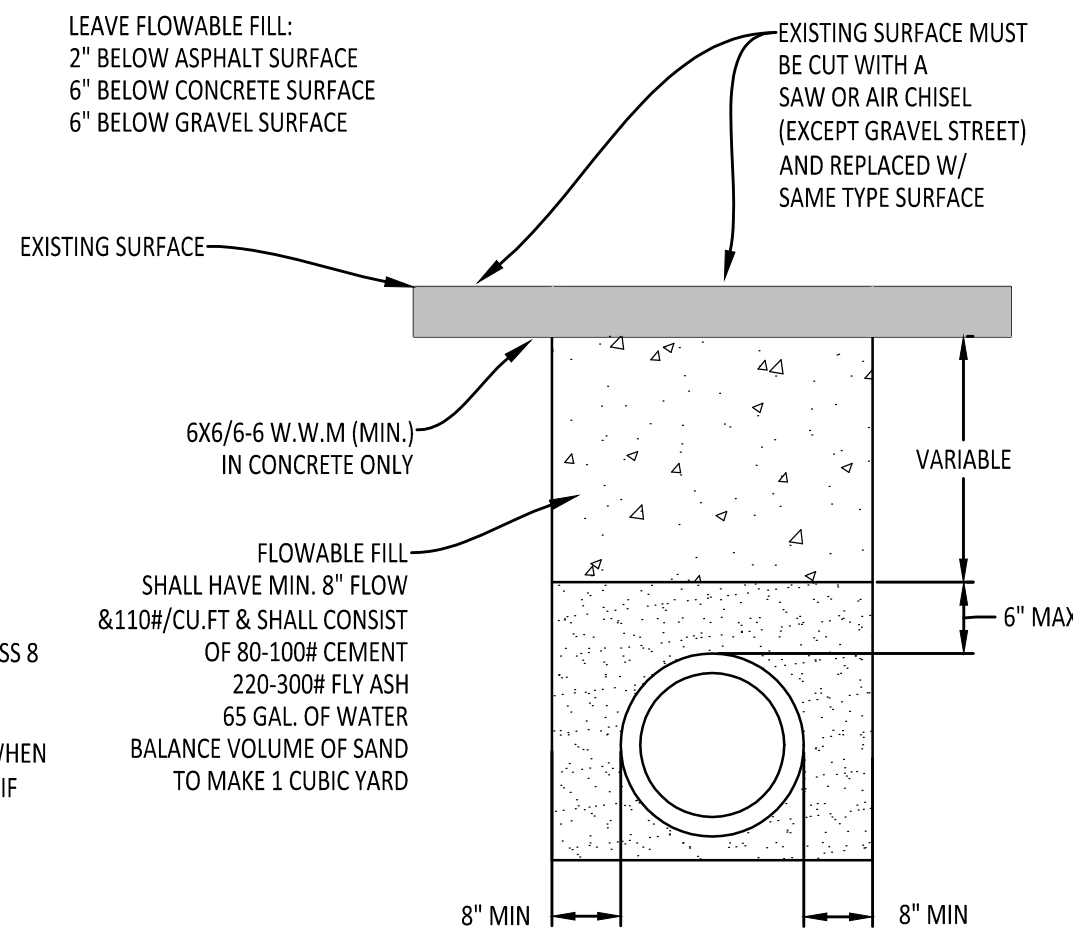


EXISTING STREET LOCATIONS

PVC TRENCH DETAIL

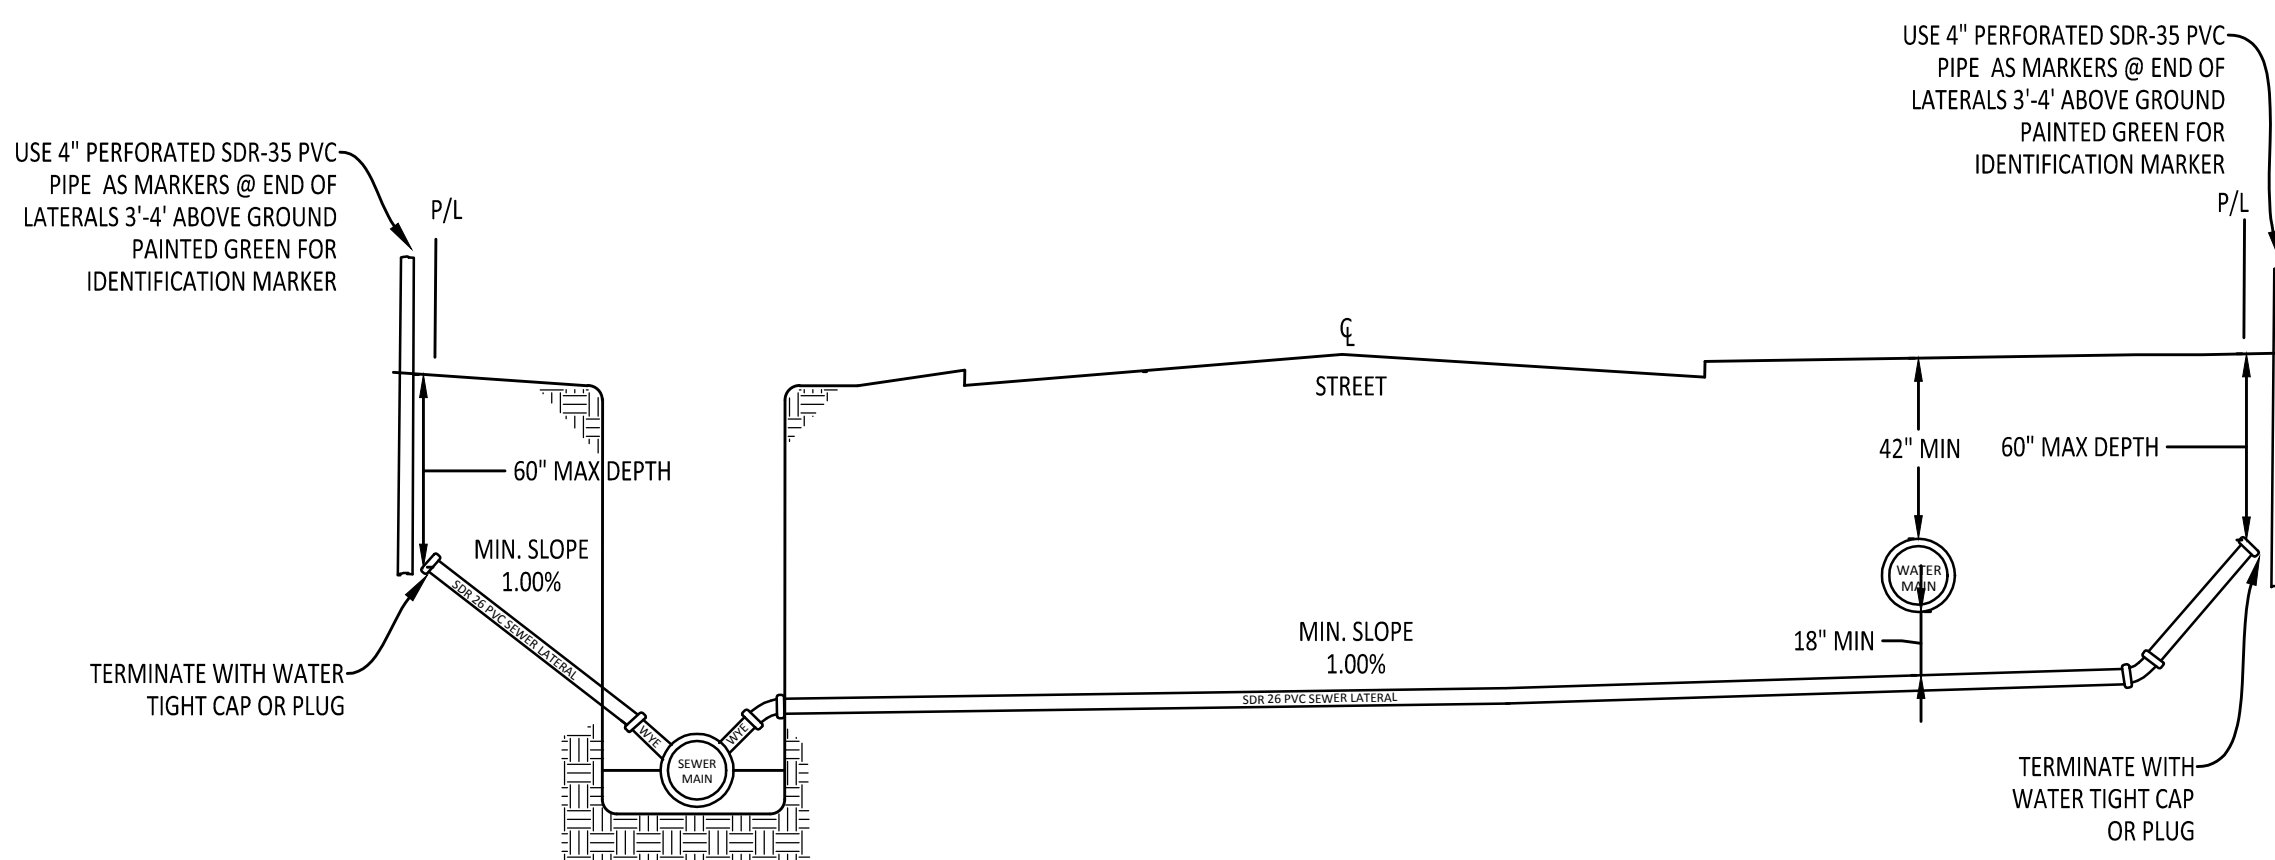


SEWER LATERAL STUBOUT
PERMITS REQUIRED BEFORE INSTALLATION


USE SAME CONFIGURATION FOR MANHOLE STUBOUTS

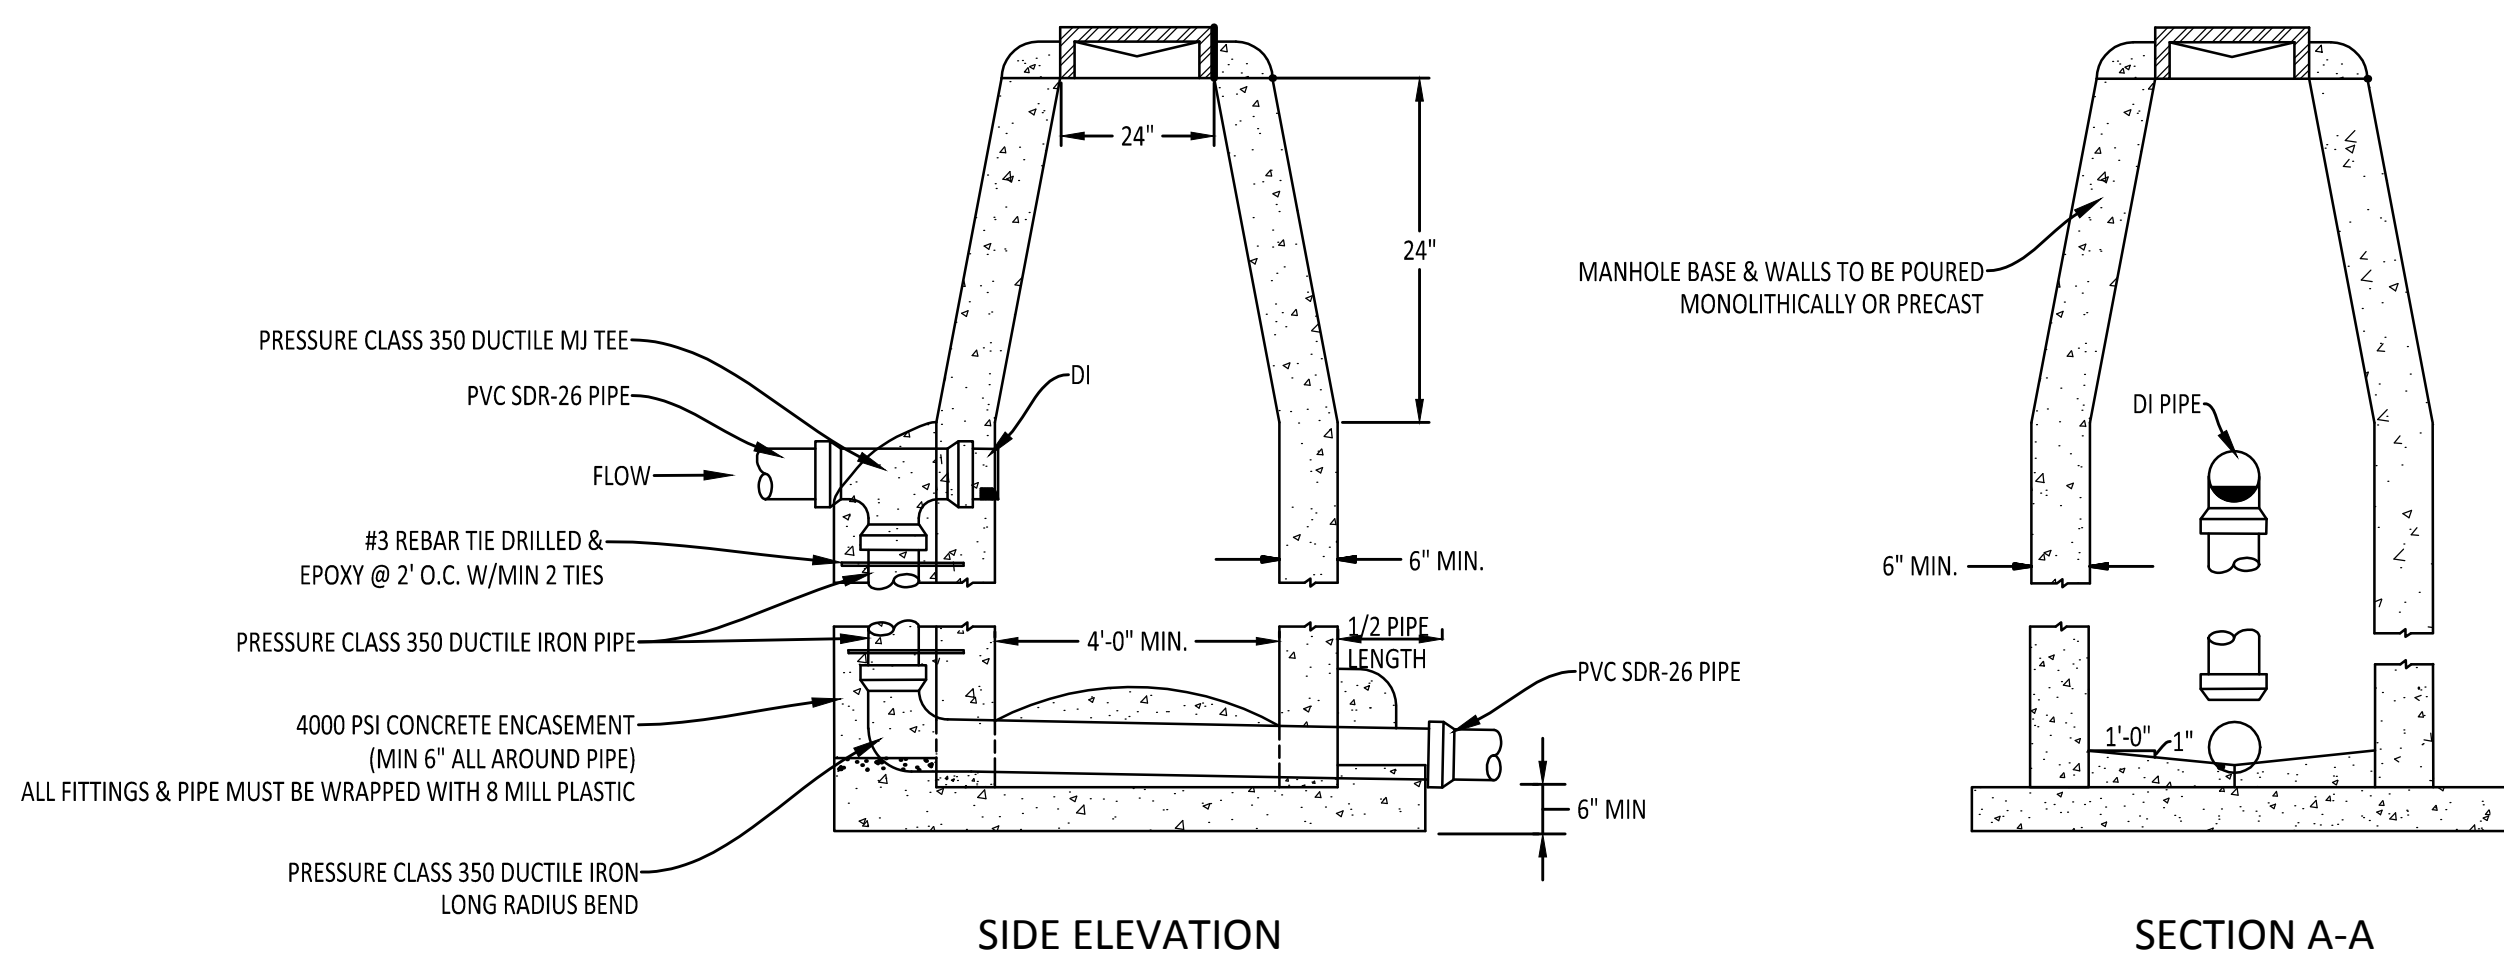

DROP MANHOLE

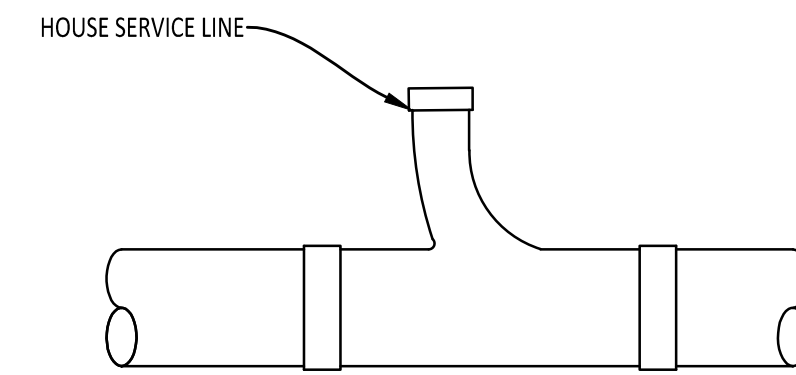

SINGLE WYE

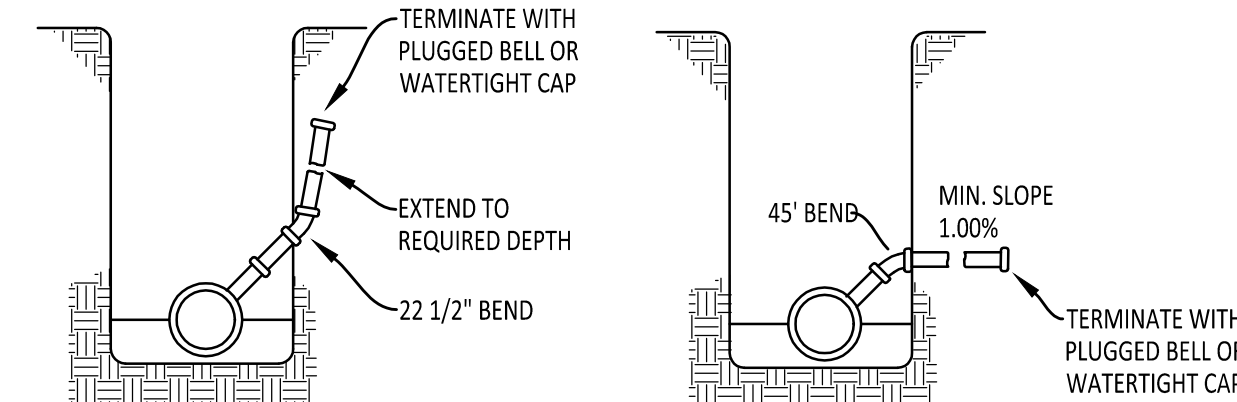

SERVICE CONNECTIONS

CONCRETE ENCASEMENT
FOR
DITCH CROSSINGS



NOTE: ENCASEMENT PIPE MUST PRESSURE CLASS 350 DUCTILE IRON AND WRAP DUCTILE IRON PIPE WITH 8 MILL PLASTIC. NOTE: WHEN 18" SEPARATION CANNOT BE MAINTAINED, JOINTS SHALL BE LOCATED SUCH THAT THEY ARE EQUAL DISTANCE BEFORE AND AFTER CROSSING.

COMPANY INFO:
2916 WOOD STREET
JONESBORO, AR 72404
PH: 1-870-203-9939
WWW.TRALANENG.COM

TRALAN
ENGINEERING

PROJECT:
MCKNIGHT FALLS APARTMENTS - PHII

CLIENT:
MCKNIGHT FALLS, LLC

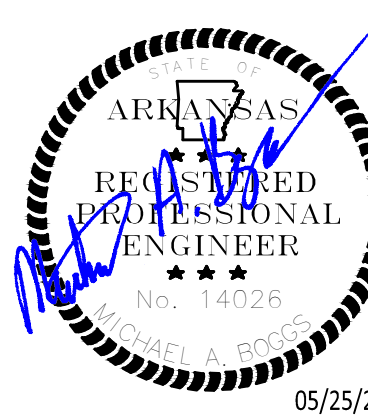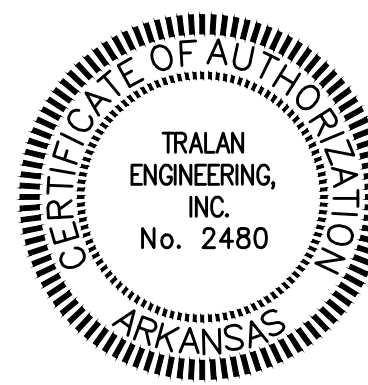

| REVISIONS | | |
|-----------|----|-------------|
| DATE | BY | DESCRIPTION |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

| DRAWING INFO. | |
|---------------|------------|
| DRAWN BY: | MAB |
| DATE: | 05/25/2017 |
| SCALE: | 16-080 |
| JOB NO.: | 16-080 |
| CAD NO.: | |

CWL SEWER
DETAILS

SHEET NUMBER:
11 of 11