


Z:\Morris Real Estate Holdings, LLC\Projects\Sarah's Crossing\Engineering\Plans\Phase 4\Sarah Crossing P4 11-2025.dwg, 7/1/2025 3:54:04 PM

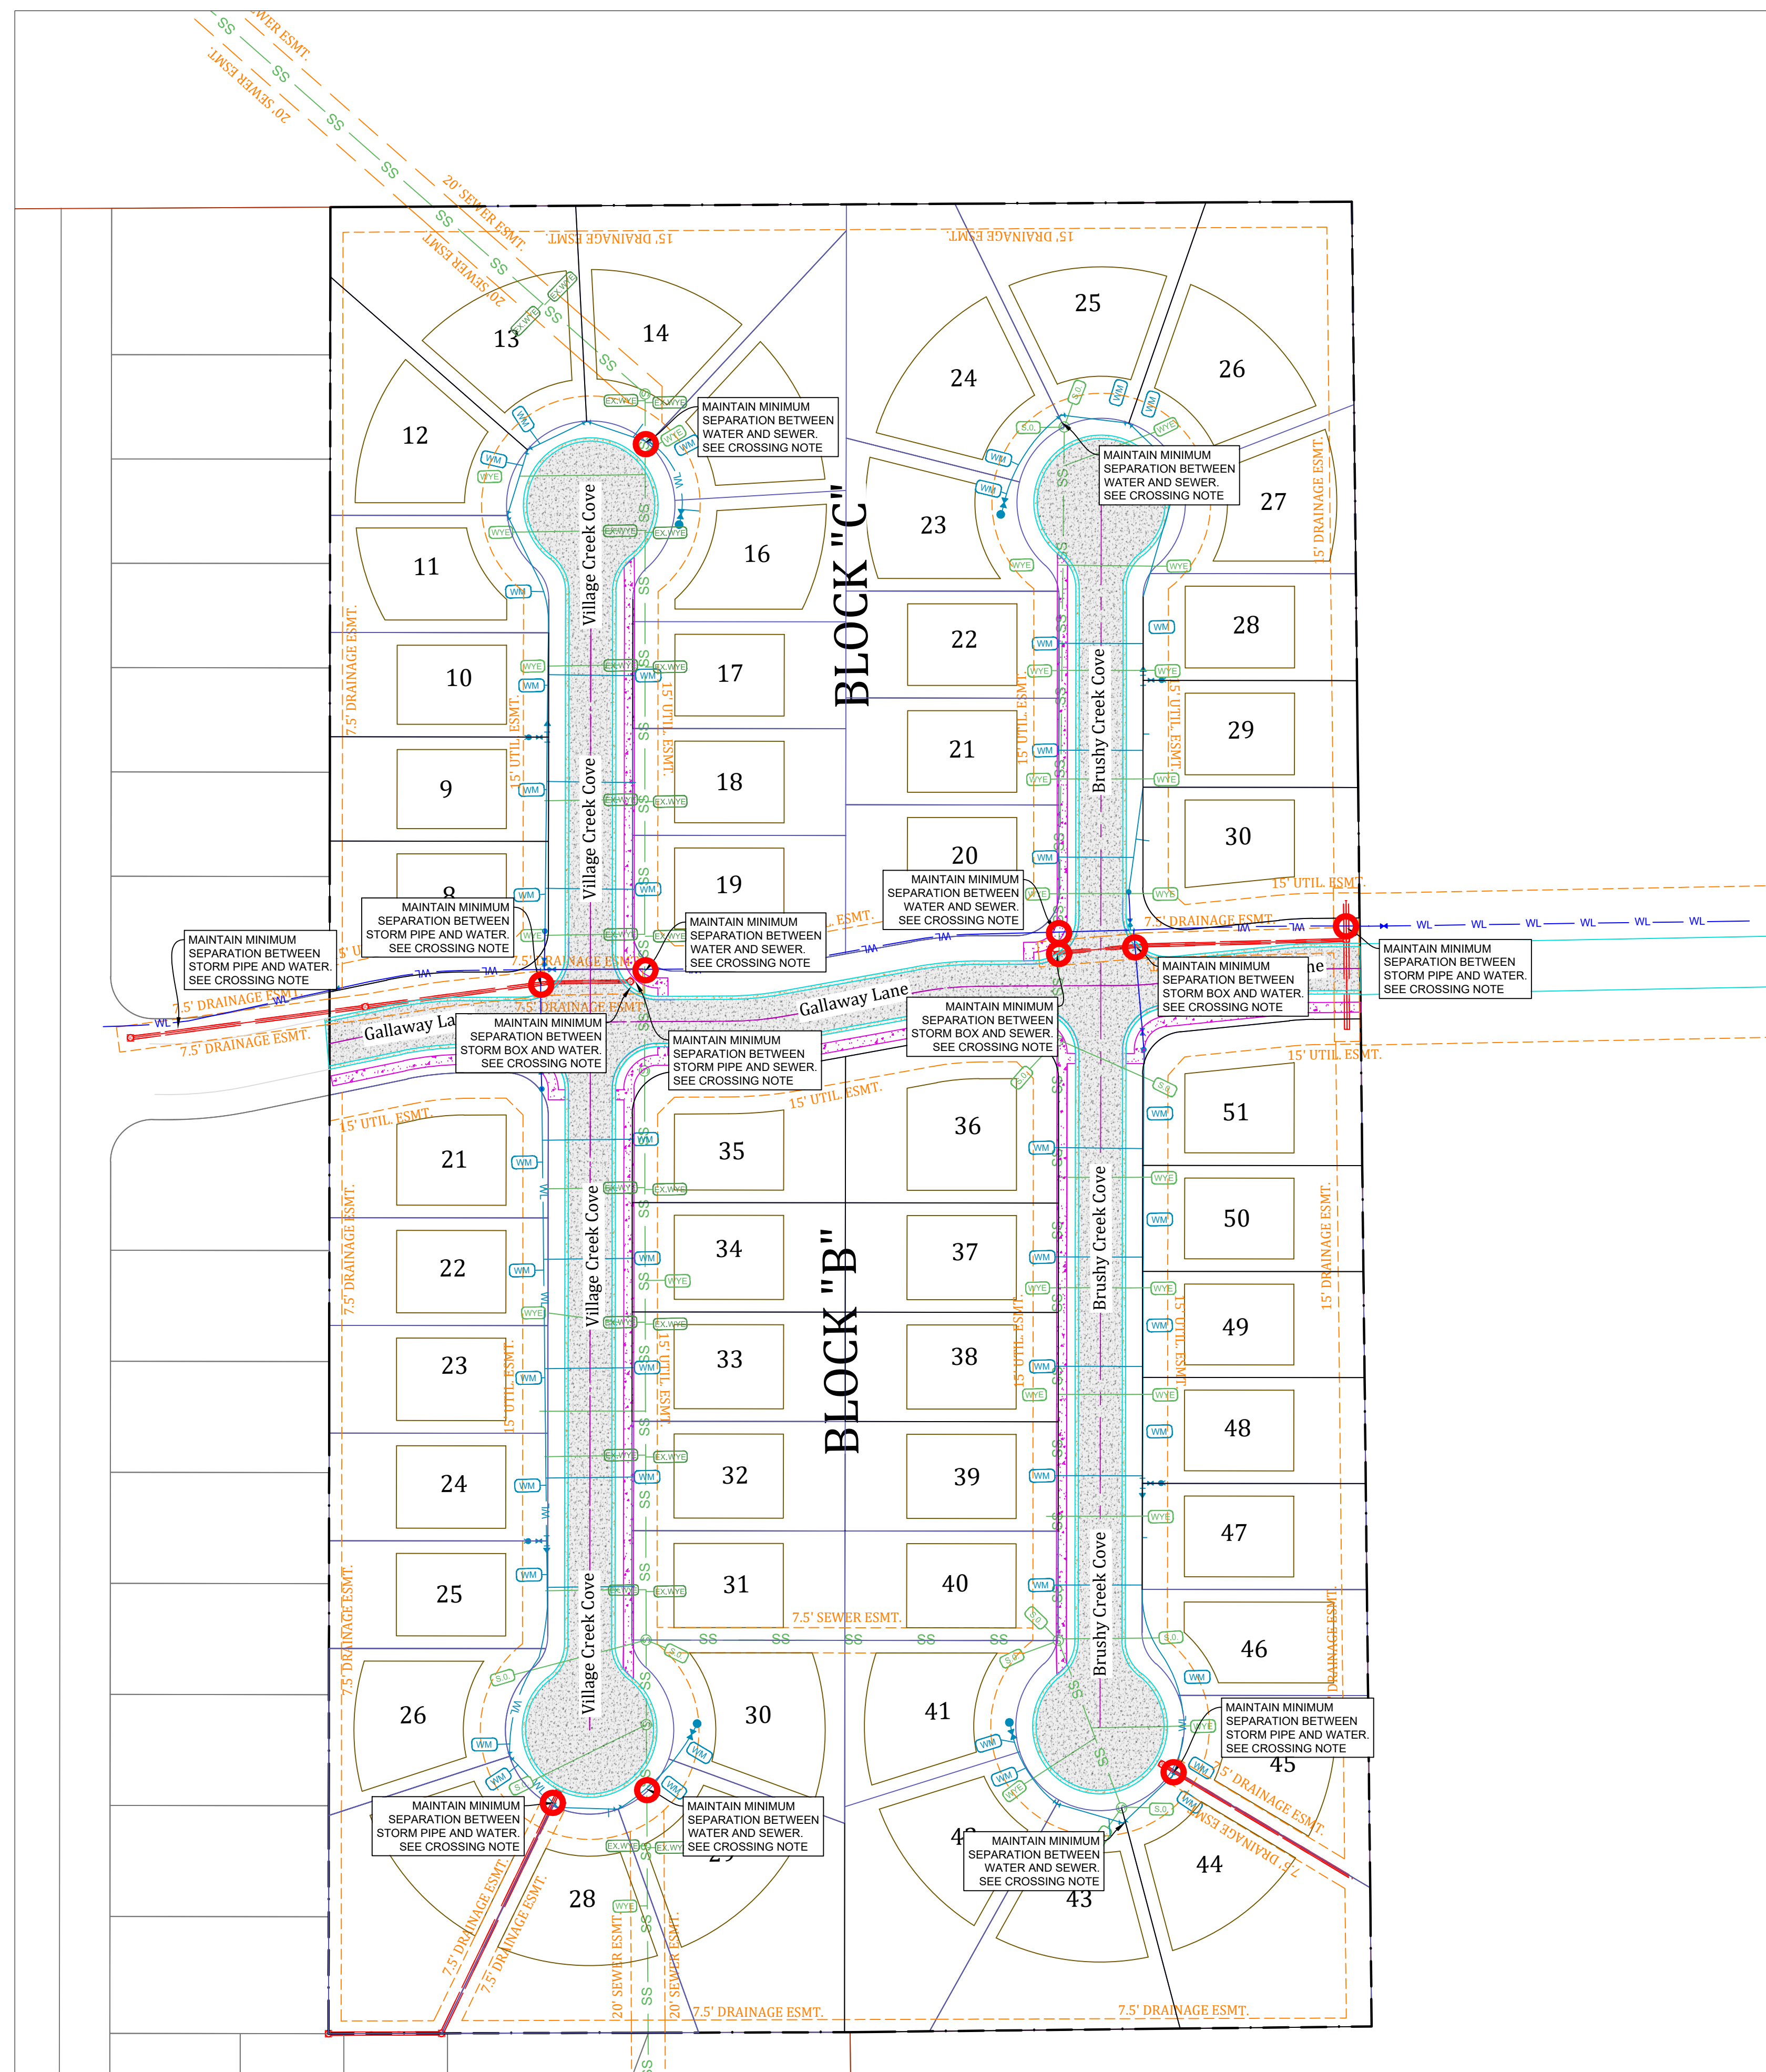


CROSSING NOTES

> WATER LINE AND SANITARY SEWER LINE SHALL MAINTAIN 18" MINIMUM VERTICAL SEPARATION.

> WATER/SEWER LINE AND STORM DRAIN NETWORK SHALL MAINTAIN 36" MINIMUM HORIZONTAL SEPARATION AND 18" VERTICAL SEPARATION TO PREVENT FREEZING.

> MAINTAIN MINIMUM 10' HORIZONTAL SEPARATION BETWEEN WATER AND SANITARY SEWER LINES.

> SEE SEWER PLAN AND PROFILE SHEETS FOR CROSSING DEPICTIONS.



SARAH CROSSING - PHASE IV

UTILITY CROSSING PLAN



REVISIONS		
DATE	BY	DESCRIPTION

DRAWING INFO.	
DRAWN BY:	IMH
DATE:	06/04/2025
SCALE:	1"=60'

SHEET NUMBER:
UT-1

MARK MORRIS P.E.
6011 SOUTHWEST DRIVE
JONESBORO, AR 72404
PH: 1-870-919-7700
MARK@MARKMORRISHOMES.COM

MARK MORRIS