

FOR THE CITY WATER AND LIGHT JONESBORO, ARKANSAS

PROJECT NO 018-0054

JANUARY, 2020

CODE ANALYSIS INFORMATION

2012 ARKANSAS FIRE PROTECTION CODE VOL I, VOL II, VOL III

(CHAPT. 3)	1.	OCCUPANCY CLASSIFICATION	UTILITY/ U
	2.	TYPE OF CONSTRUCTION	
		-PROPOSED	TYPE II B
		-SPRINKLER/NON-SPRINKLER	NON-SPRINKLER
	3.	ALLOWABLE HEIGHT & BUILDING AREA	3 STORY/ 23,000
(CHAPT. 3)	4.	FLOOR AREAS & OCCUPANT LOAD, AS FOLLOWS:	
(TABLE 1044.1.2	4a.	AREA, GROSS FLOOR/ OCCUPANT LOAD -GROSS FLOOR AREA TOTAL	544/--
(TABLE 1044.1.2	4b.	AREA, NET FLOOR/ OCCUPANT LOAD -NET FLOOR TOTAL	544/--
	5.	SEPARATION DISTANCES - EXTERIOR WALLS COMMON PROPERTY LINES	
		-NORTH	---
		-SOUTH	---
		-EAST	---
		-WEST	---
	6.	EXIT ACCESS CORRIDOR ENCLOSURE PROTECTION STRATEGY.	N/A
(TABLE 508.4)	7.	RATED CONSTRUCTION ASSEMBLIES *NO SEPARATION REQUIREMENTS	*N HOUR
	8.	FIRESTOP ASSEMBLIES	---
	9.	STATEMENT OF SPECIAL INSPECTIONS	---

2012 INTERNATIONAL EXISTING BUILDING CODE (EIBC)

2012 EXISTING BUILDING CODE

ELECTRIC CODE - 2017 NEC: NATIONAL ELECTRIC CODES

GAS CODE - ARKANSAS STATE FUEL AND GAS CODE, 2006 EDITION

MECHANICAL CODE - 2010 ARKANSAS MECHANICAL CODES

PLUMBING CODE - 2006 ARKANSAS PLUMBING CODES

2014 ARKANSAS ENERGY CODE (2009 IECC w/ SUPPLEMENTS & AMENDMENTS)

2003 ICC/ANSI A117.1: AMERICAN NATIONAL STANDARDS (ADA REQUIREMENTS)



CHRIS DOUGHERTY
ARKANSAS REGISTERED PROFESSIONAL ENGINEER NO.14497



BRAD B. HAMMOND
ARKANSAS REGISTERED PROFESSIONAL ENGINEER NO.9240



olson

302 E. Millsap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

[illegible]

COVER SHEET

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT


JONESBORO, ARKANSAS

2020


Drawn by: K. ROWETT
 Checked by: C. DOUGHERTY
 Approved by: C. DOUGHERTY
 A/QC by: M. MILIUS
 Project no.: 018-0054
 Drawing no.:
 Date: 01/02/2020

SHEET
G101


C:\Users\krowett\Documents\A_Centrol_0180054_krowett.rvt
12/24/2019 8:06:22 AM

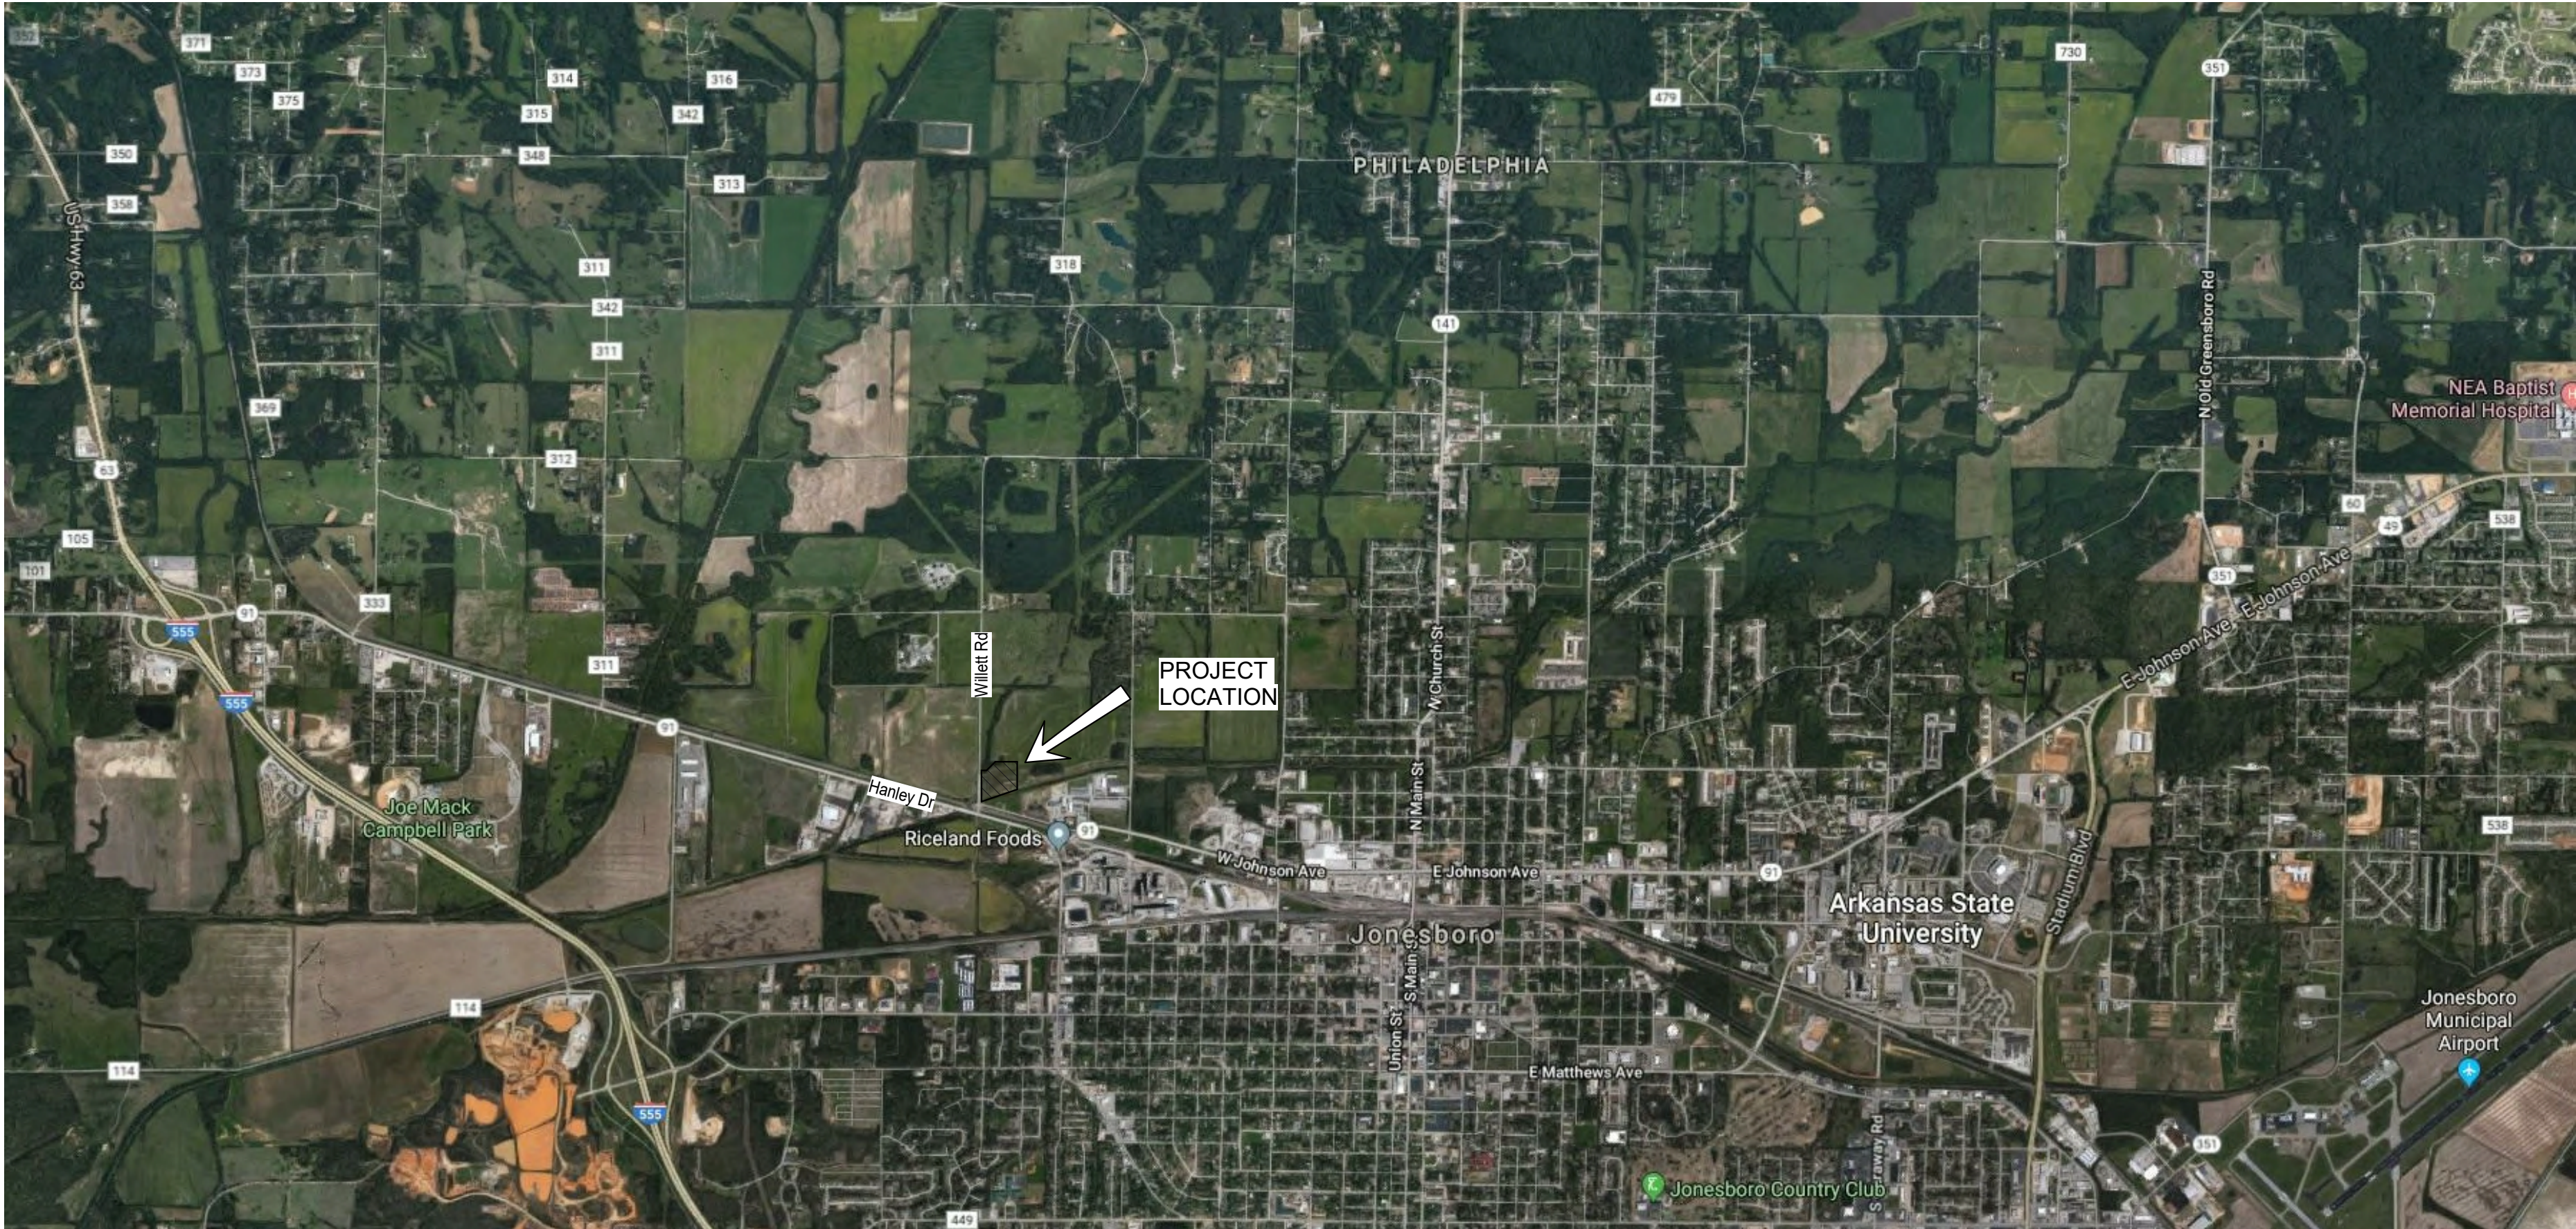

 NORTH
VICINITY MAP

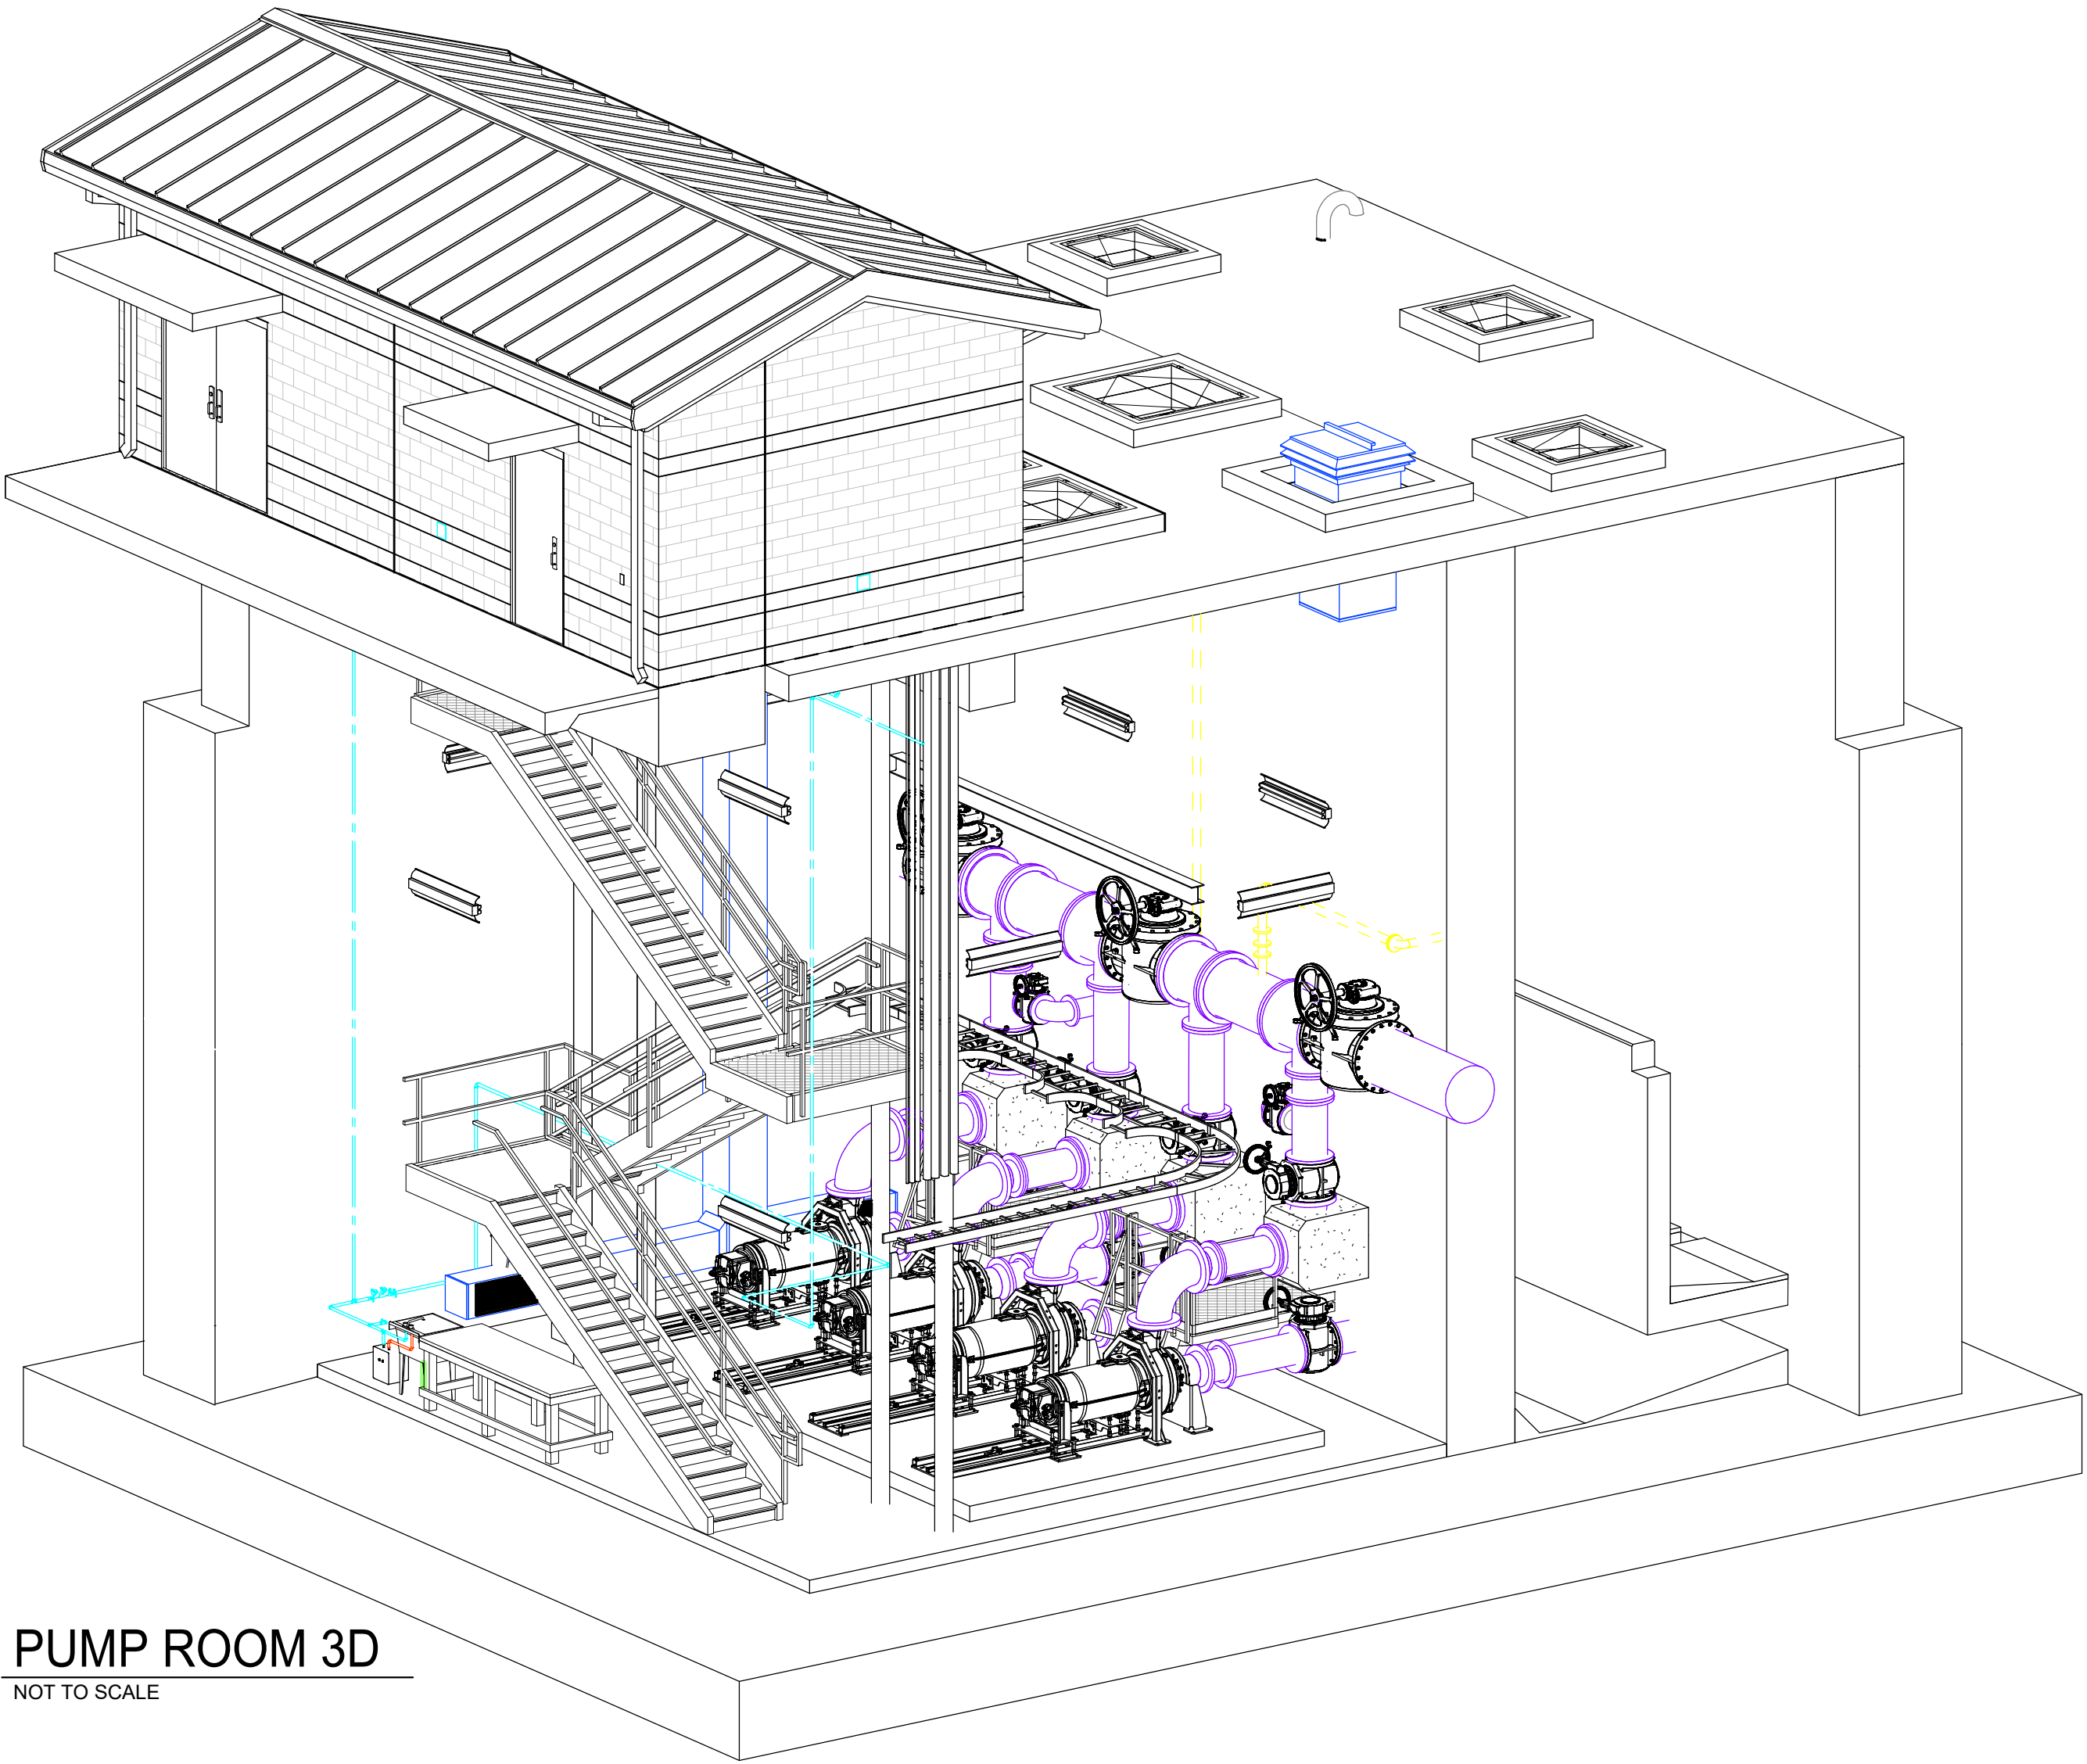


PUMP ROOM 3D
NOT TO SCALE

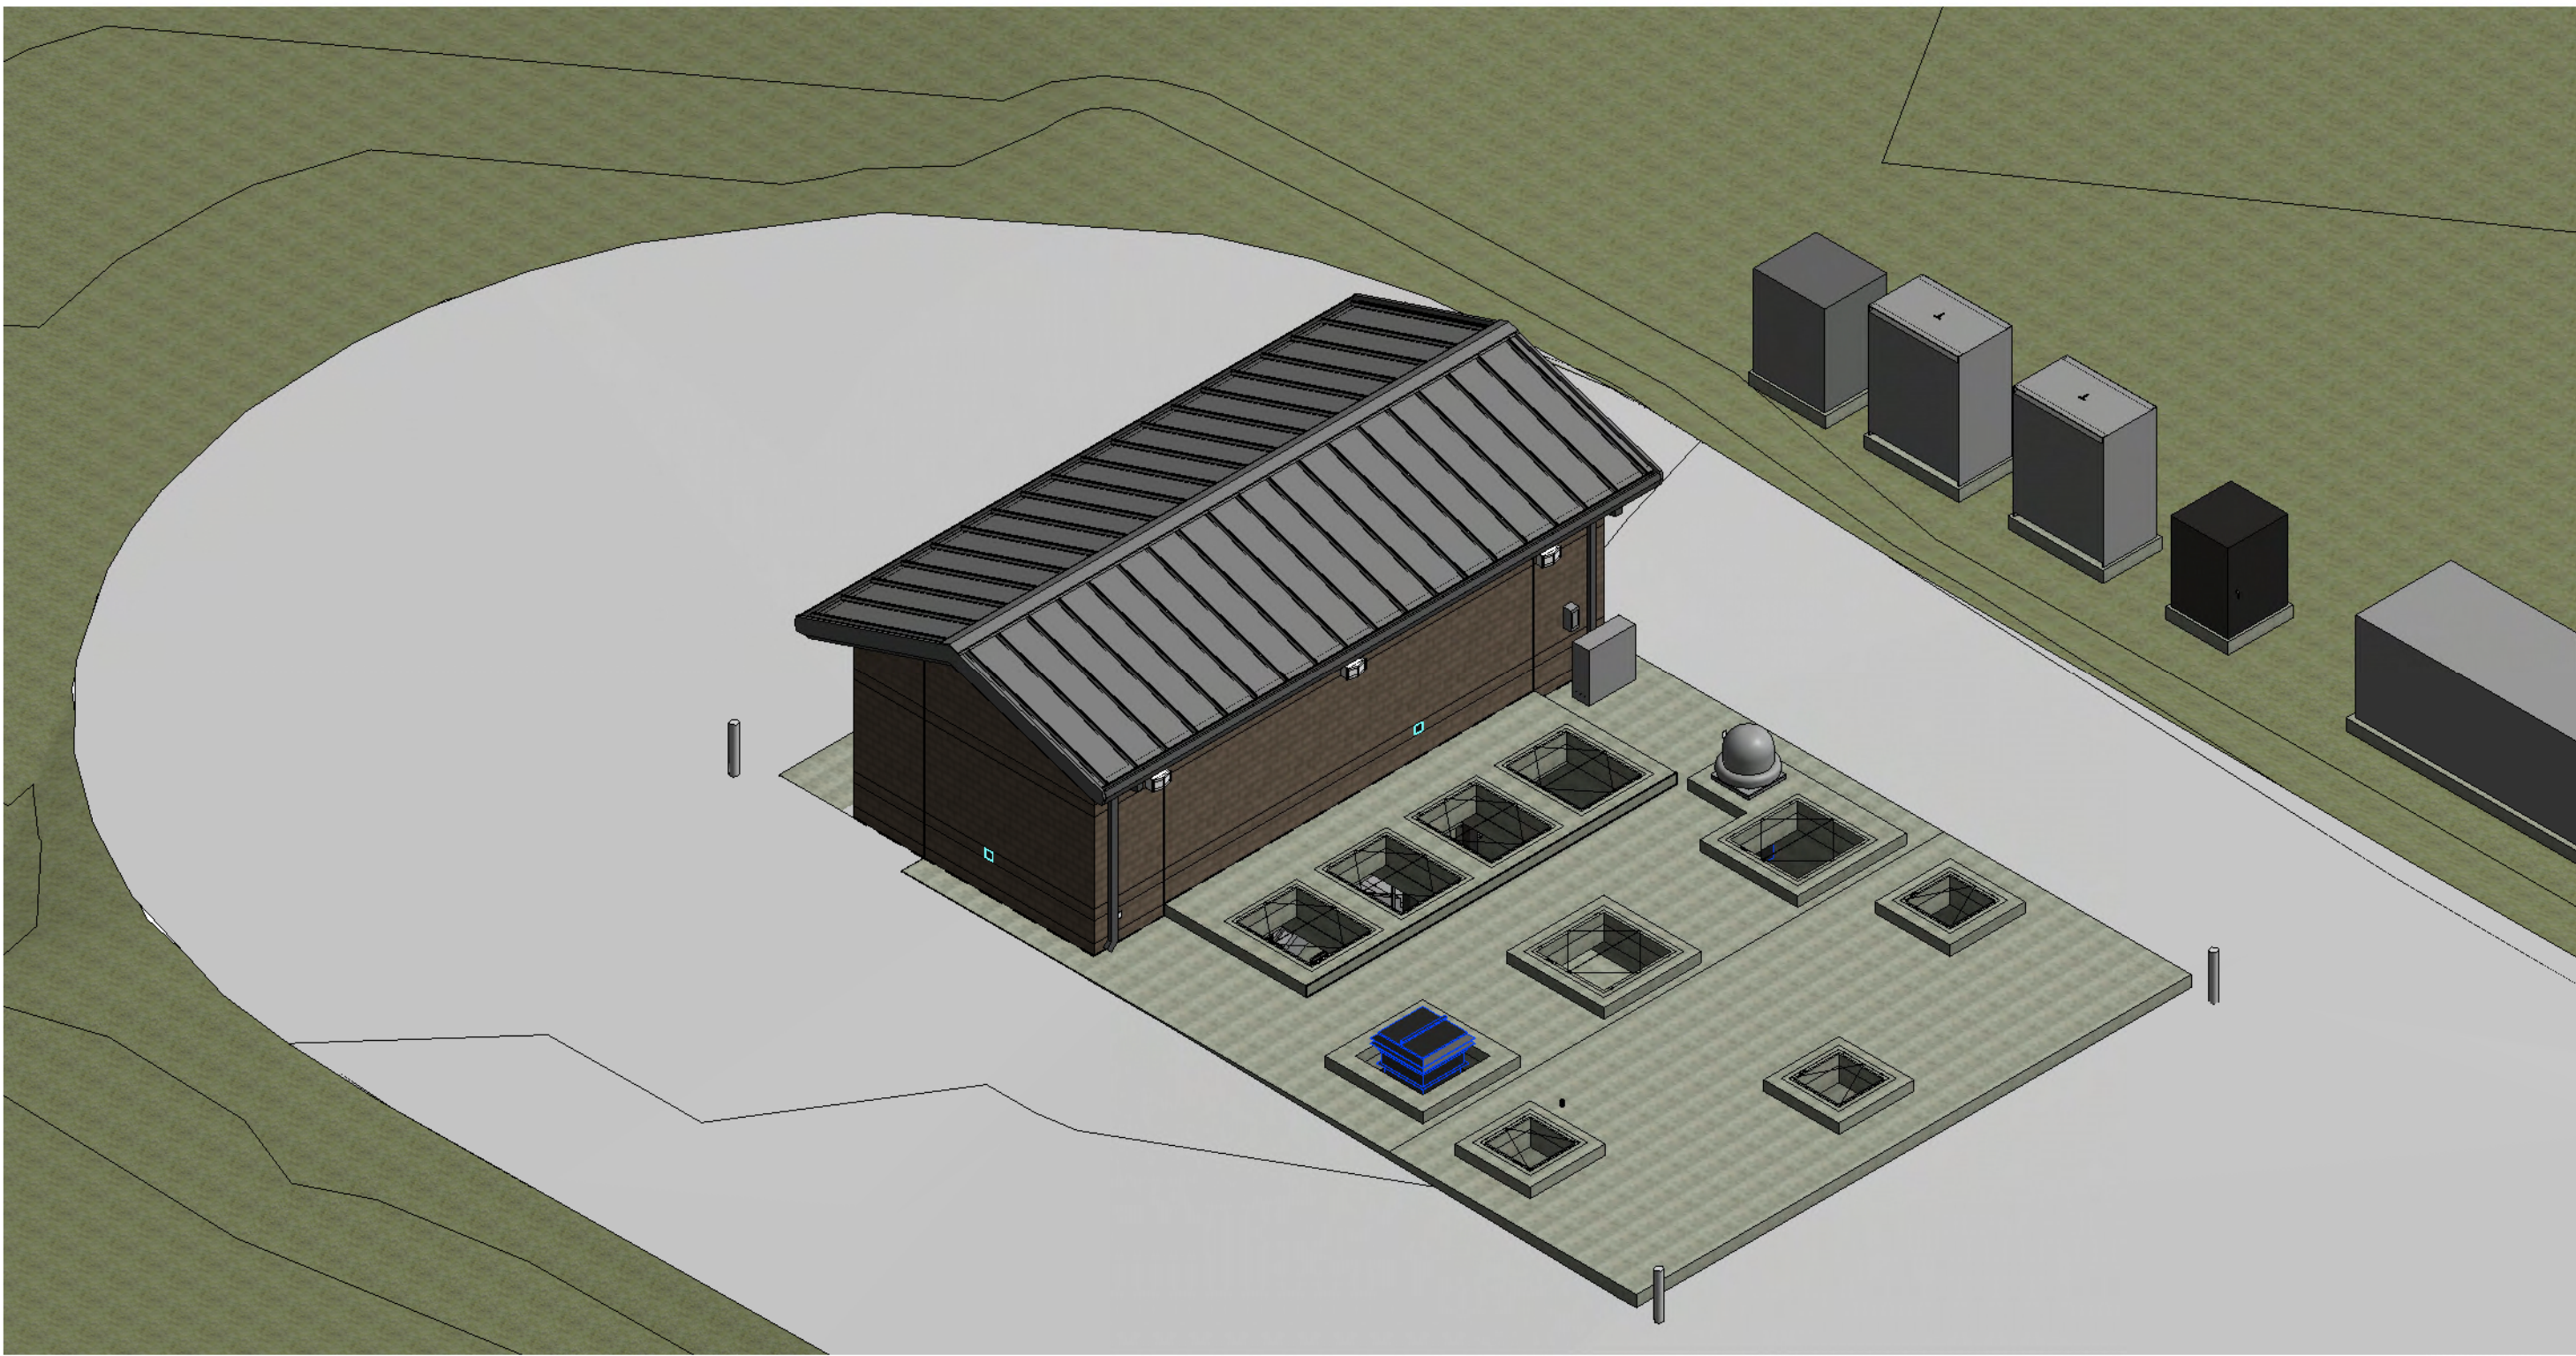


W-E 3D
NOT TO SCALE

SHEET INDEX	
Sheet #	Sheet Name
G101	COVER SHEET
G102	VICINITY MAP & SHEET INDEX
C101	CIVIL SITE, GRADING & DRAINAGE PLAN
C102	YARD PIPING PLAN
C103	YARD PIPING PROFILES
C104	CIVIL DETAILS
C105	CIVIL DETAILS
C106	LANDSCAPE PLAN
GS001	STRUCTURAL NOTES
GS002	STRUCTURAL NOTES
GS003	STRUCTURAL SPECIAL INSPECTION NOTES
GS004	STRUCTURAL SPECIAL INSPECTION
GS005	STANDARD STRUCTURAL DETAILS
GS006	STANDARD STRUCTURAL DETAILS
GS007	STANDARD STRUCTURAL DETAILS
GS008	STANDARD STRUCTURAL DETAILS
GS009	STANDARD STRUCTURAL DETAILS
GS010	STANDARD STRUCTURAL DETAILS
GS011	STANDARD STRUCTURAL DETAILS
S101	FLOOR PLAN, SECTION, SCHEDULES & NOTES
S102	ELEVATIONS
S103	STRUCTURAL PLANS - BELOW GROUND
S104	BUILDING SECTIONS
S105	BUILDING SECTIONS
S106	STRUCTURAL PLANS - BUILDING
S107	WALL SECTIONS
S108	BACKFILL PLAN
P101	PROCESS PIPING PLANS
P102	PLAN AND SECTIONS
P103	SECTIONS
P104	PROCESS DETAILS
M001	GENERAL MECHANICAL INFORMATION
M101	HVAC PLANS
M102	MECHANICAL SCHEDULES AND DETAILS
PL101	PLUMBING PLANS
PL102	PLUMBING DETAILS AND SCHEDULES
GE001	ELECTRICAL GENERAL INFORMATION
E101	ELECTRICAL SITE PLAN
E201	LIFT STATION POWER PLANS
E301	LIFT STATION LIGHTING PLANS
E401	ELECTRICAL DIAGRAMS
E501	ELECTRICAL DETAILS
E502	ELECTRICAL DETAILS
E503	ELECTRICAL DETAILS
E504	ELECTRICAL DETAILS
E505	ELECTRICAL SECTIONS
E601	ELECTRICAL SCHEDULES
I101	INSTRUMENTATION ARCHITECTURE
I102	INSTRUMENTATION DIAGRAMS
I103	INSTRUMENTATION DIAGRAMS

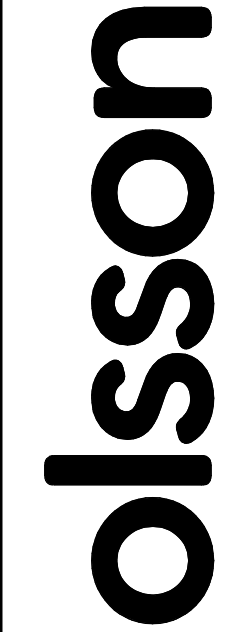

302 E. Millsap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com



BY	CBD
REVISION DESCRIPTION	
DATE	09/15/20
REV. NO.	1

VICINITY MAP & SHEET INDEX


NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K. ROWETT
checked by: C. DOUGHERTY
approved by: C. DOUGHERTY
QA/QC by: M. MILLIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

2020

SHEET
G102

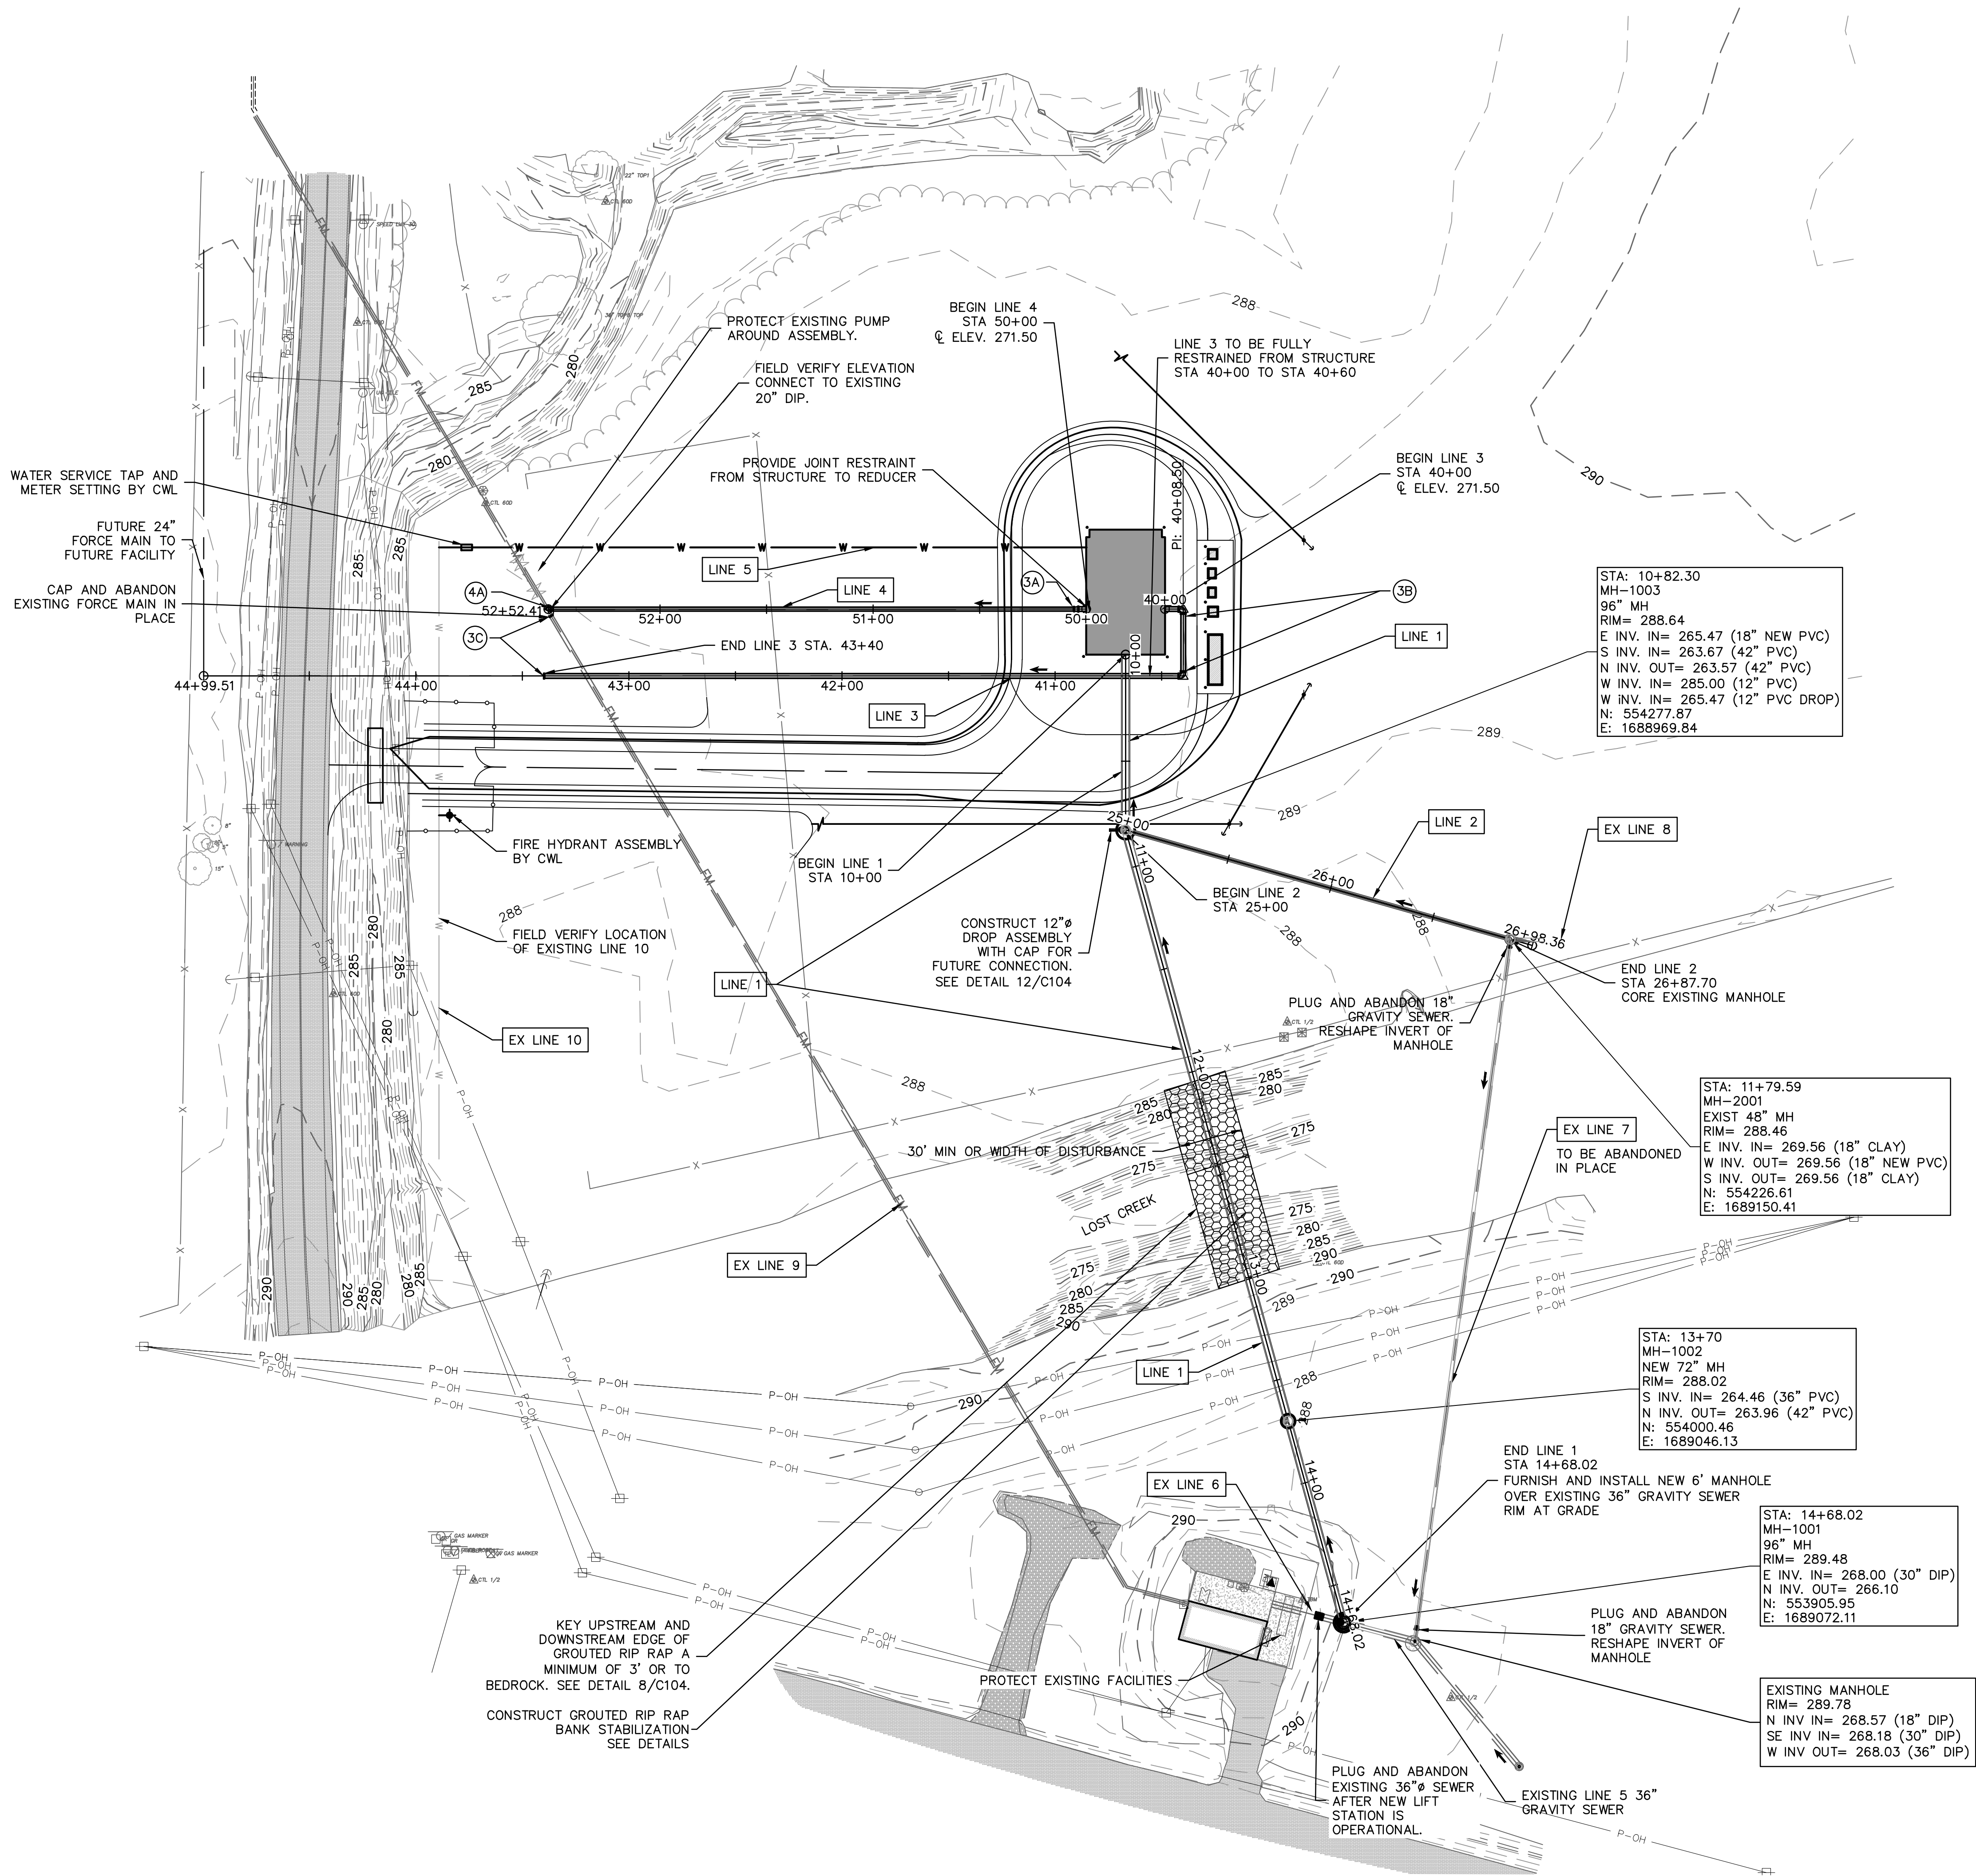


PIPE SCHEDULE		
ITEM	DESCRIPTION	REMARKS
LINE 1	CONSTRUCT APPROX. 385 L.F. OF 36"/42" PVC GRAVITY SEWER, SLOPE VARIES.	SEE PROFILE
LINE 2	CONSTRUCT APPROX. 188 L.F. OF 18" PVC GRAVITY SEWER, SLOPE 3.14%	SEE PROFILE
LINE 3	CONSTRUCT APPROX. 340 L.F. 24" AWWA C900 PVC DR-18 FORCE MAIN, CAPPED @ LINE END	SEE PROFILE
LINE 4	CONSTRUCT APPROX. 253 L.F. 20" AWWA C900 PVC DR-18 FORCE MAIN	SEE PROFILE
LINE 5	CONSTRUCT 304 L.F. 1"Ø WATER SERVICE LINE. TIE INTO EXISTING WATERLINE	SERVICE TAP AND METER SETTING BY CWL
EX LINE 6	EX. 36" GRAVITY SEWER	
EX LINE 7	EX. 18" TO BE ABANDONED.	
EX LINE 8	EX. 18" GRAVITY SEWER	
EX LINE 9	EX. 20" FORCE MAIN FROM EX LIFT STATION. LINE 4 TIES IN @ STA 52+53	
EX LINE 10	EX. 8" WATERLINE (VERIFY LOCATION)	

FITTING SCHEDULE		
ITEM	DESCRIPTION	REMARKS
3A	20"x24" MJ REDUCER	
3B	24"Ø MJ 90° BEND	
3C	24"Ø MJ CAP	
4A	20"Ø MJ 45° BEND	JOINT RESTRAINT REQUIRED WITHIN 5' OF FITTING

- FITTING NOTES:
- DUCTILE IRON FITTINGS AND VALVES SHALL BE CERAMIC EPOXY LINED IN ACCORDANCE WITH SPECIFICATIONS.
 - ALL VALVES AND FITTINGS SHALL HAVE MEGALUG RETAINER GLANDS.
 - ALL BENDS AND TEES SHALL HAVE CONCRETE REACTION BACKING IN ADDITION TO MEGALUG RETAINER GLANDS.

- NOTES:
- CONTRACTOR SHALL PROVIDE UNINTERRUPTED SEWER SERVICE AT LIFT STATION. CONTRACTOR SHALL SEQUENCE WORK SUCH THAT CONSTRUCTION OF NEW LIFT STATION IS COMPLETE AND OPERATIONAL PRIOR TO CONNECTING TO EXISTING SEWER AND FORCE MAIN. TESTING TO BE PERFORMED BEFORE TIE-INS. CWL HAS PUMP AROUND ASSEMBLY ON EXISTING FORCE MAIN LINE THAT WILL BE USED TO BYPASS PUMP.
 - PROTECT EXISTING UTILITIES AND FACILITIES.
 - CONSTRUCTION WITHIN BANK OF LOST CREEK SHALL BE PERFORMED IN ACCORDANCE TO APPLICABLE PERMITS AND REGULATIONS
 - ALL NEW MANHOLES SHALL BE EPOXY LINED IN-PLACE PER SPECIFICATION 09 96 00 EPOXY PROTECTIVE COATING SYSTEM FOR CONCRETE STRUCTURES.

LEGEND	

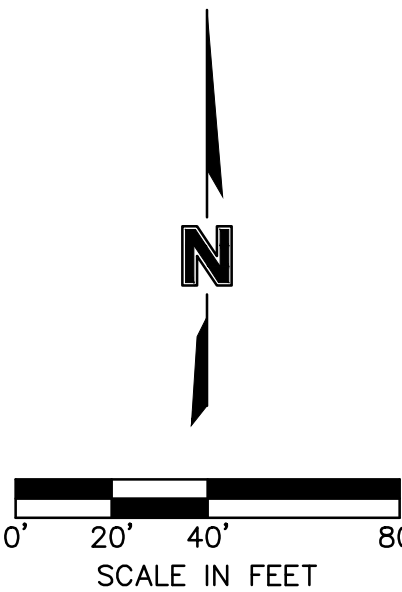

olsson

302 East Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
www.olsson.com

YARD PIPING PLAN

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

REV. NO.

DATE

REVISIONS DESCRIPTION

BY

2020

01/02/2020

drawing no.: 018-0054

project no.: 018-0054

QA/QC by: M. MILIUS



approved by: CBD

checked by: MES


drawn by: MES

SHEET

C-102





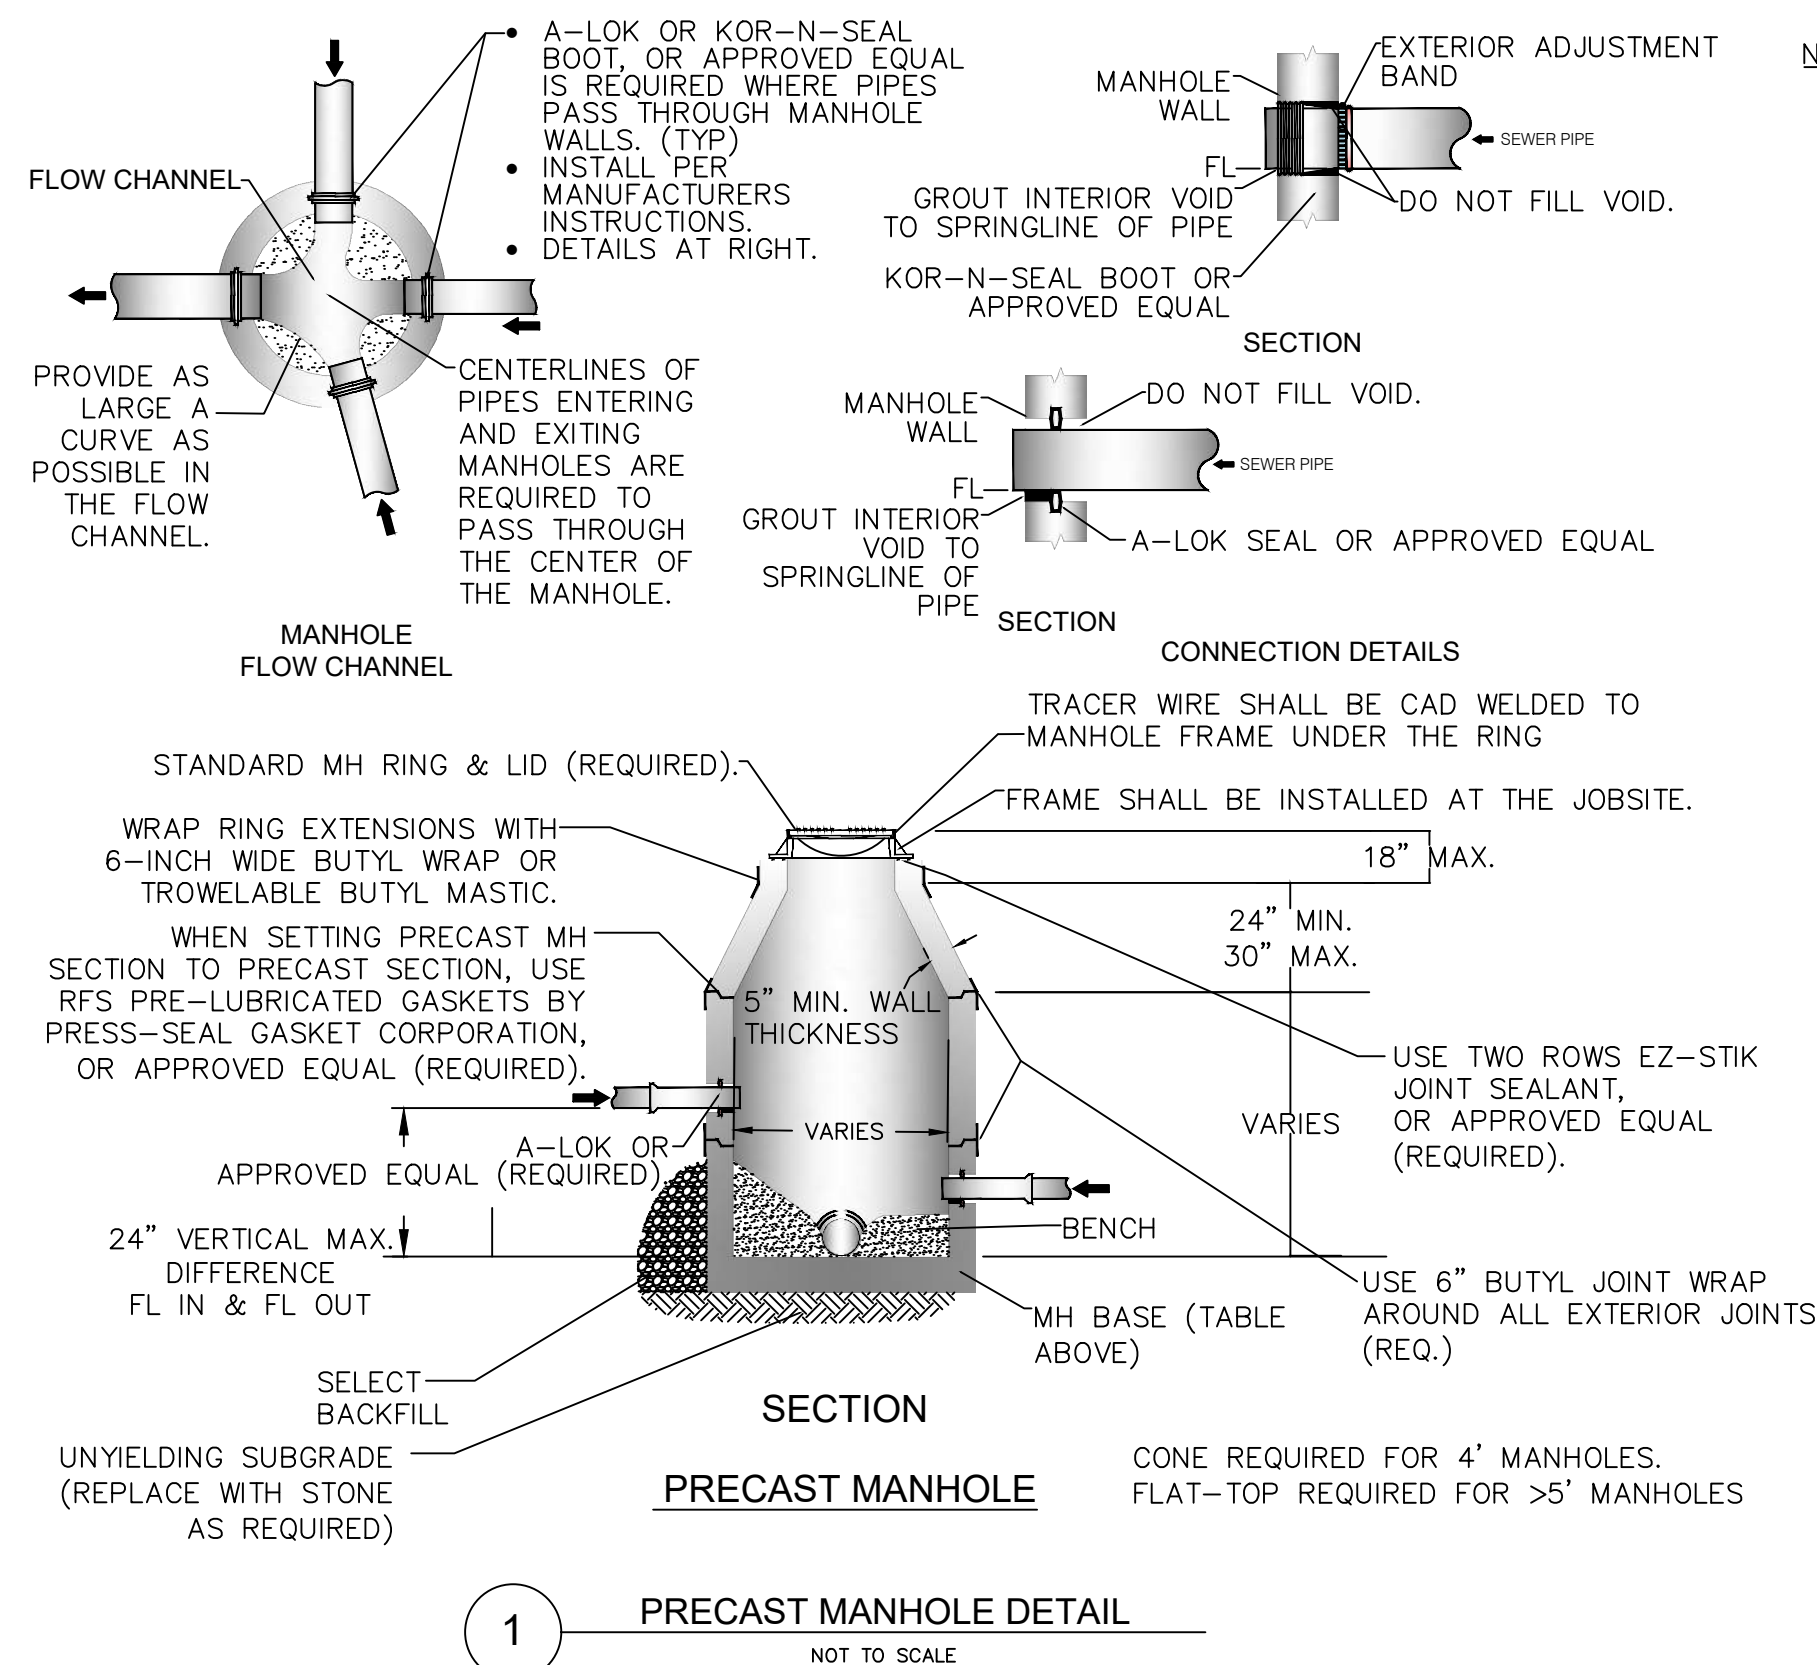


1. BENCH SHALL SLOPE FROM SPRINGLINE OF PIPE TO MANHOLE WALL. OUTLET CHANNEL SHALL BE FULL DEPTH "U" FROM CENTER OF MANHOLE TO WALL.
2. MINIMUM WALL THICKNESS:
 - 2.1. 96" ID - 9" WALL
 - 2.2. 72" ID - 7" WALL
3. MINIMUM BASE THICKNESS = 8"
4. MINIMUM RING & COVER SIZE = 24"
FOR < OR EQUAL TO 24" PIPES AND
36" FOR >24" PIPE

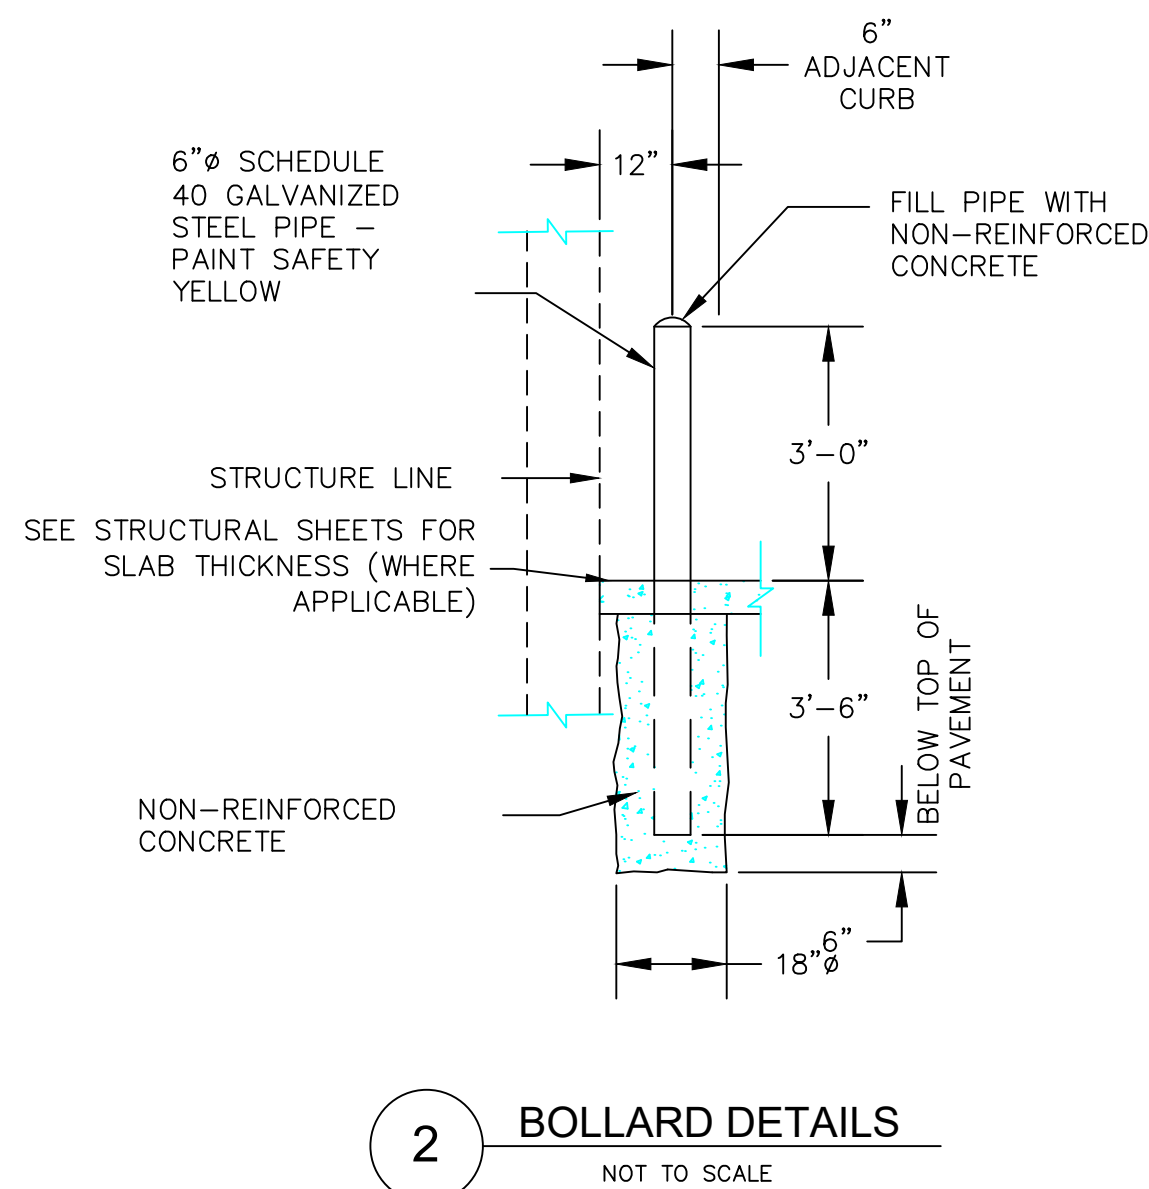

REACTION BACKING TABLE				
SIZE	REQUIRED SQ. FT. OF UNDISTURBED EARTH WALL FOR REACTION BACKING			
	TYPE OF FITTINGS			22.5" OR 11.25"
	TEE	90°	45°	
>2"	1	1	1	1
3"	1	2	1	1
4"	2	2	1	1
6"	3	5	3	2
8"	6	8	4	2
10"	8	12	6	3
12"	12	17	9	5
14"	16	23	12	6
16"	21	29	16	8
18"	26	37	20	10
20"	32	45	25	13
24"	46	65	35	18
30"	70	100	54	27
36"	101	143	77	39
42"	132	186	101	52
48"	171	242	131	67

- NOTES:
1. ALL BURIED FITTINGS SHALL BE MECHANICAL JOINTS.
 2. DO NOT COVER BELLS OR FLANGES WITH CONCRETE.
 3. WRAP ALL FITTINGS WITH 8 MIL. POLYETHYLENE FILM
 4. BACK ALL TEES ACCORDING TO SIZE OF BRANCH.
 5. BACKING FUTURE LINE EXTENSIONS SHALL BE SUCH THAT LATER REMOVAL IS POSSIBLE.
 6. UNLESS OTHERWISE NOTED, BACKING SHALL NOT BE USED AS AN ACCEPTABLE JOINT RESTRAINT SYSTEM FOR PIPING 4" AND LARGER IN DIAMETER.
 7. BACKING SHALL BE ACCEPTABLE FOR USE ON PIPING LESS THAN 4" IN DIAMETER.
 8. ALL BENDS WHERE FITTINGS ARE USED, BOTH HORIZONTAL AND VERTICAL, SHALL HAVE A JOINT RESTRAINT SYSTEM AS SET FORTH IN THE SPECIFICATIONS.
 9. REACTION BACKING TABLE IS BASED ON 175 PSI AND SOIL BEARING PRESSURE OF 2,000 LB./SQ. FT. ADDITIONAL BACKING MAY BE REQUIRED IN SOME AREAS AS DIRECTED BY THE ENGINEER.

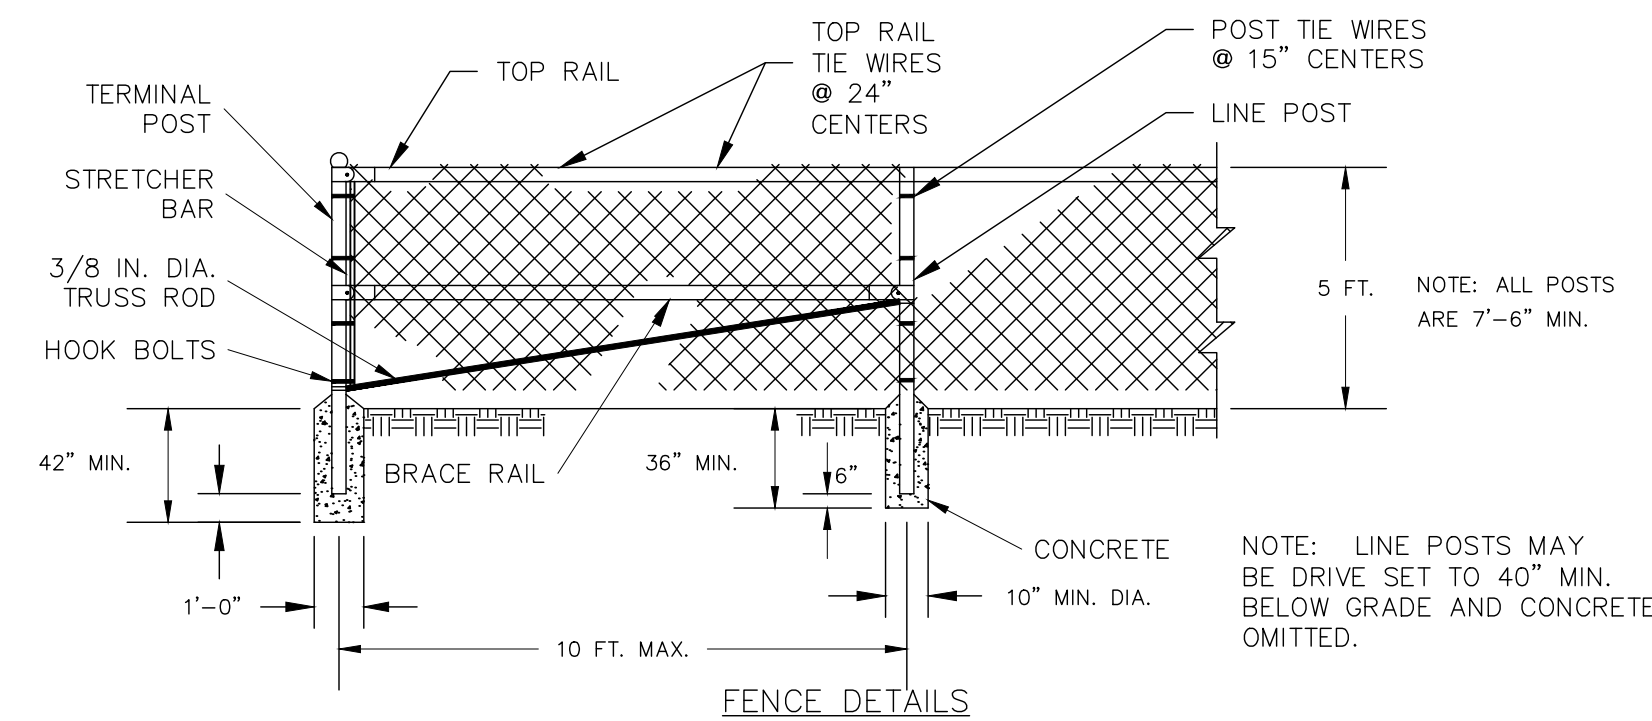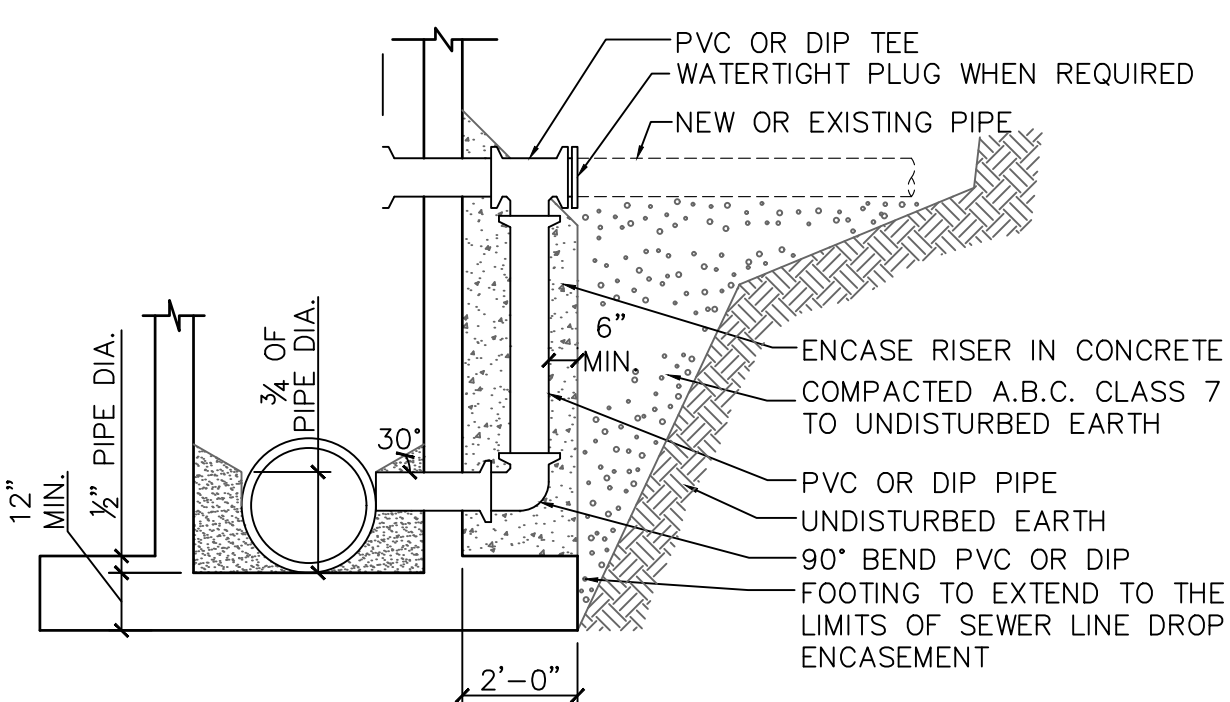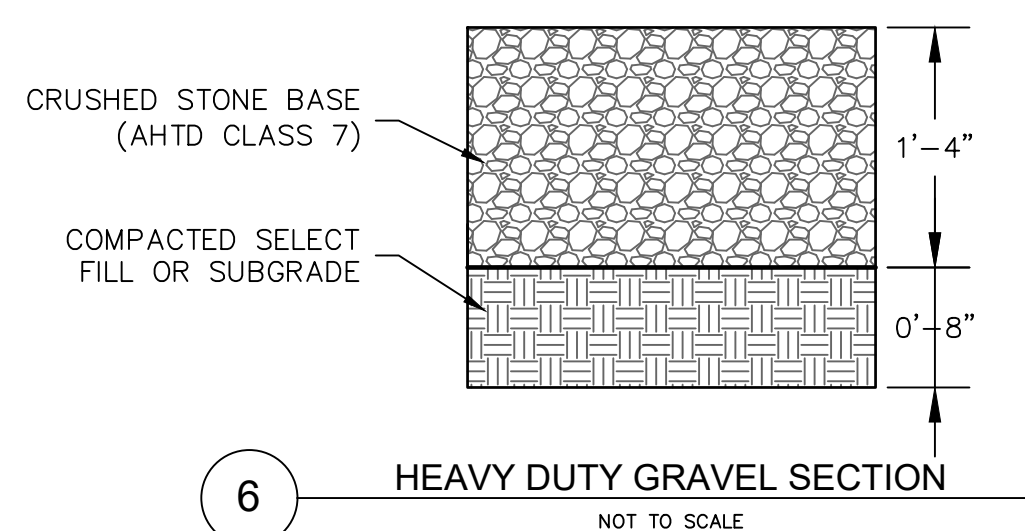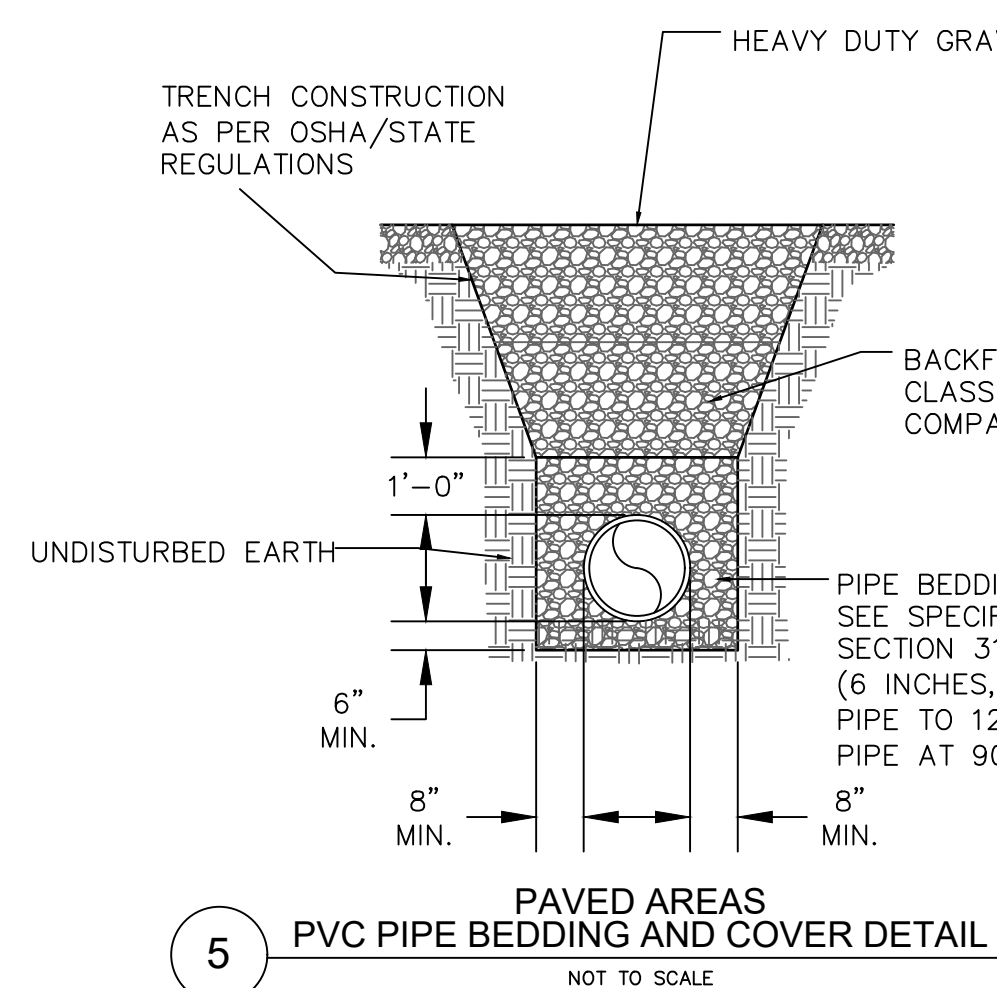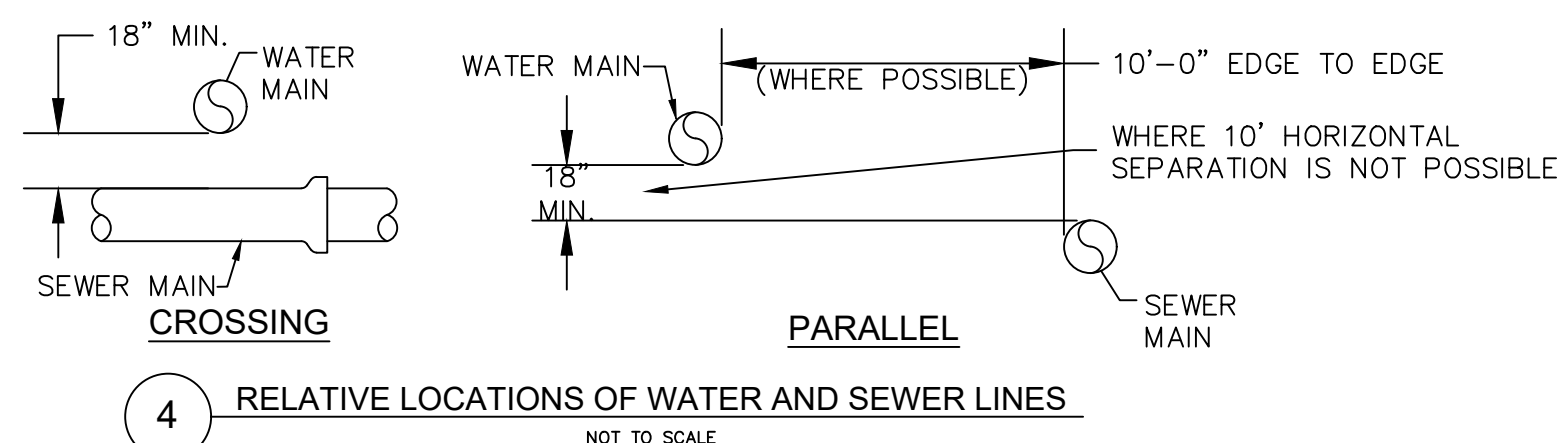



SHAPE, SIZE AND WEIGHT REQUIREMENTS FOR FENCE POSTS AND RAILS			
ITEM	SHAPE	OUTSIDE DIMENSIONS INCHES	WEIGHT LBS./LIN. FT.
** TERMINAL POSTS	ROUND *ROUND	2.375 2.375	3.65 3.12
LINE POSTS	ROUND *ROUND	1.90 1.90	2.72 2.28
TOP & BRACE RAILS	ROUND *ROUND	1.66 1.66	2.27 1.84


* GRADE B HIGH STRENGTH STEEL
 ** INCLUDES END, CORNER, ANGLE, INTERSECTION AND
 INTERMEDIATE BRACED POSTS

GATE FRAME MEMBERS SIZE AND WEIGHT		
GATE FRAME	OUTSIDE DIMENSIONS INCHES	WEIGHT LBS./LIN. FT.
ROUND	1.66	2.27
*ROUND	1.66	1.84
* GRADE B HIGH STRENGTH STEEL		


GATE POST SIZE AND WEIGHT		
GATE LEAF WIDTH OF 6 FT. OR LESS	OUTSIDE DIMENSIONS INCHES	WEIGHT LBS./LIN. FT.
ROUND	2.875	5.79
*ROUND	2.875	4.64
* GRADE B HIGH STRENGTH STEEL		

1. MATERIALS AND WORKMANSHIP NOT SHOWN ON THIS DRAWING SHALL CONFORM TO THE MANUFACTURER'S SPECIFICATIONS.
2. ALL POSTS SHALL BE INSTALLED VERTICALLY. WHERE POSTS ARE INSTALLED ON AN INCLINED SURFACE, THE ANGLE OF THE POST SHALL BE ADJUSTED SO THAT THE POST WILL BE VERTICAL.
3. THE FENCING SHALL BE #9 GAGE FENCE FABRIC, STANDARD 2-INCH CHAIN LINK DIAMOND MESH.

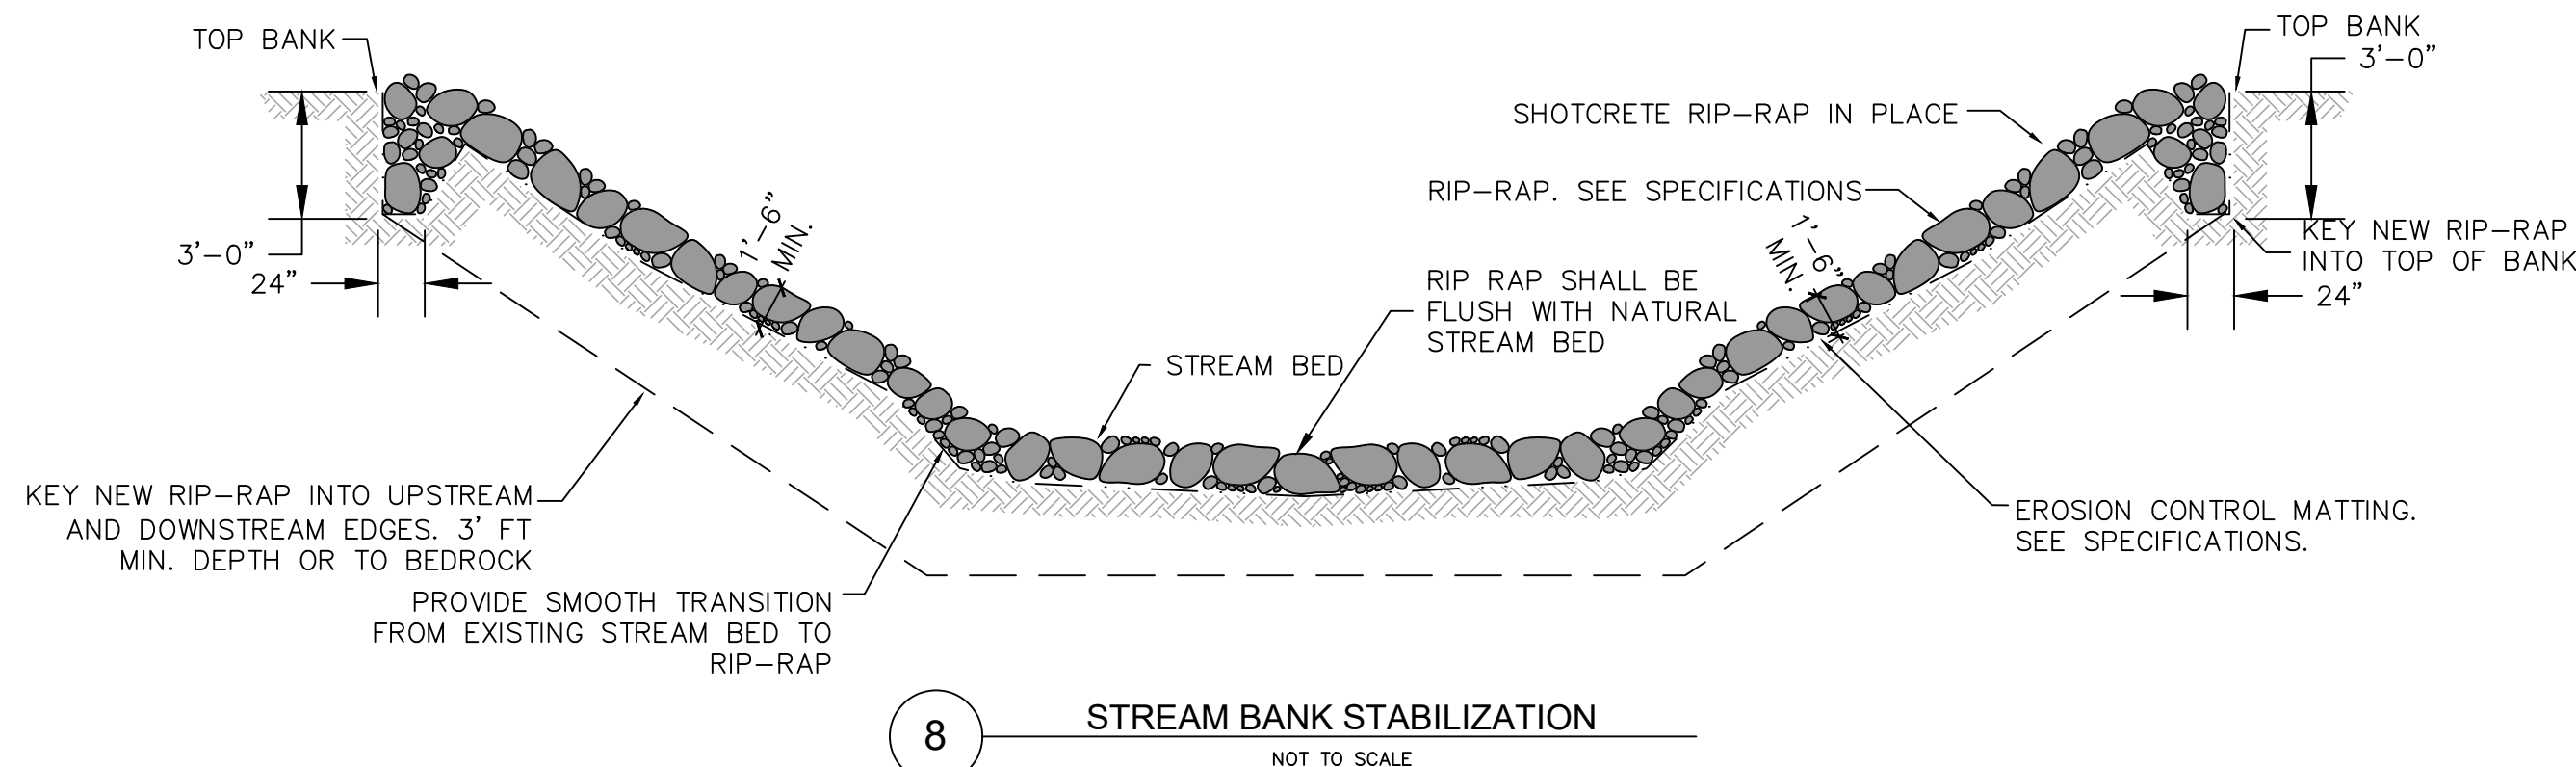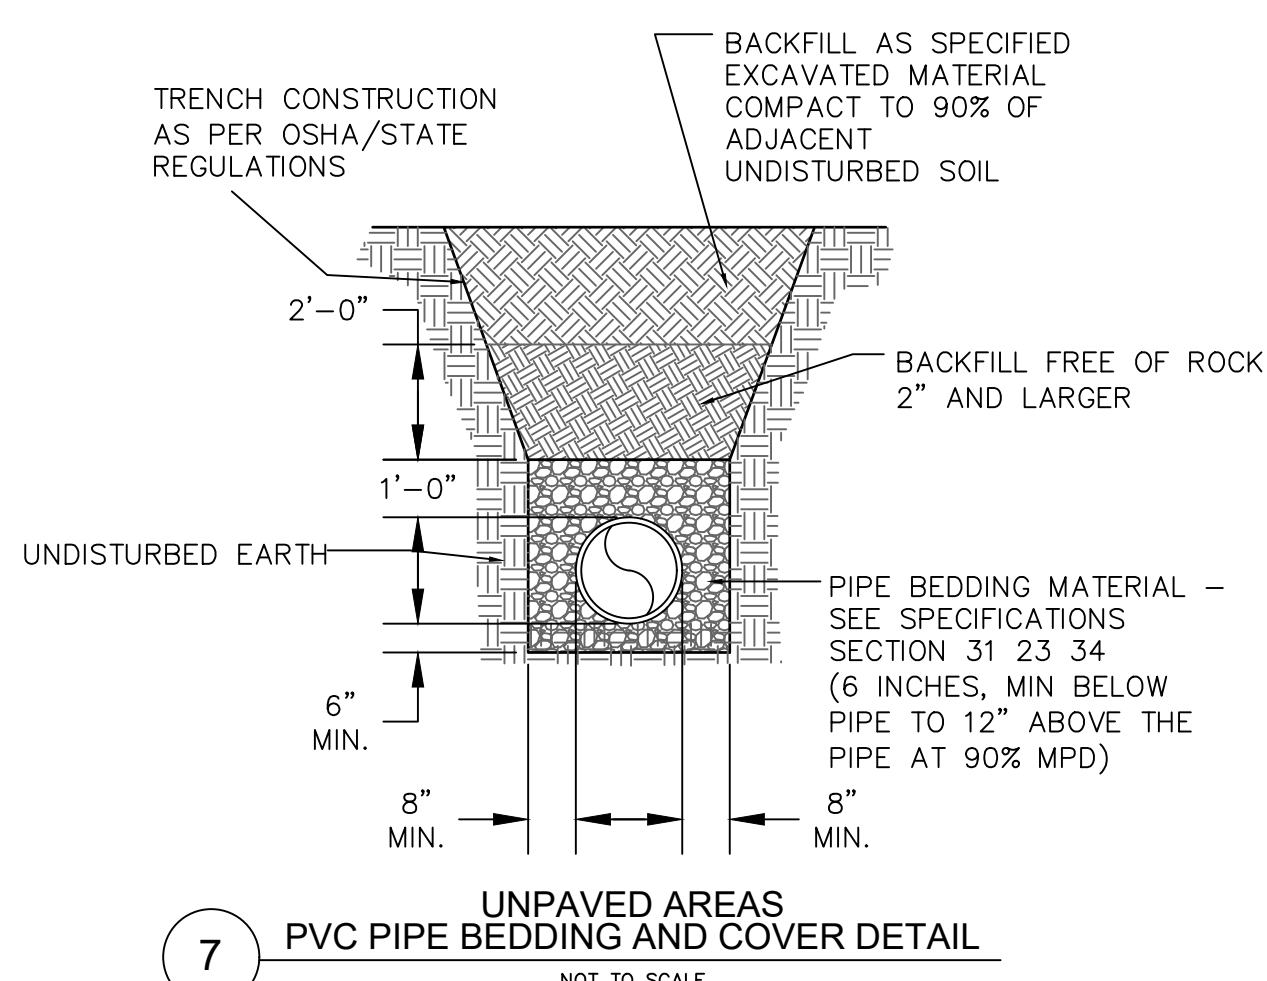

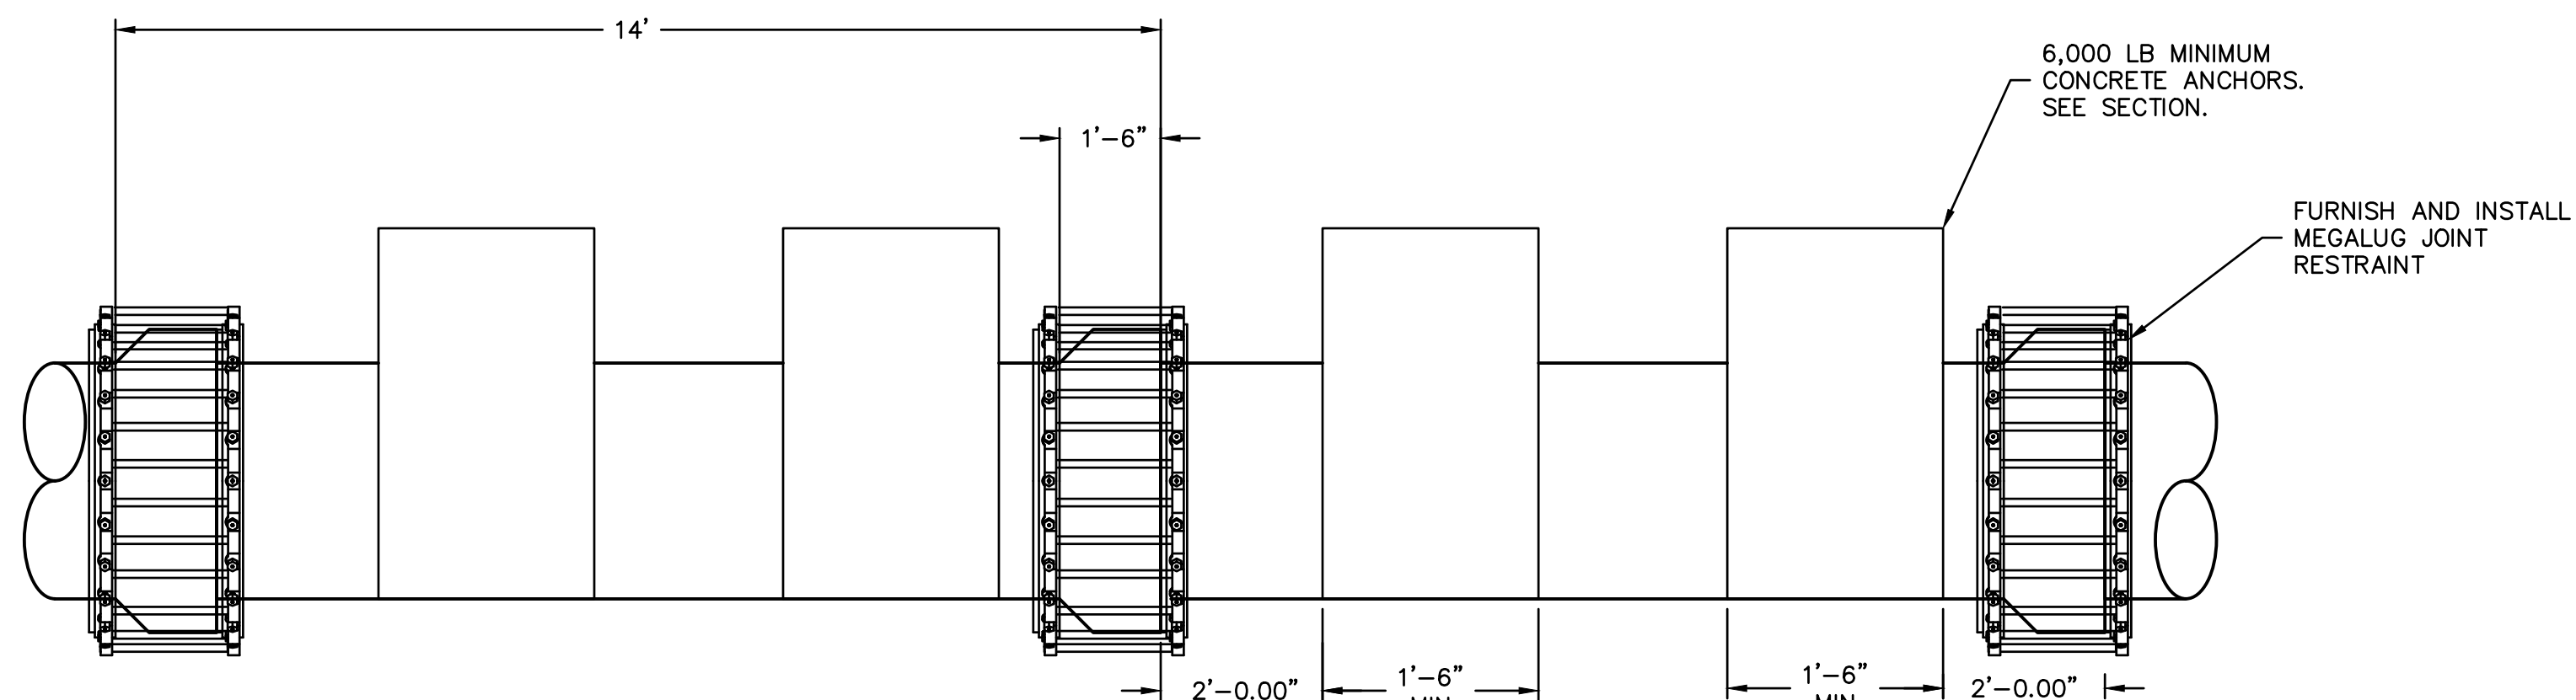


1 BOUYANCY ANCHOR LAYOUT AND SECTION

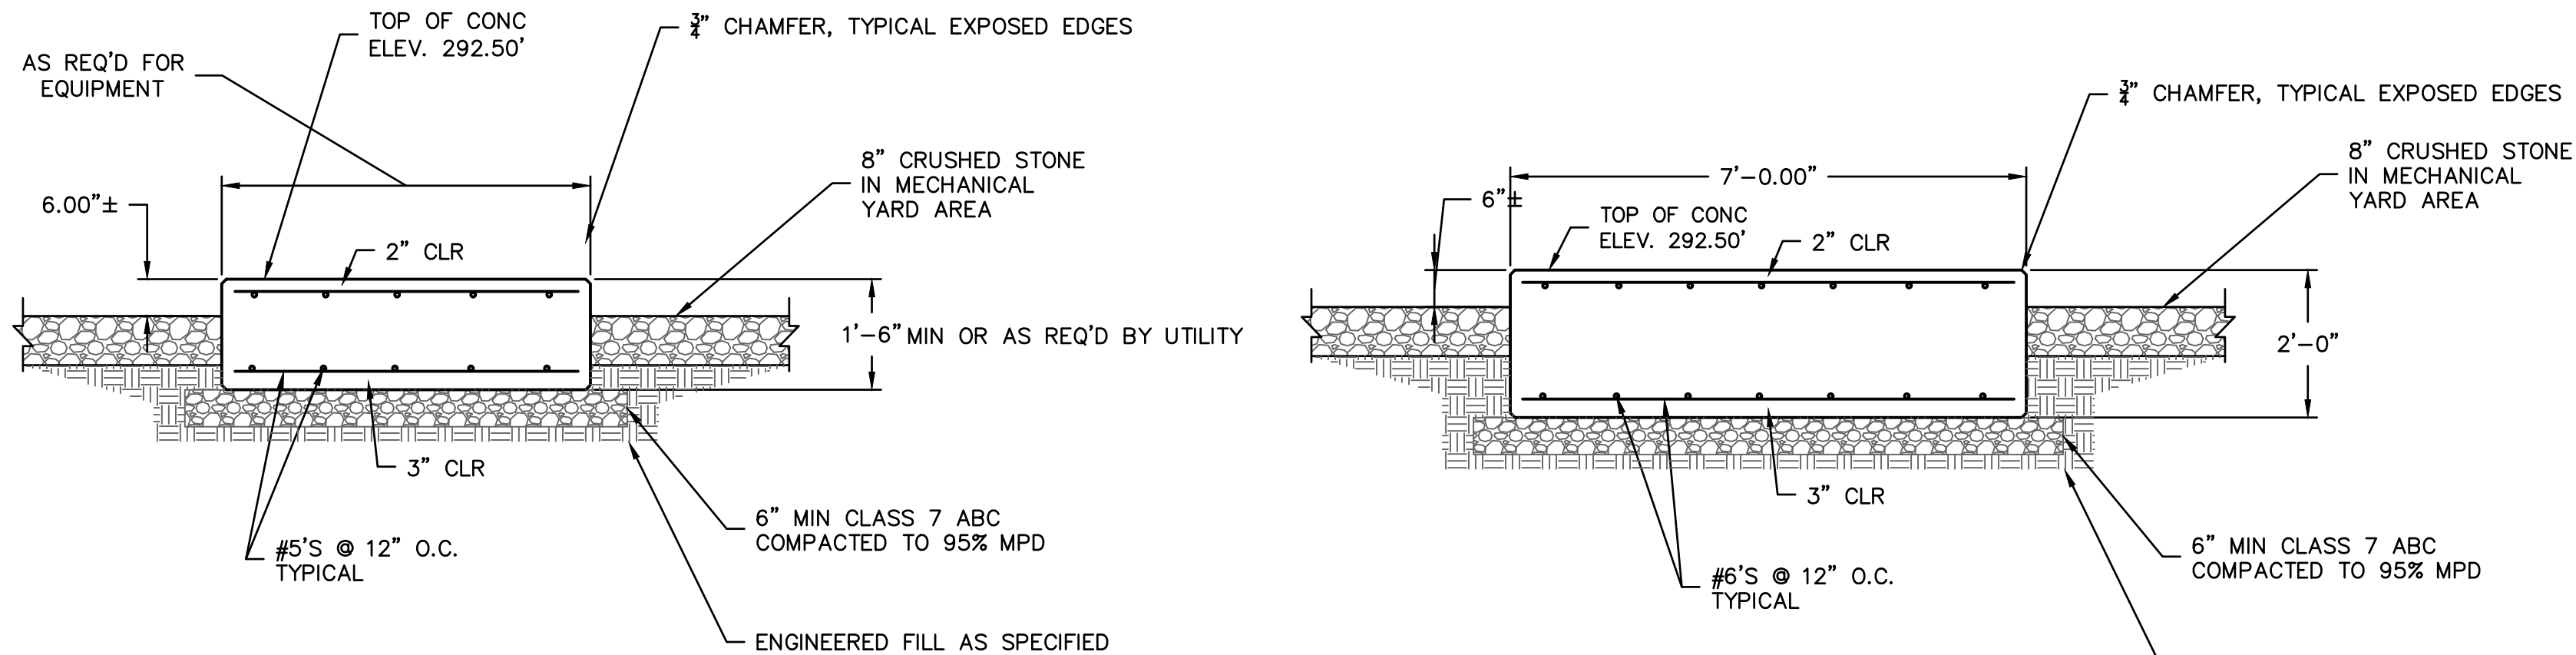

3 SECTION - EQUIPMENT PAD
1/2" = 1'-0"

2 SECTION - GENERATOR PAD
1/2" = 1'-0"

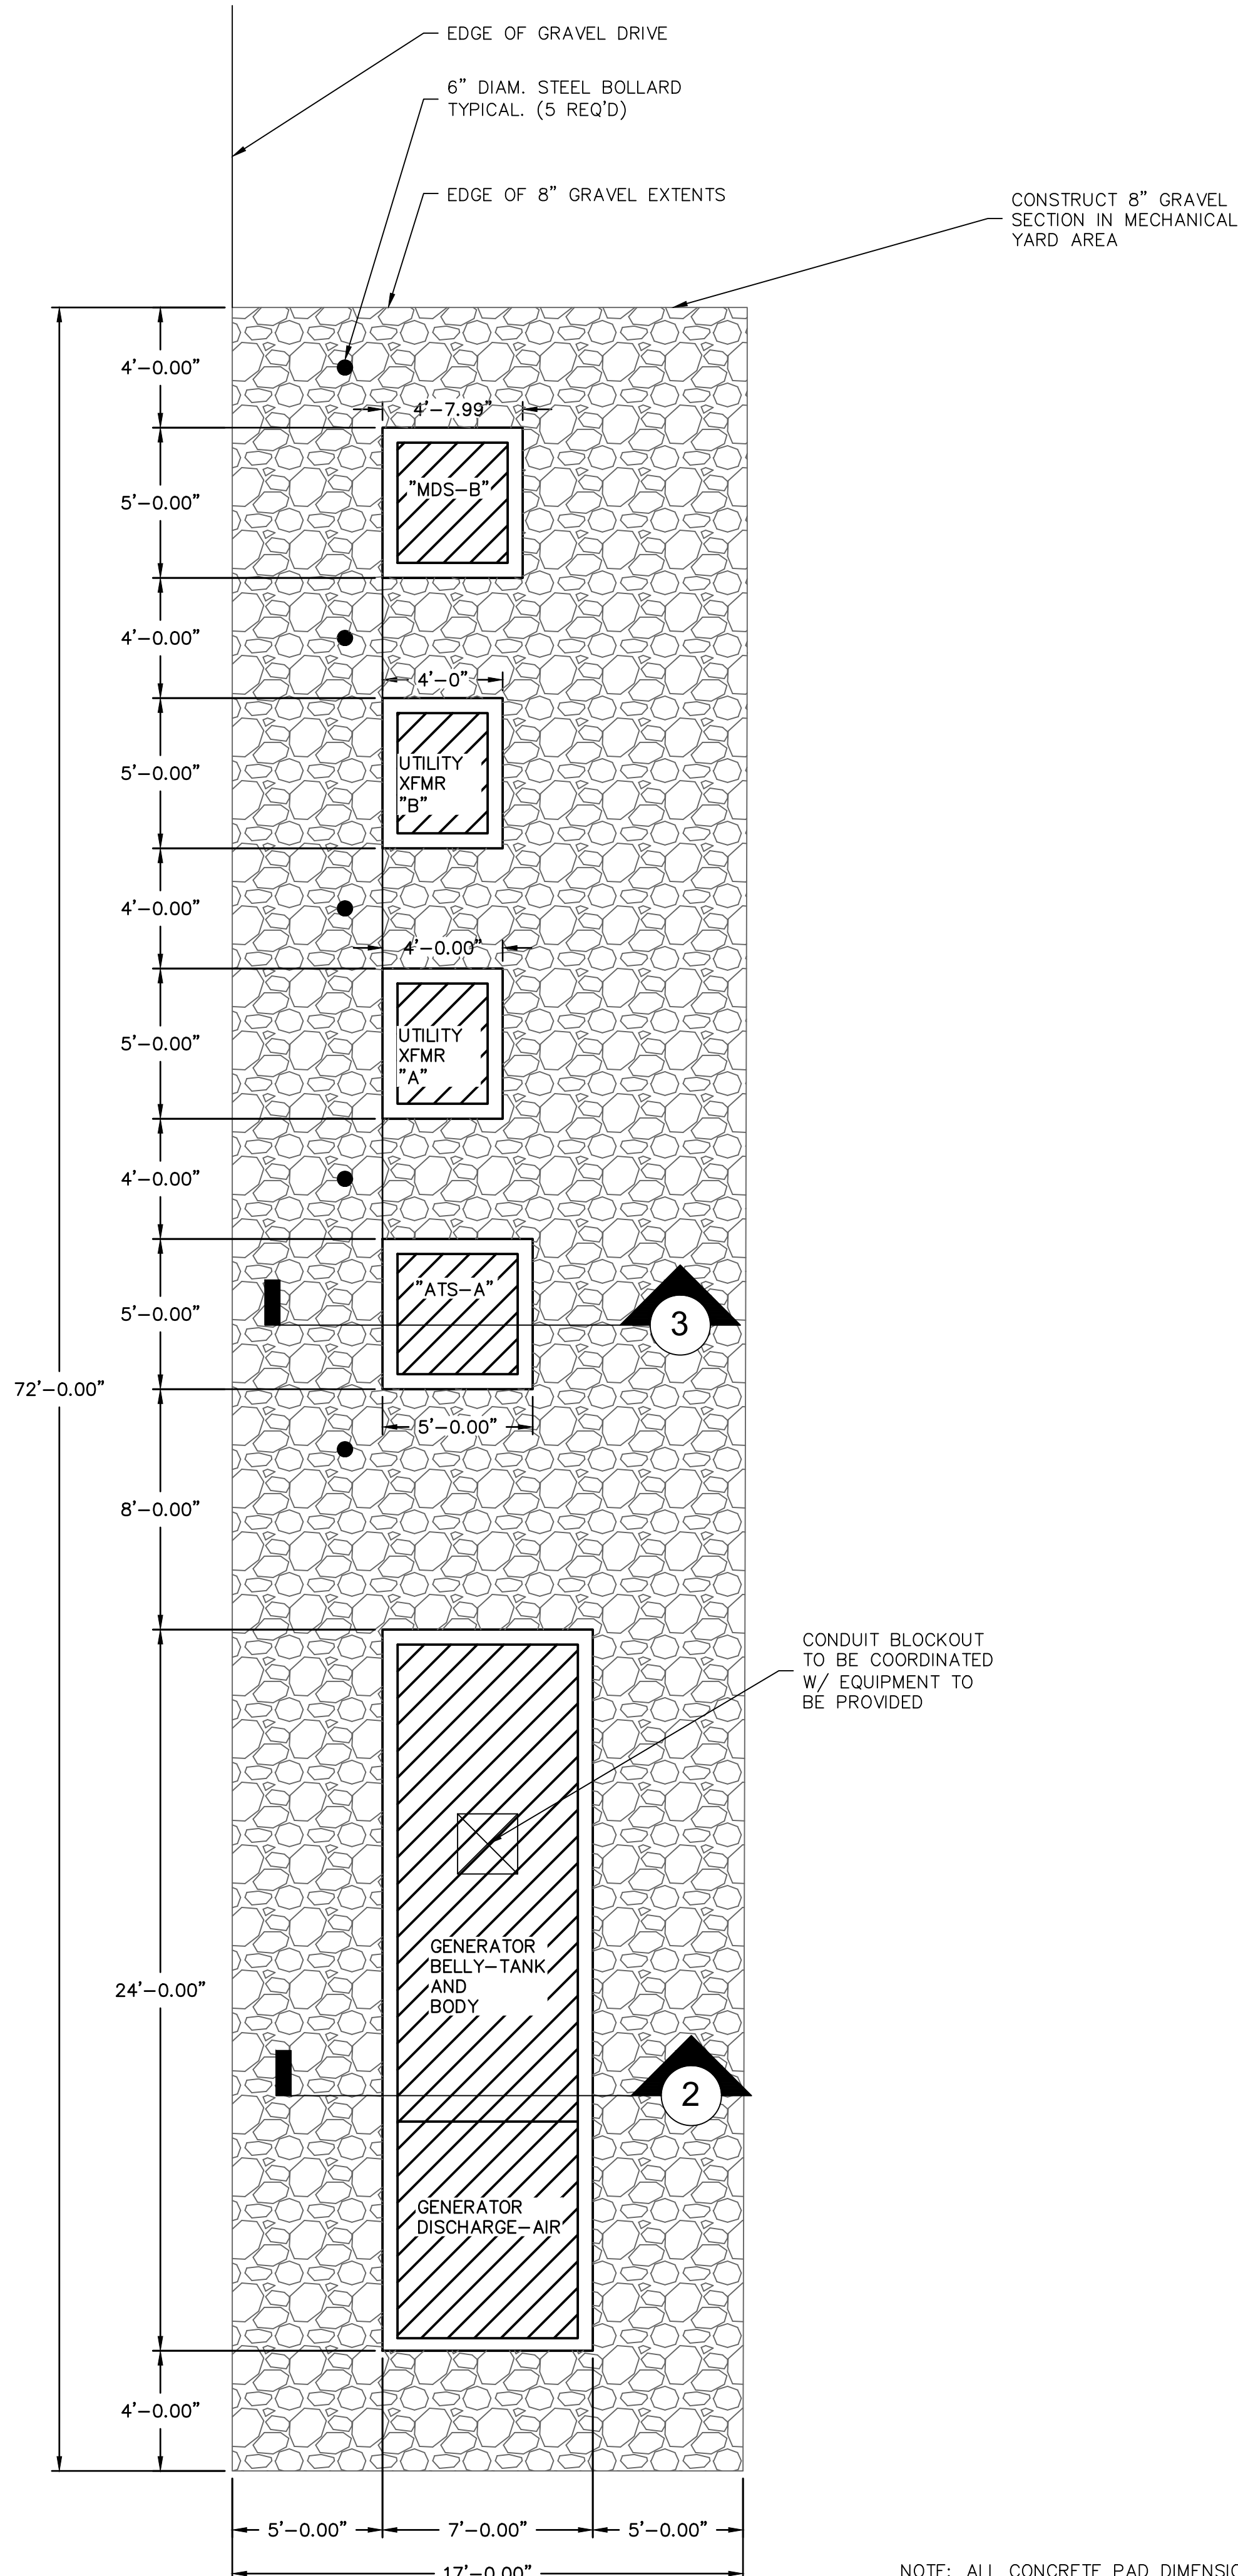

1 ELECTRICAL EQUIPMENT
PAD LAYOUT
1/4" = 1'-0"

NOTE: ALL CONCRETE PAD DIMENSIONS SHALL BE
VERIFIED WITH EQUIPMENT TO BE PROVIDED

C:\Users\Krowett\Documents\Jonesboro_Central_180054_krowett.rvt
12/30/2019 4:02:20 PM

BUILDING CODE AND STANDARDS

2012 INTERNATIONAL BUILDING CODE (IBC 2012) WITH STANDARDS AS REFERENCED IN IBC CHAPTER .

STRUCTURAL DESIGN LOADS:

UNIFORM (PSF) CONCENTRATED (LB)

DEAD LOAD - ACTUAL WEIGHT OF MATERIALS USED ADDING THE FOLLOWING ALLOWANCE FOR MEP

FLOOR LIVE & MISC LOADS

1ST FLOOR CORRIDOR 100
CORRIDOR ABOVE 1ST FLOOR 80 2,000
SIDEWALKS 250
STAIRS AND EXITS 100
LIGHT STORAGE 120
MECHANICAL EQUIPMENT ROOM 150 OR EQUIP WT
CEILING 10
PARTITION (LATERAL LOAD) 5
RAILING (LATERAL LOAD AT TOP) 20 PLF 200
*INDICATES REDUCIBLE LOAD

ROOF LIVE LOAD

20 PSF

SNOW DESIGN DATA

GROUND SNOW LOAD, P_g 10 PSF
FLAT ROOF SNOW LOAD, P_f 6.93 PSF
SNOW EXPOSURE FACOR, C_e 0.9
SNOW LOAD IMPORTANCE FACTOR, I_s 1.1
THERMAL FACTOR, C_t 1.0
UNBALANCED SNOW LOAD 11 PSF

WIND DESIGN DATA

BASIC WIND SPEED, V_{ULT/NASD} 120 MPH/93 MPH
RISK CATEGORY III
WIND EXPOSURE C
COMPONENTS AND CLADDING (ULT. PSF)

	10 SF	50 SF	100 SF
INTERIOR ROOF (ZONE 1)	-23.77/+18.0	-26.9/+16.0	-26.0/+16.0
EDGE ROOF (ZONE 2)	-50.0/+18.0	-40.7/+16.0	-36.7/+16.0
CORNER ROOF (ZONE 3)	-73.8/+18.0	-62.7/+16.0	-58.0/+16.0
INTERIOR WALL (ZONE 4)	-34.0/+11.3	-30.7/+28.1	-29.3/+26.6
CORNER WALL (ZONE 5)	-42.0/+31.3	-35.5/+28.1	-32.5/+26.6
OVERHANG (ZONES 1 AND 2)	-58.7	-58.7	-58.7
OVERHANG (ZONE 3)	-98.6	-76.2	-66.6

END ZONE DISTANCE (a) 3 FT

EARTHQUAKE DESIGN DATA

RISK CATEGORY III
SEISMIC IMPORTANCE FACTOR 1.25
SITE CLASS D
S_s = 1.378g; S₁ = 0.480g
DESIGN SPECTRAL RESPONSE COEFF'S S_{D5} = 0.919g; S_{D1} = 0.486g
SEISMIC DESIGN CATEGORY D
SEISMIC FORCE-RESISTING SYSTEM Special Reinforced Masonry Shear Walls
DESIGN BASE SHEAR V_b = 42.8 K
SEISMIC RESPONSE COEFFICIENT C_s = 0.209
RESPONSE MODIFICATION COEFFICIENT R = 5.5
ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE PROCEDURE

GEOTECHNICAL DESIGN DATA

ALLOWABLE SOIL BEARING PRESSURE 3000 PSF

MATERIAL DATA:

CONCRETE & REINFORCING

CONCRETE WEIGHT ALL CONCRETE SHALL BE NORMAL-WEIGHT UNLESS NOTED OTHERWISE.

C.I.P. CONCRETE STRENGTH (MIN f'_c at 28 days) 5,000 PSI (AE)

MAX WATER/CEMENT RATIO 0.42 UNLESS OTHERWISE NOTED

CEMENT TYPE PORTLAND TYPE III - ASTM C150
AGGREGATES REGULAR WEIGHT HARDROCK TYPE - ASTM C33
ADMIXTURES ASTM C494
AIR-ENTRAINMENT ASTM C260
REINFORCING STEEL ASTM A615, GRADE 60, DEFORMED
WELDED WIRE REINFORCEMENT ASTM A1064, PROVIDE SHEET-TYPE; ROLL-TYPE IS NOT ACCEPTABLE

PERFORMED EXPANSION JOINT(1/2") ASTM D1751

STEEL

W SHAPES, WT SHAPES ASTM A992
M AND S SHAPES ASTM A36
HP SHAPES, PLATES ASTM A572, GRADE 50
C AND MC SHAPES, ANGLES ASTM A529, GRADE 50
HSS SQUARE AND RECTANGULAR TUBES ASTM A500 GRADE C, F_y = 50 ksi
HSS ROUNDS ASTM A500, GRADE C, F_y = 46 ksi
PIPES ASTM A53, GRADE B, F_y = 35 ksi
ANCHOR RODS ASTM F1554, GRADE 36
WASHERS FOR ANCHOR RODS ASTM F844
HIGH STRENGTH BOLTS ASTM F3125, GRADE 325 TYPE 1
ASTM F3125, GRADE 490 TYPE 1
WASHERS FOR HIGH STRENGTH BOLTS ASTM F436
TENSION INDICATING WASHERS ASTM F959
HEAVY HEX NUTS ASTM A563
STICK ELECTRODES AWS CLASS E70XX
AWS CLASS E6010 OR E6011 (GALV. SURFACES)
ASTM A108 GRADES C1010 THRU C1020 (Fu = 55 ksi)
ASTM A1008 OR ASTM A653
SJI CRITERIA
ASTM A1003 (G60 GALVANIZING PER ASTM A653 & C955)
S33H (F_y = 33 KSI)

MASONRY

ALL MATERIALS AND WORKMANSHIP SHALL COMPLY WITH TMS 602/ACI 530.1/ASCE 6.

MASONRY STRENGTH (f_m AT 28 DAYS) 1,500 PSI

CONCRETE MASONRY UNITS (CMU) ASTM C90 NORMAL WEIGHT
CMU STRENGTH 1,900 PSI (BASED ON NET AREA)
MORTAR TYPE ASTM C270, TYPE S ABOVE GRADE, TYPE M BELOW GRADE

GROUT TYPE ASTM C476 - MAX. AGGREGATE SIZE = 3/8"
GROUT STRENGTH (AT 28 DAYS) 2,000 PSI
HORIZONTAL WIRE REINFORCING ASTM A951, LADDER-TYPE AT 16" O.C
VERTICALLY IN 10 FT. LENGTHS
9 GAGE WIRE PER ASTM A1064
HOT DIP GALVANIZED
PER ASTM A 153 CLASS B-2
SPACING AS SHOWN ON THE DRAWINGS,
FULL HEIGHT UNLESS OTHERWISE

VERTICAL WALL REINFORCEMENT (2) #4 BARS CONTINUOUS, MIN. REFERENCE DRAWINGS
CONTINUOUS BOND BEAM REINFORCING RUBBER SHEAR KEY WITH DUROMETER HARDNESS OF 80 MIN
CONTRACTION JOINT KEY

WOOD

SAWN LUMBER
STUDS AND BLOCKING SPF, HEM FIR, OR DOUGLAS FIR - STUD GRADE
ALL SAWN LUMBER SHALL BE IDENTIFIED WITH GRADE MARK BY AN ENTITY COMPLYING WITH DOC PS 20

WOOD FASTENERS
NAILS AND STAPLES ASTM F1667
BOLTS, LAG SCREWS ANSI/ASME STANDARD B18.2.1
WOOD SCREWS ANSI/ASME STANDARD B18.6.1
FASTENERS FOR TREATED WOOD ASTM A 153 OR ASTM B 695, CLASS 55 MINIMUM

GENERAL NOTES

1. THE STRUCTURAL DRAWINGS ARE TO BE COORDINATED AND USED IN CONJUNCTION WITH THE CIVIL, ARCHITECTURAL/GENERAL ARRANGEMENT, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL/GENERAL ARRANGEMENT DRAWINGS AND IMMEDIATELY NOTIFY THE STRUCTURAL ENGINEER OF ANY DISCREPANCIES.

2. OLSSON SHALL NOT BE RESPONSIBLE FOR, NOR HAVE CHARGE OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES FOR THE SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THIS PROJECT AND SHALL NOT BE RESPONSIBLE FOR CONTRACTOR'S FAILURE TO CARRY OUT HIS WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

3. OLSSON SHALL NOT BE RESPONSIBLE FOR, NOR HAVE CONTROL OVER, THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTORS, ANY OF THEIR AGENTS OR EMPLOYEES, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

4. THE CONTRACTOR SHALL PROVIDE AND BE RESPONSIBLE FOR ALL TEMPORARY SHORINGS AND BRACING REQUIRED FOR THE CONSTRUCTION OF THIS PROJECT. ALL SHORING AND BRACING MEMBERS AND CONNECTIONS SHALL BE OF SUFFICIENT STRENGTH TO SUPPORT THE IMPOSED LOADS. TEMPORARY MEMBERS AND CONNECTIONS SHALL NOT BE REMOVED UNTIL PERMANENT MEMBERS ARE IN PLACE AND FINAL CONNECTIONS ARE MADE.

5. THE CONTRACTOR SHALL VERIFY IN FIELD ALL DIMENSIONS, ELEVATIONS, AND MEMBER SIZES AS SHOWN ON THE CONTRACT DRAWINGS FOR THE EXISTING CONSTRUCTION PRIOR TO THE DETAILING OF ANY NEW STRUCTURAL ELEMENT. THE CONTRACTOR SHALL DOCUMENT ANY CONSTRUCTION-RELATED DISCREPANCIES, PRIOR TO THE SCHEDULED START OF ANY DETAILING OR FABRICATION, THE CONTRACTOR SHALL FURNISH THE ABOVE INFORMATION IN THE FORM OF DETAILED SKETCHES TO THE STRUCTURAL ENGINEER FOR REVIEW.

6. THE CONTRACTOR SHALL PROVIDE ALL MEASURES AND PRECAUTIONS NECESSARY TO PREVENT DAMAGE AND/OR SETTLEMENT OF EXISTING OR NEW CONSTRUCTION INSIDE OR OUTSIDE THE PROJECT LIMITS DURING EXCAVATION AND FOLLOW-UP CONSTRUCTION. ANY DAMAGE TO NEW OR EXISTING CONSTRUCTION INSIDE OR OUTSIDE OF THE PROJECT LIMITS CAUSED BY CONSTRUCTION TECHNIQUES IS THE RESPONSIBILITY OF THE CONTRACTOR.

7. NO FIELD MODIFICATIONS TO ANY STRUCTURAL COMPONENTS SHALL BE MADE WITHOUT PRIOR APPROVAL BY THE STRUCTURAL ENGINEER. THIS INCLUDES, BUT IS NOT LIMITED TO, REVISIONS DUE TO MIS-LOCATION, MISFIT, OR ANY OTHER CONSTRUCTION ERRORS.

8. NO OPENING SHALL BE PLACED IN ANY STRUCTURAL MEMBER (OTHER THAN AS INDICATED ON APPROVED SHOP DRAWINGS) UNTIL THE LOCATION HAS BEEN APPROVED BY THE STRUCTURAL ENGINEER.

9. PROVIDE SLEEVE LAYOUTS FOR ALL PENETRATIONS THROUGH STRUCTURAL MEMBERS FOR ALL TRADES. LAYOUTS ARE TO BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW PRIOR TO CONSTRUCTION.

10. ALL ROOF MOUNTED EQUIPMENT OR EQUIPMENT SUSPENDED FROM FLOORS OR THE ROOF SHALL BE SUPPORTED BY BEAMS DESIGNATED FOR SUCH PURPOSE ONLY. IF NO SUPPORT HAS BEEN DESIGNATED OR IF A QUESTION ARISES, NOTIFY STRUCTURAL ENGINEER PRIOR TO ERECTION OF EQUIPMENT.

11. ALL DETAILS, SECTIONS, AND NOTES ON THE DRAWINGS ARE INTENDED TO BE TYPICAL FOR SIMILAR SITUATIONS ELSEWHERE UNLESS OTHERWISE NOTED. SEE THE ARCHITECTURAL/GENERAL ARRANGEMENT DRAWINGS FOR DETAILS AND DIMENSIONS NOT INDICATED ON THE STRUCTURAL DRAWINGS.

12. MATERIALS AND EQUIPMENT SHALL BE STORED AND TRANSPORTED IN A MANNER SO AS NOT TO EXCEED THE ALLOWABLE CAPACITY OF THE CONSTRUCTION.

13. THE SPECS AND REQUIREMENTS INDICATED ON THIS SHEET ARE INTENDED AS A BASIC SUMMARY OF THE MATERIAL, CONNECTION, AND INSPECTION REQUIREMENTS FOR THE PROJECT. ADDITIONAL, MORE STRINGENT REQUIREMENTS MAY BE GIVEN IN THE PROJECT SPECIFICATIONS. IN THE EVENT OF A CONFLICT BETWEEN THE REQUIREMENTS INDICATED ON THIS SHEET AND THOSE IN THE PROJECT SPECS, THE MORE STRINGENT REQUIREMENT SHALL GOVERN.

14. FOR LOCATIONS AND DIMENSIONS OF SLEEVES, CURBS, OPENINGS, AND DEPRESSIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS, SEE THE ARCHITECTURAL/GENERAL ARRANGEMENT, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS. CONTRACTOR SHALL VERIFY AND COORDINATE LOCATION OF ABOVE ITEMS WHETHER SHOWN ON THE STRUCTURAL DRAWINGS OR NOT.

15. EMBEDDED ITEMS, SUCH AS PIPE SLEEVES, CONDUITS, AND INSERTS, SHALL BE IN PLACE BEFORE CONCRETE IS POURED.

16. THE CONTRACTOR SHALL FOLLOW WRITTEN DIMENSIONS ONLY. DO NOT SCALE DRAWINGS.

17. THE STEEL FRAMING COMPONENTS SHOWN RELY ON BUILDING COMPONENTS OTHER THAN STRUCTURAL STEEL FOR FINAL STRUCTURAL STABILITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DESIGN AND PROVISION OF ANY AND ALL TEMPORARY BRACING AND SHORING AGAINST WIND, ERECTION AND ALL CONSTRUCTION LOADS UNTIL ALL ELEMENTS, MEMBERS, AND CONNECTIONS (FLOORS, ROOF, SHEAR WALLS, ETC.) AS SHOWN ON THE CONTRACT DOCUMENTS ARE COMPLETELY INSTALLED. THE STRUCTURAL MEMBERS SHOWN ON THE CONTRACT DOCUMENTS ARE DESIGNED FOR THE ANTICIPATED LOADS THAT THE STRUCTURE WILL BE SUBJECTED TO ONLY AFTER ALL STRUCTURAL ELEMENTS ARE IN PLACE AND FINAL CONNECTIONS ARE COMPLETE.

SHOP DRAWINGS

1. ALL SHOP DRAWING SUBMITTALS SHALL BE AS DESCRIBED IN THE PROJECT SPECIFICATIONS OR IN THESE NOTES.

2. SHOP DRAWINGS AND RELATED MATERIALS PREPARED BY SUPPLIERS AND SUBCONTRACTORS SHALL BE REVIEWED BY THE GENERAL CONTRACTOR PRIOR TO SUBMITTING TO THE STRUCTURAL ENGINEER.

3. THE GENERAL CONTRACTOR SHALL REVIEW ALL SUBMISSIONS FOR CONFORMANCE WITH THE CONTRACT DOCUMENTS, MEANS, METHODS, TECHNIQUES, SEQUENCES, AND OPERATION OF CONSTRUCTION, TECHNICAL CONTENT, COORDINATION OF TRADES, DIMENSIONAL ACCURACY, SAFETY PRECAUTIONS AND PROGRAMS INCIDENTAL THERETO, ALL OF WHICH ARE THE SOLE RESPONSIBILITY OF THE GENERAL CONTRACTOR.

4. THE GENERAL CONTRACTOR SHALL APPROVE AND SO STAMP EACH SUBMISSION.

5. SHOP SUBMITTALS SHALL BE SUBMITTED IN A DIGITAL FORMAT. MULTIPLE COPIES OF DRAWINGS WILL NOT BE MARKED-UP WITH REVIEW COMMENTS.

6. THE STRUCTURAL DRAWINGS SHALL NOT BE USED AS BACKGROUNDS FOR THE PRODUCTION OF ANY SHOP DRAWINGS THAT ARE SUBMITTED FOR REVIEW.

7. ANY DEVIATIONS FROM THE ORIGINAL DESIGN OR DESIGN CRITERIA AS SPECIFIED ON THE "FOR CONSTRUCTION" DESIGN DOCUMENTS OF THE PROJECT SHALL BE BOLDLY NOTED ON THE SHOP DRAWINGS THAT ARE SUBMITTED FOR APPROVAL.

8. ALL CHANGES TO RESUBMITTED SHOP DRAWINGS SHALL BE BUBBLED.

EARTHWORK

1. REFERENCE THE GEOTECHNICAL INVESTIGATION REPORT PREPARED BY ANDERSON ENGINEERING CONSULTANTS, INC., DATED 07-15-2019. CONTRACTOR SHALL OBTAIN A COPY OF SAID REPORT AND ANY AVAILABLE ADDENDA OR SUPPLEMENTS AND FOLLOW ALL REQUIREMENTS SPECIFIED THEREIN.

2. SHALLOW FOUNDATIONS: CONTINUOUS WALL FOOTINGS, ISOLATED SPREAD FOOTINGS, AND GROUND SUPPORTED MAT FOUNDATIONS HAVE BEEN DESIGNED TO BEAR ON FIRM NATIVE SOILS OR COMPACTED ENGINEERED FILL. REFER TO THE SOILS REPORT FOR SPECIFIC SOIL PREPARATION REQUIREMENTS.

3. ALL UNSUITABLE SOILS SHALL BE REMOVED WITHIN THE EXCAVATION AREA OF THE FOUNDATIONS. ALL FOOTINGS SHALL BEAR ON VIRGIN SOIL OR PROPERLY PLACED AND COMPACTED ENGINEERED FILL.

4. FOUNDATIONS EXPOSED TO FROST SHALL BE PLACED SUCH THAT THE BOTTOM OF FOUNDATION IS AT LEAST 18" BELOW THE ADJACENT FINISHED GRADE.

5. SHOULD UNSUITABLE BEARING CONDITIONS BE ENCOUNTERED DURING EXCAVATION, NOTIFY THE OWNER, ENGINEER, AND STRUCTURAL ENGINEER BEFORE CONTINUING WITH CONSTRUCTION.

6. THE CONTRACTOR MUST PROVIDE SURFACE DRAINAGE AND PUMPS TO PROTECT ALL EXCAVATION FROM FLOODING. FLOODING OF ANY EXCAVATION AFTER APPROVAL OF THE SUBGRADE WILL BE CAUSE FOR RE-PREPARATION AND RE-APPROVAL OF THE SUBGRADE.

7. THE CONTRACTOR SHALL PROVIDE ALL NECESSARY MEASURES TO PREVENT ANY WATER, FROST, OR ICE FROM PENETRATING ANY FOOTING OR SLAB SUBGRADE BEFORE AND AFTER PLACING OF CONCRETE AND UNTIL SUCH SUBGRADES ARE FULLY PROTECTED BY THE PERMANENT BUILDING STRUCTURE.

8. RECORDS OF ANY EXISTING SUBGRADE INTERFERENCES, OTHER THAN THOSE INTERFERENCES SHOWN OR INDICATED ON THE CIVIL CONSTRUCTION DOCUMENTS, ARE NOT CURRENTLY AVAILABLE. DURING EXCAVATION WORK, INTERFERENCES MAY BE DISCOVERED. CONTRACTOR SHALL DOCUMENT CONSTRUCTION-RELATED DIMENSIONS OF ALL INTERFERENCES. CONTRACTOR SHALL FURNISH THE ABOVE INFORMATION IN THE FORM OF DETAILED SKETCHES TO THE STRUCTURAL ENGINEER FOR REVIEW.

9. DO NOT BACKFILL AGAINST FOUNDATION WALLS UNTIL THE PERMANENT BELOW-GRADE LATERAL BRACING SYSTEM IS IN PLACE AND THE CONCRETE HAS ATTAINED FULL DESIGN STRENGTH.

10. ALL SLABS-ON-GRADE SHALL BE PLACED OVER A LOW PERMEANCE VAPOR BARRIER, 10 MIL MINIMUM THICKNESS, OVER A BASE/SUBBASE AS SPECIFIED BY THE GEOTECHNICAL ENGINEER FOR THE PROJECT. EXISTING SUBBASE WILL BE COMPACTED IN PLACE OR WILL BE CUT OUT AND REPLACED WITH AN ENGINEERED FILL AS SPECIFIED BY THE GEOTECHNICAL ENGINEER.

11. FLOWABLE FILL FOR USE AS FOUNDATION SUPPORT IS DEFINED AS CONTROLLED LOW STRENGTH MATERIAL (CLSM)
A. FLOWABLE FILL IS NOT INTENDED TO BE EXCAVATABLE IN THE FUTURE.
B. PROVIDE CONCRETE CONTRACTOR'S STANDARD MIX FOR FLOWABLE FILL THAT MEETS THE FOLLOWING REQUIREMENTS:
a. CONFORM TO THE RECOMMENDATIONS OF ACI 229R.
b. 28 DAY MINIMUM COMPRESSIVE STRENGTHS OF 300PSI.
c. MIXTURE SHALL FLOW INTO PLACE AND CONSOLIDATE DUE TO ITS FLUIDITY WITHOUT VIBRATION OR PUDLING ACTION.
d. LIMIT SUBSIDENCE OF FLOWABLE FILL TO 1/8" PER FOOT OF DEPTH
e. CURING PROCEDURES ARE NOT REQUIRED, BUT PROTECT FROM FREEZING UNTIL MIX HAS HARDENED.

12. REFER TO THE TESTING AND INSPECTION SECTION OF THESE NOTES FOR THE FOUNDATION TESTING AND INSPECTION REQUIREMENTS.

STRUCTURAL CONCRETE

1. CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITIONS OF THE FOLLOWING REFERENCE DOCUMENTS UNLESS INDICATED OTHERWISE:
A. ACI 301 - "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS"
B. ACI 302 - "RECOMMENDED PRACTICE FOR CONCRETE FLOOR AND SLAB CONSTRUCTION"
C. ACI 304 - "ACI MANUAL OF CONCRETE INSPECTION"
D. ACI 311 - "RECOMMENDED PRACTICE FOR MEASURING, MIXING, TRANSPORTING, AND PLACING CONCRETE"
E. ACI 315 - "DETAILS AND DETAILING OF CONCRETE REINFORCEMENT"
F. ACI 318 - "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE"
G. ACI 347 - "RECOMMENDED PRACTICE FOR CONCRETE FORMWORK"

2. CONCRETE MIX FOR INTERIOR CONCRETE SLABS-ON-GRADE SHALL ADHERE TO THE FOLLOWING CRITERIA:
A. FLY ASH MAY REPLACE 15% OF PORTLAND CEMENT MAXIMUM.
a. DO NOT USE POZZOLANS IN MIXES FOR FINISHED FLOOR SLABS.
B. AGGREGATE SHALL BE WELL GRADED WITH 1-1/2" MAXIMUM DIAMETER.
C. THE MIX SHALL CONTAIN NO ADMIXTURES THAT EXACERBATE SHRINKAGE.

3. FLY ASH MAY REPLACE 15% OF PORTLAND CEMENT MAXIMUM IN STRUCTURAL SLABS.

4. CURE SPECIFIC CONCRETE ELEMENTS AS INDICATED BELOW:
A. SLAB-ON-GRADE: MOISTURE-RETAINING COVER CURING.
B. STRUCTURAL SLABS: MOISTURE-RETAINING COVER CURING.

5. LABORATORY TEST REPORTS OR MATERIAL CERTIFICATES FOR CONCRETE MATERIALS AND MIX DESIGN TEST DATA, IN CONFORMANCE WITH ACI STANDARDS, SHALL BE SUBMITTED FOR REVIEW FOR EACH TYPE OF CONCRETE TO BE USED. EACH SUBMITTED MIX DESIGN SHALL IDENTIFY THE APPLICATION FOR WHICH THE MIX WILL BE USED.

6. THE CONTRACTOR SHALL SUBMIT CHECKED, DETAILED REINFORCEMENT SHOP DRAWINGS SHOWING THE LOCATIONS AND DETAILING OF ALL FOOTINGS, WALLS, PIERS, BEAMS, COLUMNS, SLABS, CONSTRUCTION JOINTS, CONTROL JOINTS, ETC, PRIOR TO FABRICATION. DETAILS SHALL INCLUDE BAR SIZES, LAPS, SPACING, AND PLACEMENT.

7. WELDED WIRE FABRIC SHALL BE LAPPED TWO PANELS AT EDGES AND ENDS, AND TIED SECURELY.

8. THE MINIMUM CONCRETE COVER FOR CAST-IN-PLACE (NON-PRESTRESSED) CONCRETE SHALL BE IN ACCORDANCE WITH THE FOLLOWING:
A. CONCRETE CAST AGAINST/PERMANENTLY EXPOSED TO EARTH: 3"
B. CONCRETE EXPOSED TO EARTH OR WEATHER:
a. NO 6 THROUGH NO 18 BARS 2"
b. NO 5 BAR, W#1 OR D31 WIRE, AND SMALLER 2"
C. CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND:
a. SLABS, WALLS, JOISTS:
• NO 14 AND NO 18 BARS 1 1/2"
• NO 11 BAR AND SMALLER 3/4"
b. BEAMS, COLUMNS:
• PRIMARY REINFORCEMENT 1 1/2"
• TIES, STIRRUPS, SPIRALS 1 1/2"

9. PROVIDE LAP SPLICES AS DETAILED IN THE DRAWINGS.

10. ALL HOOKS SHALL BE "STANDARD" PER ACI SPECIFICATIONS.

11. CONTINUOUS TOP AND BOTTOM BARS SHALL BE SPLICED AS FOLLOWS:
A. TOP BARS: AT MID SPAN
B. BOTTOM BARS: CENTERED OVER SUPPORT

12. CORNER BARS MATCHING HORIZONTAL BARS SHALL BE PROVIDED AT ALL WALL CORNERS AND INTERSECTIONS UNLESS INDICATED OTHERWISE.

13. ELECTRICAL CONDUITS AND PLUMBING PIPES IN ELEVATED STRUCTURAL SLABS SHALL BE PLACED BETWEEN THE TOP AND BOTTOM LAYERS OF REINFORCEMENT AND SHALL NOT HAVE AN OUTSIDE DIAMETER GREATER THAN ONE-THIRD THE SLAB THICKNESS. CROSSOVERS OF CONDUITS AND/OR PIPES SHALL NOT BE PERMITTED. THE CENTER-TO-CENTER DISTANCE BETWEEN CONDUITS AND/OR PLUMBING PIPES SHALL NOT BE LESS THAN THREE TIMES THE LARGEST CONDUIT OR PIPE DIAMETER OR WIDTH. NO CONDUITS SHALL BE PLACED WITHIN 12" OF A COLUMN FACE.

STRUCTURAL CONCRETE WATER RETAINING STRUCTURES

1. CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITIONS OF THE FOLLOWING REFERENCE DOCUMENTS UNLESS INDICATED OTHERWISE:
A. ACI 325 - "JOINTS IN CONCRETE CONSTRUCTION"
B. ACI 301 - "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS"
C. ACI 302 - "RECOMMENDED PRACTICE FOR CONCRETE FLOOR AND SLAB CONSTRUCTION"
D. ACI 304 - "ACI MANUAL OF CONCRETE INSPECTION"
E. ACI 311 - "RECOMMENDED PRACTICE FOR MEASURING, MIXING, TRANSPORTING, AND PLACING CONCRETE"
F. ACI 315 - "DETAILS AND DETAILING OF CONCRETE REINFORCEMENT"
G. ACI 350 - "CODE REQUIREMENTS FOR ENVIRONMENTAL ENGINEERING CONCRETE STRUCTURES AND COMMENTARY"
H. ACI 347 - "RECOMMENDED PRACTICE FOR CONCRETE FORMWORK"

2. CONCRETE MIX DESIGN REQUIREMENTS:
A. MINIMUM CONCRETE COMPRESSIVE STRENGTH - 5,000 PSI
B. MAXIMUM WATER TO CEMENT RATIO - 0.42
C. MAXIMUM FLY ASH - 15% OF PORTLAND MIX

3. ALL CONCRETE SHALL BE WET CURED FOR A MINIMUM OF 7 DAYS.

4. UTILIZE EXACT CONSTRUCTION JOINT LOCATIONS SHOWN ON PLAN. NO SUBSTITUTIONS OR MODIFICATIONS SHALL BE ACCEPTABLE WITHOUT EOR APPROVAL.

5. ALL PVC WATERSTOP INTERSECTIONS SHALL BE PRE-WELDED BY THE MANUFACTURER.

6. LABORATORY TEST REPORTS OR MATERIAL CERTIFICATES FOR CONCRETE MATERIALS AND MIX DESIGN TEST DATA, IN CONFORMANCE WITH ACI STANDARDS AND AS INDICATED IN THE PROJECT SPECIFICATIONS BOOK, SHALL BE SUBMITTED FOR REVIEW FOR EACH TYPE OF CONCRETE TO BE USED. EACH SUBMITTED MIX DESIGN SHALL IDENTIFY THE APPLICATION FOR WHICH THE MIX WILL BE USED.

7. THE CONTRACTOR SHALL SUBMIT CHECKED, DETAILED REINFORCEMENT SHOP DRAWINGS SHOWING THE LOCATIONS AND DETAILING OF ALL FOOTINGS, WALLS, PIERS, BEAMS, COLUMNS, SLABS, CONSTRUCTION JOINTS, CONTROL JOINTS, ETC, PRIOR TO FABRICATION. DETAILS SHALL INCLUDE BAR SIZES, LAPS, SPACING, AND PLACEMENT.

8. THE MINIMUM CONCRETE COVER FOR CAST-IN-PLACE (NON-PRESTRESSED) CONCRETE SHALL BE IN ACCORDANCE WITH ACI 350.

9. PROVIDE LAP SPLICES OF 1.7xDEVELOPMENT LENGTH UNLESS NOTED OTHERWISE.

10. ALL HOOKS SHALL BE "STANDARD" PER ACI SPECIFICATIONS UNLESS NOTED OTHERWISE.

11. CORNER BARS MATCHING HORIZONTAL BARS SHALL BE PROVIDED AT ALL WALL CORNERS AND INTERSECTIONS UNLESS INDICATED OTHERWISE, SEE TYPICAL DETAILS FOR FURTHER INFORMATION

12. BASIN SHALL BE FILLED WITH WATER AS SOON AS PRACTICAL TO IDENTIFY ANY LEAKS. LEAKING AREAS SHALL BE PATCHED WITH XYPEX CONCENTRATE AND XYPEX PATCH AND PLUG. FOLLOW MANUFACTURERS RECOMMENDATIONS FOR SURFACE PREP AND APPLICATION.

STRUCTURAL STEEL

1. ALL STRUCTURAL STEEL SHALL BE DETAILED, FABRICATED AND ERECTED IN ACCORDANCE WITH THE LATEST EDITION OF AISC 303 "CODE OF STANDARD PRACTICE FOR STEEL BUILDING AND BRIDGES".

2. THE STEEL FABRICATOR/ERECTOR SHALL DOCUMENT ANY CONSTRUCTION RELATED DISCREPANCIES AND SHALL FURNISH SAID INFORMATION IN THE FORM OF DETAILED SKETCHES TO THE STRUCTURAL ENGINEER FOR REVIEW. THERE SHALL BE RESOLUTION TO THE NOTED DISCREPANCIES PRIOR TO FABRICATION OF ANY NEW STRUCTURAL ELEMENTS.

3. THE FABRICATOR SHALL SUBMIT TO THE ENGINEER FOR REVIEW, ENGINEERED AND CHECKED DRAWINGS SHOWING FABRICATION DETAILS, FIELD ASSEMBLY DETAILS, AND ERECTION DIAGRAM FOR ALL STRUCTURAL STEEL ELEMENTS.

4. ALL BEAMS AND JOISTS SHALL BE FABRICATED WITH THE NATURAL CAMBER UP.

5. THE FOLLOWING INFORMATON IS PRESENTED AS REQUIRED BY AISC 330 SECTION 3.1:
A. ALL SHEAR CONNECTIONS, UNLESS SPECIFICALLY DETAILED, SHALL BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER EMPLOYED BY THE FABRICATOR FOR THE BEAM END REACTIONS SHOWN ON THE FRAMING PLANS (OPTION 3 PER AISC 330 SECTION 3.1.1 (3)).
B. ALL END REACTIONS ARE LISTED AT FACTORED LEVELS AND CONNECTIONS SHALL BE DESIGNED USING LRFD METHODS.
C. ALL MOMENT CONNECTIONS AND SPECIAL SHEAR CONNECTIONS HAVE BEEN DESIGNED BY THE EOR AND ARE INCLUDED IN THESE DRAWINGS. (OPTION 1 PER AISC 330 SECTION 1.1 (3))
D. FABRICATOR SHALL SUBMIT REPRESENTATIVE SAMPLES OF THE THE REQUIRED SUBSTANTIATING CONNECTION INFORMATION EARLY IN THE CONNECTION DESIGN PROCESS FOR REVIEW BY THE EOR.
a. INFORMATION SHALL INCLUDE A SKETCH OF THE CONNECTION AND CALCULATIONS DETERMINING CONNECTION LIMIT STATE VALUES. THE GOVERNING LIMIT STATE SHALL BE HIGHLIGHTED.
b. EOR SHALL RESPOND IN WRITING CONFIRMING THAT THE SUBMITTED REPRESENTATIVE SAMPLES ARE CONSISTENT WITH THE REQUIREMENTS IN THE CONTRACT DOCUMENTS, OR SHALL ADVISE WHAT MODIFICATONS ARE REQUIRED TO BRING THE REPRESENTATIVE SAMPLES INTO COMPLIANCE WITH THE REQUIREMENTS IN THE CONTRACT DOCUMENTS.
c. THE LICENSED PROFESSIONAL ENGINEER IN RESPONSIBLE CHARGE OF THE CONNECTION DESIGN SHALL REVIEW AND CONFIRM IN WRITING AS PART OF THE SUBSTANTIATING CONNECTION INFORMATION, THAT THE SHOP AND ERECTION DRAWINGS PROPERLY INCORPORATE THE CONNECTION DESIGNS.

6. ALL WELDING SHALL BE PERFORMED BY CERTIFIED/QUALIFIED WELDERS AND SHALL CONFORM TO THE LATEST EDITION OF AWS D1.1 "STRUCTURAL WELDING CODE - STEEL".

7. ALL BOLTED STEEL CONNECTIONS SHALL UTILIZE HIGH STRENGTH BOLTS IN BEARING-TYPE CONNECTIONS, UNLESS OTHERWISE NOTED. TENSION-CONTROLLED BOLTS (T/C BOLTS) MAY BE USED AT THE ERECTOR'S DISCRETION.

8. BOLTS ARE TO BE TIGHTENED, AT A MINIMUM, TO THE "SNUG TIGHT" CONDITION, UNLESS NOTED AS "PRETENSIONED" OR "SLIP CRITICAL".

9. BOLTS DESIGNATED AS "PRETENSIONED" OR "SLIP CRITICAL" ARE TO BE TIGHTENED IN ACCORDANCE WITH AN APPROVED METHOD OUTLINED IN THE AISC SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS.

10. THERE SHALL BE NO FIELD CUTTING OF STRUCTURAL STEEL MEMBERS WITHOUT THE PRIOR APPROVAL OF THE STRUCTURAL ENGINEER. REFER TO DRAWINGS FOR MISCELLANEOUS STEEL NOT SHOWN ON STRUCTURAL DRAWINGS.

olsson

302 E. Millisap Road
Fayetteville, AR 72703

TEL 479.443.3404
FAX 479.443.4340

www.olsson.com

REVISIONS

2020

STRUCTURAL NOTES

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K.ROWETT
checked by: A.STENGEL
approved by: C.HARDIN
QA/QC by: M.MILLIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
GS001

MISCELLANEOUS METALS

- ALL GRATINGS SHALL BE ALUMINUM I-BAR GRATING, UNLESS OTHERWISE NOTED.
- GRATING SHALL SPAN AS INDICATED ON THE DESIGN DRAWINGS. BEARING AND TWISTED BARS SHALL BE ALIGNED.
- GRATING SHALL BE BANDED AT OPENINGS IN PLATFORMS AROUND REMOVABLE PANELS OR AT LOCATIONS CALLED FOR ON THE DESIGN DRAWINGS. NOSING SHALL BE PROVIDED AT ALL STAIR TREADS AND TOP OF ALL LANDINGS.
- GRATING SHALL BE NEATLY CUT AND FITTED AROUND COLUMNNS, EQUIPMENT SUPPORT LEGS, PIPING, DUCTION, ETC. TOE PLATE MAY BE REQUIRED AT SPECIFIC LOCATIONS PER IBC AND OSHA REQUIREMENT.
- STAIRS, LADDERS, HANDRAILS, AND OTHER MISCELLANEOUS DETAILS SHALL CONFORM TO THE STANDARD DETAILS SHOWN ON THE DRAWINGS.
- ALL CHECKER PLATE SHALL BE 1/4" THICK, UNLESS OTHERWISE NOTED.
 - FIXED CHECKER PLATE IS TO BE WELDED TO STRUCTURAL MEMBERS WITH 3/16" STITCH WELDS AT EDGES 4" LONG AT 24" OC, PLUS 3/4" SLOT WELDS AT 24" OC FOR ALL INTERIOR SUPPORTS.
 - REMOVABLE CHECKER PLATE IS TO BE DRILLED AND COUNTERSUNK FOR FASTENING TO STRUCTURAL MEMBERS WITH 3/8"x1" FLAT HEAD SOCKET CAP SCREWS AT 24" OC MAXIMUM PLUS 2" EACH CORNER.
- PROVIDE MISCELLANEOUS SUPPORT MEMBERS FOR GRATING WHERE GRATING BEARING AREA ON BEAM TOP FLANGE IS OBSTRUCTED BY EQUIPMENT OR OTHER STRUCTURAL MEMBERS.
- ALL KICK PLATES SHALL EXTEND A MINIMUM OF 4" ABOVE WALKING SURFACE WITH A MAXIMUM OF 1/4" BETWEEN KICKPLATE AND FINISHED FLOOR.
- PROVIDE GALVANIZED FASTENERS FOR ALL BOLTED CONNECTIONS WHERE ONE OR MORE MEMBERS OR ELEMENTS ARE OF GALVANIZED MATERIAL.
- MISCELLANEOUS ANCHOR BOLTS, POST-INSTALLED ANCHORS, AND FASTENERS NOT INDICATED, BUT REQUIRED FOR ANCHORAGE OF EQUIPMENT AND MATERIALS, SHALL BE PROVIDED (AS RECOMMENDED BY MANUFACTURER OF ITEMS), ANCHORAGE WILL BE SUBJECT TO REVIEW BY ENGINEER.

POST-INSTALLED ANCHORS

- ALL POST-INSTALLED ANCHORS SHALL BE STAINLESS STEEL ADHESIVE ANCHORS UNLESS INDICATED OR APPROVED OTHERWISE.
- ADHESIVE ANCHORS:
 - EPOXY: HILTI HIT-HY 200 WITH SAFESET APPLICATION OR AUTHORIZED EQUAL, UNLESS OTHERWISE SPECIFIED.
 - MINIMUM EMBEDMENT SHALL BE 9 TIMES ANCHOR DIAMETER UNLESS OTHERWISE SPECIFIED OR LIMITED BY THICKNESS OF CONCRETE.
- ALL POST-INSTALLED ANCHORS SHALL BE INSTALLED BY QUALIFIED INDIVIDUALS IN STRICT CONFORMANCE TO THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- ALL POST-INSTALLED ANCHORS SHALL CONFORM TO THE REQUIREMENTS OF THE MOST RECENT VERSIONS OF ACI 355.2 OR ACI 355.4.

REINFORCED MASONRY

- PLACING CONCRETE MASONRY UNITS:
 - USE RUNNING BOND. FULLY BOND CORNERS BY OVERLAPPING OF UNITS. BOND WALL INTERSECTIONS WITH CORROSION-RESISTANT 1'-8"x4" STRAP ANCHORS SPACED AT 16" OC VERTICALLY.
 - PLACE CONTINUOUS HORIZONTAL JOINT REINFORCEMENT EVERY SECOND BED JOINT. PLACE REINFORCEMENT AT FIRST AND SECOND JOINTS ABOVE AND BELOW OPENINGS. LAP SPLICES 6" MINIMUM.
 - MAINTAIN FLUSH FACE ON EXPOSED MASONRY SURFACES.
 - FACE SHELLS: FULLY MORTARED.
 - WEBS: FULLY MORTARED IN PIERS. PLASTERS, STARTING COURSE AT FOUNDATION OR FLOOR LEVEL AND WHERE ADJACENT CELLS OR CAVITIES ARE TO BE GROUTED.
 - HEAD SHELLS: MORTARED FROM EACH FACE EQUAL TO THE FACE SHELL THICKNESS.
 - KEEP VERTICAL CELLS THAT ARE TO BE GROUTED ALIGNED AND FREE FROM OBSTRUCTIONS AND MORTAR FINS.
 - DO NOT LAY DAMAGED UNITS.
 - PERFORM JOB SITE CUTTING WITH PROPER TOOLS TO PROVIDE STRAIGHT AND TRUE UNCHIPPED EDGES.
 - TOOL JOINTS WHEN MORTAR IS THUMB PRINT HARD TO FORM CONCAVE JOINTS.
 - COVER TOP OF UNFINISHED MASONRY WORK.
- GROUTING:
 - VERIFY REINFORCEMENT IS PROPERLY PLACED AND SECURED IN POSITION PRIOR TO GROUTING.
 - ALL BOND BEAMS SHALL BE GROUTED SOLID.
 - FULLY GROUT CELLS AT EACH SIDE OF OPENINGS AND CONTROL JOINTS WITH (1) #5 BAR PLACED IN CENTER OF CELL, UNLESS OTHERWISE SHOWN ON DRAWINGS.
 - PLACE GROUT IN LIFTS NOT EXCEEDING 5'-0". CONSOLIDATE AT TIME OF PLACEMENT BY RODDING OR VIBRATING FOLLOWED BY RECONSOLIDATION LATER BEFORE PLASTICITY IS LOST.
- HOT AND COLD WEATHER CONDITIONS:
 - COLD WEATHER: CONFORM TO THE REQUIREMENTS OF ACI/ASCE 530 WHEN THE AMBIENT TEMPERATURE FALLS BELOW 40°F.
 - HOT WEATHER: WHEN AIR TEMPERATURE EXCEEDS 90°F DO NOT SPREAD MORTAR BED MORE THAN 4'-0" AHEAD OF MASONRY. SET MASONRY UNITS WITHIN ONE MINUTE OF SPREADING MORTAR.
- CONSTRUCTION PRECAUTIONS:
 - ADEQUATELY BRACE ALL WALLS DURING CONSTRUCTION.
 - IF INTERIOR WALLS ARE CONSTRUCTED PRIOR TO ENCLOSURE OF STRUCTURE, PROVIDE ADEQUATE TEMPORARY BRACING. REMOVE BRACING AFTER STRUCTURE IS ENCLOSED.
 - DO NOT EMBED ALUMINUM CONDUIT, PIPE OR ACCESSORIES IN MASONRY.

TESTING AND INSPECTIONS

- THE TESTING AGENCY SHALL BE RETAINED BY THE OWNER.
- THE TESTING AGENCY SHALL BE THE "SPECIAL INSPECTOR".
- THE TESTING AGENCY SHALL SUBMIT TO THE ENGINEER ONE ELECTRONIC COPY OF WEEKLY REPORTS OF THE TESTS AND INSPECTIONS CONDUCTED DURING THE WEEK. THE REPORT SHALL STATE IF THE TESTS AND INSPECTIONS MET THE PROJECT REQUIREMENTS AND, IF NOT, WHAT FOLLOW-UP TESTS OR INSPECTIONS WILL BE MADE.
- AT THE END OF THE PROJECT, THE TESTING AGENCY SHALL SUBMIT ONE ELECTRONIC COPY OF A SUMMARY REPORT OF ALL TESTS AND INSPECTIONS MADE TO THE ENGINEER. THE SUMMARY REPORT SHALL STATE THAT THE TESTS AND INSPECTIONS MET THE PROJECT REQUIREMENTS. ANY TEST OR INSPECTION THAT FAILED TO MEET PROJECT REQUIREMENTS SHALL BE NOTED. SUBMIT COPIES OF CORRESPONDENCE SHOWING ACCEPTANCE OR REJECTION OF THE MATERIAL OR WORKMANSHIP THAT FAILED TESTS OR INSPECTIONS.

FOUNDATION INSPECTION

- ALL FOUNDATION EXCAVATIONS SHALL BE OBSERVED AND TESTED BY A REPRESENTATIVE OF A QUALIFIED GEOTECHNICAL ENGINEERING FIRM. DAILY REPORTS OF OBSERVATIONS SHALL BE PREPARED. ALL REPORTS ARE TO BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW. THE REQUIRED TEST TYPE AND FREQUENCY SHALL BE AS SPECIFIED IN THE PROJECT SPECIFICATIONS.
- SEE PROJECT SPECIFICATIONS FOR ADDITIONAL TESTING AND INSPECTION REQUIREMENTS.

REINFORCED CONCRETE INSPECTION

- PROVIDE CONTINUOUS INSPECTION OF THE FOLLOWING:
 - ANCHOR RODS OR OTHER BOLTS INSTALLED IN CONCRETE PRIOR TO AND DURING PLACEMENT OF CONCRETE.
 - SAMPLING OF FRESH CONCRETE FOR SLUMP, AIR CONTENT AND TEMPERATURE AT THE TIME OF MAKING SPECIMENS FOR STRENGTH TESTS.
 - CONCRETE PLACEMENT.
- PROVIDE PERIODIC INSPECTION AND VERIFICATION OF THE FOLLOWING:
 - REINFORCING STEEL PLACEMENT INCLUDING REINFORCING SIZE, LENGTHS, POSITION, SHAPES, SPACING, NUMBER OF BARS, REINFORCING TYPE, GRADE, FINISH, CLEANNESS, AND CONCRETE COVER TO FORMWORK AND TO TOP OF SLABS.
 - BAR SUPPORT TYPE, FINISH, AND LOCATION AND HEIGHT OF BAR SUPPORT.
 - CONDITION OF REINFORCING AND SUPPORTS, CHECKING FOR DAMAGE INCLUDING BENDS NOT DETAILED, EXCESSIVE RUST, AND REPAIR OF COATINGS.
 - PLACEMENT OF ADDITIONAL STEEL AS REQUIRED BY DETAILS AT OPENINGS, SLEEVES, EDGE OF SLABS, AND OTHER TYPICAL DETAILS.
 - USE OF REQUIRED CONCRETE MIX.
 - MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.
- TESTING FREQUENCY: OBTAIN ONE COMPOSITE SAMPLE FOR EACH 50 CUBIC YARDS OR FRACTION THEREOF OF EACH CONCRETE MIX PLACED EACH DAY. WHEN FREQUENCY OF TESTING WILL PROVIDE FEWER THAN FIVE COMPRESSIVE STRENGTH TESTS FOR EACH CONCRETE MIX, TESTING SHALL BE CONDUCTED FROM AT LEAST FIVE RANDOMLY SELECTED BATCHES OR FROM EACH BATCH IF FEWER THAN FIVE ARE USED.
- PERFORM THE FOLLOWING TESTS:
 - SLUMP: ASTM C 143; ONE TEST AT POINT OF PLACEMENT FOR EACH COMPOSITE SAMPLE, BUT NOT LESS THAN ONE TEST FOR EACH DAY'S POUR OF EACH CONCRETE MIX. PERFORM ADDITIONAL TESTS WHEN CONCRETE CONSISTENCY APPEARS TO CHANGE.
 - AIR CONTENT: ASTM C 231, PRESSURE METHOD, FOR NORMAL WEIGHT CONCRETE; ASTM C 173, VOLUMETRIC METHOD, FOR LIGHTWEIGHT CONCRETE; ONE TEST FOR EACH COMPOSITE SAMPLE, BUT NOT LESS THAN ONE TEST FOR EACH DAY'S POUR OF EACH CONCRETE MIX.
 - CONCRETE TEMPERATURE: ASTM C 1064; ONE TEST HOURLY WHEN AIR TEMPERATURE IS 40 DEG F AND BELOW AND WHEN 80 DEG F AND ABOVE, AND ONE TEST FOR EACH COMPOSITE SAMPLE.
 - UNIT WEIGHT: ASTM C 567; FRESH UNIT WEIGHT OF LIGHTWEIGHT CONCRETE; ONE TEST FOR EACH COMPOSITE SAMPLE, BUT NOT LESS THAN ONE TEST FOR EACH DAY'S POUR OF EACH CONCRETE MIX.
 - COMPRESSIVE TEST SPECIMENS: ASTM C 31; CAST AND LABORATORY CURE ONE SET OF FIVE STANDARD CYLINDER SPECIMENS FOR EACH COMPOSITE SAMPLE. CAST AND FIELD CURE ONE SET OF THREE STANDARD CYLINDER SPECIMENS FOR EACH COMPOSITE SAMPLE.
 - COMPRESSIVE-STRENGTH TESTS: ASTM C39; TEST TWO LABORATORY CURED SPECIMENS AT 7 DAYS AND TWO AT 28 DAYS. RESERVE ONE CYLINDER FOR FURTHER TESTING IF NECESSARY. TEST ONE FIELD CURED SPECIMEN AT 7 DAYS AND TWO AT 28 DAYS. WHEN STRENGTH OF FIELD CURED CYLINDERS IS LESS THAN 85% OF COMPANION LABORATORY CURED CYLINDERS, CONTRACTOR SHALL EVALUATE OPERATIONS AND METHODS.
- SEE PROJECT SPECIFICATIONS FOR ADDITIONAL TESTING AND INSPECTION REQUIREMENTS

TESTING AND INSPECTIONS-CONTINUED

STRUCTURAL STEEL INSPECTION

- SHOP INSPECTIONS
 - MATERIAL VERIFICATION OF STRUCTURAL STEEL:
 - IDENTIFICATION OF MARKINGS TO CONFORM TO STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS.
 - SUBMIT COPIES OF MANUFACTURER'S CERTIFIED MILL TEST REPORTS.
- WELDING:
 - REVIEW WELDING PROCEDURES.
 - VERIFY WELD FILLER MATERIALS.
 - PROVIDE CONTINUOUS INSPECTIONS AND TESTS OF THE FOLLOWING:
 - COMPLETE AND PARTIAL PENETRATION GROOVE WELDS.
 - MULTI-PASS FILLET WELDS.
 - SINGLE-PASS FILLET WELDS GREATER THAN 5/16".
 - PROVIDE PERIODIC INSPECTIONS FOR SINGLE-PASS FILLET WELDS LESS THAN 5/16".
 - TESTS:
 - PROVIDE VISUAL INSPECTION OF ALL WELDS.
 - CHECK 15% OF ALL FILLET WELDS AND PARTIAL PENETRATION WELDS WITH MAGNETIC PARTICLE OR DYE PENETRATION TESTS.
 - PROVIDE ULTRASONIC TESTING ON 100% OF ALL FULL PENETRATION WELDS.
- BOLTING:
 - VERIFY HIGH-STRENGTH BOLT, NUT AND WASHER MATERIALS.
 - IDENTIFY MARKINGS TO ASTM STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS.
 - SUBMIT COPIES OF MANUFACTURER'S CERTIFICATES OF COMPLIANCE.
 - PROVIDE CONTINUOUS INSPECTION OF SLIP-CRITICAL CONNECTIONS. SLIP-CRITICAL BOLTS SHALL BE TIGHTENED BY THE "TURN OF THE NUT" METHOD.
 - PROVIDE PERIODIC INSPECTION OF BEARING TYPE CONNECTIONS.
 - SEE PROJECT SPECIFICATIONS FOR ADDITIONAL TESTING AND INSPECTION REQUIREMENTS.
- FIELD INSPECTION
 - INSPECTION OF STEEL FRAME FOR COMPLIANCE WITH APPROVED CONSTRUCTION DOCUMENTS.
 - MEMBER LOCATIONS.
 - DETAILS, INCLUDING BRACING AND STIFFENING ELEMENTS.
 - APPLICATION OF JOINT DETAILS AT EACH CONNECTION.
 - WELDING:
 - REVIEW WELDING PROCEDURES.
 - VERIFY WELD FILLER MATERIALS.
 - PROVIDE CONTINUOUS INSPECTIONS AND TESTS OF THE FOLLOWING:
 - COMPLETE AND PARTIAL PENETRATION GROOVE WELDS.
 - MULTI-PASS FILLET WELDS.
 - SINGLE-PASS FILLET WELDS GREATER THAN 5/16".
 - PROVIDE PERIODIC INSPECTIONS FOR SINGLE-PASS FILLET WELDS LESS THAN 5/16".
 - TESTS:
 - PROVIDE VISUAL INSPECTION OF ALL WELDS.
 - CHECK 15% OF ALL FILLET WELDS AND PARTIAL PENETRATION WELDS WITH MAGNETIC PARTICLE OR DYE PENETRATION TESTS.
 - PROVIDE ULTRASONIC TESTING ON 100% OF ALL FULL PENETRATION WELDS.
 - BOLTING:
 - VERIFY HIGH-STRENGTH BOLT, NUT, AND WASHER MATERIALS.
 - IDENTIFY MARKINGS TO ASTM STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS.
 - SUBMIT COPIES OF MANUFACTURER'S CERTIFICATES OF COMPLIANCE.
 - PROVIDE CONTINUOUS INSPECTION OF SLIP-CRITICAL CONNECTIONS. SLIP-CRITICAL BOLTS SHALL BE TIGHTENED BY THE "TURN OF THE NUT" METHOD.
 - PROVIDE PERIODIC INSPECTION OF BEARING TYPE CONNECTIONS.
 - SEE PROJECT SPECIFICATIONS FOR ADDITIONAL TESTING AND INSPECTION REQUIREMENTS.

REINFORCED MASONRY INSPECTIONS

- PROVIDE SPECIAL INSPECTIONS PER TMS 402/ACI 530/ASCE 5 AND TMS 602/ACI 530.1/ASCE 6 TABLE 3.1.3 - LEVEL B QUALITY ASSURANCE.

olsson

302 E. Millsap Road
Fayetteville, AR 72703

TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

REGISTERED
PROFESSIONAL
ENGINEER
No. 13205
KERRY C. HARON
12/20/2019

AR
ARKANSAS
REGISTERED
PROFESSIONAL
ENGINEER
No. 13205
KERRY C. HARON
12/20/2019

BY

REV. NO.

DATE

REVISION DESCRIPTION

2020

REVISIONS

STRUCTURAL NOTES

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
GS002

IBC SCHEDULE OF SPECIAL INSPECTION SERVICES				
INSPECTION ITEM REQUIRED	FREQUENCY		CODE REFERENCE	REMARKS
	CONTINUOUS	PERIODIC		
GENERAL				
CONDUCT WEEKLY VISUAL OBSERVATIONS OF THE STRUCTURAL SYSTEMS FOR GENERAL CONFORMANCE TO THE CONSTRUCTION DOCUMENTS AND PREPARE WEEKLY REPORTS OF OBSERVATIONS DESCRIBING WORK PROGRESS AND NON-CONFORMING ITEMS		X		
EARTHWORK				
VERIFY MATERIAL BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY		X		
VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL		X		ALL FOOTING AND PILE CAP EXCAVATIONS SHALL BE OBSERVED AND APPROVED PRIOR TO CONCRETE PLACEMENT
PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS		X		TEST EACH SOURCE
VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESS DURING PLACEMENT AND COMPACTION OF COMPACTED FILL	X			
OBSERVE PROOF ROLLING OF SUBGRADE PRIOR TO FILL PLACEMENT				
TESTING AND EVALUATION OF IN-PLACE DENSITY OF COMPACTED FILL AS WORK PROGRESSES		X		ONE DENSITY TEST FOR EACH LIFT, DAYS OPERATION, OR 5000 SQ. FT. OF FILL AREA
INSPECT VAPOR RETARDER FOR CONFORMANCE WITH MANUFACTURERS WRITTEN INSTALLATION INSTRUCTIONS		X		

IBC SCHEDULE OF SPECIAL INSPECTION SERVICES				
INSPECTION ITEM REQUIRED	FREQUENCY		CODE REFERENCE	REMARKS
	CONTINUOUS	PERIODIC		
CONCRETE & REINFORCING STEEL				
INSPECT REINFORCEMENT, INCLUDING PRESTRESSING TENDONS, AND VERIFY PLACEMENT PRIOR TO CLOSING OF FORMS AND ARRIVAL OF CONCRETE TO THE JOB-SITE		✗	IBC: 1908.4 ACI 318: CH. 20, 25.2, 25.3, 26.6.1-26.6.3	
REINFORCING BAR WELDING:				
a. VERIFY WELDABILITY OF REINFORCING BARS OTHER THAN ASTM A706		✗	AWS D1.4 ACI 318: 26.6.4	
b. INSPECT SINGLE-PASS FILLET WELDS, MAXIMUM 5/16"		✗		
c. INSPECT ALL OTHER WELDS	✗			
OBSERVE & VERIFY PLACEMENT OF EMBEDDED BOLTS & RODS PRIOR TO CONCRETE PLACEMENT	✗			
INSPECT ANCHORS CAST IN CONCRETE		✗	ACI 318: 17.8.2	
INSPECT ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS:				SPECIFIC REQUIREMENTS FOR SPECIAL INSPECTION SHALL BE INCLUDED IN THE RESEARCH REPORT FOR THE ANCHOR ISSUED BY AN APPROVED SOURCE IN ACCORDANCE WITH 17.8.2 IN ACI 318, OR OTHER QUALIFICATION PROCEDURES, WHERE SPECIFIC REQUIREMENTS ARE NOT PROVIDED. SPECIAL INSPECTION REQUIREMENTS SHALL BE SPECIFIED BY THE REGISTERED DESIGN PROFESSIONAL AND SHALL BE APPROVED BY THE BUILDING OFFICIAL PRIOR TO COMMENCEMENT OF THE WORK
a. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY UP OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS	✗		ACI 318: 17.8.2.4	
b. MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED ABOVE		✗	ACI 318: 17.8.2	
VERIFY USE OF REQUIRED MIX DESIGN		✗	IBC: 1904.1, 1904.2, 1908.2, 1908.3 ACI 318: CH. 19, 26.4.3, 26.4.4	
PRIOR TO CONCRETE PLACEMENT, FABRICATE SPECIMENS FOR STRENGTH TESTS, PERFORM SLUMP AND AIR CONTENT TESTS, AND DETERMINE THE TEMPERATURE OF THE CONCRETE	✗		IBC: 1908.10 ASTM: C172, C31 ACI 318: 26.4, 26.12	ADDITIONAL CYLINDERS SHALL BE MADE AS NEEDED FOR EARLY FORM REMOVAL. NOTE: TWO 6X12 OR 4X8 CYLINDERS ARE REQUIRED FOR AN ACCEPTABLE TEST.
SAMPLE CONCRETE SPECIMENS FOR STRENGTH TESTS TO BE PERFORMED IN LAB. A MINIMUM OF FIVE (5) CYLINDERS SHALL BE MADE. TEST TWO AT 7 DAYS AND TWO AT 28 DAYS. THE 5TH CYLINDER SHALL BE HELD IN RESERVE	✗			OBTAIN ONE COMPOSITE SAMPLE FOR EACH 100 CUBIC YARDS OR FRACTION THEREOF OF EACH CONCRETE MIX PLACED EACH DAY. WHEN FREQUENCY OF TESTING WILL PROVIDE FEWER THAN FIVE COMPRESSIVE STRENGTH TESTS FOR EACH CONCRETE MIX, TESTING SHALL BE CONDUCTED FROM AT LEAST FIVE RANDOMLY SELECTED BATCHES OR FROM EACH BATCH IF FEWER THAN FIVE ARE USED.
PERFORM CONCRETE STRENGTH TESTING		✗		
MAINTAIN A SPREADSHEET SHOWING DATE, SEQUENTIAL ORDER OF STRENGTH TEST RESULTS, AND INDICATE RUNNING AVERAGE	✗		ACI 318 PAR. 6.2	
INSPECT CONCRETE AND SHOTCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES	✗		IBC: 1908.6, 1908.7, 1908.8 ACI 318: 26.5	
VERIFY MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES		✗	IBC: 1908.9 ACI 318: 26.5.3-26.5.5	
VERIFY THAT THE NECESSARY DESIGN STRENGTH HAS BEEN REACHED PRIOR TO THE REMOVAL OF FORMS		✗		
INSPECT PRESTRESSED CONCRETE FOR:				
a. APPLICATION OF PRESTRESSING FORCES	✗		ACI 318: 26.10	
b. GROUTING OF BONDED PRESTRESSING TENDONS	✗			
INSPECT ERECTION OF PRECAST CONCRETE MEMBERS AND CONNECTIONS		✗	ACI 318: CH. 26.8	
VERIFY IN-SITU CONCRETE STRENGTH, PRIOR TO STRESSING OF TENDONS IN POST-TENSIONED CONCRETE AND PRIOR TO REMOVAL OF SHORES AND FORMS FROM BEAMS AND STRUCTURAL SLABS		✗	ACI 318: CH. 26.11.2	
INSPECT CONCRETE FORMWORK FOR SHAPE, LOCATION, AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED		✗	ACI 318: 26.11.1.2(b)	
VERIFY CORRECT MATERIAL USED, INCLUDING THE USE OF A706 IN WELDED SPLICES, IF ANY		✗	AWS: D1.4	
VERIFY FABRICATION/QUALITY CONTROL PROCEDURES FOR PRECAST CONCRETE MANUFACTURER		✗		VERIFY PLANT IS PCI CERTIFIED
MEASURE FLOOR FLATNESS AND LEVELNESS AS DIRECTED		✗		

IBC SCHEDULE OF SPECIAL INSPECTION SERVICES				
INSPECTION ITEM REQUIRED	FREQUENCY		CODE REFERENCE	REMARKS
	CONTINUOUS	PERIODIC		
STRUCTURAL STEEL				
VISIT FABRICATION SHOP TO OBSERVE FABRICATION PROCEDURES		✗		ONLY ONE INSPECTION IS REQUIRED UNLESS ON-SITE EVENTS INDICATE FURTHER INSPECTIONS ARE NECESSARY
VERIFY FABRICATOR CERTIFICATION		✗		
VERIFY CORRECT STRUCTURAL STEEL MATERIAL DELIVERED TO JOB SITE.		✗		
VERIFY WELDING PROCEDURE SPECIFICATIONS (WPSs) AVAILABLE	✗			
VERIFY MANUFACTURERS CERTIFICATIONS FOR WELDING CONSUMABLES AVAILABLE	✗			
VERIFY MATERIAL IDENTIFICATIONS (TYPE/GRADE)		✗		
OBSERVE WELDER IDENTIFICATION SYSTEM		✗		THE FABRICATOR OR ERECTOR, AS APPLICABLE, SHALL MAINTAIN A SYSTEM BY WHICH A WELDER WHO HAS WELDED A JOINT OR MEMBER CAN BE IDENTIFIED. STAMPS, IF USED, SHALL BE THE LOW-STRESS TYPE.
OBSERVE FIT-UP OF GROOVE WELDS (INCLUDING JOINT GEOMETRY) FOR JOINT PREPARATION, DIMENSIONS (ALIGNMENT, ROOT OPENING, ROOT FACE, BEVEL), CLEANLINESS (CONDITION OF STEEL SURFACES), TACKING (TACK WELD QUALITY AND LOCATION), BACKING TYPE AND FIT (IF APPLICABLE)		✗		
OBSERVE CONFIGURATION AND FINISH OF ACCESS HOLES		✗		
OBSERVE FIT-UP OF FILLET WELDS, DIMENSIONS (ALIGNMENT, GAPS AT ROOT), CLEANLINESS (CONDITION OF STEEL SURFACES), TACKING (TACK WELD QUALITY AND LOCATION)		✗		
OBSERVE USE OF QUALIFIED WELDERS		✗		
OBSERVE CONTROL AND HANDLING OF WELDING CONSUMABLES, (PACKAGING AND EXPOSURE CONTROL)		✗		
VERIFY NO WELDING OVER CRACKED TACK WELDS		✗		
OBSERVE ENVIRONMENTAL CONDITIONS (WIND SPEED WITHIN LIMITS, PRECIPITATION, AND TEMPERATURE)		✗		
VERIFY WPS FOLLOWED (WELDING EQUIPMENT SETTINGS, TRAVEL SPEED, SELECTED WELDING MATERIALS, SHIELDING GAS TYPE/FLOW RATE, PREHEAT APPLIED, INTERPASS TEMPERATURE MAINTAINED (MIN/MAX), PROPER POSITION (F, V, H, OH))		✗		
OBSERVE WELDING TECHNIQUES (INTERPASS AND FINAL CLEANING, EACH PASS WITHIN PROFILE LIMITS AND EACH PASS MEETS QUALITY REQUIREMENTS)		✗		
VISUALLY INSPECT ALL WELDS FOR SIZE, LENGTH, AND LOCATION OF WELD. PROVIDE CONTINUOUS INSPECTION ON ALL FULL OR PARTIAL PENETRATION WELDS AND FILLET WELDS GREATER THAN 5/16"	✗			
PERFORM ULTRASONIC TESTING ON ALL FULL PENETRATION WELDS	✗			
VERIFY NO ARC STRIKES EXIST	✗			
VISUALLY INSPECT K-AREA, WHEN WELDING OF DOUBLER PLATES, CONTINUITY PLATES, OR STIFFENERS HAS BEEN PERFORMED IN THE K-AREA, FOR CRACKS WITHIN 3" OF THE WELD	✗			
VERIFY REPAIR ACTIVITY ACCEPTABILITY AS APPLICABLE	✗			
DOCUMENT ACCEPTANCE OR REJECTION OF WELDED JOINTS OR MEMBERS	✗			
PERFORM MAGNETIC PARTICLE TESTING ON 20% OF ALL PARTIAL PENETRATION AND FILLET WELDS GREATER THAN 5/16"		✗		
PERFORM MAGNETIC PARTICLE TESTING OR PENETRANT TESTING THERMALLY CUT SURFACES OF ACCESS HOLES WHERE THE FLANGE THICKNESS EXCEEDS 2 IN. FOR ROLLED SHAPES, OR WHEN THE WEB THICKNESS EXCEEDS 2 IN. FOR BUILT-UP SHAPES.		✗		ANY CRACK SHALL BE DEEMED UNACCEPTABLE REGARDLESS OF THE SIZE OR LOCATION
VERIFY MANUFACTURER'S CERTIFICATIONS FOR FASTENER MATERIALS ARE AVAILABLE	✗			
VERIFY FASTENERS MARKED IN ACCORDANCE WITH ASTM REQUIREMENTS		✗		
VERIFY PROPER FASTENERS SELECTED FOR THE JOINT DETAIL (GRADE, TYPE, BOLT LENGTH IF THREADS ARE TO BE EXCLUDED FROM THE SHEAR PLANE)		✗		
VERIFY PROPER BOLTING PROCEDURE SELECTED FOR JOINT DETAIL		✗		
VERIFY CONNECTING ELEMENTS, INCLUDING THE APPROPRIATE FAYING SURFACE CONDITION AND HOLE PREPARATION, IF SPECIFIED, MEET APPLICABLE REQUIREMENTS		✗		

IBC SCHEDULE OF SPECIAL INSPECTION SERVICES				
INSPECTION ITEM REQUIRED	FREQUENCY		CODE REFERENCE	REMARKS
	CONTINUOUS	PERIODIC		
STRUCTURAL STEEL - CONTINUED				
CONFIRM PRE-INSTALLATION VERIFICATION TESTING BY INSTALLATION PERSONNEL OBSERVED AND DOCUMENTED FOR FASTENER ASSEMBLIES AND METHODS USED		X		
VERIFY PROPER STORAGE PROVIDED FOR BOLTS, NUTS, WASHERS AND OTHER FASTENER COMPONENTS		X		
VERIFY FASTENER ASSEMBLIES, OF SUITABLE CONDITION, PLACED IN ALL HOLES AND WASHERS (IF REQUIRED) ARE POSITIONED AS REQUIRED		X		
VERIFY JOINT BROUGHT TO SNUG-TIGHT CONDITION PRIOR TO THE PRETENSIONING OPERATION		X		
VERIFY FASTENER COMPONENT NOT TURNED BY THE WRENCH PREVENTED FROM ROTATING		X		
VERIFY FASTENERS ARE PRETENSIONED IN ACCORDANCE WITH THE RSCG SPECIFICATION, PROGRESSING SYSTEMATICALLY FROM THE MOST RIGID POINT TOWARD THE FREE EDGES		X		
DOCUMENT ACCEPTANCE OR REJECTION OF BOLTED CONNECTIONS		X		
OBSERVE AND TEST ALL FIELD APPLIED HEADED STUDS	X			VERIFY CORRECT NUMBER, LOCATION, AND WELDING
DOCUMENT ACCEPTANCE OR REJECTION OF STEEL ELEMENTS	X			

olsson

302 E. Millsap Road
Fayetteville, AR 72703

TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
NO. 13205
HARRY C. HARDIN
1/14/2014

BY

REV. NO.

REVISION DESCRIPTION

DATE

2020

STRUCTURAL SPECIAL INSPECTION NOTES

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS


drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
GS003

IBC SCHEDULE OF SPECIAL INSPECTION SERVICES				
INSPECTION ITEM REQUIRED	FREQUENCY		CODE REFERENCE	REMARKS
	CONTINUOUS	PERIODIC		
COLD-FORMED STEEL				
WHERE TRUSS SPAN IS 60 FEET OF GREATER, VERIFY THAT THE TEMPORARY INSTALLATION RESTRAINT/BRACING AND THE PERMANENT INDIVIDUAL TRUSS MEMBER RESTRAINT/BRACING ARE INSTALLED IN ACCORDANCE WITH THE APPROVED TRUSS SUBMITTAL PACKAGE		×		IBC 2207.1
VERIFY COMPLIANCE OF COLD-FORMED STEEL STRUCTURAL MEMBERS	×			
VERIFY COMPLIANCE OF CONNECTORS	×			
DOCUMENT ACCEPTANCE OR REJECTION OF COLD-FORMED STEEL STRUCTURAL MEMBERS AND CONNECTORS	×			
VERIFY WELDING PROCEDURE SPECIFICATION AVAILABLE		×		
VERIFY MANUFACTURER CERTIFICATIONS FOR WELDING CONSUMABLES AVAILABLE		×		
VERIFY MATERIAL IDENTIFICATION (TYPE/GRADE)		×		
VERIFY USE OF QUALIFIED WELDERS		×		
VERIFY CONTROL AND HANDLING OF WELDING CONSUMABLES		×		
VERIFY ENVIRONMENTAL CONDITIONS (WIND SPEED, MOISTURE, TEMPERATURE)		×		
VERIFY WELDING PROCEDURE SPECIFICATIONS FOLLOWED		×		
VERIFY COMPLIANCE OF WELDS	×			
VERIFY WELDS MEET VISUAL ACCEPTANCE CRITERIA	×			
VERIFY REPAIR ACTIVITIES AS APPLICABLE	×			
DOCUMENT ACCEPTANCE OR REJECTION OF WELDED CONNECTIONS	×			
VERIFY MECHANICAL FASTENER MANUFACTURER INSTALLATION INSTRUCTIONS AVAILABLE FOR MECHANICAL FASTENERS		×		
VERIFY PROPER TOOLS AVAILABLE FOR MECHANICAL FASTENER INSTALLATION		×		
VERIFY PROPER STORAGE FOR MECHANICAL FASTENERS		×		
VERIFY MECHANICAL FASTENERS ARE POSITIONED AS REQUIRED AND INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS		×		
VERIFY COMPLIANCE OF MECHANICAL FASTENERS WITH CONSTRUCTION DOCUMENTS	×			
VERIFY REPAIR ACTIVITIES AS APPLICABLE	×			
DOCUMENT ACCEPTANCE OR REJECTION OF MECHANICALLY FASTENED CONNECTIONS	×			
VERIFY COMPLIANCE OF COLD-FORMED STEEL LIGHT-FRAME CONSTRUCTION	×			
DOCUMENT ACCEPTANCE OR REJECTION OF COLD-FORMED STEEL LIGHT-FRAME CONSTRUCTION	×			
VERIFY COMPLIANCE OF SHEAR WALL AND DIAPHRAGM SHEATHING, DIAGONAL STRAP BRACING, AND HOLD-DOWNS	×			
DOCUMENT ACCEPTANCE OR REJECTION OF SHEAR WALL AND DIAPHRAGM SHEATHING, DIAGONAL STRAP BRACING, AND HOLD-DOWNS	×			
OBSERVE WELDER IDENTIFICATION SYSTEM FOR LATERAL FORCE-RESISTING SYSTEM PRIOR TO WELDING		×		A SYSTEM MAINTAINED BY THE COMPONENT MANUFACTURER OR INSTALLER, AS APPLICABLE, BY WHICH A WELDER WHO HAS WELDED A JOINT OR MEMBER CAN BE IDENTIFIED
OBSERVE FIT-UP OF WELDS (ALIGNMENT, GAPS, CONDITION OF STEEL SURFACES) FOR LATERAL FORCE-RESISTING SYSTEM PRIOR TO WELDING		×		
VERIFY PROPER FASTENERS SELECTED FOR LATERAL FORCE-RESISTING SYSTEM PRIOR TO INSTALLATION		×		
VERIFY PROPER INSTALLATION PROCEDURE SELECTED FOR LATERAL FORCE-RESISTING SYSTEM PRIOR TO INSTALLATION		×		
VERIFY JOINT BROUGHT TIGHT (e.g., CLAMPED) TO AVOID GAPS BETWEEN PLIES FOR SCREW CONNECTIONS		×		
VERIFY TOOL ADJUSTED TO AVOID STRIPPED AND OVERDRIVEN FASTENERS FOR SCREW CONNECTIONS		×		
VERIFY INSTALLATION IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS FOR POST-INSTALLED CONNECTIONS TO CONCRETE	×			
VERIFY COMPLIANCE OF COLD-FORMED STEEL LATERAL FORCE-RESISTING SYSTEM INSTALLATION	×			
DOCUMENT ACCEPTANCE OR REJECTION OF INSTALLATION OF COLD-FORMED STEEL LATERAL FORCE-RESISTING SYSTEM	×			

DWG: \\oed\oedconsulting.com\ite-ns\projects-drawings\2018\0001-0500\018-0054\40-Design\AutoCAD\Final Plans\Sheets\Main Lift Station\Sheets\Main Lift Station\Structural\5-GS005-0180054.dwg
DATE: Dec 30, 2019 4:52pm
USER: krowett
XREFS: S_TBK_0180054

TABLE 1 - REINFORCING BARS IN TENSION									
CONCRETE: $f'_c = 4000$ PSI @ 28 DAYS REINFORCING STEEL: ASTM A615 GRADE 60									
BAR SIZE		DIAMETER (d_b) (INCHES)	DEVELOPMENT LENGTH (l_d) (INCHES)		CLASS B TENSION LAP SPLICE (LL) (INCHES)		STANDARD HOOK		
METRIC	IN-LB		"TOP" BARS	OTHER	"TOP" BARS	OTHER	90° STD. HOOK "X" (MIN)	180° STD HOOK "Y" (MIN.)	OUTSIDE RADIUS "r"
#10	#3	0.375	18	14	24	18	6	4"	1.5"
#13	#4	0.5	25	19	32	25	8	5"	2.0"
#16	#5	0.625	31	24	40	31	10	5"	2.5"
#19	#6	0.75	37	28	48	37	12	6"	3.0"
#22	#7	0.875	54	42	70	54	14	7"	3.5"
#25	#8	1.0	62	47	80	62	16	8"	4.0"
#29	#9	1.128	70	54	90	70	20	12"	5.64"
#32	#10	1.27	78	60	102	78	22	13"	6.35"
#36	#11	1.41	87	67	113	87	24	14"	7.05"
#43	#14	1.693	104	80	136	104	31	21"	10.16"

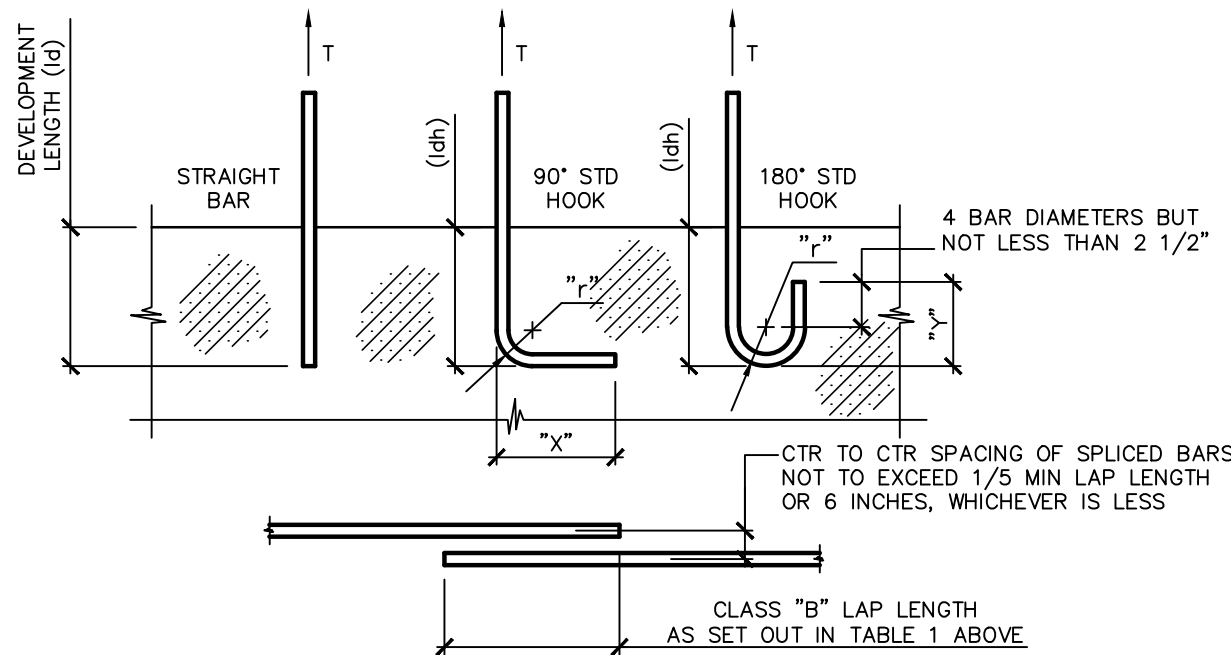

NOTES:


- "TOP" BARS SHALL BE HORIZONTAL REINFORCEMENT PLACED SO THAT MORE THAN 12 INCHES OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE BAR.
- CLEAR SPACING OF BARS BEING DEVELOPED OR SPLICED SHALL 1.) NOT BE LESS THAN d_b , HAVE CLEAR COVER NOT LESS THAN d_b , AND STIRRUPS OR TIES THROUGHOUT l_d NOT LESS THAN THE CODE MINIMUM OR; 2.) CLEAR SPACING OF BARS BEING DEVELOPED OR SPLICED NOT LESS THAN $2d_b$ AND CLEAR COVER NOT LESS THAN d_b , WHERE d_b =DIAMETER OF REINFORCING BAR AND l_d =DEVELOPMENT LENGTH.
- ALL LAP SPLICES SHALL BE CLASS B UNO.

1

STANDARD DEVELOPMENT LENGTH & LAP SPLICES IN TENSION

NOT TO SCALE

TABLE 2 - REINFORCING BARS IN COMPRESSION				
CONCRETE: $f'_c = 4000$ PSI @ 28 DAYS REINFORCING STEEL: ASTM A615 GRADE 60				
BAR SIZE		DIAMETER (d_b) (INCHES)	DEVELOPMENT LENGTH (l_d) (INCHES)	COMPRESSION LAP SPLICE (LL) (INCHES)
METRIC	IN-LB			
#10	#3	0.375	8	12
#13	#4	0.5	10	15
#16	#5	0.625	12	19
#19	#6	0.75	15	23
#22	#7	0.875	17	27
#25	#8	1.0	19	30
#29	#9	1.128	22	34
#32	#10	1.27	24	38
#36	#11	1.41	27	43
#43	#14	1.693	32	51

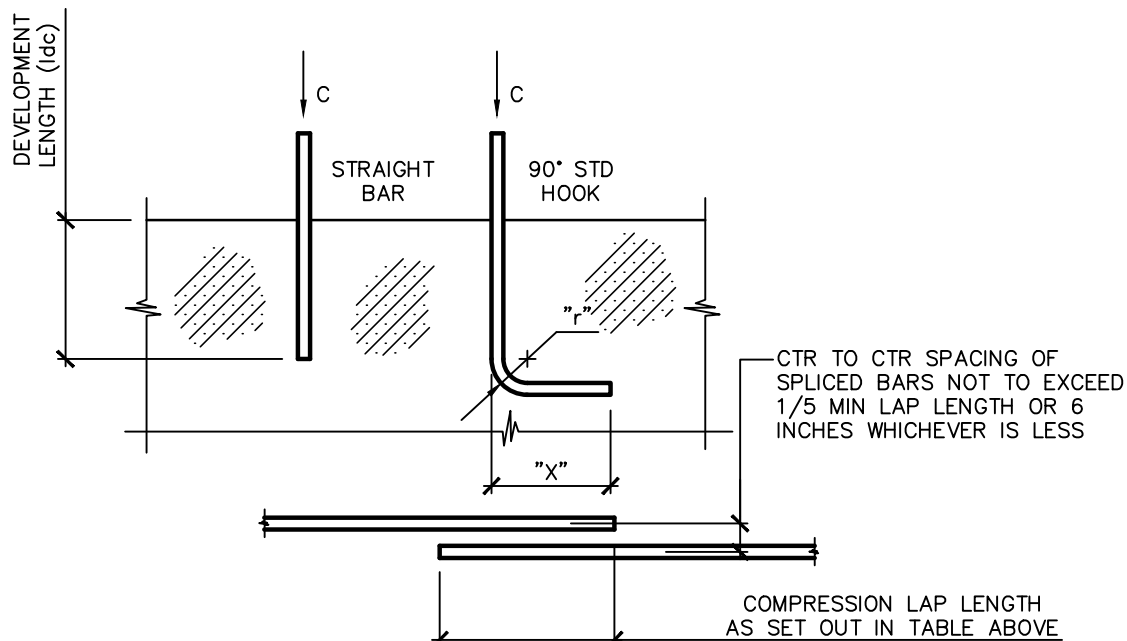


NOTES:

- IF BARS OF DIFFERENT SIZE ARE LAP SPLICED, SPLICE LENGTH SHALL BE THE LARGER OF EITHER DEVELOPMENT LENGTH OF LARGER BAR, OR SPLICE LENGTH OF SMALLER BAR.

2

STANDARD DEVELOPMENT LENGTH & LAP SPLICES IN COMPRESSION

NOT TO SCALE

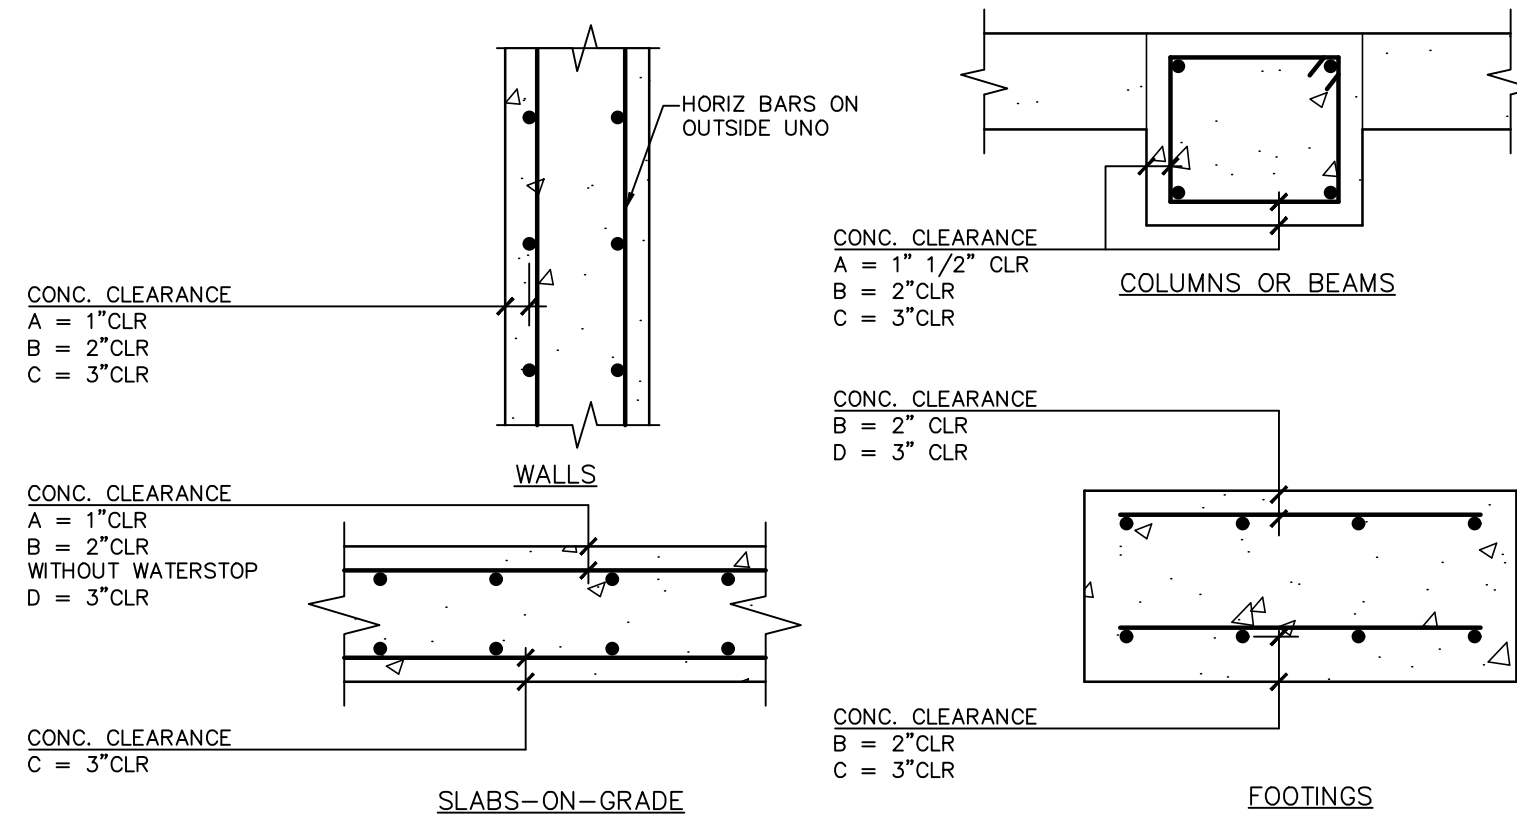


- A = NO EXPOSURE TO GROUND, WEATHER OR WATER AFTER FORM REMOVAL.
B = EXPOSURE TO GROUND, WEATHER OR WATER AFTER FORM REMOVAL.
C = CONCRETE PLACED AGAINST GROUND.
D = FOR INSTALLATION OF WATERSTOP

3

STANDARD CLEARANCE FOR REINFORCING STEEL (UNO)

NOT TO SCALE


TYPICAL BAR LAP LENGTHS			
BAR SIZE		C TO C LAP "C"	LAP LENGTH "LL"
METRIC	IN-LB		
#10	#3	4'-0"	SEE TABLE 1 - DETAIL 1/GS005
#13	#4	5'-2"	SEE TABLE 1 - DETAIL 1/GS005
#16	#5	6'-8"	SEE TABLE 1 - DETAIL 1/GS005
#19	#6	8'-0"	SEE TABLE 1 - DETAIL 1/GS005
#22	#7	11'-8"	SEE TABLE 1 - DETAIL 1/GS005
#25	#8	13'-4"	SEE TABLE 1 - DETAIL 1/GS005
#29	#9	15'-0"	SEE TABLE 1 - DETAIL 1/GS005

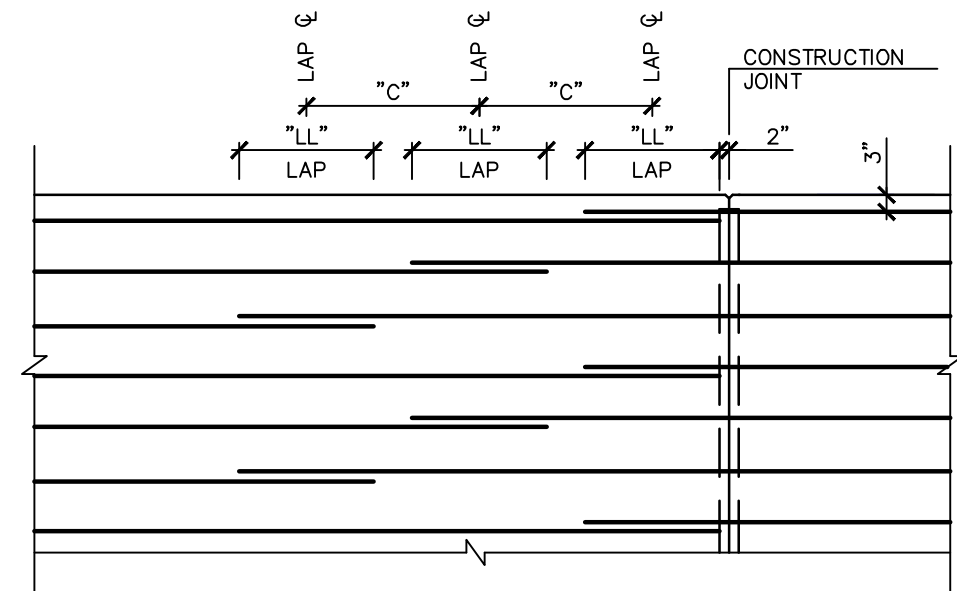

4

REINFORCING LAP SPLICE LAYOUT - WALLS

NOT TO SCALE

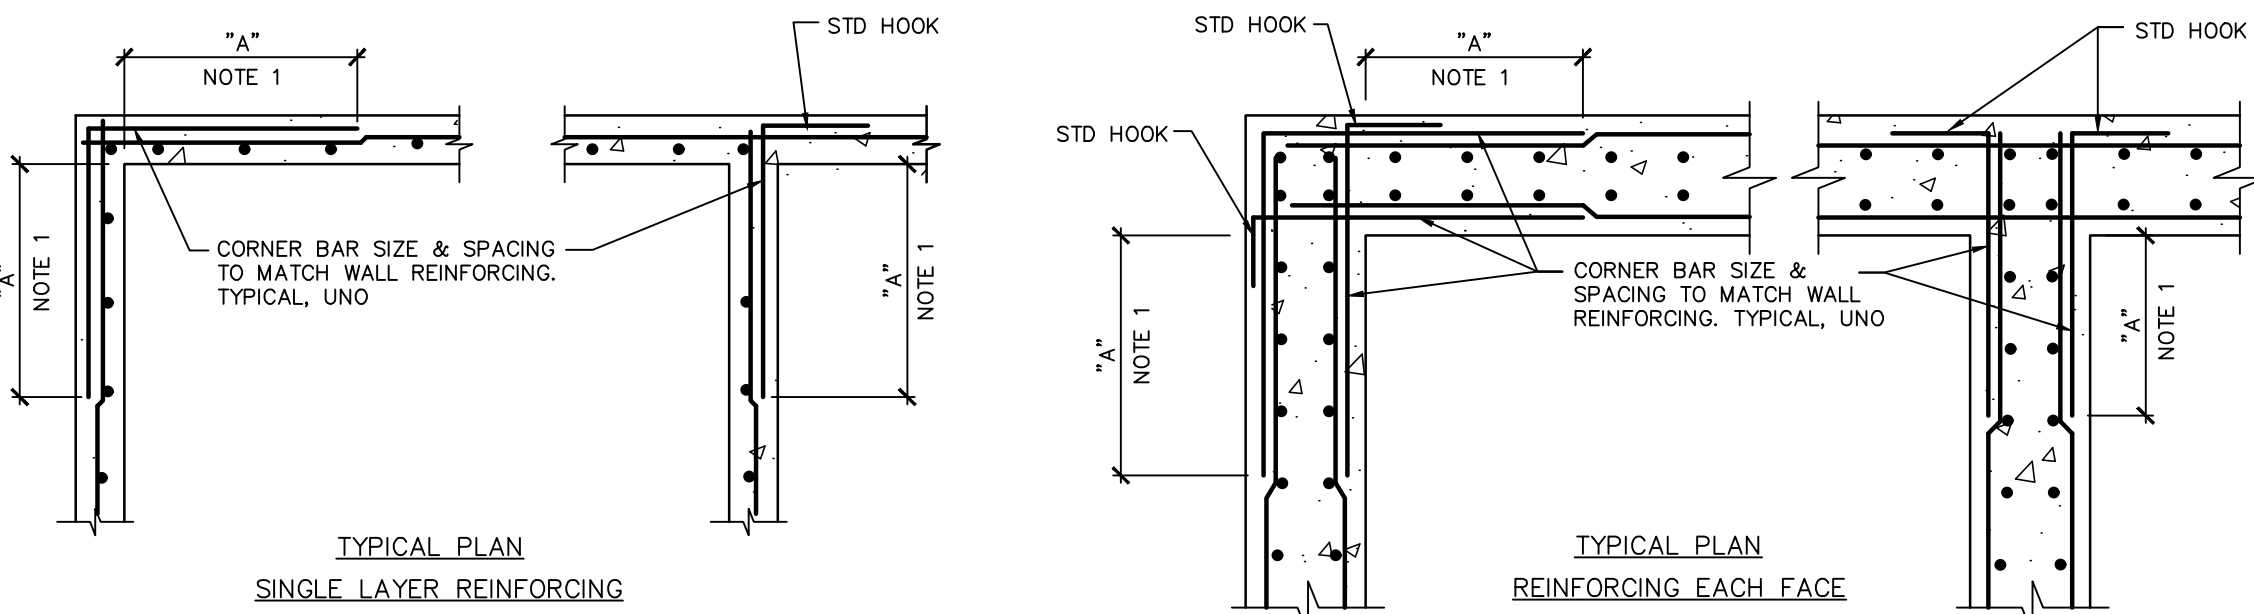

TYPICAL PLAN
SINGLE LAYER REINFORCING


NOTES:

- UNLESS OTHERWISE NOTED ON THE DRAWINGS, DIMENSION "A" SHALL BE THE MINIMUM CLASS B TENSION LAP SPLICE LENGTH AS REQUIRED IN TABLE 1 - DETAIL 1, SHEET S2. IF BAR SIZES DIFFER, USE THE MINIMUM LAP LENGTH AS REQUIRED FOR THE LARGER OF THE TWO BARS BEING SPLICED.
- ALL GRADE BEAMS AND FOUNDATIONS SHALL HAVE CORNER BARS.

5

TYPICAL REINFORCING - HORIZONTAL WALL, GRADE BEAM, AND FOUNDATION INTERSECTION/CORNER REINFORCING

NOT TO SCALE

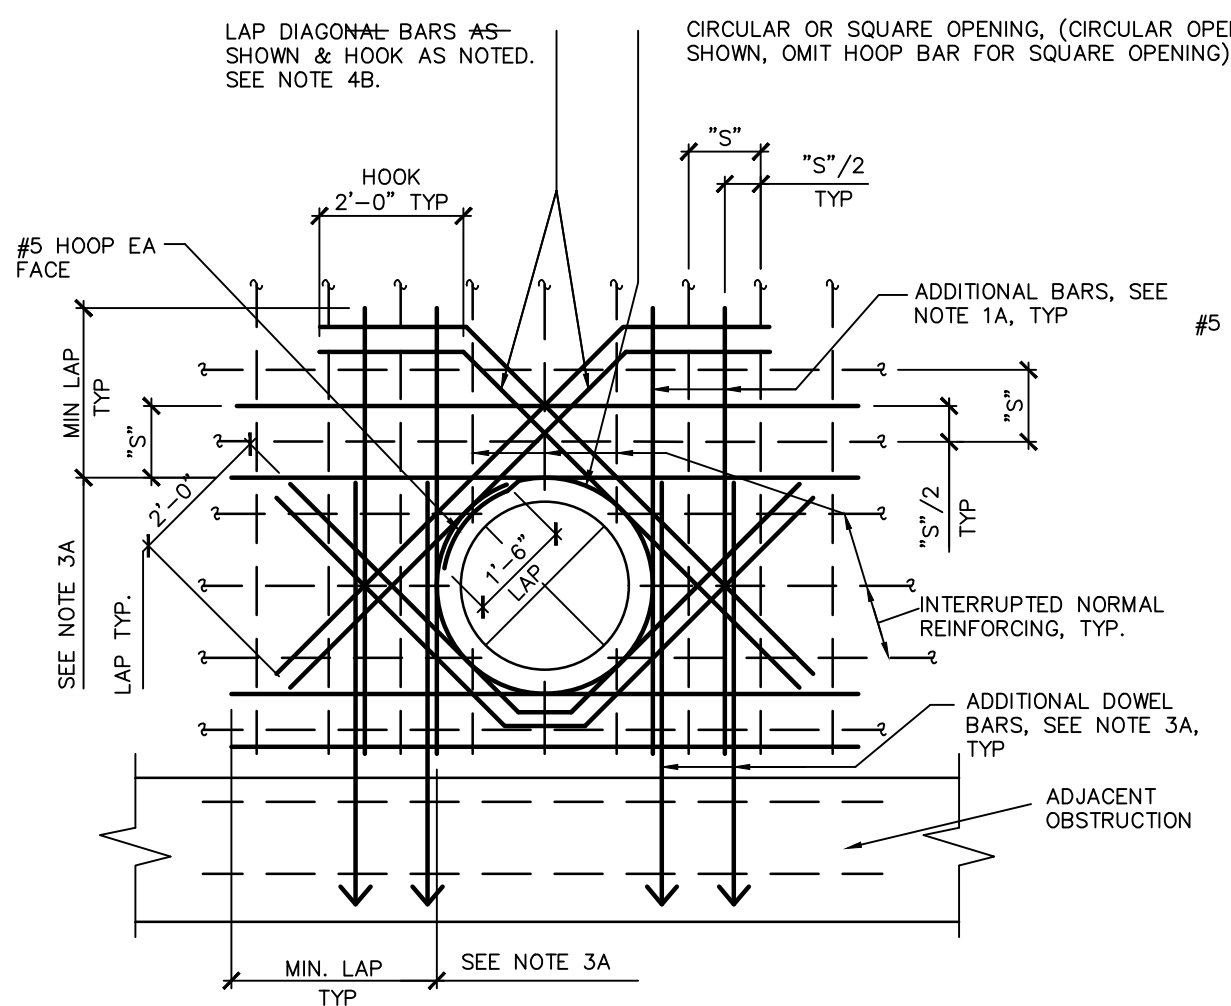


WITH ADJACENT OBSTRUCTION

6

ADDITIONAL REINFORCING AT OPENINGS

NOT TO SCALE

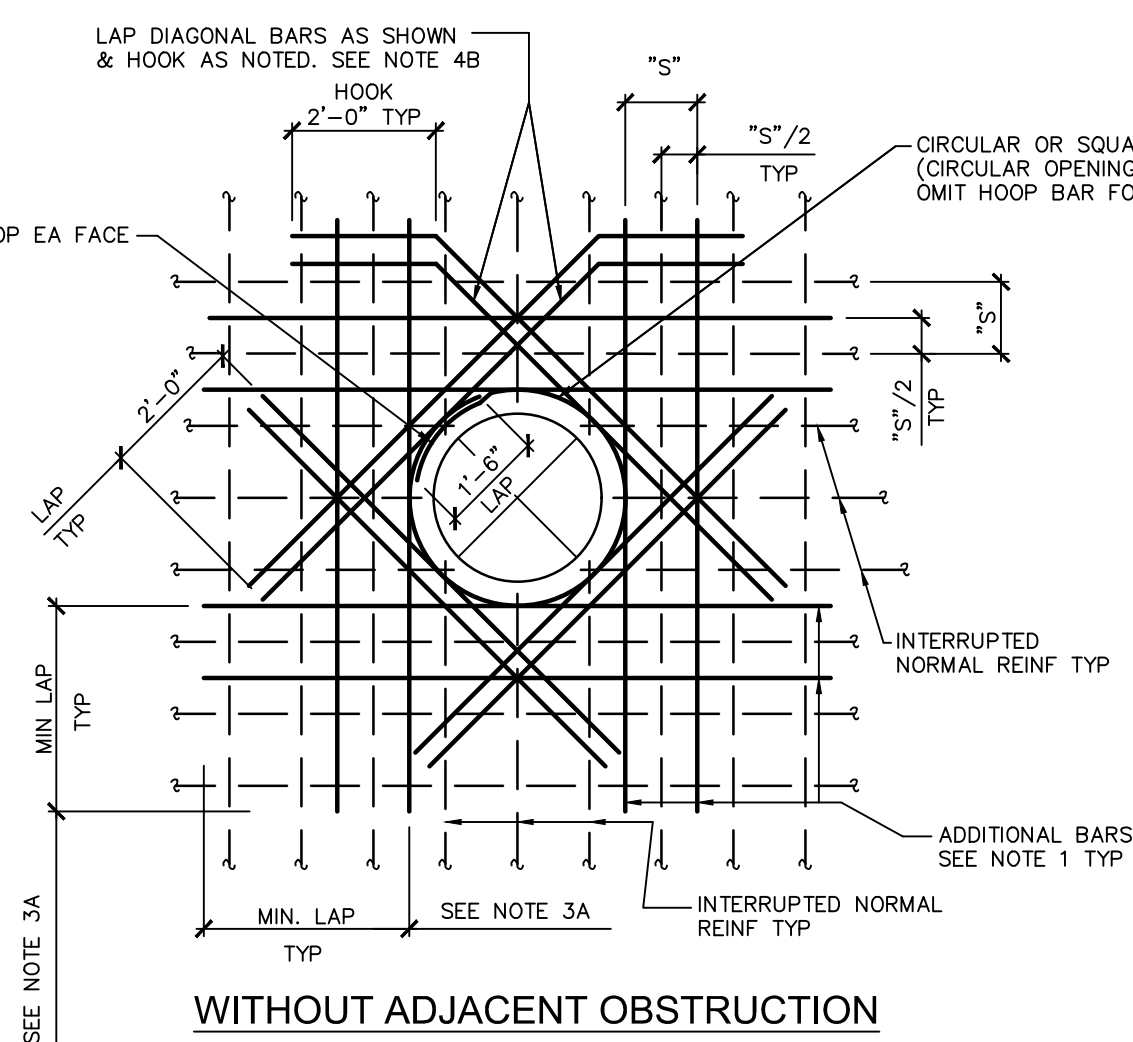

WITHOUT ADJACENT OBSTRUCTION

NOTES:

GENERAL

- ALL REINF TO CLEAR OPENING OR FLANGE COLLARS BY 2".
- "S" = NORMAL BAR SPACING SHOWN ON PLANS.

MAIN VERT. AND HORIZ. REINFORCING

- NUMBER OF ADDITIONAL REINF BARS AT EACH SIDE OF OPENING SHALL EQUAL HALF THE NUMBER OF INTERRUPTED BARS IN EACH LAYER OF REINF.
- SIZE OF ADDITIONAL REINF BARS TO EQUAL SIZE OF INTERRUPTED REINF BARS.
- PROVIDE STANDARD LAP LENGTH FOR BARS BEYOND OPENING (UNO). PROVIDE ADDITIONAL DOWELS WITH STD HOOKS FOR BARS TO BE LAP SPLICED IF LAP LENGTH EXTENSION CANNOT BE OBTAINED AT JOINTS OR OTHER OBSTRUCTIONS. LAP SPLICES SHALL BE CLASS B (UNO).
- PLACE ADDITIONAL BARS IN SAME PLANES AS INTERRUPTED REINF.

DIAGONAL REINFORCING

- UNLESS NOTED OTHERWISE, SIZE OF DIAGONAL BARS SHALL BE THE SIZE OF THE LARGEST NORMAL REINF BAR CUT. LOCATE DIAGONALS IN EACH LAYER OF REINF.
- PLACE DIAGONAL BARS INSIDE NORMAL REINF.
- PROVIDE 2 DIAGONAL BARS EACH LAYER OR FACE, EACH WAY AS SHOWN.
- PROVIDE LAP LENGTH FOR BARS AS INDICATED (UNO). PROVIDE HOOKS OR BENT BARS AS INDICATED IF LAP LENGTH EXTENSION CANNOT BE OBTAINED AT JOINTS OR OTHER OBSTRUCTIONS.

STANDARD STRUCTURAL DETAILS

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

2020

BY

REVISIONS DESCRIPTION

DATE

REV. NO.

REVISIONS

drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020


SHEET
GS005



olsson


302 East Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
www.olsson.com

DWG: \\ao.edi.com\projects\2018\0001-0500\018-0054\40-Design\AutoCAD\Final Plans\Sheets\Main Lift Station\Structural\S-GS006-0180054.dwg
DATE: Dec 30, 2019 4:51pm
XREFS: S_TBLK_0180054
USER: krowett

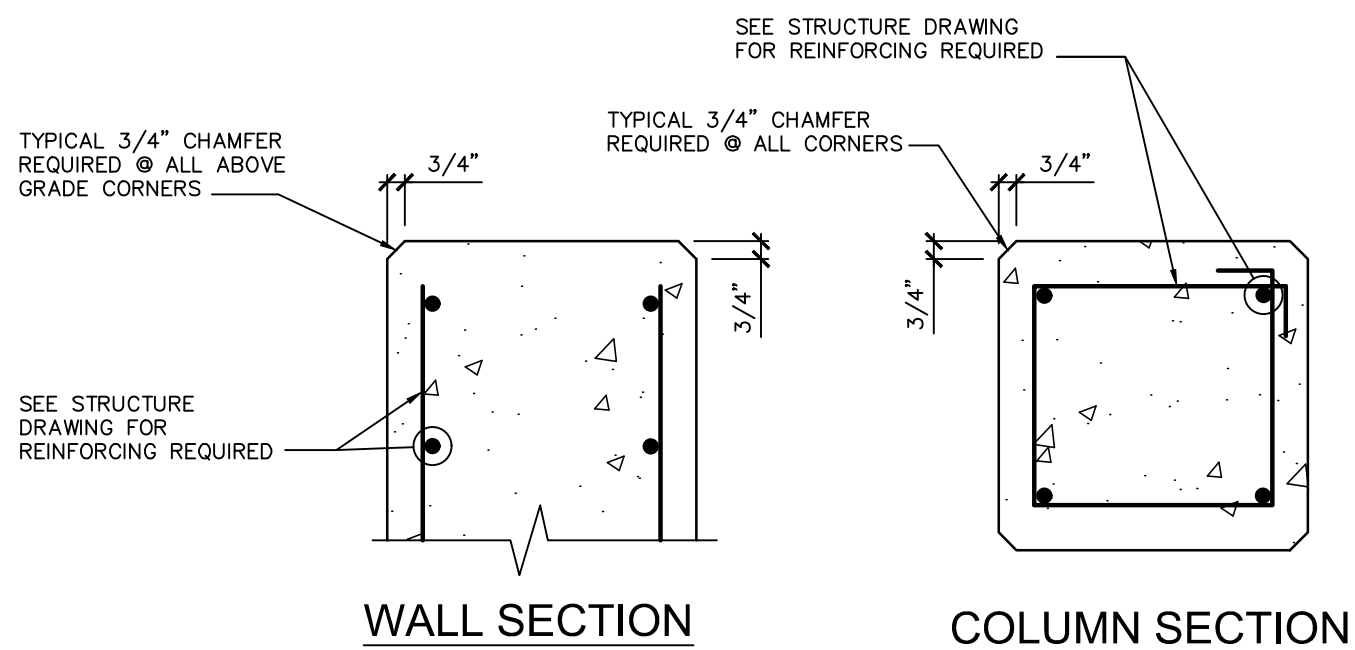


NOTE: ALL EXPOSED EDGES OF CONCRETE SURFACES ABOVE GRADE SHALL HAVE 3/4" CHAMFER UNLESS NOTED OTHERWISE

1 STANDARD CHAMFER IN CONCRETE
NOT TO SCALE

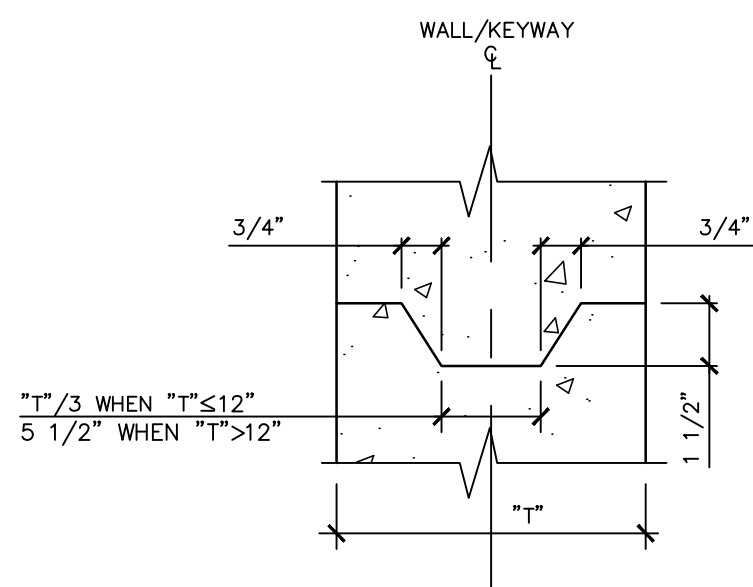


- NOTES:
- "T" = WALL OR SLAB THICKNESS
 - WHEN WALL THICKNESSES DIFFER USE THE SMALLER WALL THICKNESS OF THE TWO WALLS TO DETERMINE KEYWAY WIDTH.

4 KEYWAY DETAIL
NOT TO SCALE

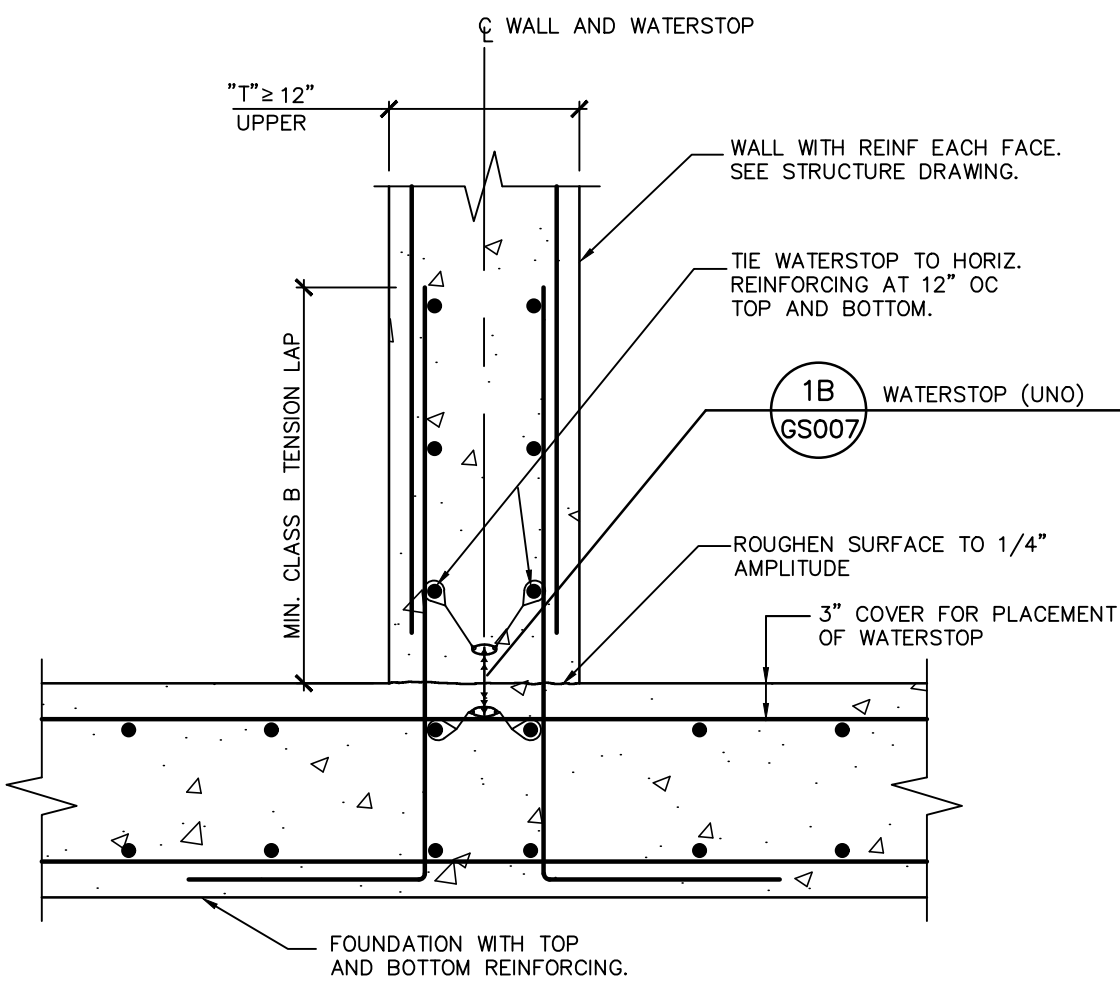

5A WALL THICKNESS GREATER THAN OR EQUAL TO 12"


- NOTES:
- "T" = WALL THICKNESS
 - FLATSTRIP WATERSTOP SHOWN ON THESE DRAWINGS FOR THIS TYPE OF JOINT. CONTRACTOR MAY SUBSTITUTE CONT. 6" CENTER BULB WATERSTOP IN CONFORMANCE WITH THE DRAWINGS FOR THIS LOCATION.

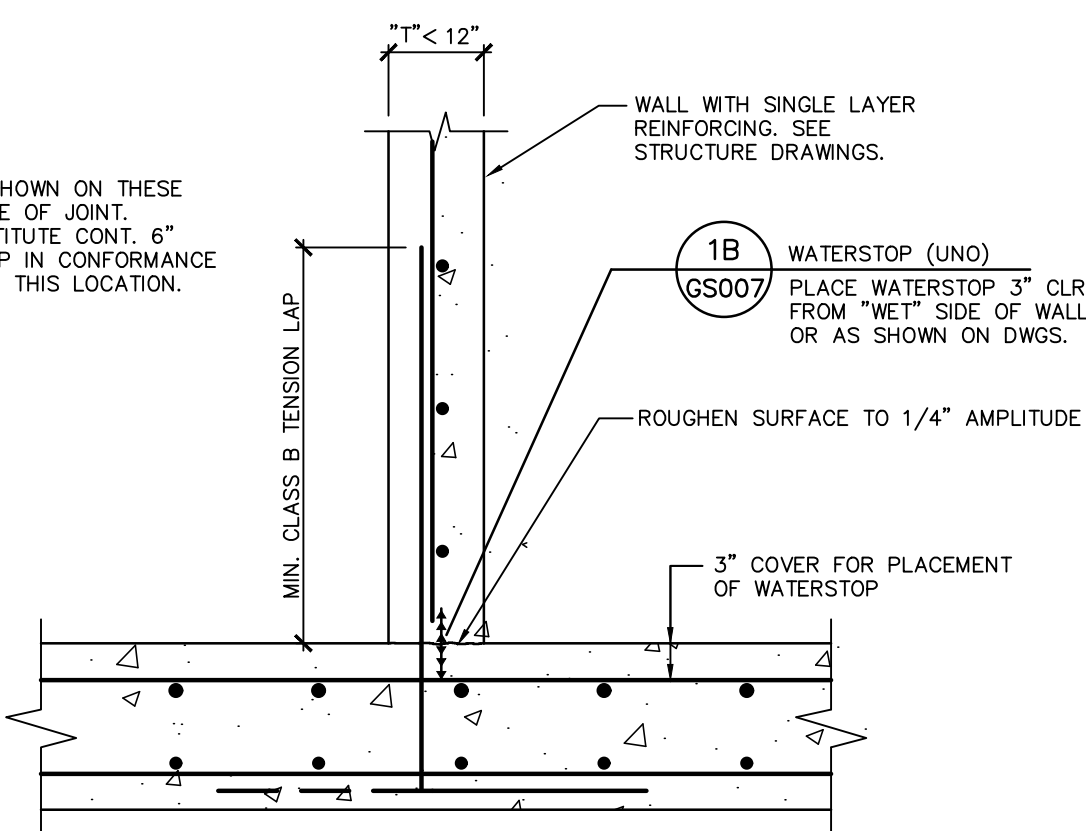


5B WALL THICKNESS LESS THAN 12"

NOTES:


- "T" = WALL THICKNESS
- FLATSTRIP WATERSTOP SHOWN ON THESE DRAWINGS FOR THIS TYPE OF JOINT. CONTRACTOR MAY SUBSTITUTE CONT. 6" CENTER BULB WATERSTOP IN CONFORMANCE WITH THE DRAWINGS FOR THIS LOCATION.
- PROVIDE CONCRETE COVER INDICATED ON DETAIL 3/GS2 (UNO).
- MINIMUM CLASS B TENSION LAP SPlice LENGTH SHALL BE FOR THE LARGER BAR BEING SPLICED.

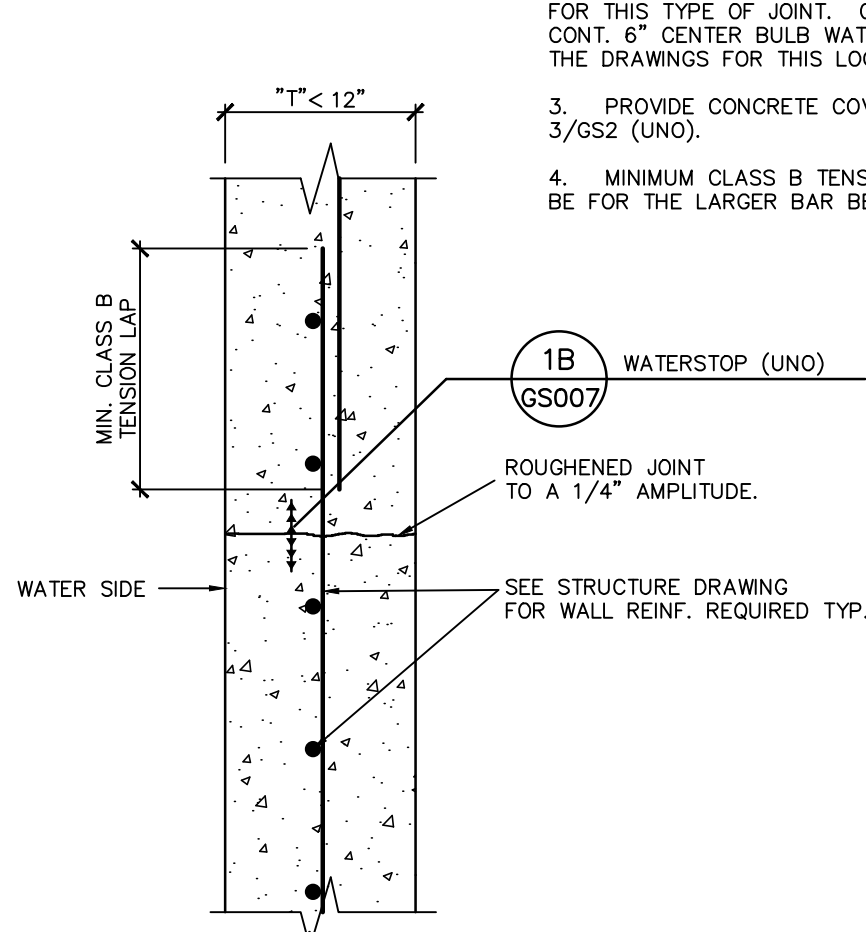

2A WALL THICKNESS LESS THAN 12"

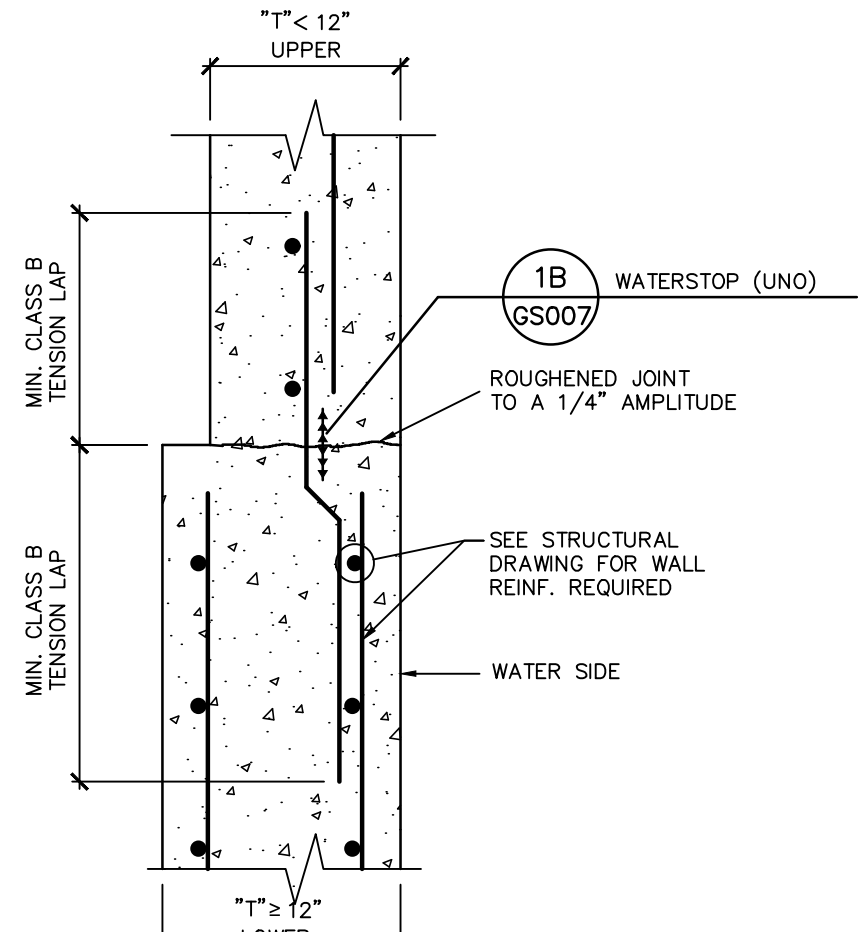


2B DIFFERING WALL THICKNESSES

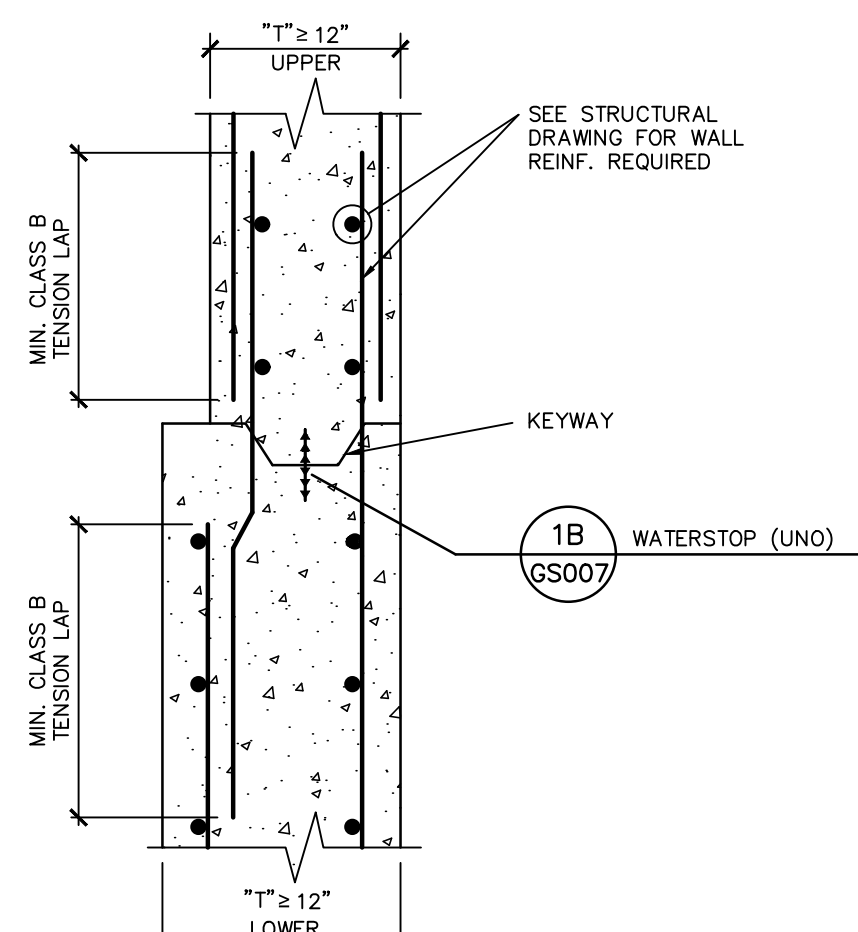

2C WALL THICKNESS GREATER THAN OR EQUAL TO 12"

2D DIFFERING WALL THICKNESSES


2 WALL JOINT - HORIZONTAL
NOT TO SCALE

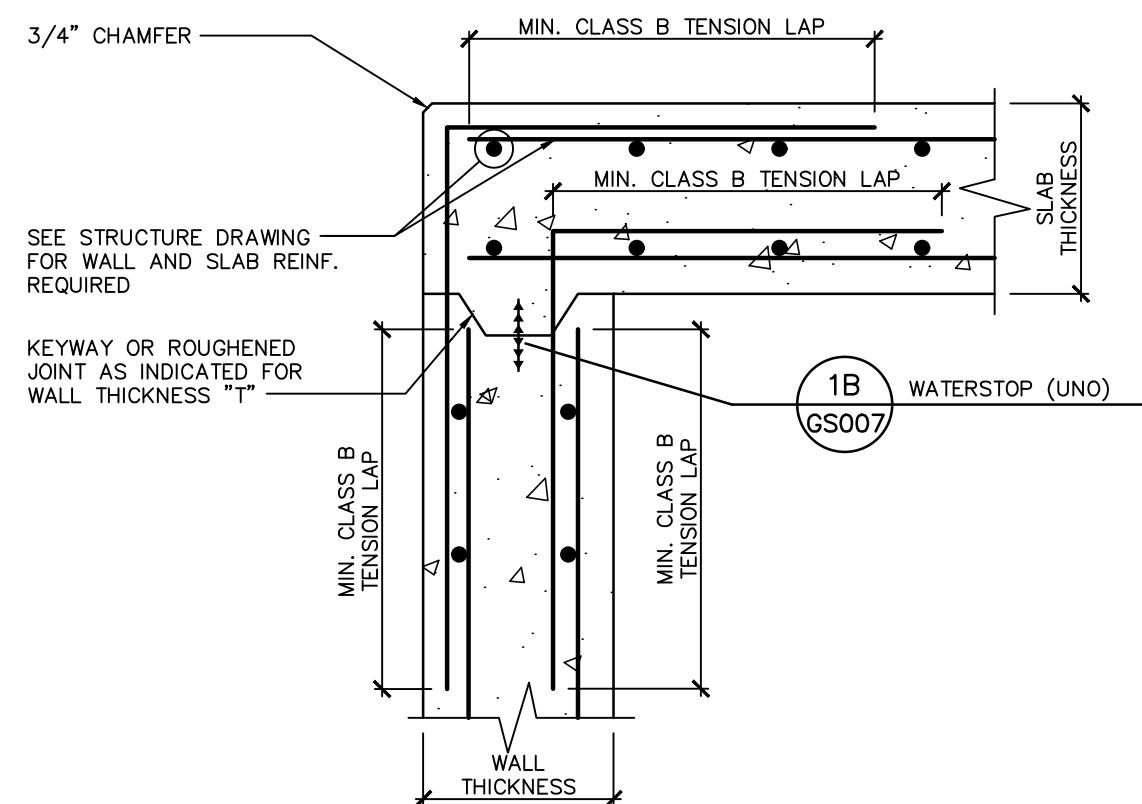

3A WALL TO ELEVATED SLAB JOINT


NOTES:

- IF WATERSTOP IS NOT REQUIRED, A ROUGHENED JOINT AT TOP OF WALL MAY BE SUBSTITUTED FOR THE KEYWAY INDICATED.
- FLATSTRIP WATERSTOP SHOWN ON THESE DRAWINGS FOR THIS TYPE OF JOINT. CONTRACTOR MAY SUBSTITUTE CONT. 6" CENTER BULB WATERSTOP IN CONFORMANCE WITH THE DRAWINGS FOR THIS LOCATION.
- PROVIDE CONCRETE COVER INDICATED ON DETAIL 3/GS2 (UNO).
- MINIMUM CLASS B TENSION LAP SPlice LENGTH SHALL BE FOR THE LARGER BAR BEING SPLICED.

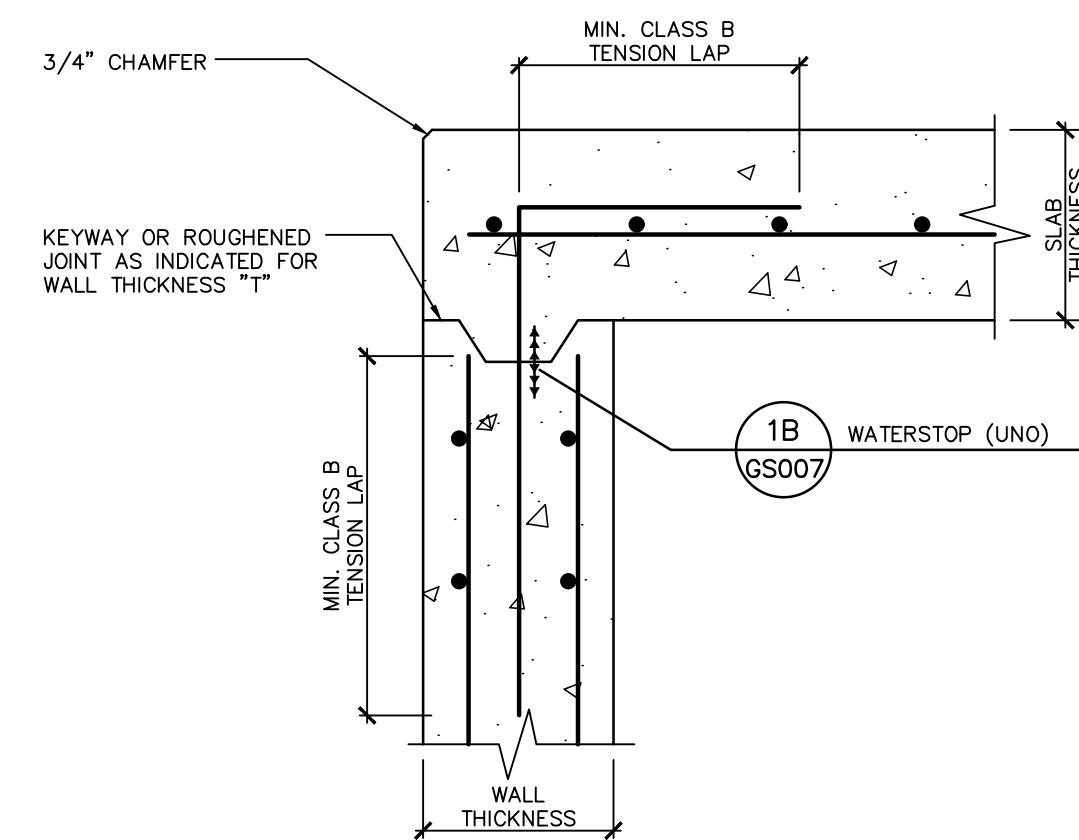


3B WALL TO ELEVATED SLAB JOINT

3 WALL TO ELEVATED SLAB JOINT
NOT TO SCALE

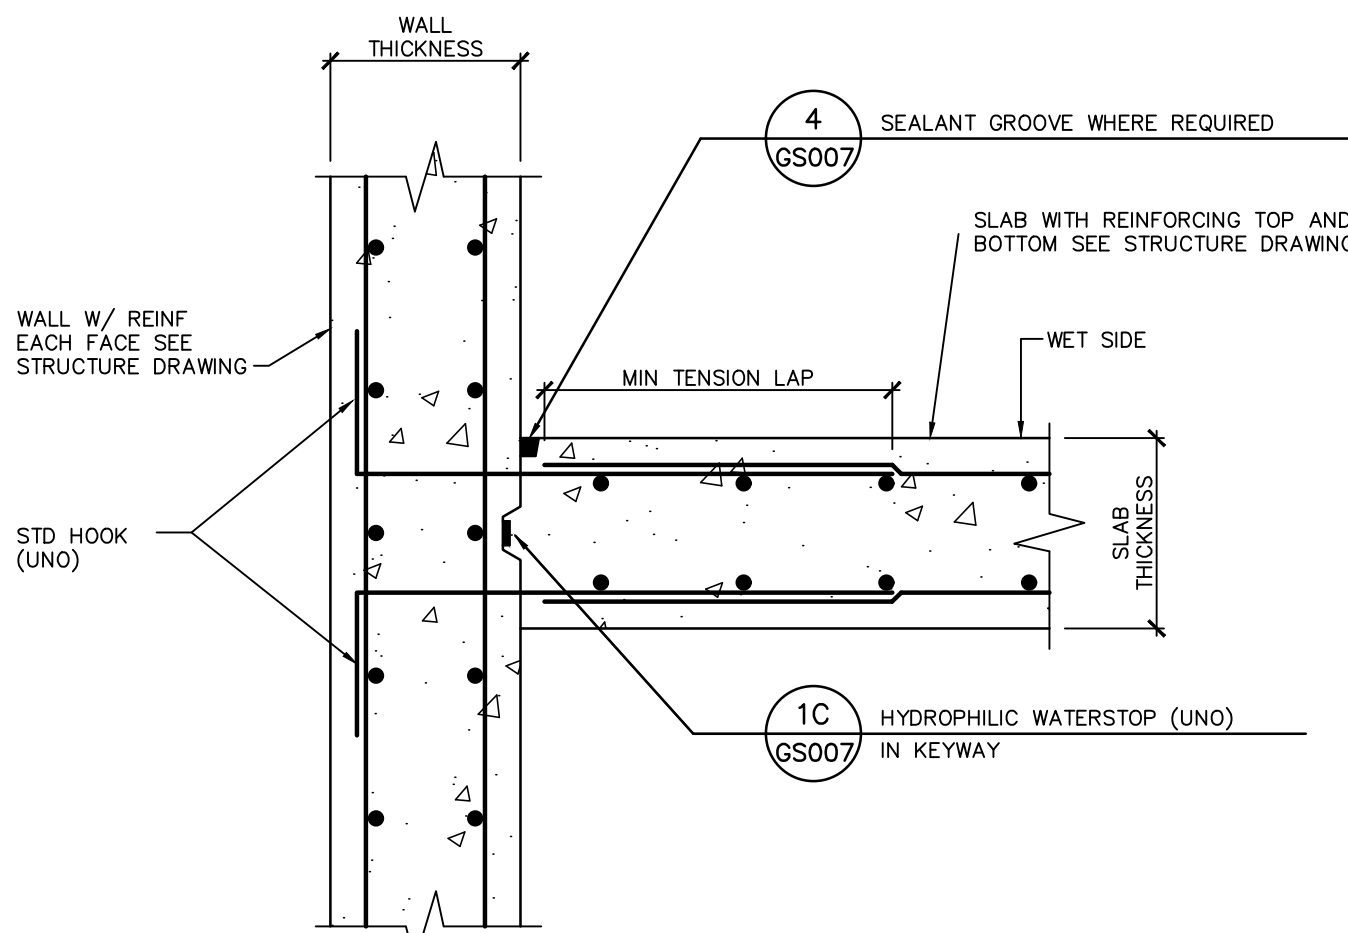

6A WITH DOUBLE MAT IN SLAB

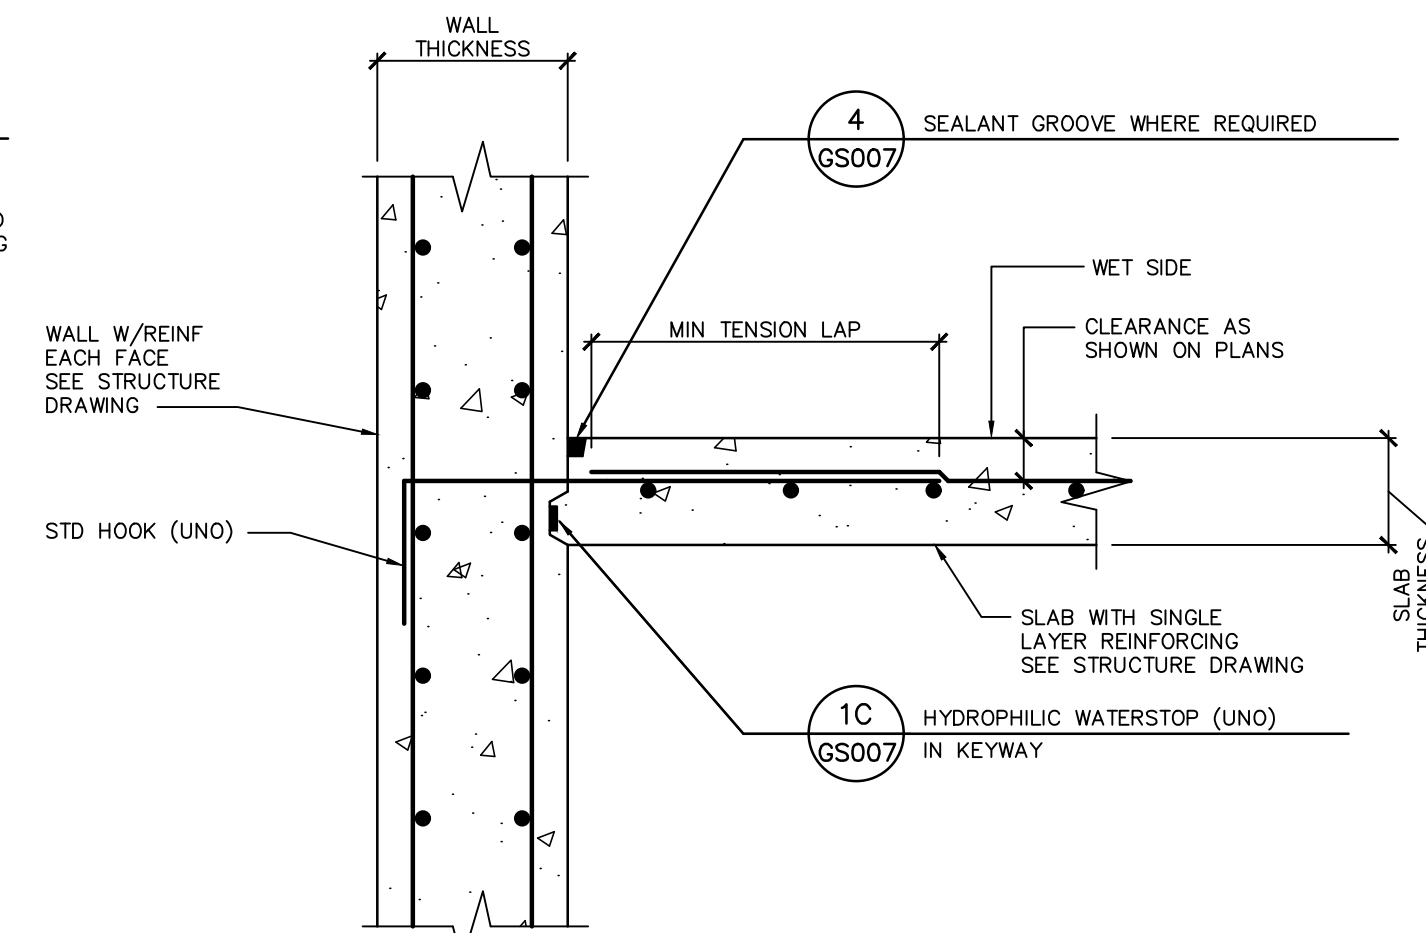

6B WITH SINGLE MAT IN SLAB

6 CONSTRUCTION JOINT - SLAB TO WALL
NOT TO SCALE

STANDARD STRUCTURAL DETAILS

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

2020



REV. NO.	DATE	REVISIONS DESCRIPTION	BY

REVISIONS





olsson

302 East Millap Road
Fayetteville, AR 72703
TEL 479.443.3404
www.olsson.com

drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
GS006

DWG: \\oed\oedconsulting.com\lts-nst\projects-direct\2018\0001-0500\018-0054\40-Design\AutoCAD\Final Plans\Structural\5-GS008-0180054.dwg
DATE: Dec 30, 2019 4:50pm
USER: krowett
XREFS: S-TBK-0180054

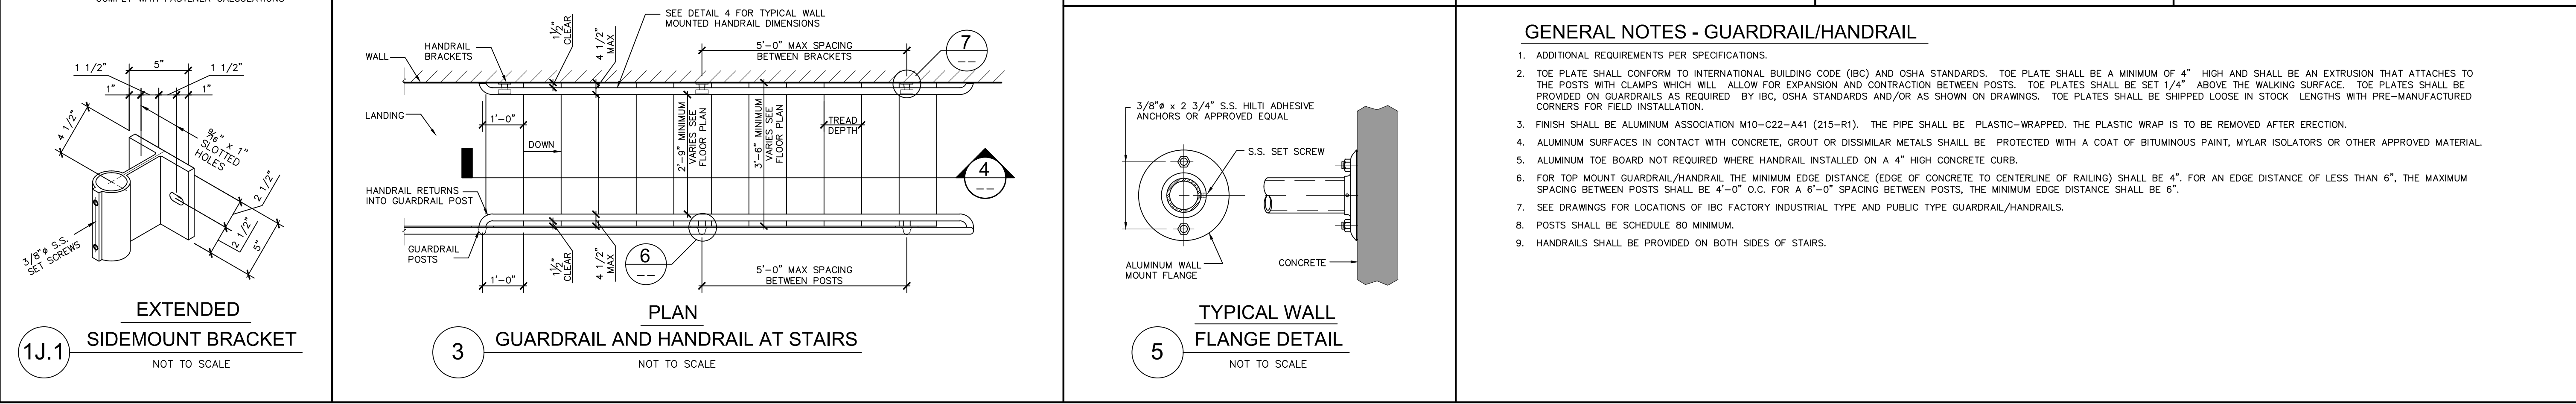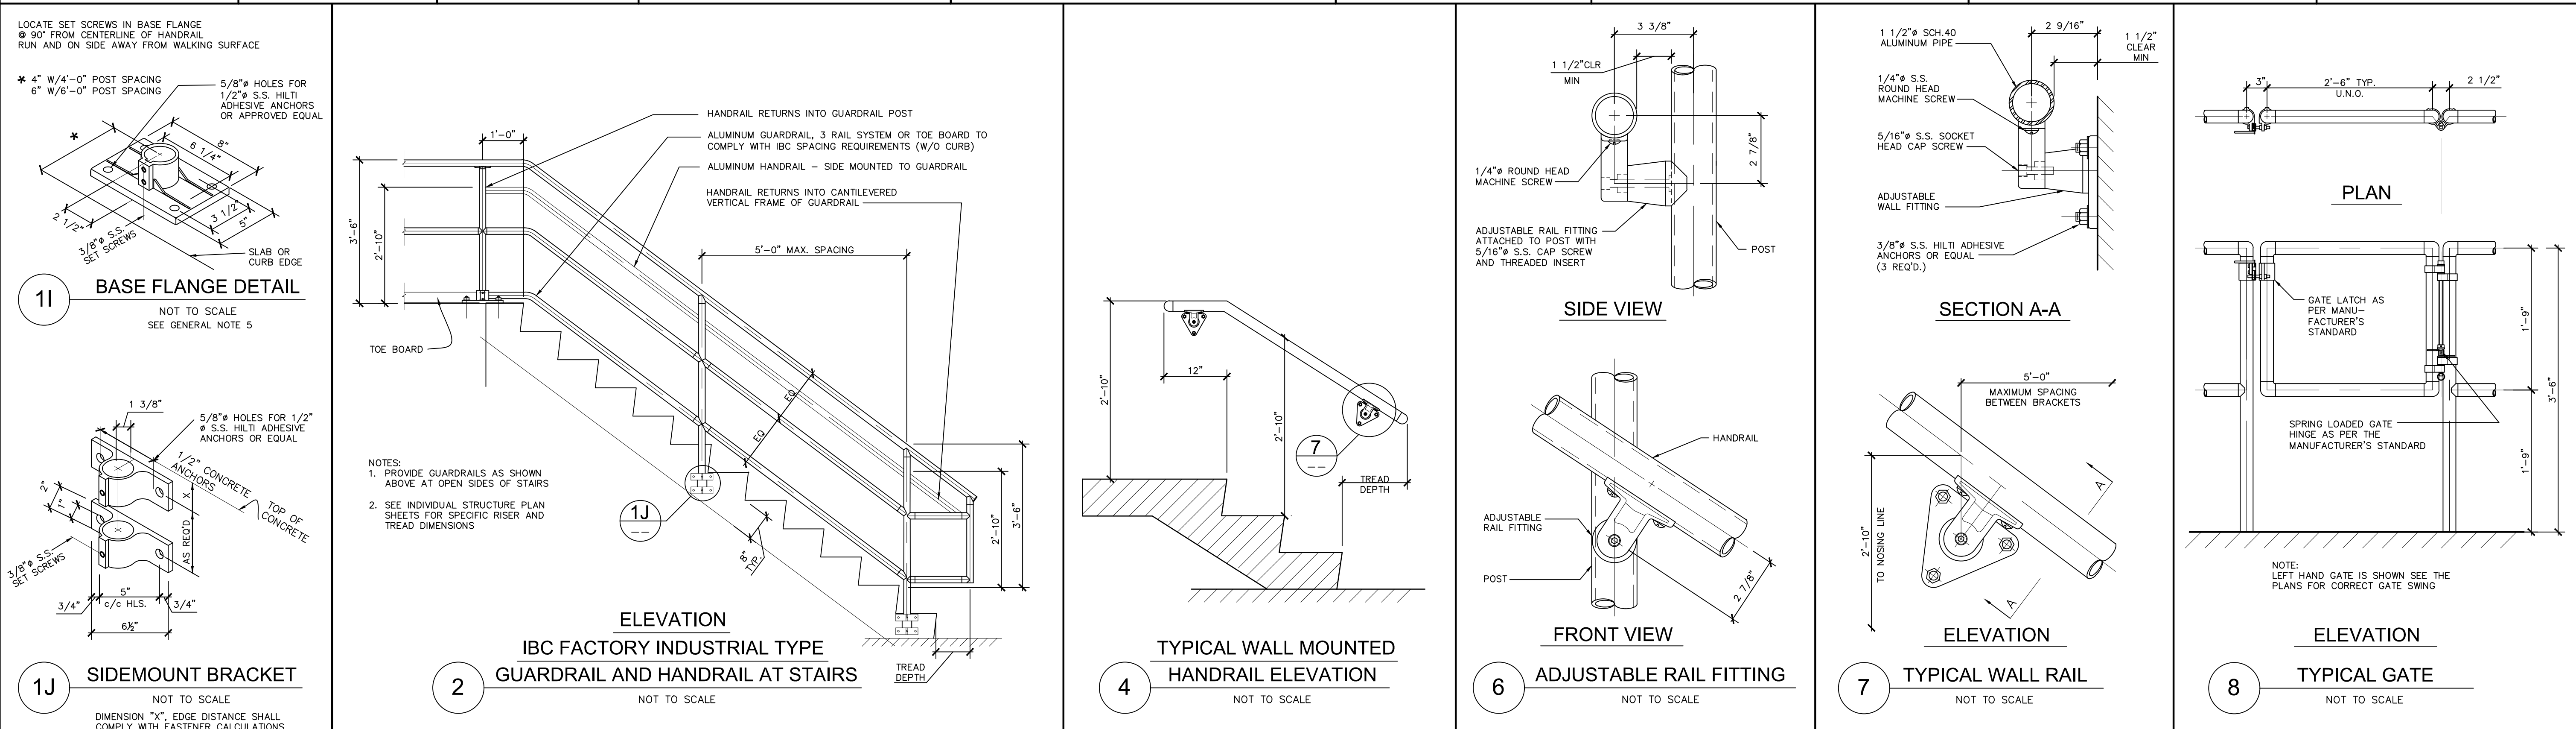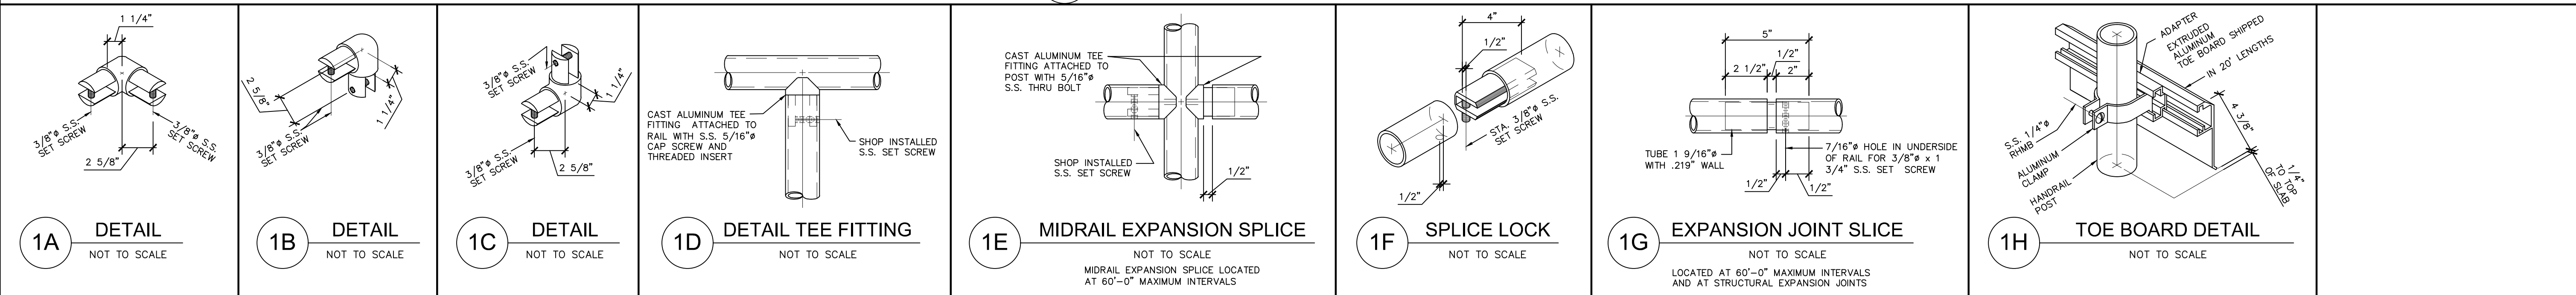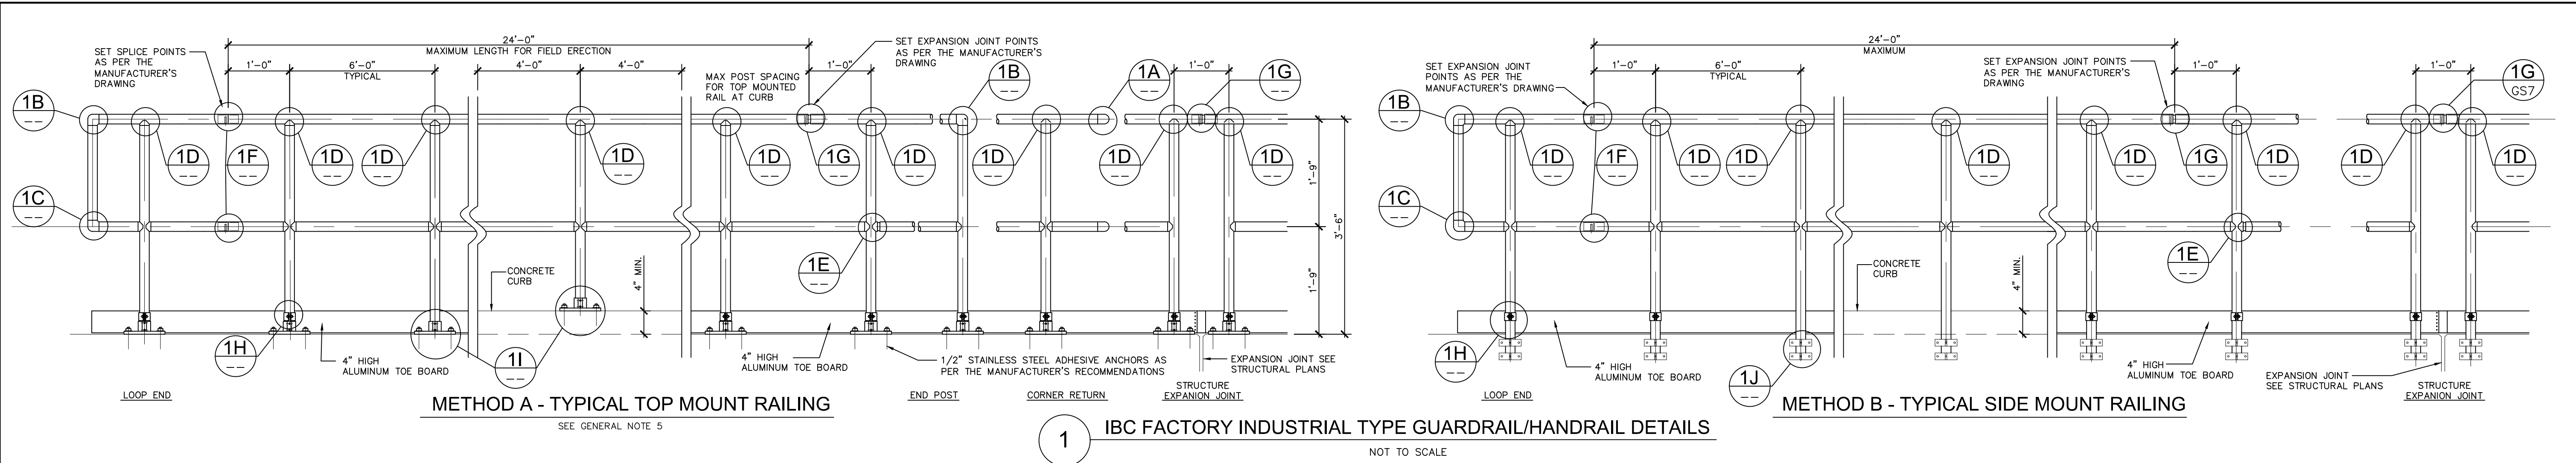

GENERAL NOTES - GUARDRAIL/HANDRAIL

- ADDITIONAL REQUIREMENTS PER SPECIFICATIONS.
- TOE PLATE SHALL CONFORM TO INTERNATIONAL BUILDING CODE (IBC) AND OSHA STANDARDS. TOE PLATE SHALL BE A MINIMUM OF 4" HIGH AND SHALL BE AN EXTRUSION THAT ATTACHES TO THE POSTS WITH CLAMPS WHICH WILL ALLOW FOR EXPANSION AND CONTRACTION BETWEEN POSTS. TOE PLATES SHALL BE SET 1/4" ABOVE THE WALKING SURFACE. TOE PLATES SHALL BE PROVIDED ON GUARDRAILS AS REQUIRED BY IBC, OSHA STANDARDS AND/OR AS SHOWN ON DRAWINGS. TOE PLATES SHALL BE SHIPPED LOOSE IN STOCK LENGTHS WITH PRE-MANUFACTURED CORNERS FOR FIELD INSTALLATION.
- FINISH SHALL BE ALUMINUM ASSOCIATION M10-C22-A41 (215-1R). THE PIPE SHALL BE PLASTIC-WRAPPED. THE PLASTIC WRAP IS TO BE REMOVED AFTER ERECTION.
- ALUMINUM SURFACES IN CONTACT WITH CONCRETE, GROUT OR DISSIMILAR METALS SHALL BE PROTECTED WITH A COAT OF BITUMINOUS PAINT, MYLAR ISOLATORS OR OTHER APPROVED MATERIAL.
- ALUMINUM TOE BOARD NOT REQUIRED WHERE HANDRAIL INSTALLED ON A 4" HIGH CONCRETE CURB.
- FOR TOP MOUNT GUARDRAIL/HANDRAIL THE MINIMUM EDGE DISTANCE (EDGE OF CONCRETE TO CENTERLINE OF RAILING) SHALL BE 4". FOR AN EDGE DISTANCE OF LESS THAN 6", THE MAXIMUM SPACING BETWEEN POSTS SHALL BE 4'-0" O.C. FOR A 6'-0" SPACING BETWEEN POSTS, THE MINIMUM EDGE DISTANCE SHALL BE 6".
- SEE DRAWINGS FOR LOCATIONS OF IBC FACTORY INDUSTRIAL TYPE AND PUBLIC TYPE GUARDRAIL/HANDRAILS.
- POSTS SHALL BE SCHEDULE 80 MINIMUM.
- HANDRAILS SHALL BE PROVIDED ON BOTH SIDES OF STAIRS.

olsson

302 East Millap Road
Fayetteville, AR 72703
TEL 479.443.3404
www.olsson.com

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 13205
BARRY C. HARDIN
01/02/2020

BY
REVISIONS DESCRIPTION
DATE
REV. NO.

REVISIONS
2020

STANDARD STRUCTURAL DETAILS

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS


drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
GS008



NOTES:

1. MEMBER SIZES SHOWN ARE MINIMUM ACCEPTABLE UNLESS INDICATED OR INDIVIDUALLY DETAILED OTHERWISE.
2. ALL OTHER REQUIREMENTS PER SPECIFICATIONS.
3. ALUMINUM SURFACES IN CONTACT WITH CONCRETE, GROUT OR DISIMILAR METALS WILL BE PROTECTED WITH A COAT OF BITUMINOUS PAINT, MYLAR INSULATORS OR OTHER APPROVED MATERIAL.

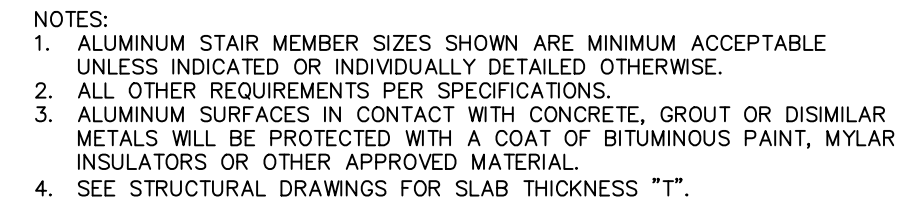



(1)



(



(

LINTEL SCHEDULE





NOTES:

(



NOTES:

1. APPLICABLE UNLESS OTHERWISE NOTED (UNO)
ON PLAN OR DETAILS.
2. REFER TO DETAIL 1 SHEET GS005 FOR REINFORCEMENT LAP
SPICES FOR REINFORCED CONCRETE.

5



(6)




(5)




1 FLOOR PLAN @ ELEC ROOM

SCALE: 1/4" = 1'-0"

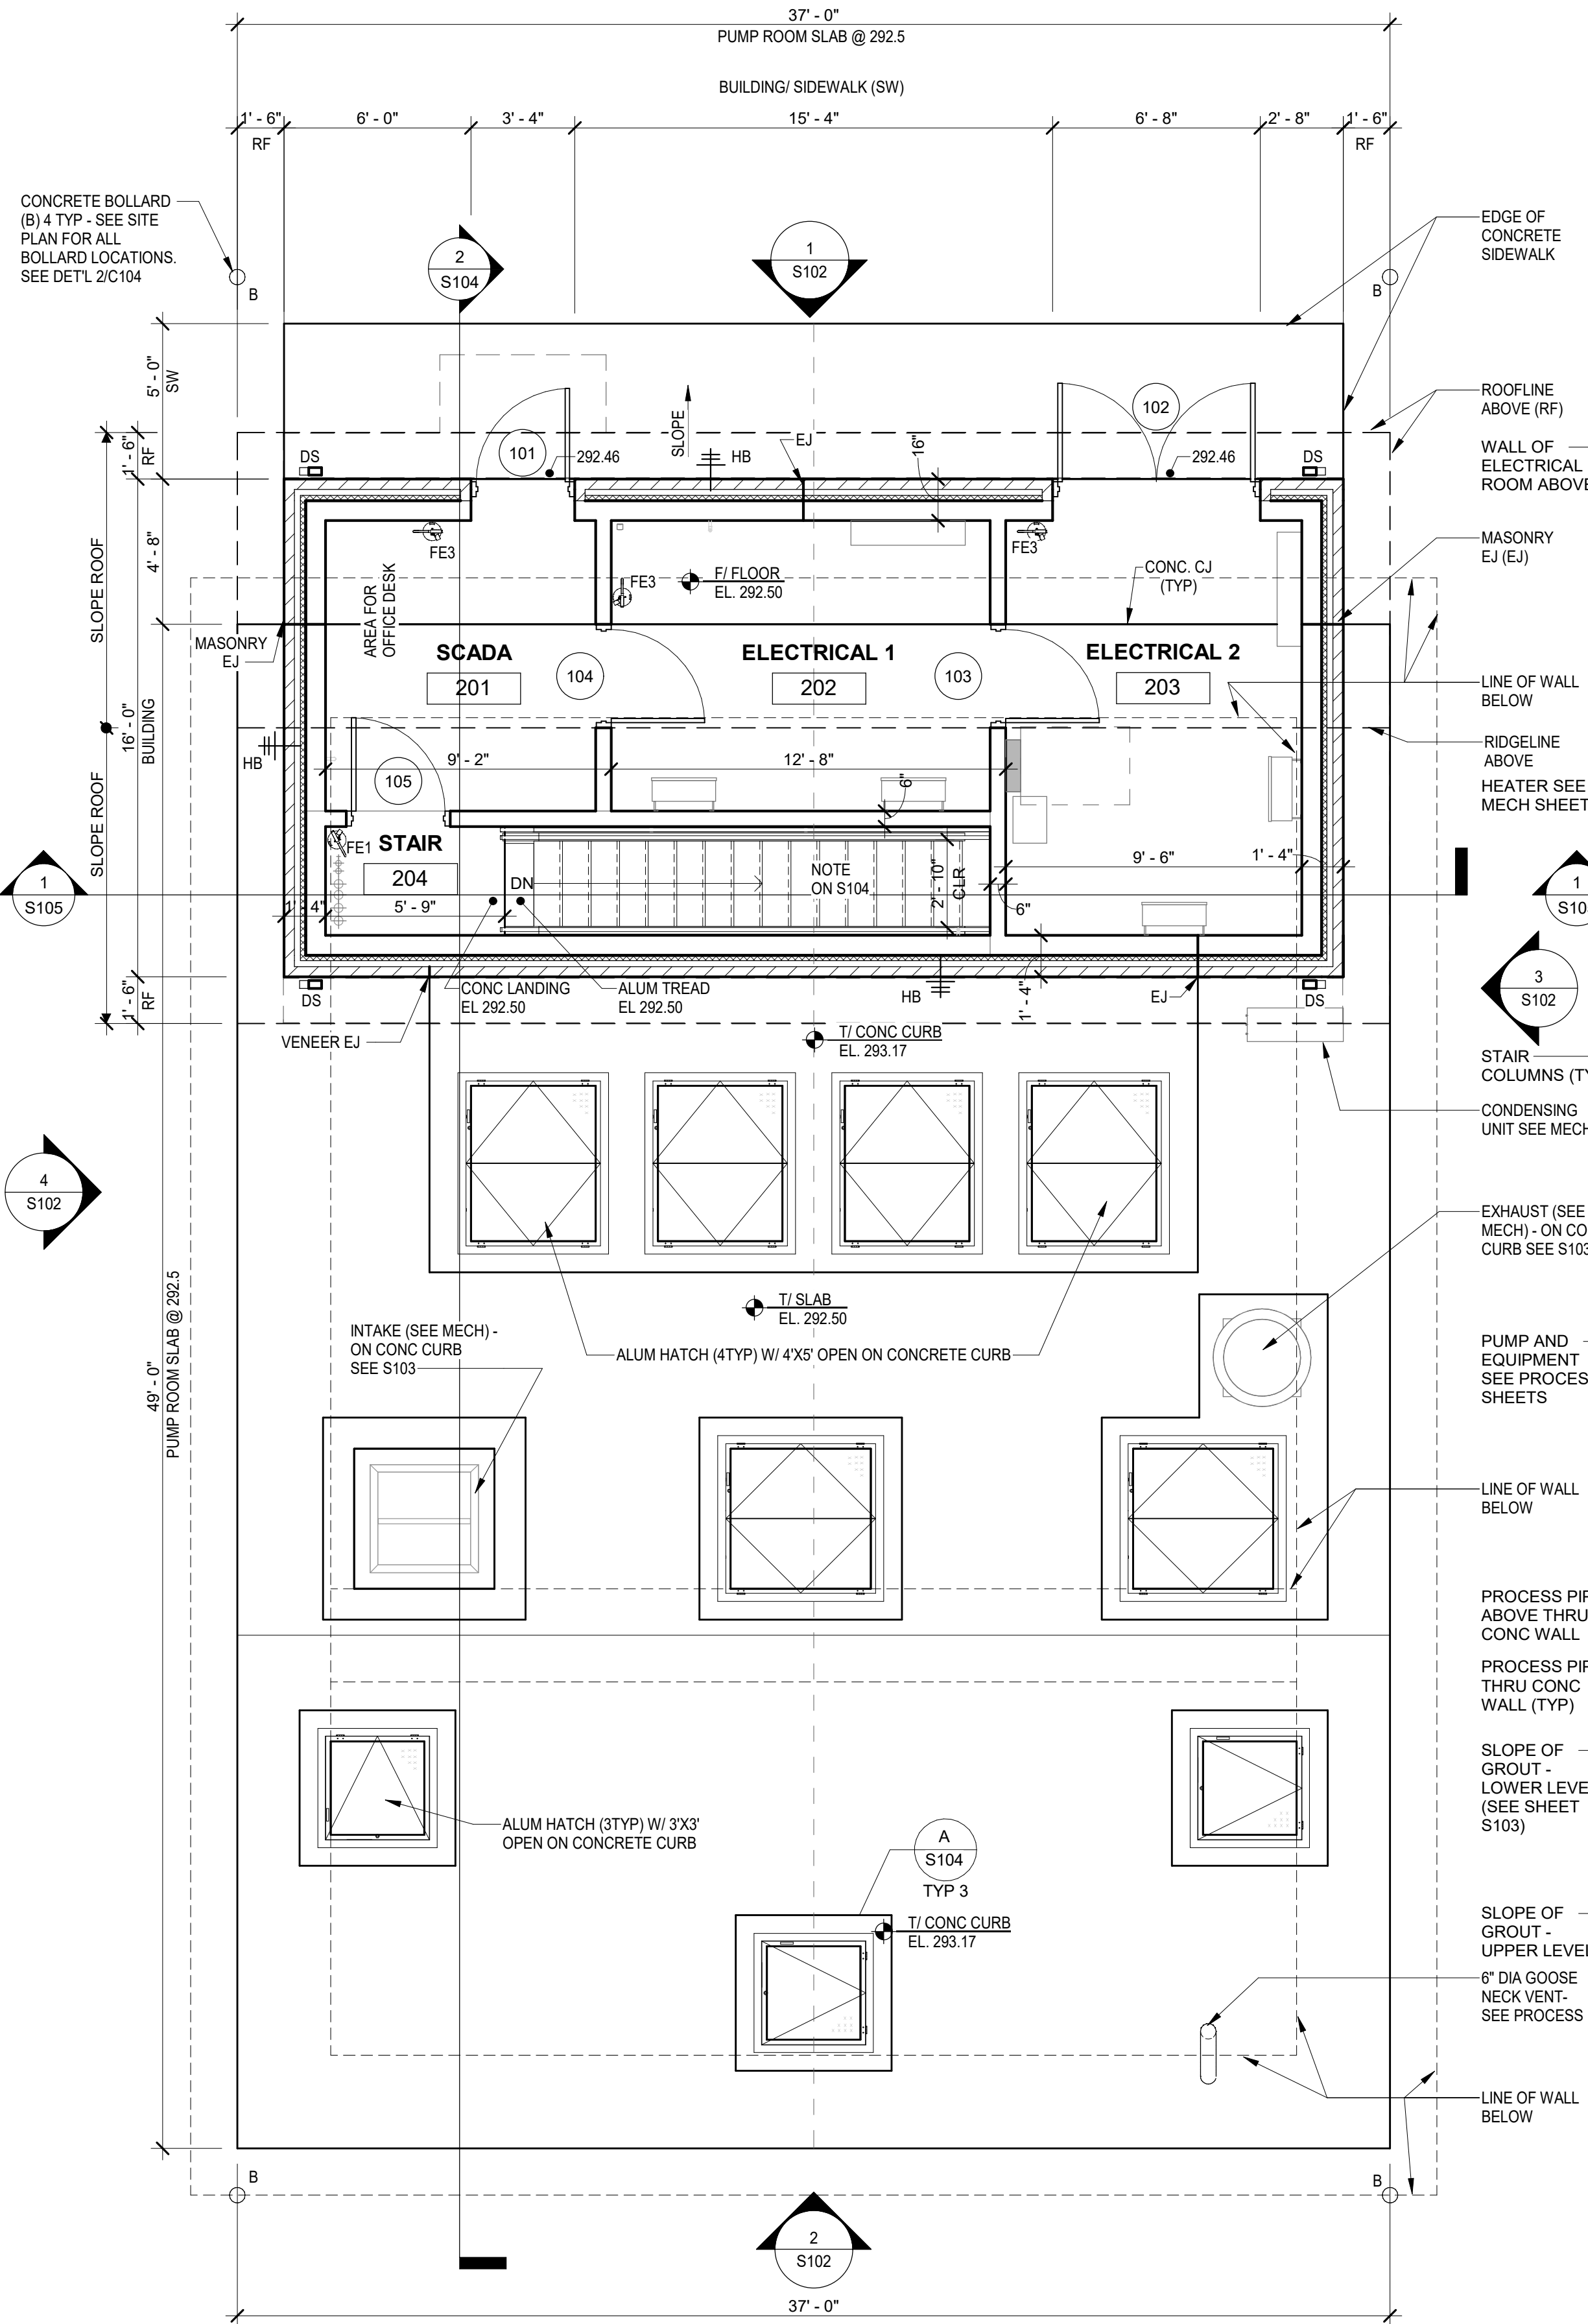

2 BUILDING SECTION @ ELEV 261.50

SCALE: 1/4" = 1'-0"

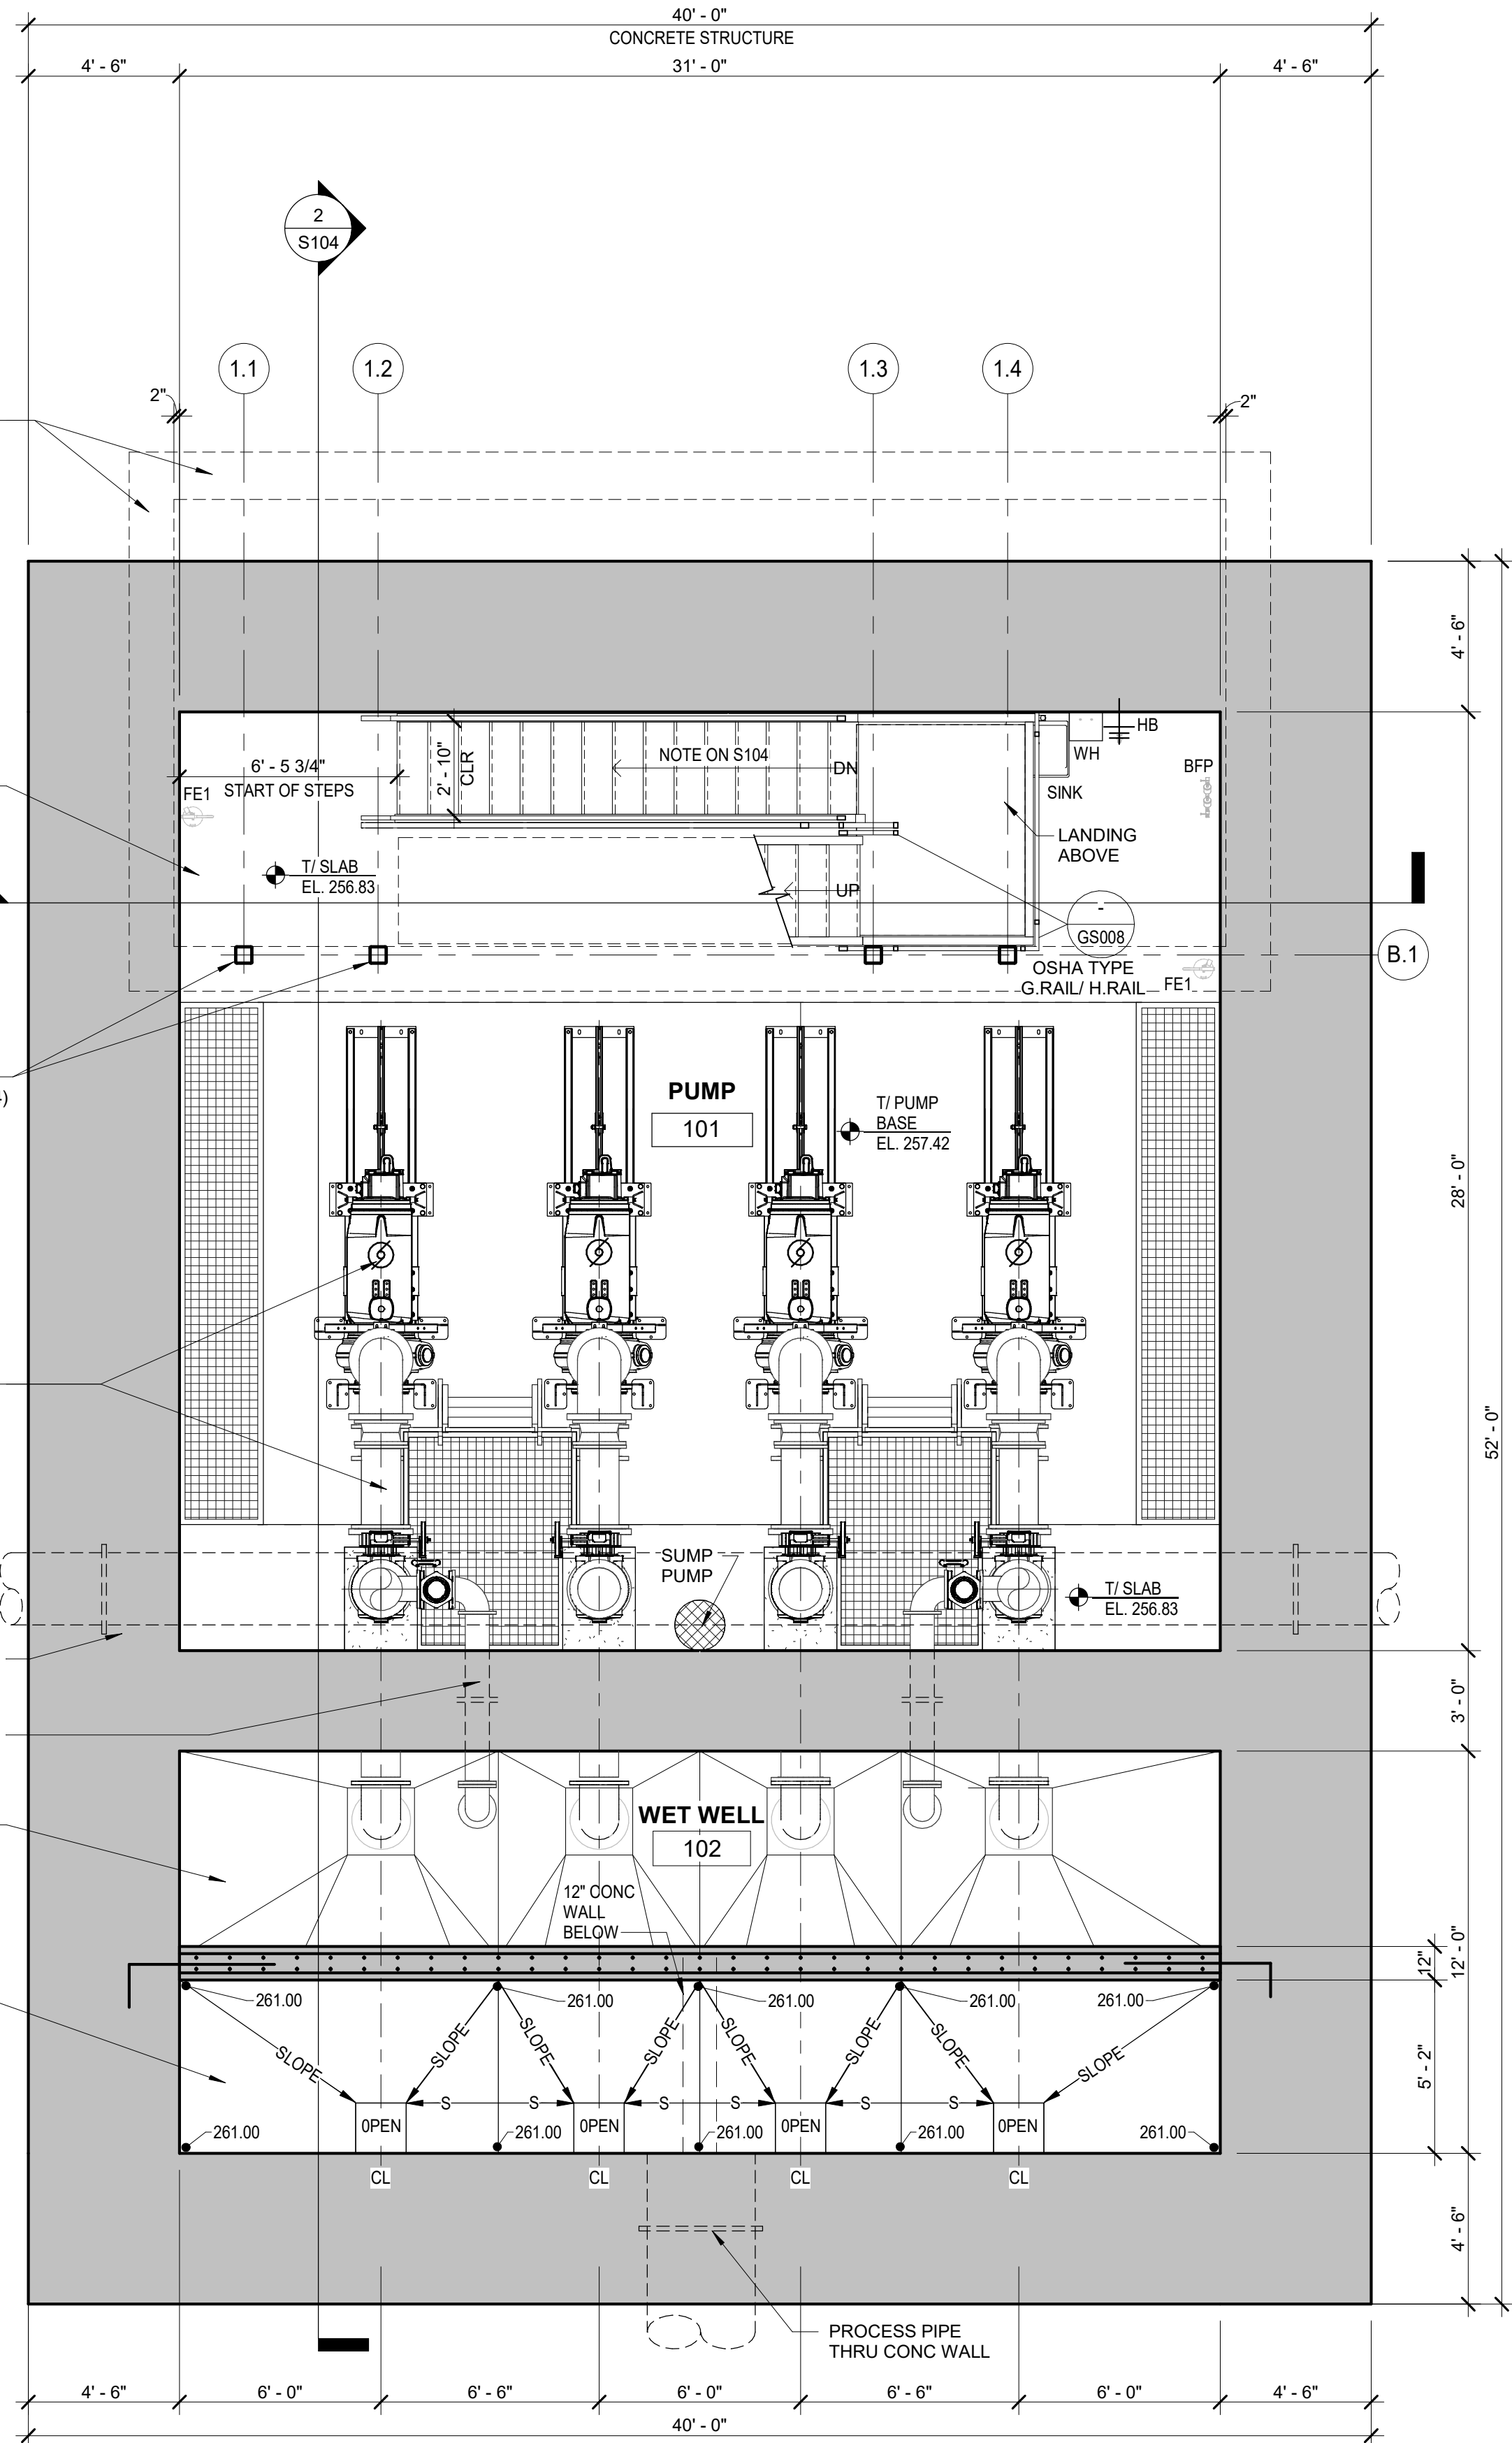

FINISH SCHEDULE

NO.	ROOM	FLOOR	BASE	WALLS	CEIL	REMARKS
101	PUMP ROOM	F1	--	--	--	FORMED FINISHED CONC. W REBAR
102	WET WELL	F2	--	W2	W2	W2
201	SCADA	F1	--	W1	W1	C1
202	ELECTRICAL 1	F1	--	W1	W1	C1
203	ELECTRICAL 1	F1	--	W1	W1	C1
204	STAIRS	F1	--	W1	W1	C1

FINISH MATERIALS LEGEND

FLOORS	F1	- CURE AND SEAL CONCRETE
	F2	- GROUTED
BASE	B1	- ----
WALLS	W1	- CMU - PAINTED
	W2	- EPOXY PROTECTIVE LINING SYSTEM
CEILINGS	C1	- EXPOSED STRUCTURE - PRIMED AND PAINTED
	C2	- EPOXY PROTECTIVE LINING SYSTEM



DOOR SCHEDULE

MAIN LIFT STATION

NO.	DOOR SIZE	DOOR TYPE	FRAME TYPE	HARDWARE SET	REMARKS
101	3'-0" x 7'-0"	D1/HM	HMF1	E-1	
102	(2) 3'-0" x 7'-0"	D1/HM	HMF2	E-2	
103	3'-0" x 7'-0"	D2/HM	HMF1	I-1	
104	3'-0" x 7'-0"	D2/HM	HMF1	I-1	
105	3'-0" x 7'-0"	D2/HM	HMF1	I-2	

HARDWARE SET SCHEDULE

SET E-1	BB HINGES-HW w/IN R.P.; MORTISE LOCK EXIT DEVICE (WITH EXTERIOR LEVER HANDLE AND KEY CYLINDER); CLOSER W/ HOLD OPEN & POSITIVE STOP; KICKPLATE, H.D. FLOOR STOP, WEATHERSTRIP, BOTTOM SWEEP AND OFFSET THRESHOLD.
SET E-2	BB HINGES-HW w/IN R.P.; MORTISE LOCK EXIT DEVICE (WITH EXTERIOR LEVER HANDLE AND KEY CYLINDER) @ ACTIVE LEAF; CLOSER WITH HOLD OPEN & POSITIVE STOP-OVERHEAD STOP @ ACTIVE LEAF; T'ASTRAGAL @ ACTIVE LEAF; FLUSH BOLTS @ INACTIVE LEAF; HD KICK STOP & KICK PLATES (EACH DOOR); WEATHERSTRIP, BOTTOM SWEEP AND OFFSET THRESHOLD.
SET I-1	BB HINGES-HW; MORTISE LOCK SET; CLOSER WITH HOLD OPEN & POSITIVE STOP; HD KICK STOP & KICK PLATES.
SET I-2	BB HINGES-HW; MORTISE LATCH SET; CLOSER WITH HOLD OPEN & POSITIVE STOP; HD KICK STOP & KICK PLATES, WEATHERSTRIPS, BOTTOM SWEEP/OFFSET THRESHOLD.

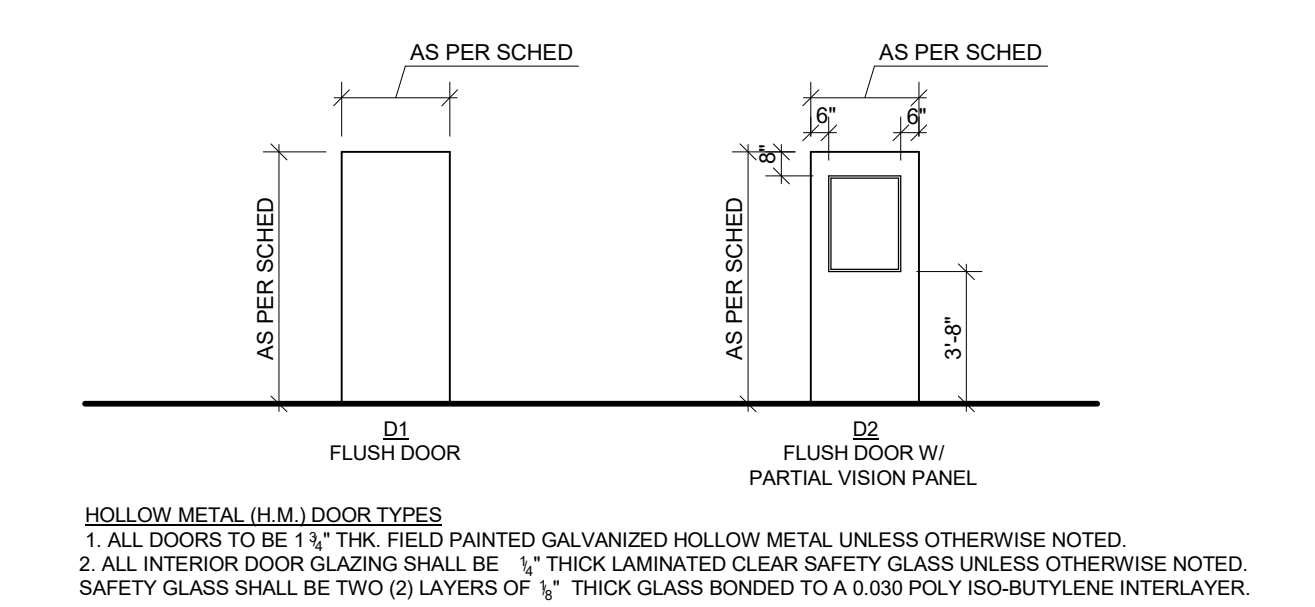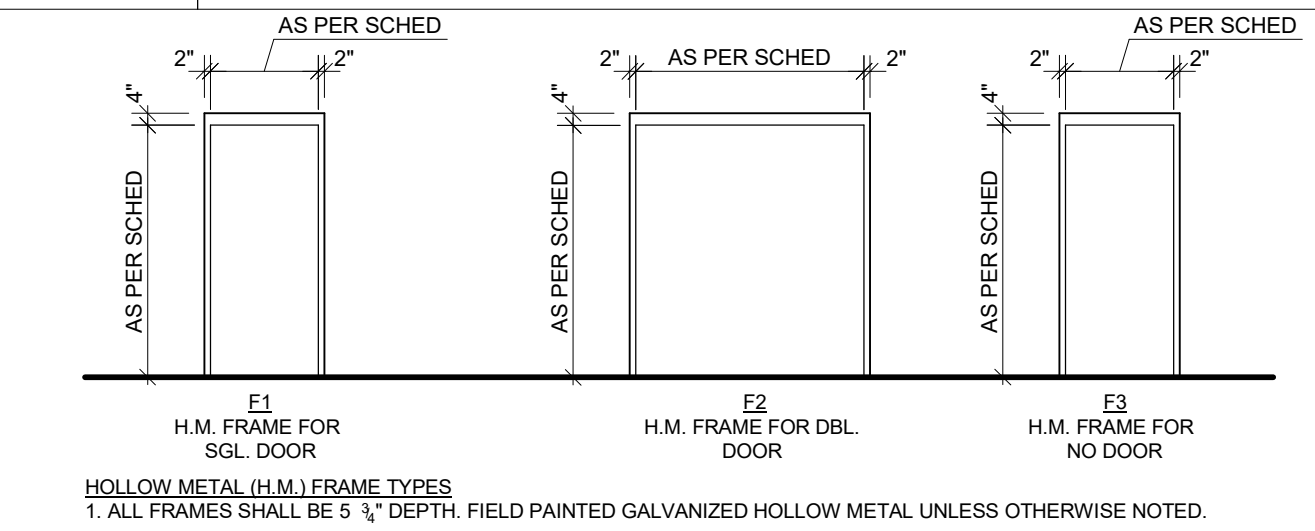

SPECIFICATION

- 10523 FIRE EXTINGUISHERS
1. FE-1: MULTIPURPOSE EXTINGUISHERS SHALL BE 10-POUND NOMINAL CAPACITY, W/ UL RATING OF 4A-60B-C
2. FE-2: HALOTRON EXTINGUISHERS SHALL BE 15-POUND NOMINAL CAPACITY, HALOTRON 1 TYPE, WITH UL RATING OF 2A-10B-C
- 2.1. DESIGN STANDARD: LARSEN'S HT SERIES (OR EQUAL)
3. FE-3: CARBON DIOXIDE EXTINGUISHERS SHALL BE 15-POUND NOMINAL CAPACITY, W/ UL RATING OF 10B-C
- 3.1. DESIGN STANDARD: LARSEN'S CD SERIES (OR EQUAL)
4. MOUNTING BRACKETS: SURFACE MOUNTING BRACKETS SHALL BE THE SIZE AND TYPE DESIGNED FOR EACH EXTINGUISHER TYPE.
- 4.1. DESIGN STANDARD: LARSEN'S MOUNTING BRACKET #862/864.

LEGEND

FD	- FLOOR DRAIN
FE-???	- FIRE EXTINGUISHER - SURFACE MOUNTED
CJ	- CONTROL JOINT
EJ	- EXPANSION JOINT
B	- BOLLARD
HB	- FROST PROOF HOSE BIBB
4" X 8" X 16" CMU VENEER	- 4" X 8" X 16" CMU VENEER
RIGID INSULATION	- RIGID INSULATION
REINFORCED CMU WALL	- REINFORCED CMU WALL

FLOOR PLAN, SECTION, SCHEDULES & NOTES

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K.ROWETT
checked by: C.HARDIN
approved by: C.HARDIN
QA/QC by: M.MILILUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
S101



BY

REVISION DESCRIPTION

DATE

REV. NO.

REVISIONS

2020

FLOOR PLAN, SECTION, SCHEDULES & NOTES

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K.ROWETT
checked by: C.HARDIN
approved by: C.HARDIN
QA/QC by: M.MILILUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
S101



BY

REVISION DESCRIPTION

DATE

REV. NO.

REVISIONS

2020

FLOOR PLAN, SECTION, SCHEDULES & NOTES

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K.ROWETT
checked by: C.HARDIN
approved by: C.HARDIN
QA/QC by: M.MILILUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
S101



BY

REVISION DESCRIPTION

DATE

REV. NO.

REVISIONS

2020

FLOOR PLAN, SECTION, SCHEDULES & NOTES


NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K.ROWETT
checked by: C.HARDIN
approved by: C.HARDIN
QA/QC by: M.MILILUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
S101


C:\Users\krowett\Documents\S_Jonesboro_Central_180054_krowett.rvt
12/30/2019 4:02:22 PM

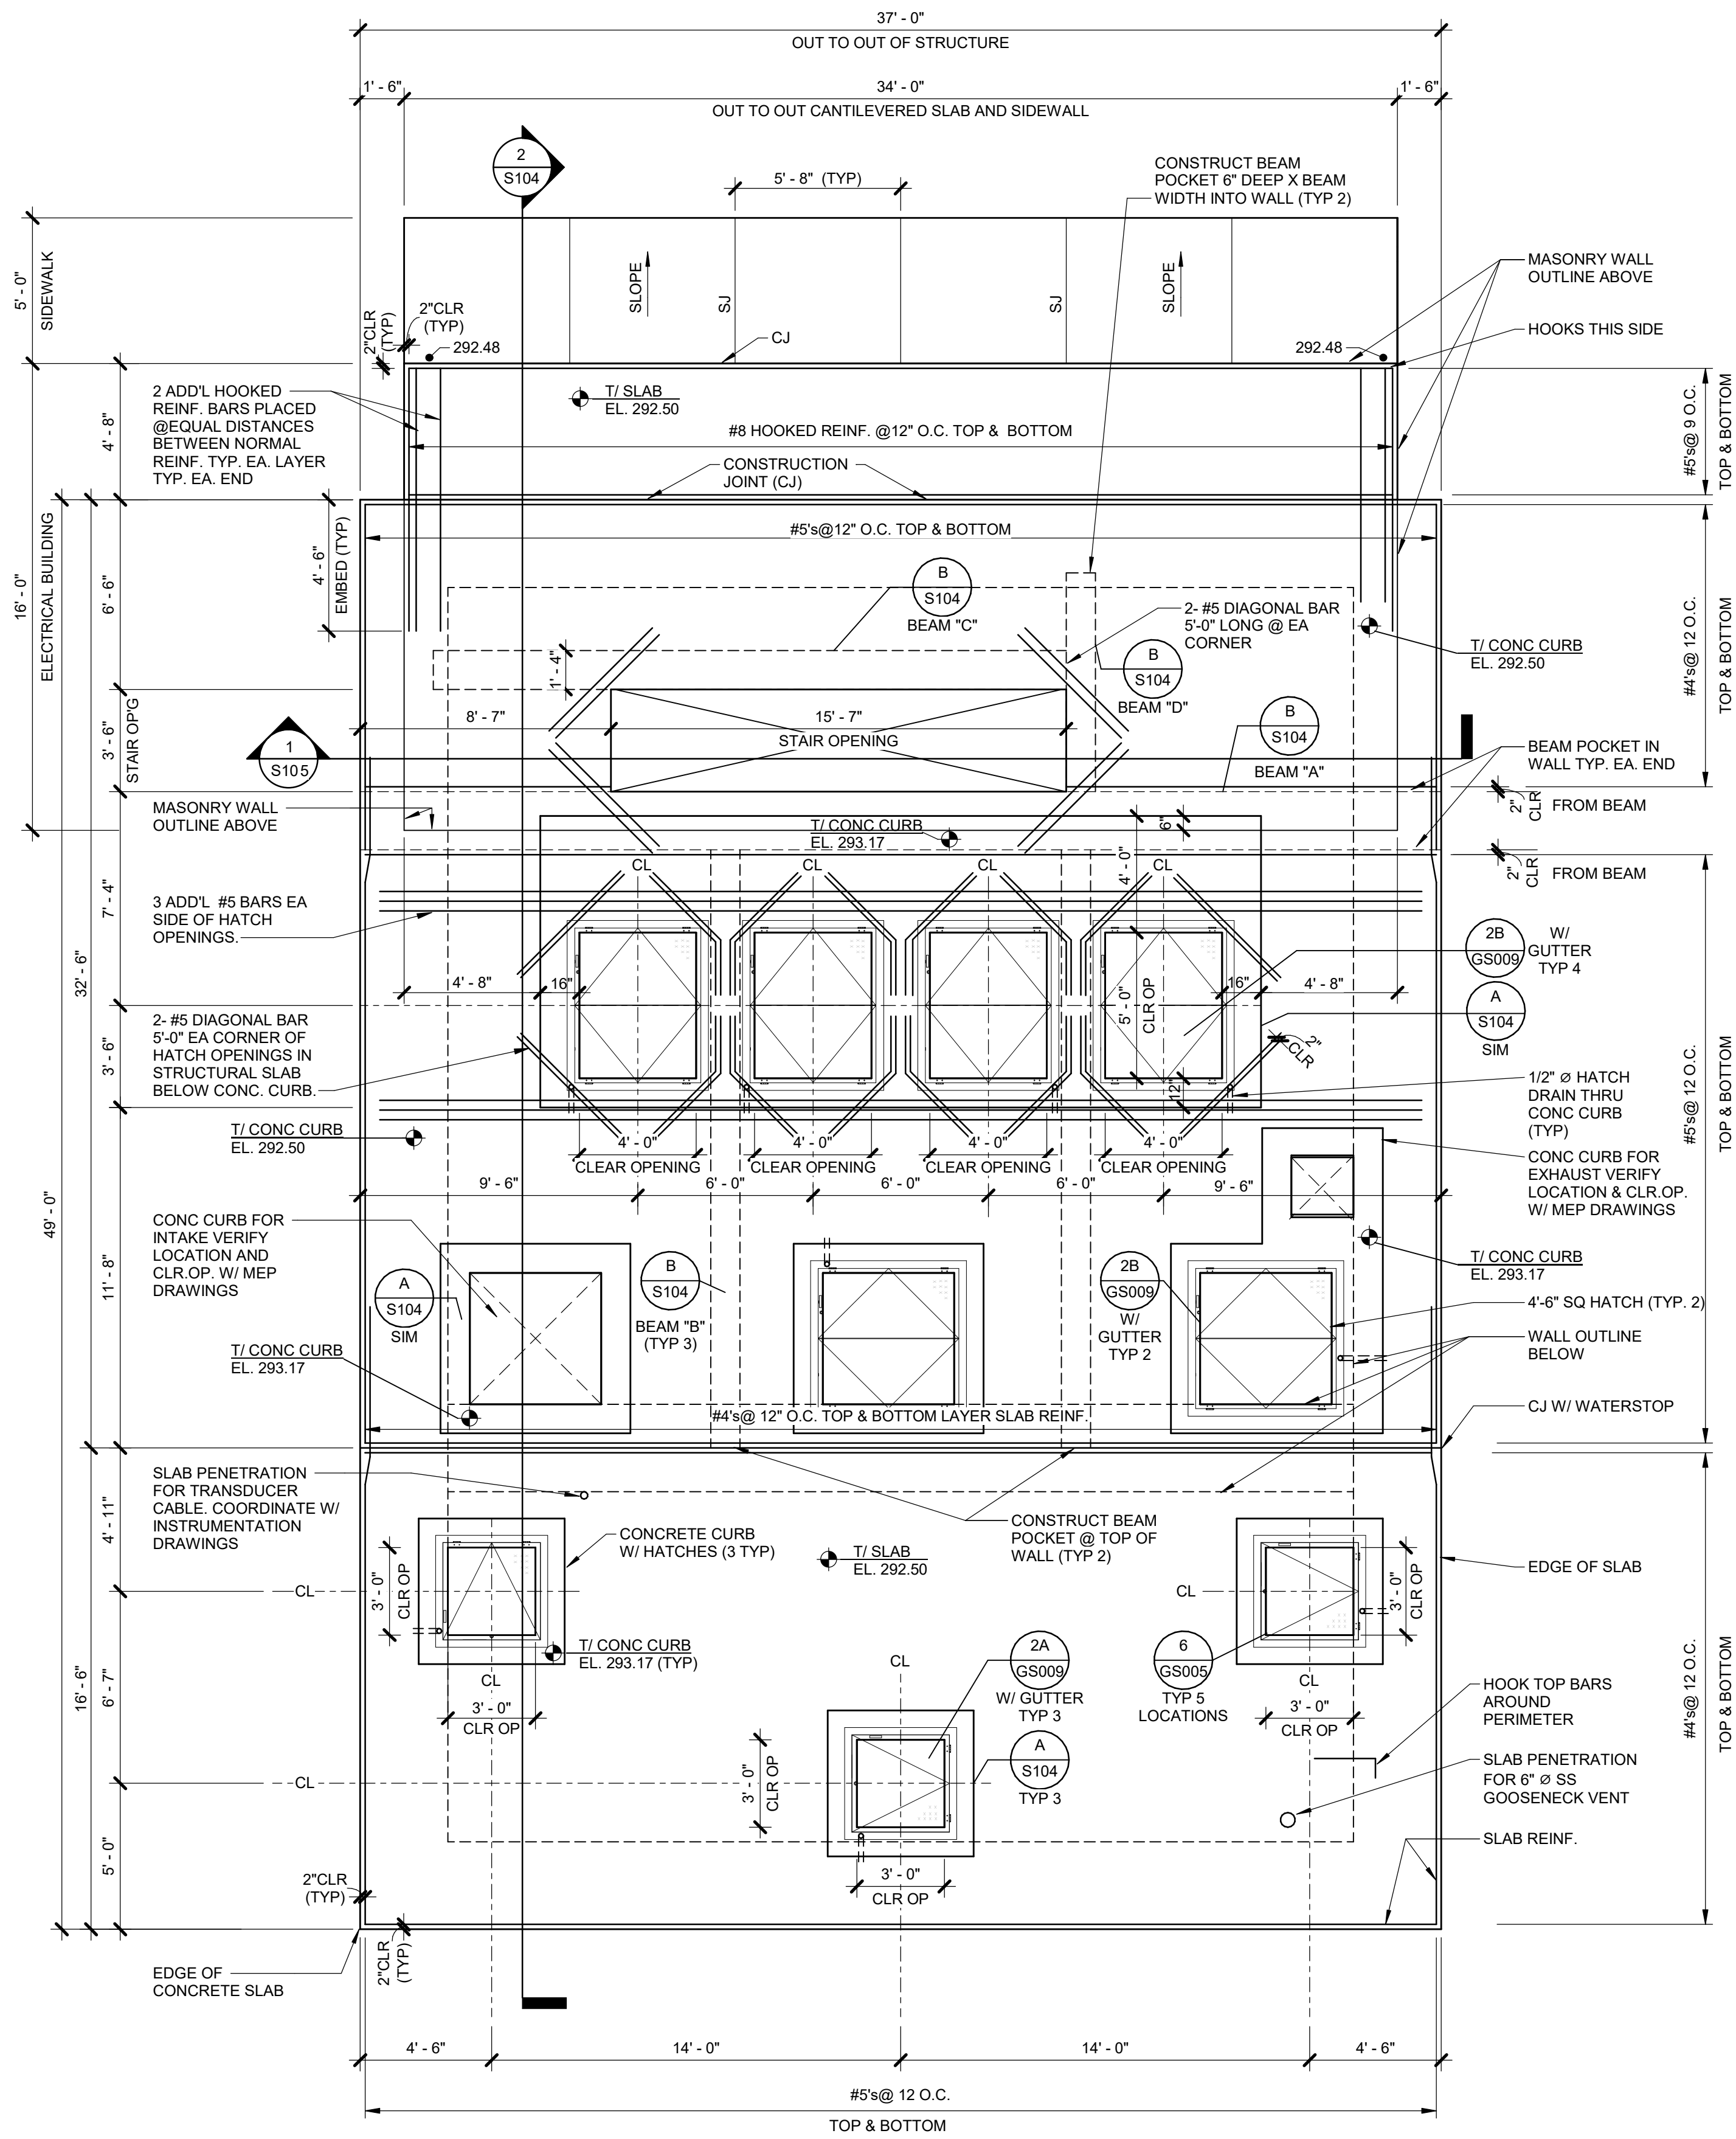

3

TOP OF SLAB @ FFL 292.5

SCALE: 1/4" = 1'-0"

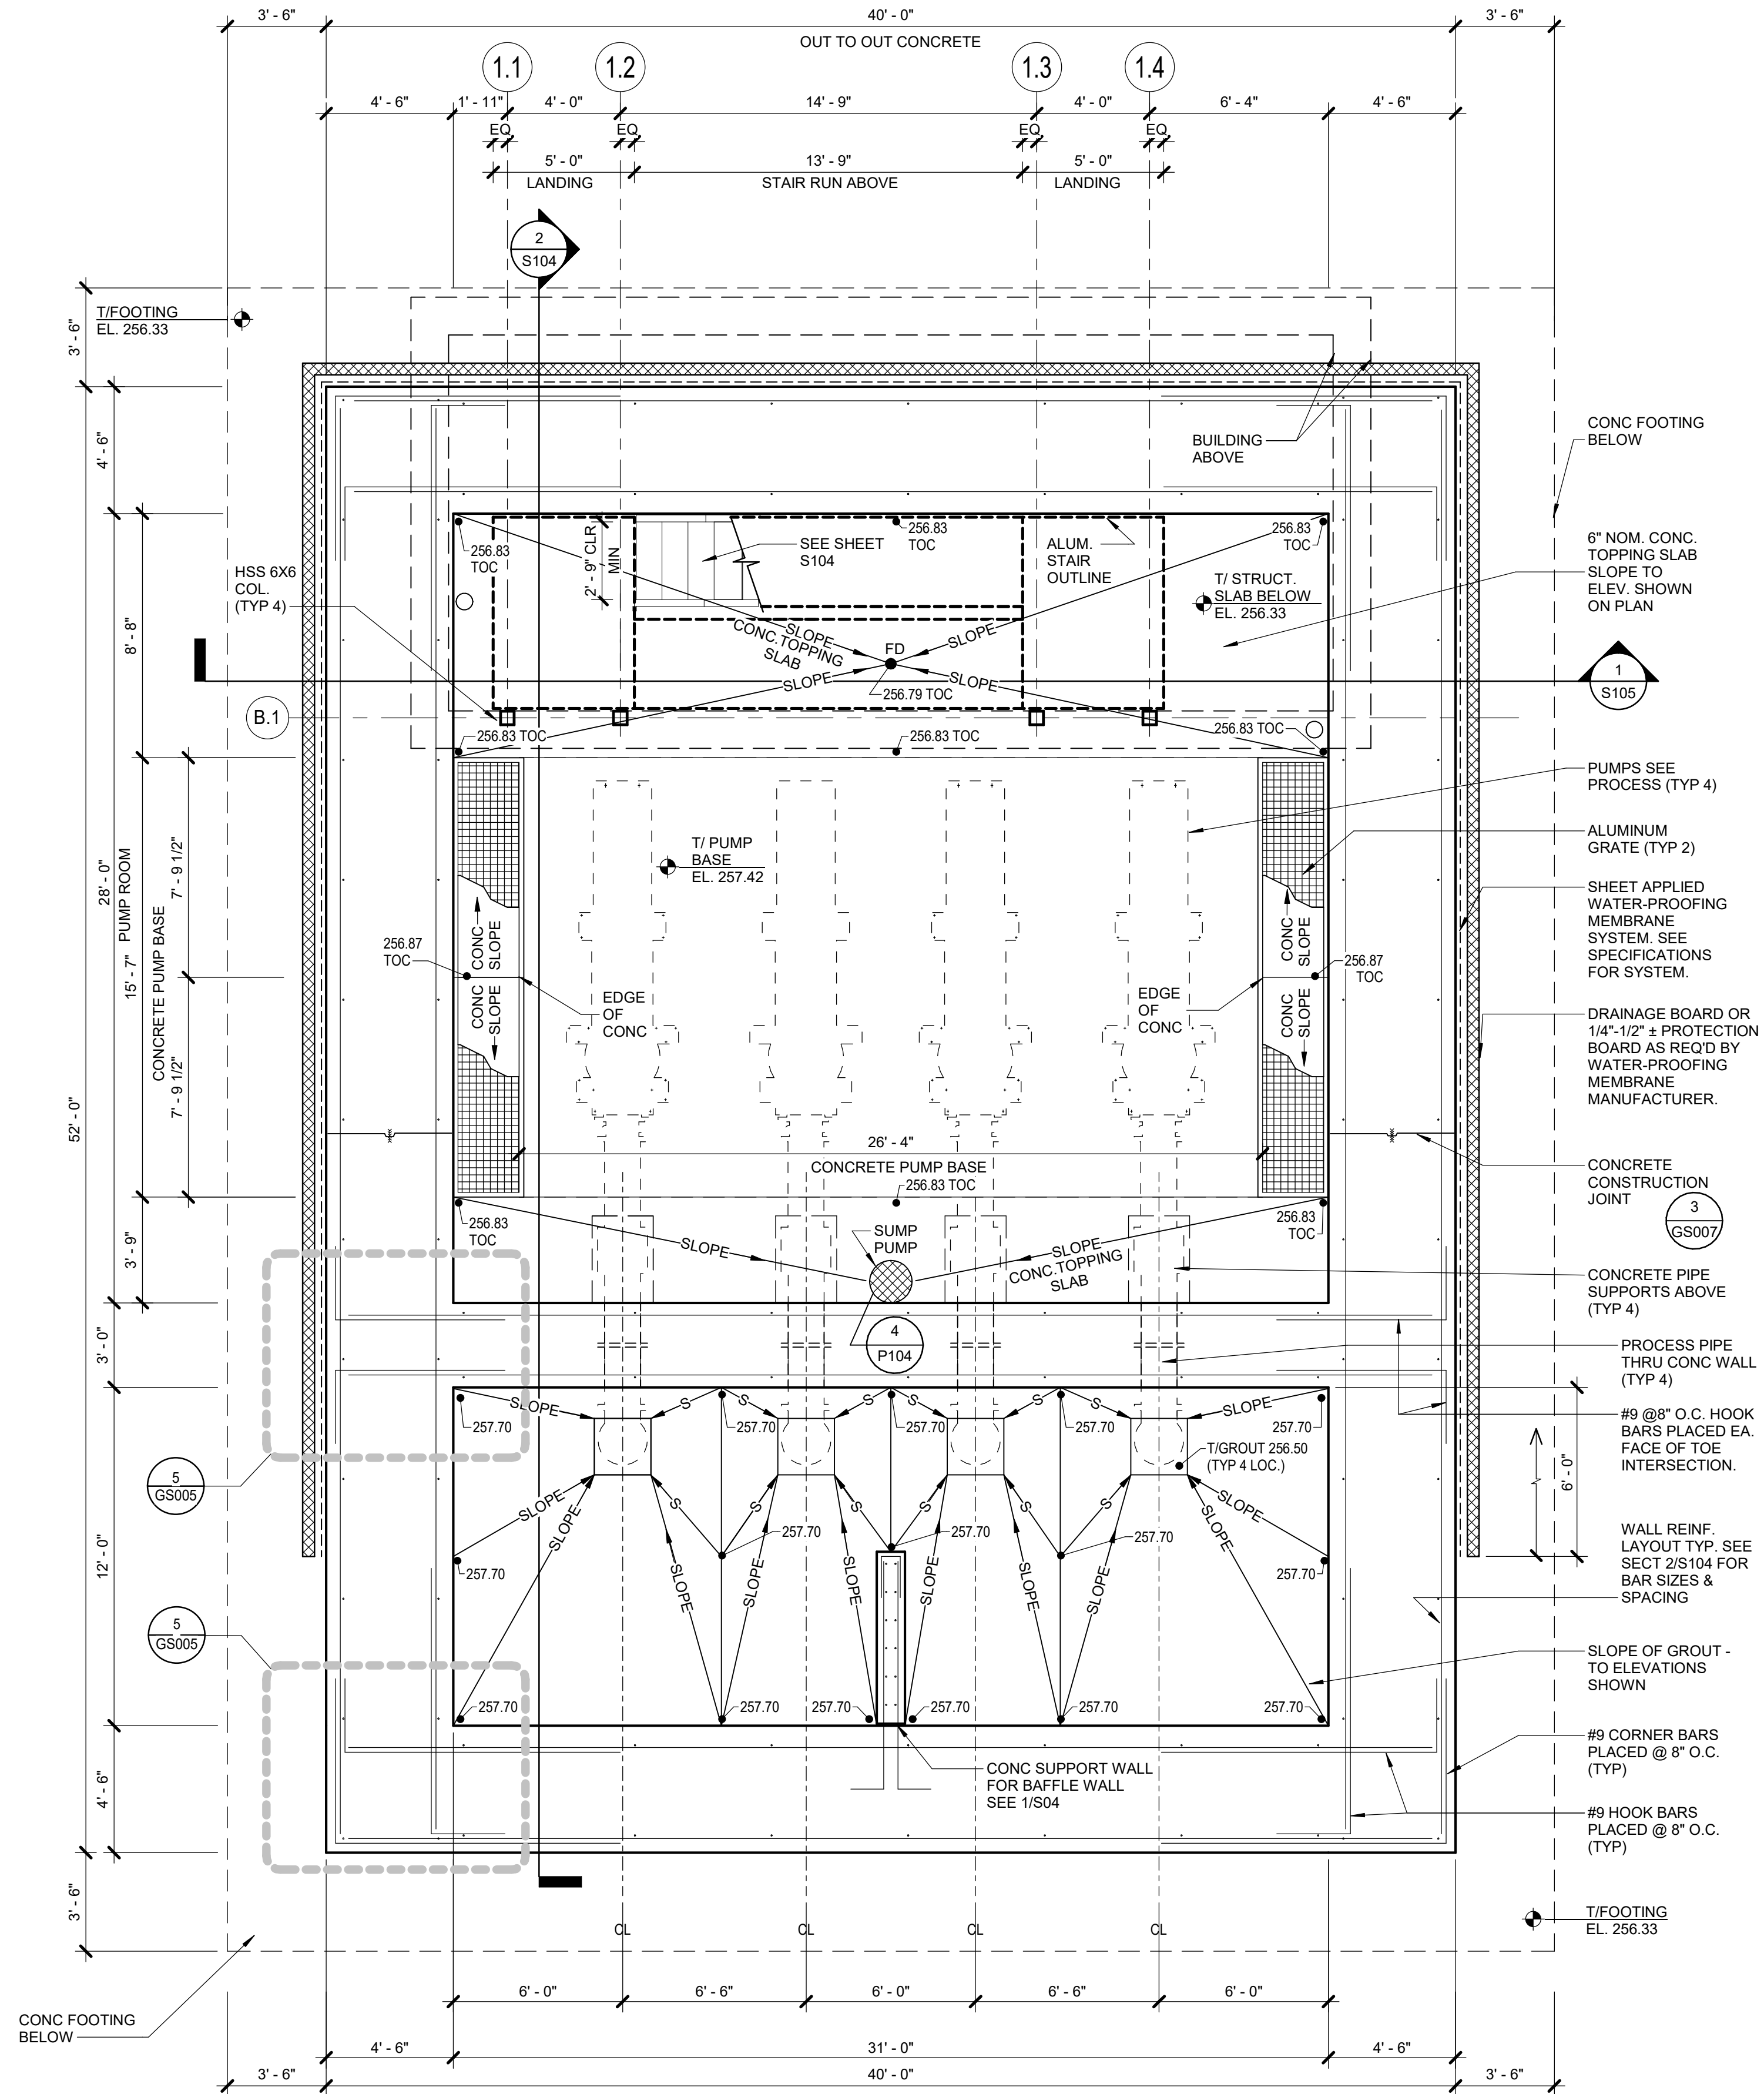

4

BUILDING SECTION @ ELEV 259.50

SCALE: 1/4" = 1'-0"

STRUCTURAL PLANS - BELOW GROUND

NEW WESTSIDE MAIN LIFT STATION

CITY WATER & LIGHT

JONESBORO, ARKANSAS



REV. NO.	DATE	REVISION DESCRIPTION
1		BY
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		

2020



drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020





SHEET
S103

olsson

302 E. Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com


REVISIONS



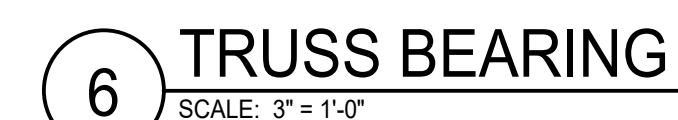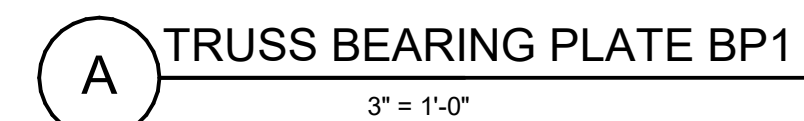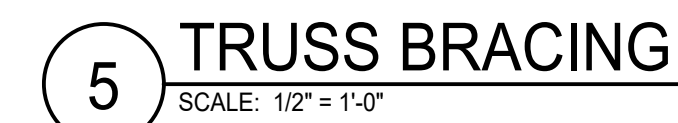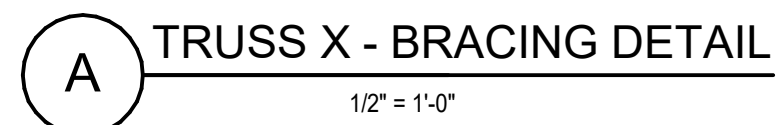

C:\Users\krowett\Documents\S_Jonesboro_Central_180054_krowett.rvt

12/30/2019 4:02:24 PM

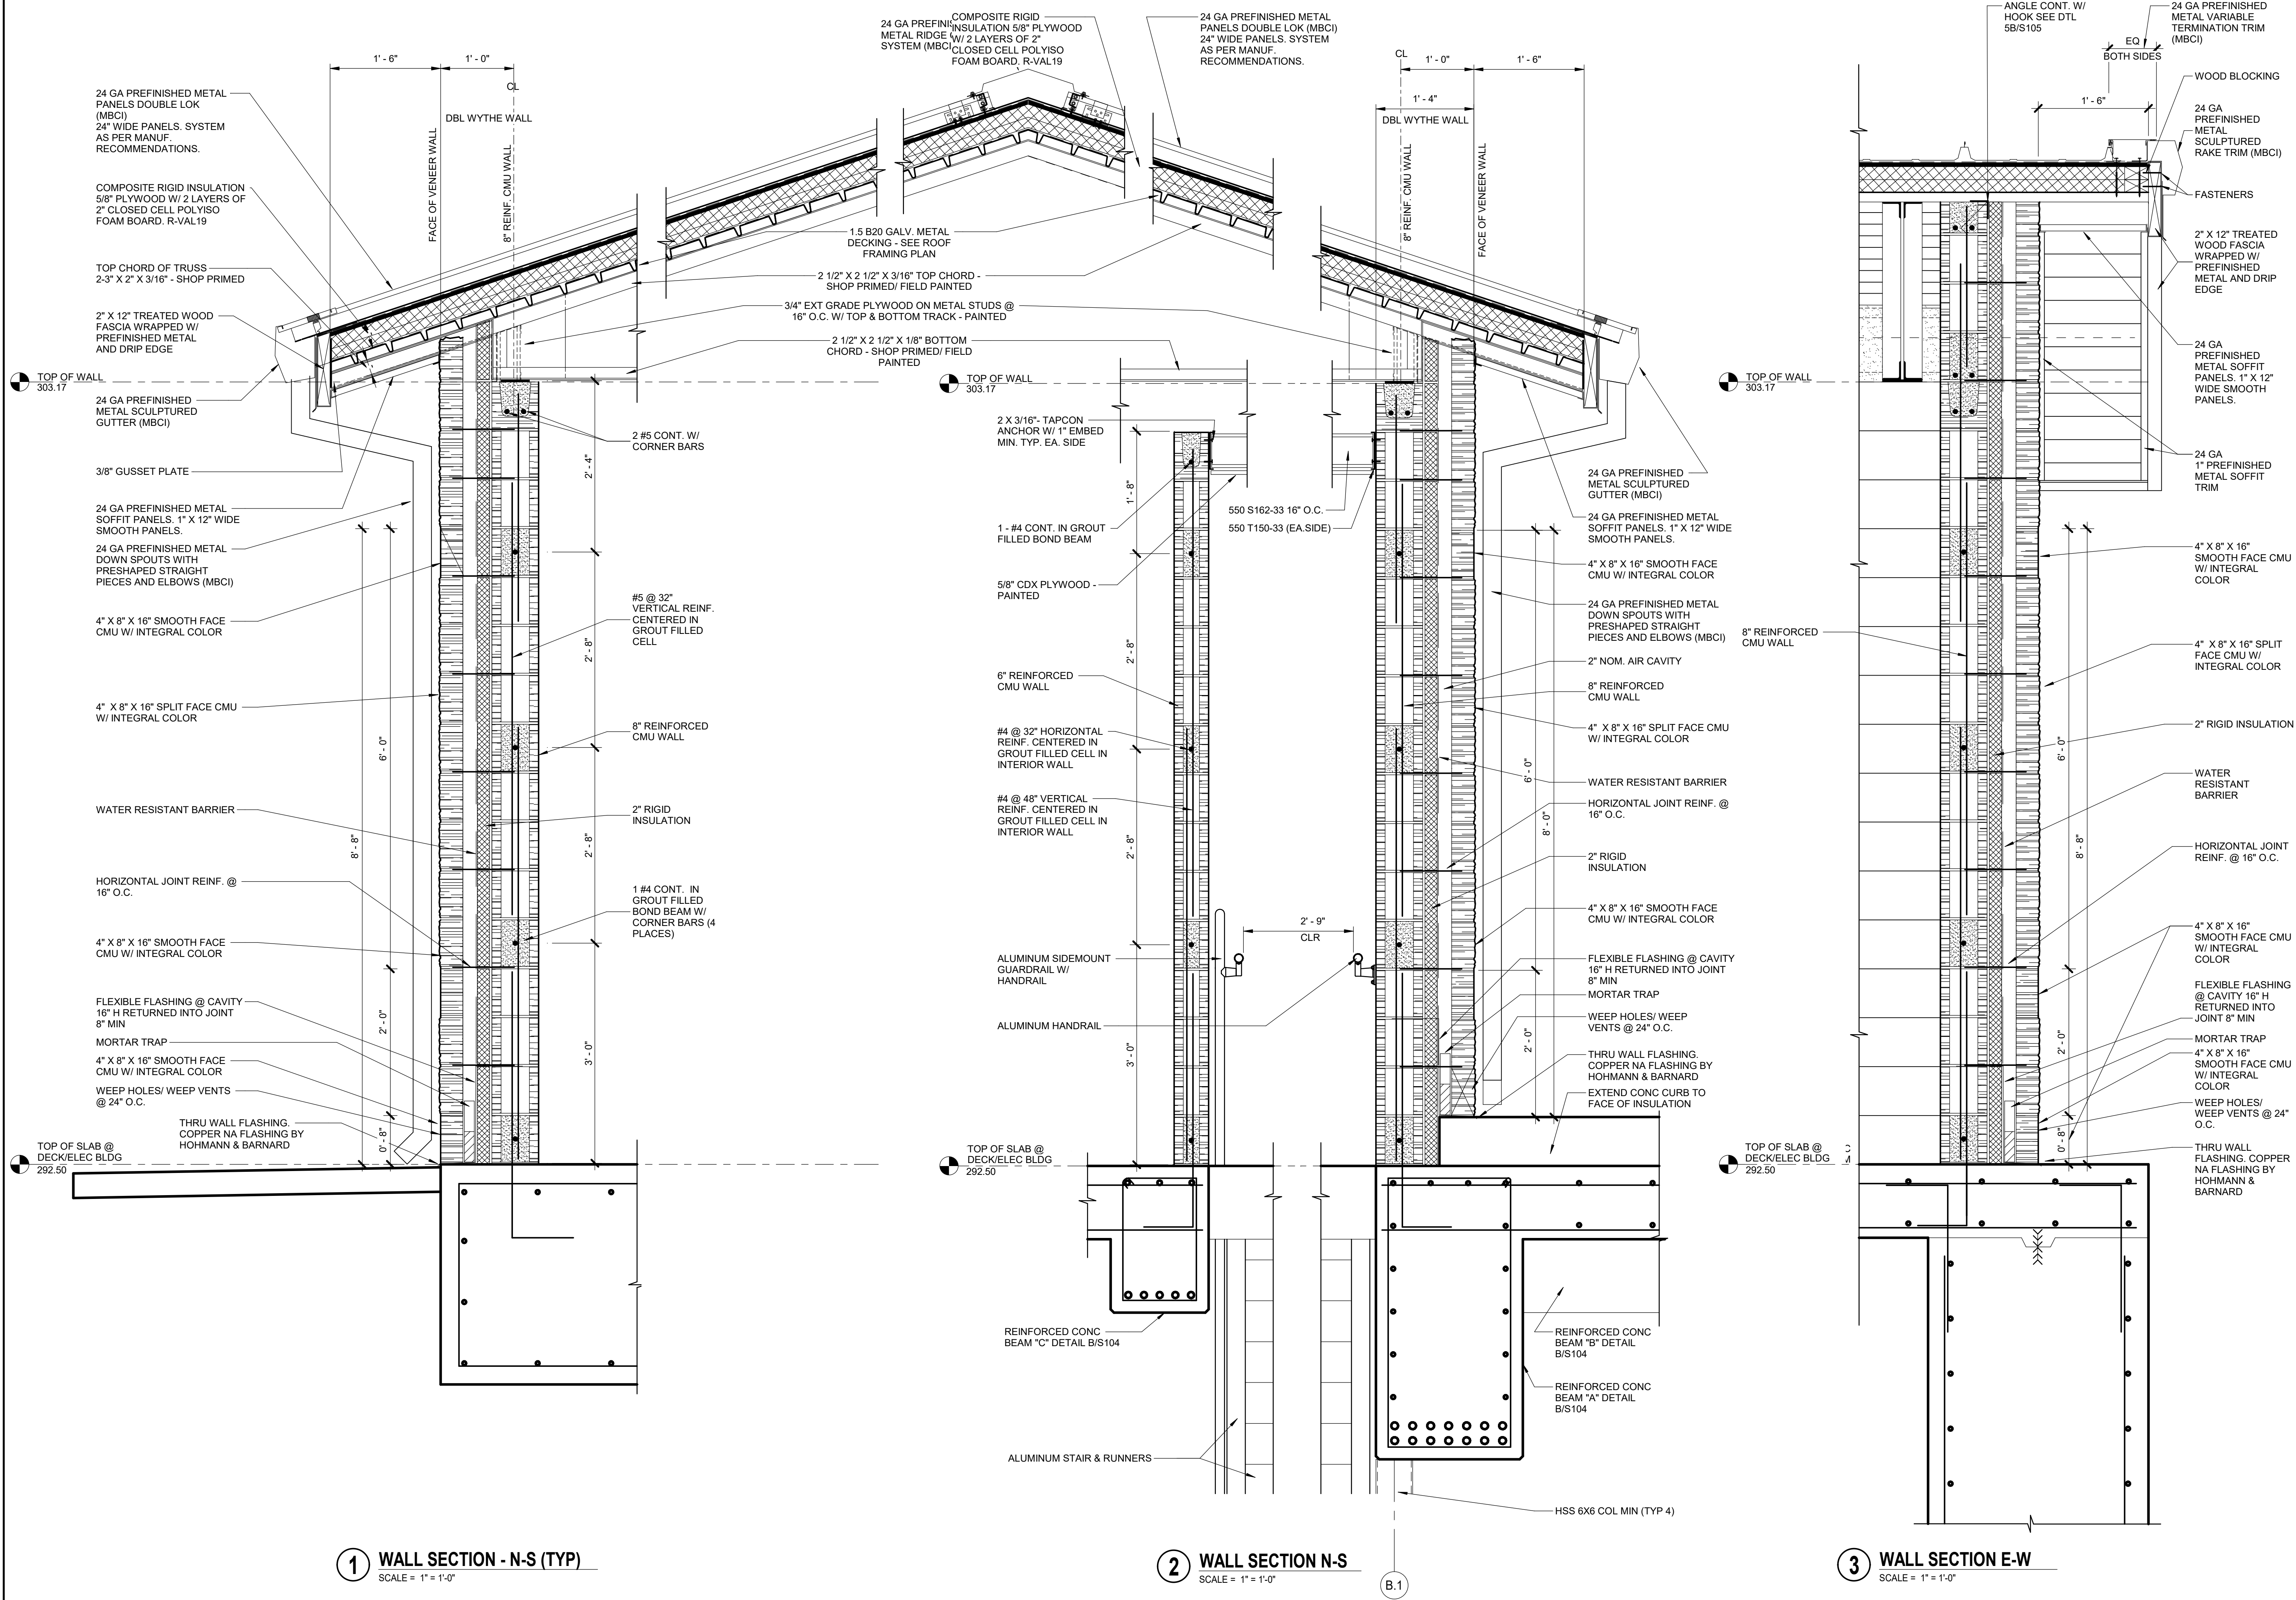

olsson

302 E. Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 13205
HARRY C. HARDIN
01/02/2020

BY
REVISION DESCRIPTION
DATE
REV. NO.

2020

WALL SECTIONS


NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
S107

DWG: \\oac.dgsconsulting.com\lts-ns1\projects-direct\2018\0001-0500\018-0054\40-Design\AutoCAD\Final Plans\Sheets\Main Lift Station\Structural\S-S108-0180054.dwg
DATE: Dec 31, 2019 8:58am USER: krowett

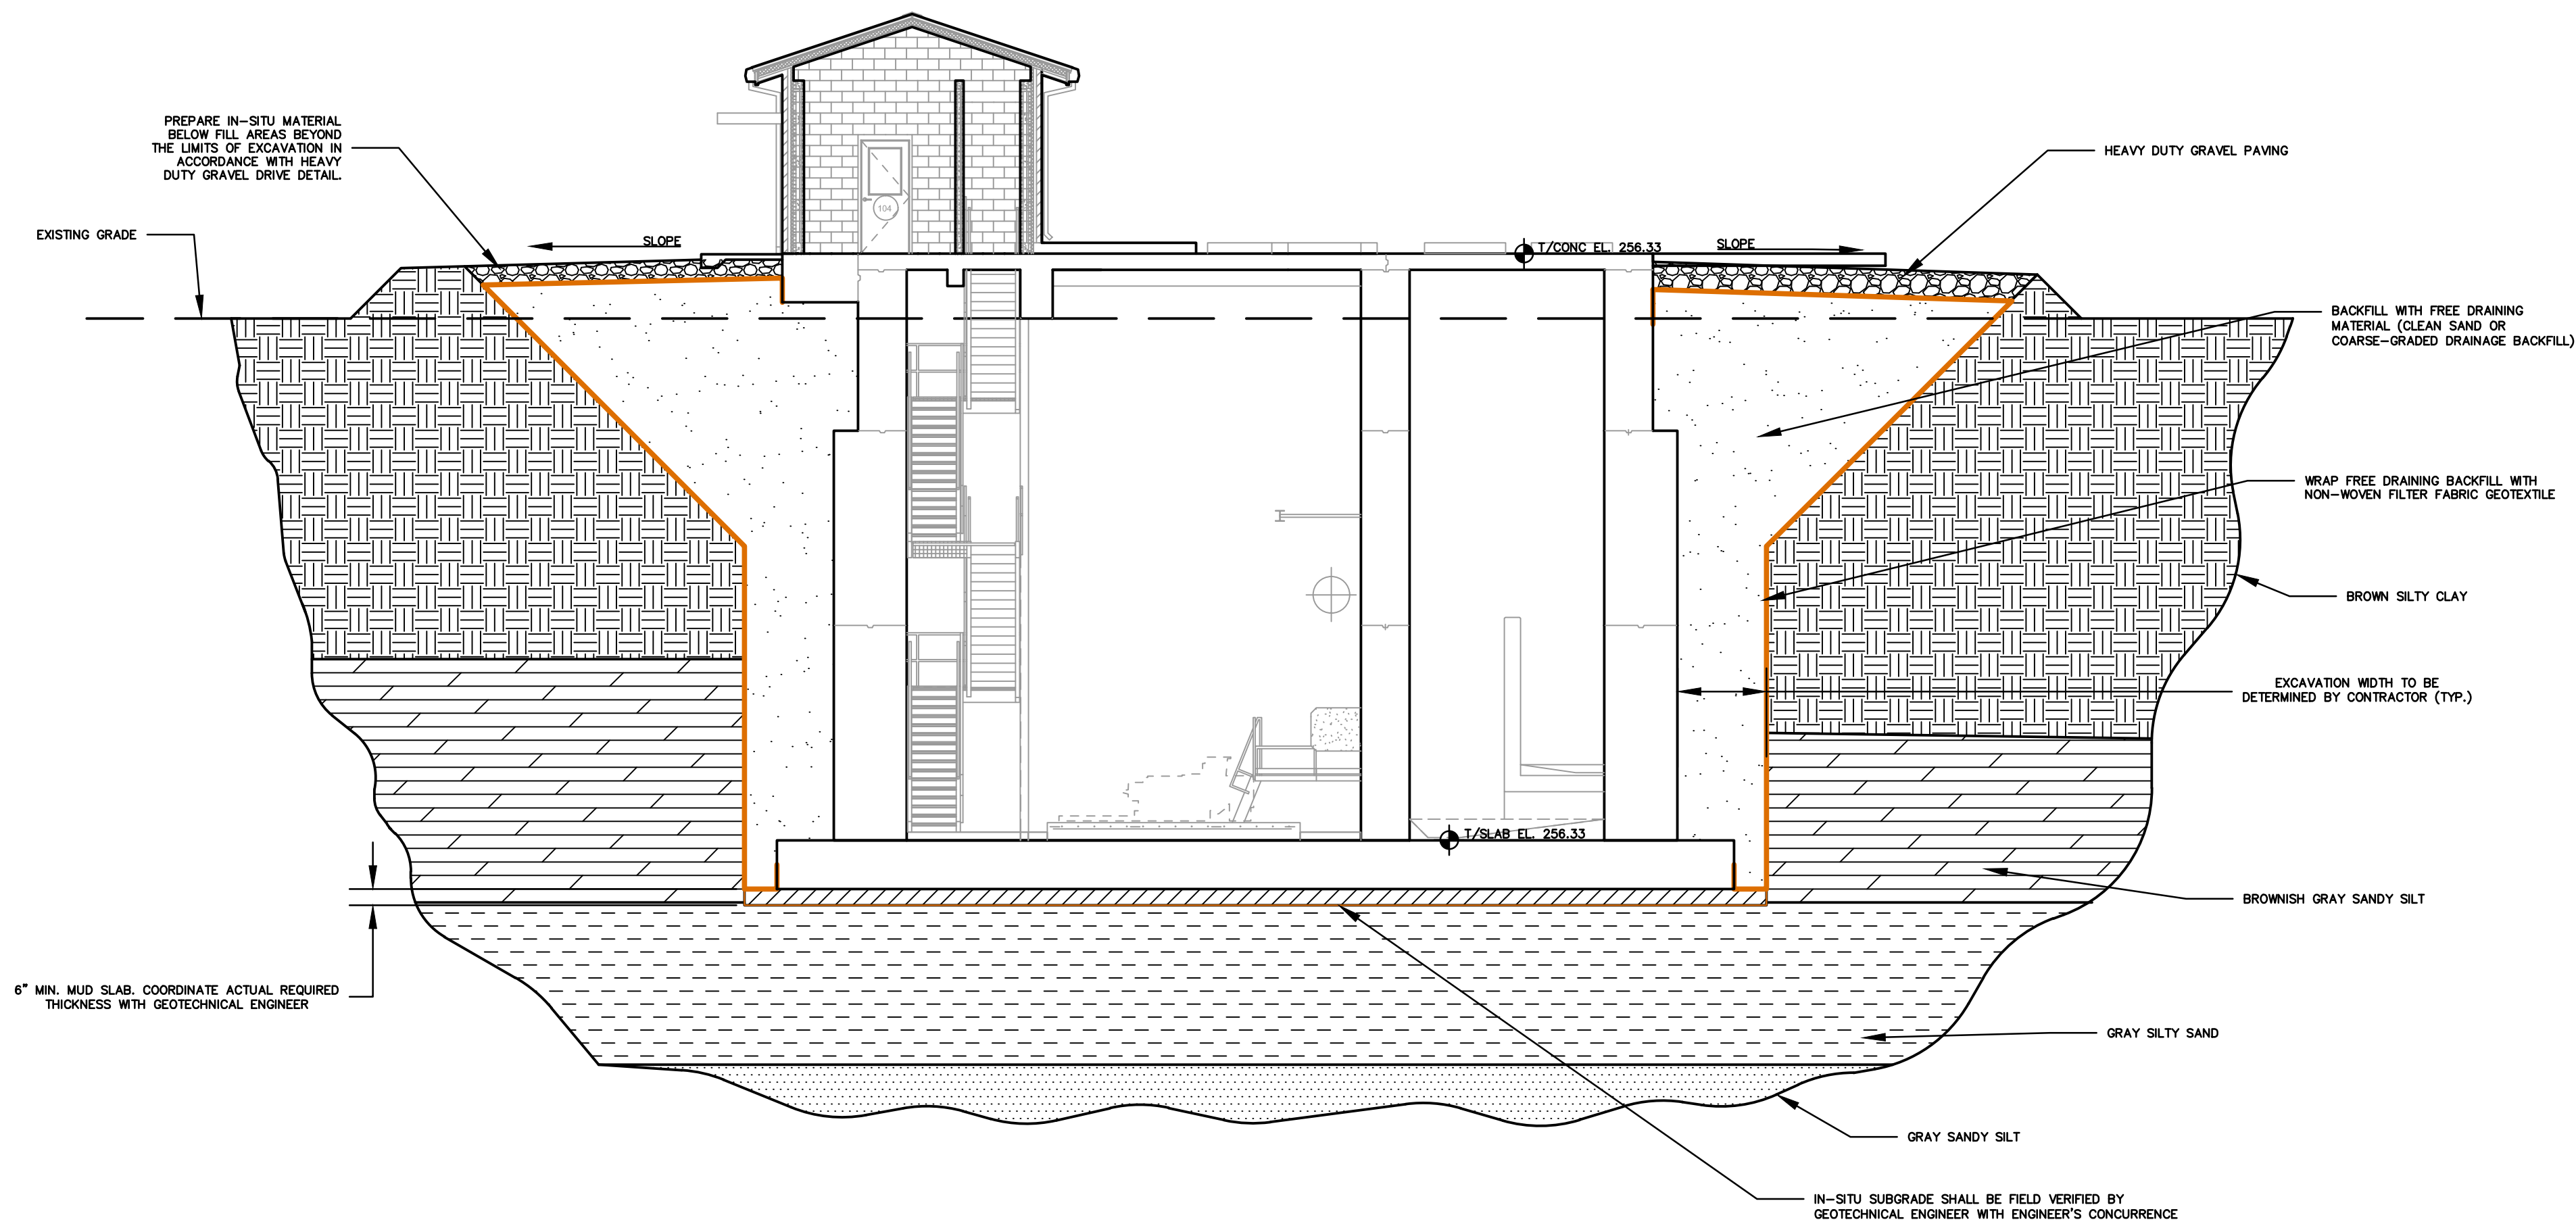

olsson

302 East Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
www.olsson.com

STATE OF
ARKANSAS
REGISTERED
PROFESSIONAL
ENGINEER
No. 13205
HARRY C. HARDIN
01/02/2020

BY

REVISIONS DESCRIPTION

DATE

REV. NO.

REVISIONS

BACKFILL PLAN

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K. ROWETT
checked by: A. STENGEL
approved by: C. HARDIN
QA/QC by: M. MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

2020

SHEET
S108


C:\Users\krowett\Documents\Jonesboro_Central_180054_krowett.rvt
12/30/2019 4:58:00 PM



1

TOP OF SLAB @ DECK/ ELECTRICAL BUILDING

SCALE: 1/4" = 1'-0"

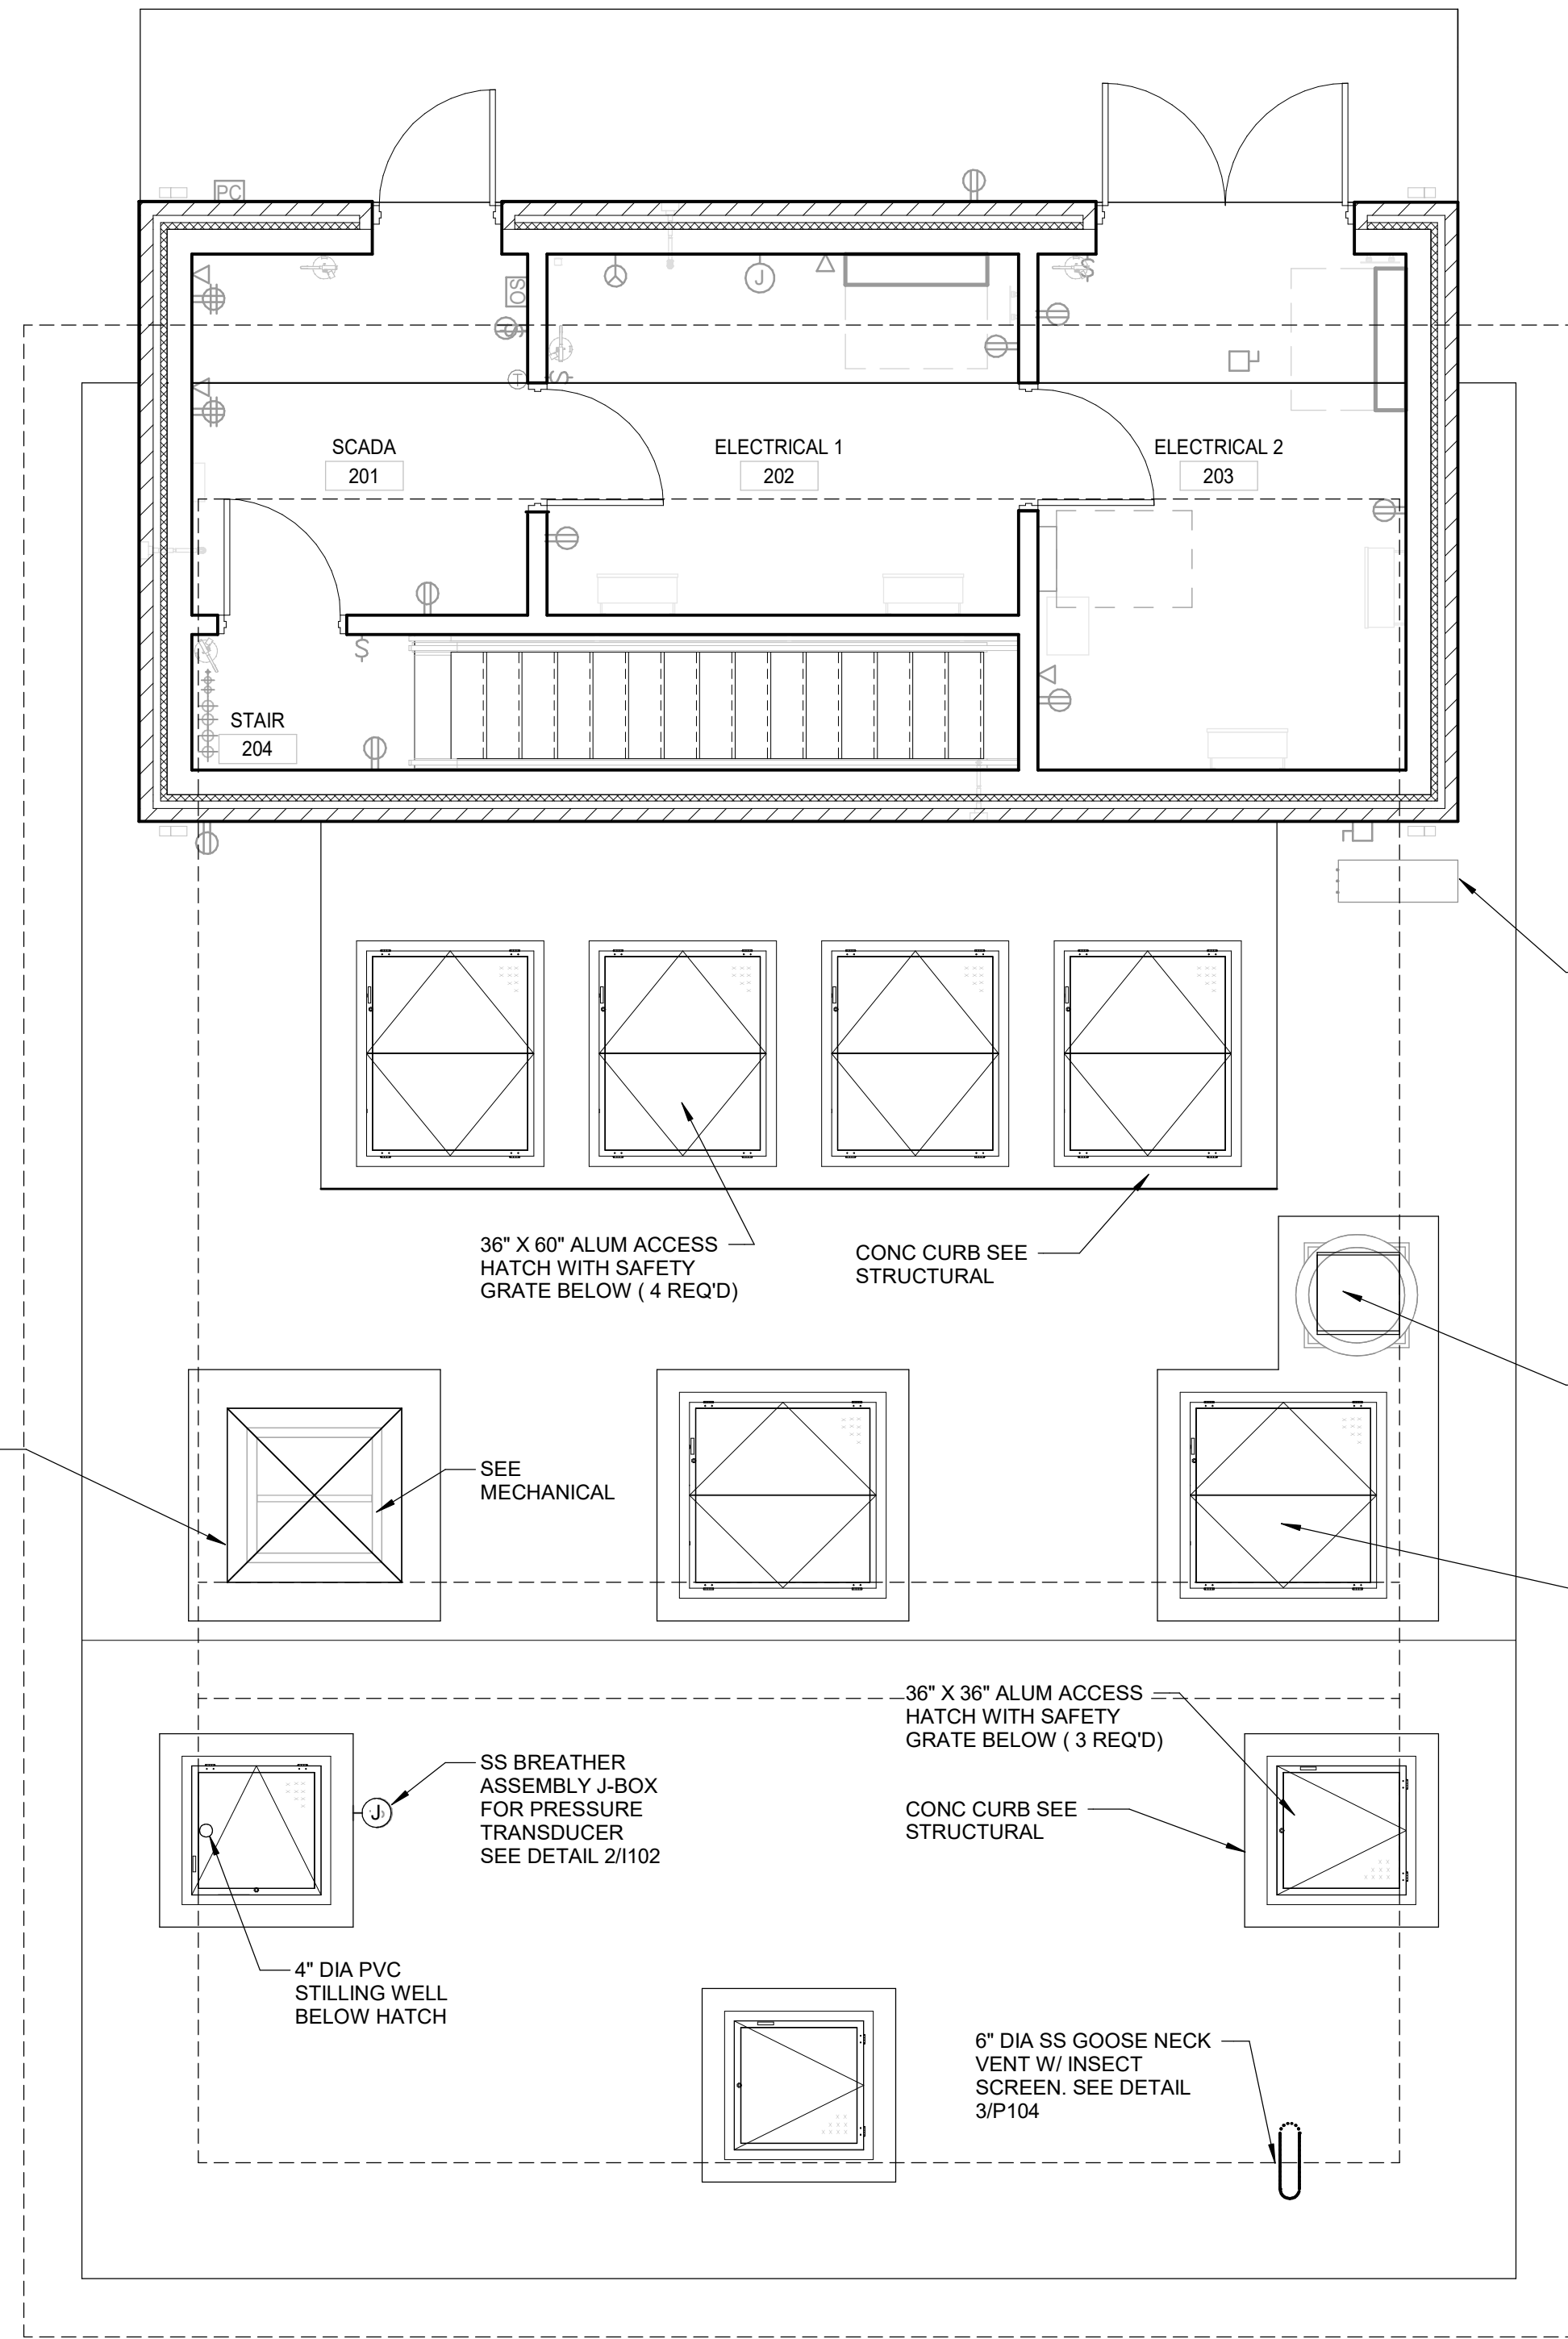

SEE MECHANICAL

SEE MECHANICAL

54" X 54" ALUM ACCESS
HATCH WITH SAFETY
GRATE BELOW (2 REQ'D)

WALL BELOW

TOP OF SLAB @
DECK/ELEC BLDG
SEE SHEET D102
292.50

PROCESS PIPING
PLAN SEE D101
280.00


PROCESS PIPING
PLAN SEE D101
261.50

TOP OF SLAB @
PUMP ROOM
256.33

3

SECTION - BAFFLE WALL


SCALE: 1/4" = 1'-0"

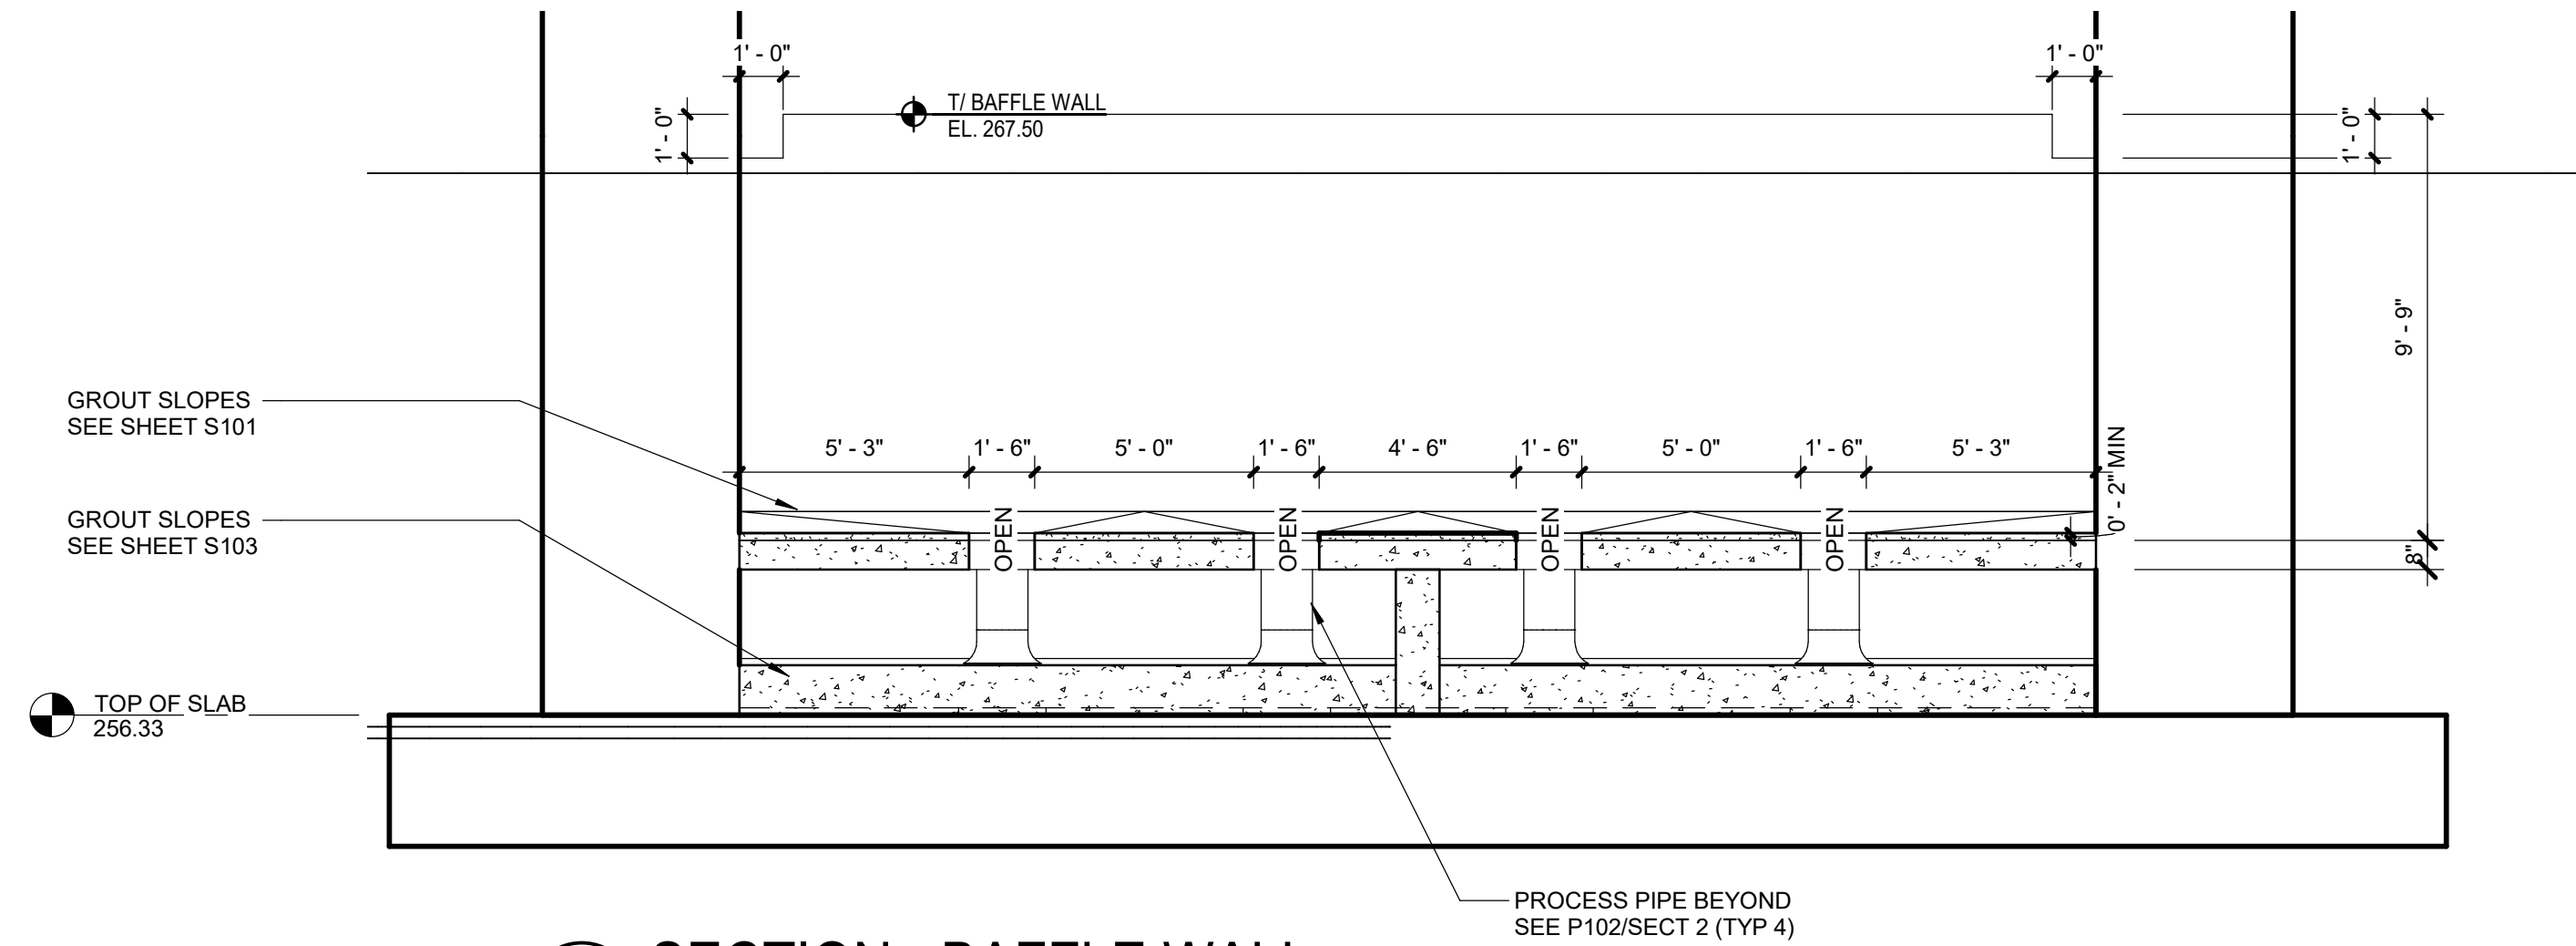

2

SECTION N-S

SCALE: 1/4" = 1'-0"

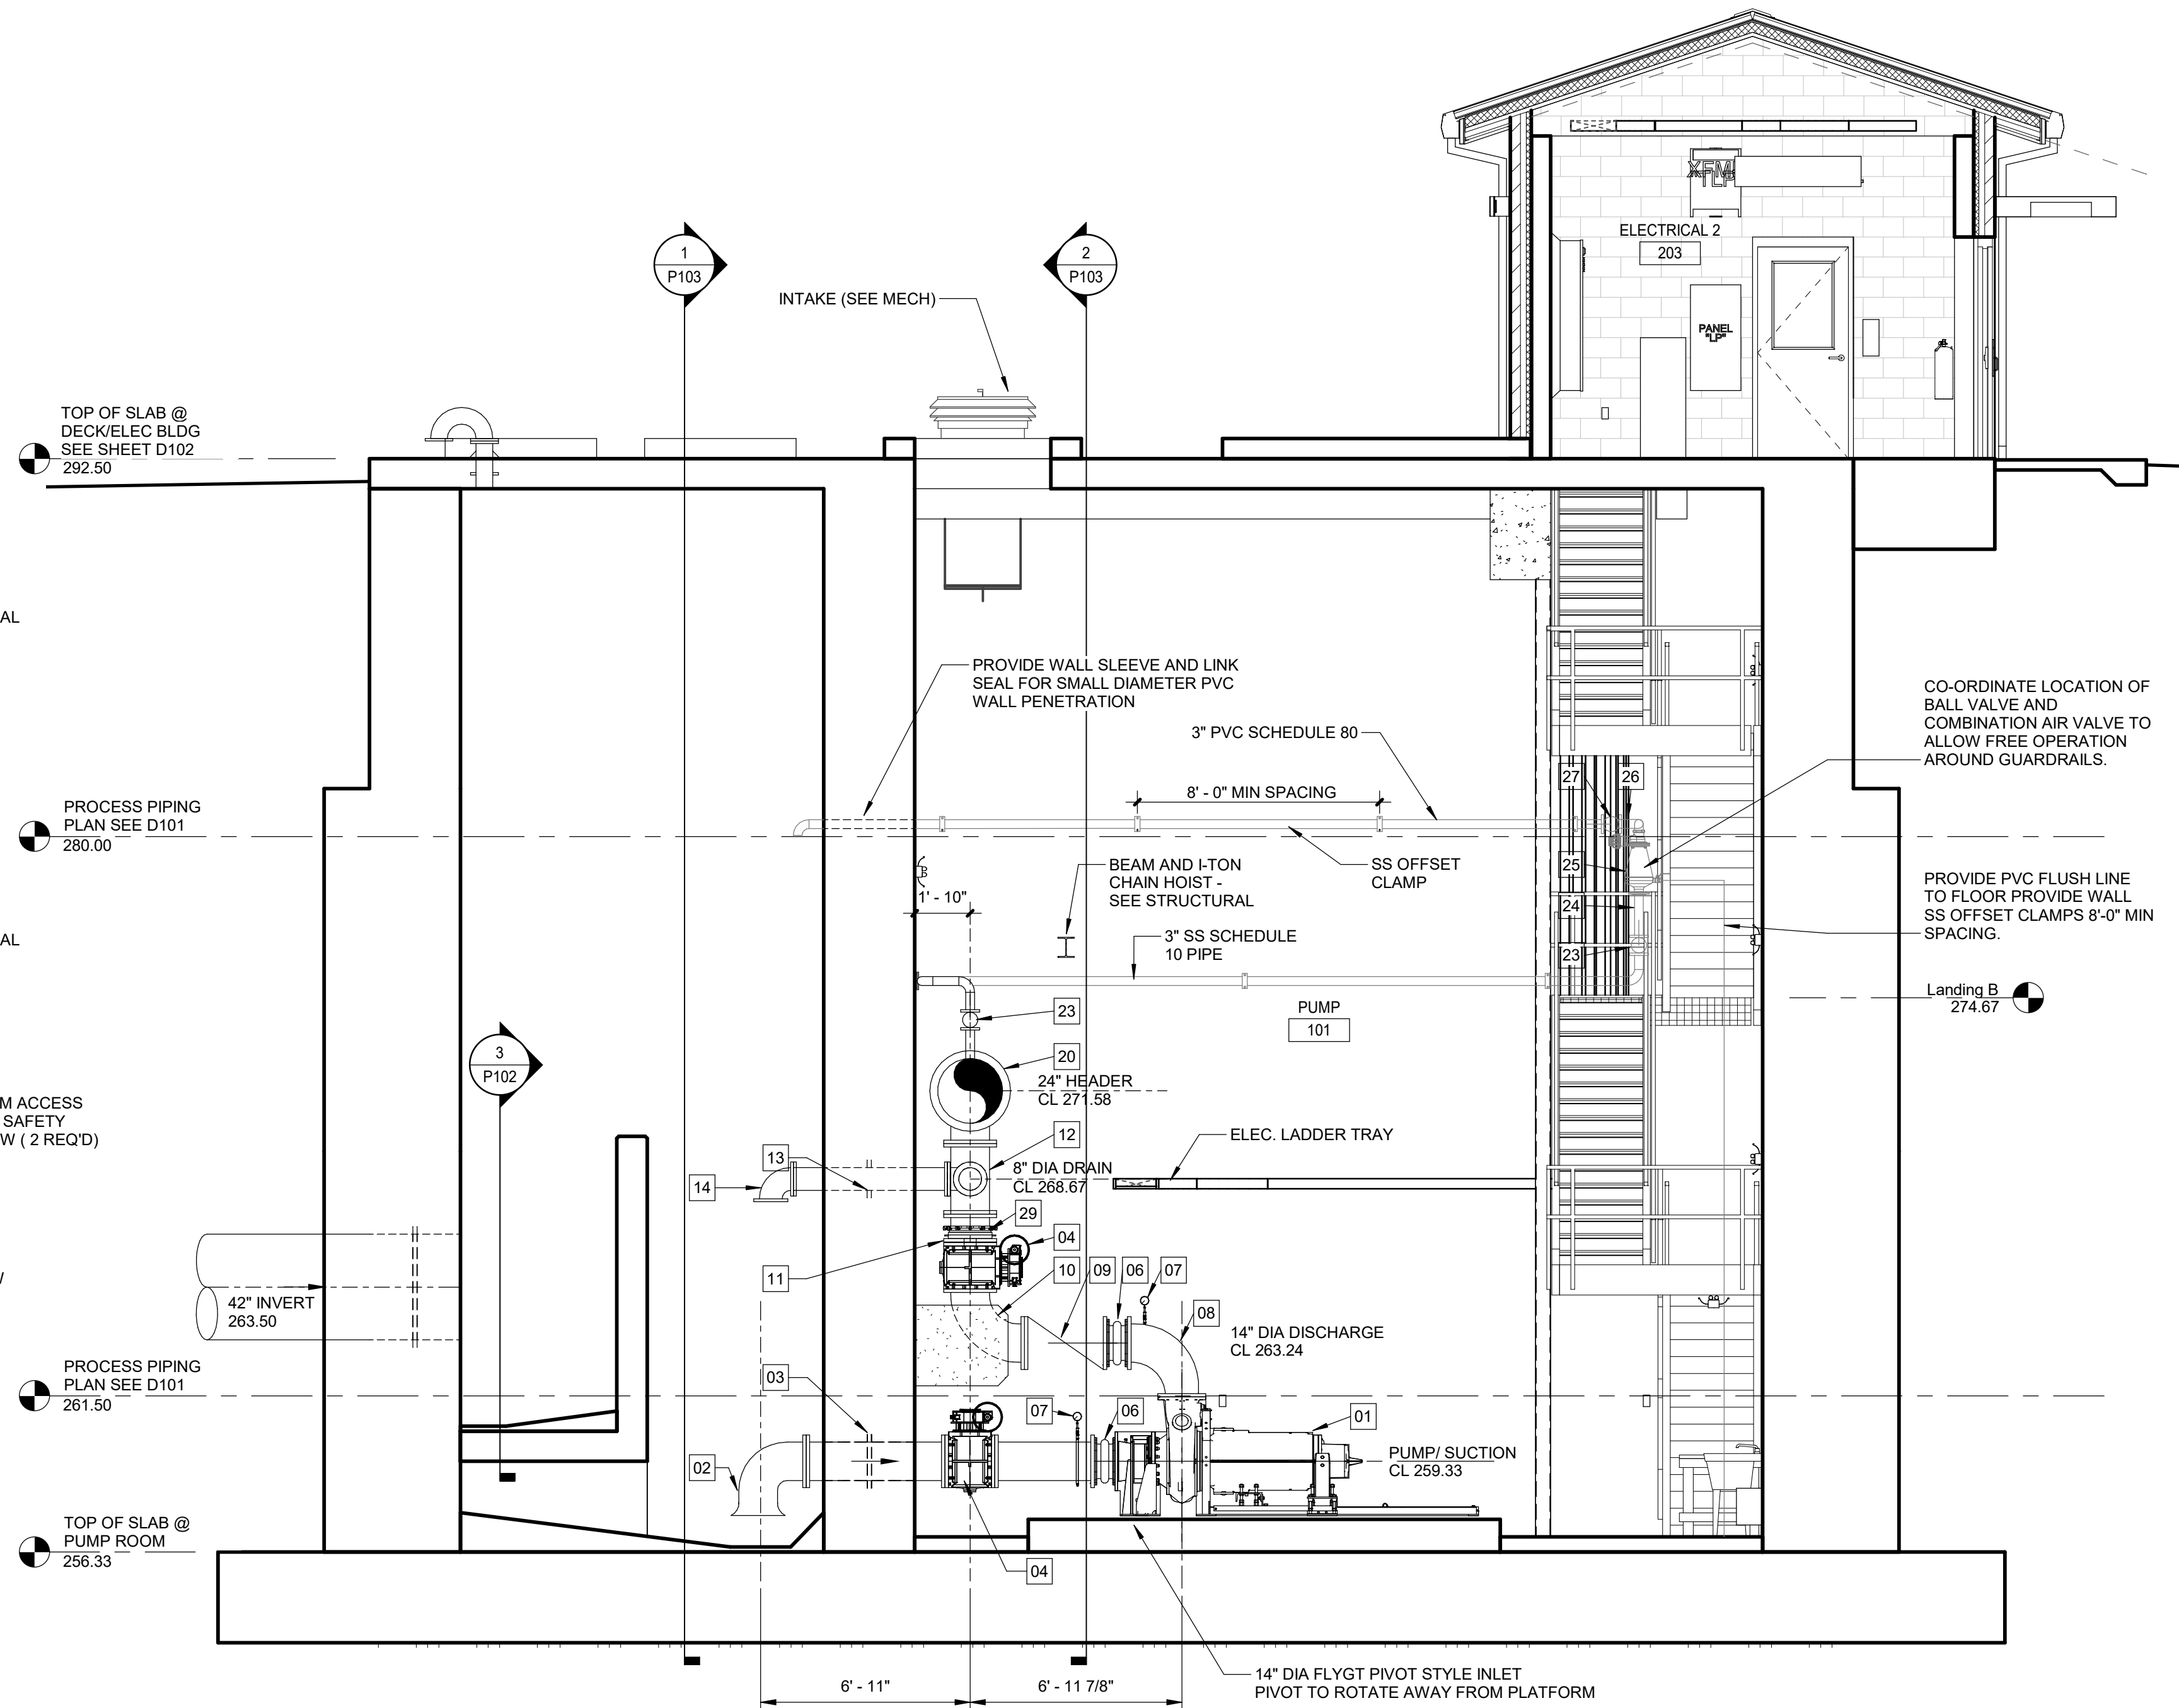

PLAN AND SECTIONS

NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

2020

REVISIONS

REV. NO.	DATE	REVISION DESCRIPTION	BY






olsson

302 E. Millsap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com


drawn by: K.ROWETT
checked by: C.DOUGHERTY
approved by: C.DOUGHERTY
QA/QC by: M.MILIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
P102

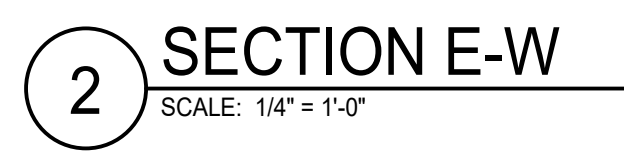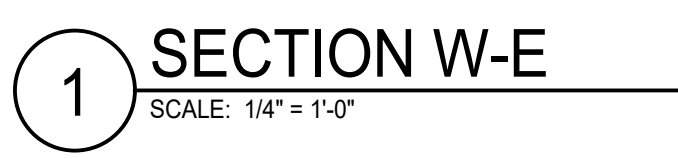


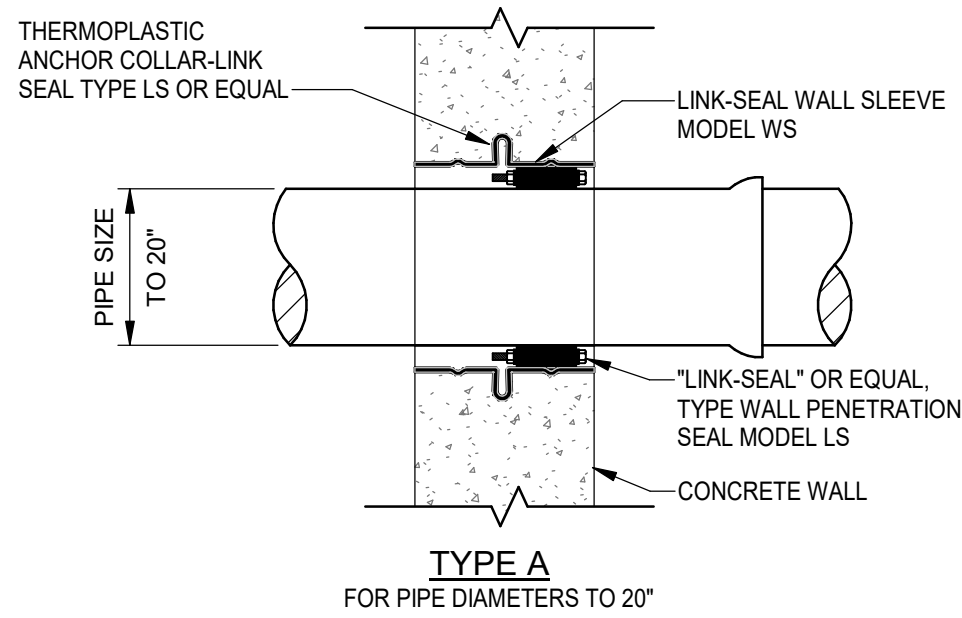


TYPE A
FOR PIPE DIAMETERS TO 20"

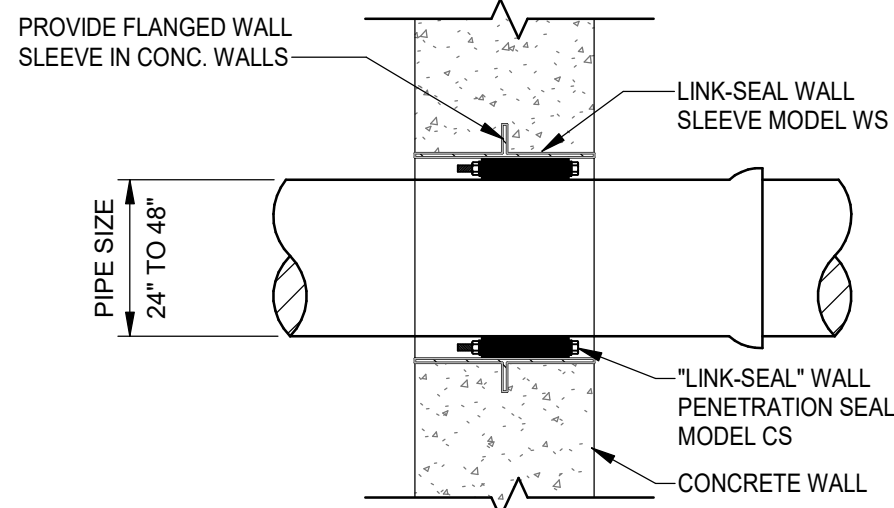

TYPE B
FOR PIPE DIAMETERS 20" TO 48"

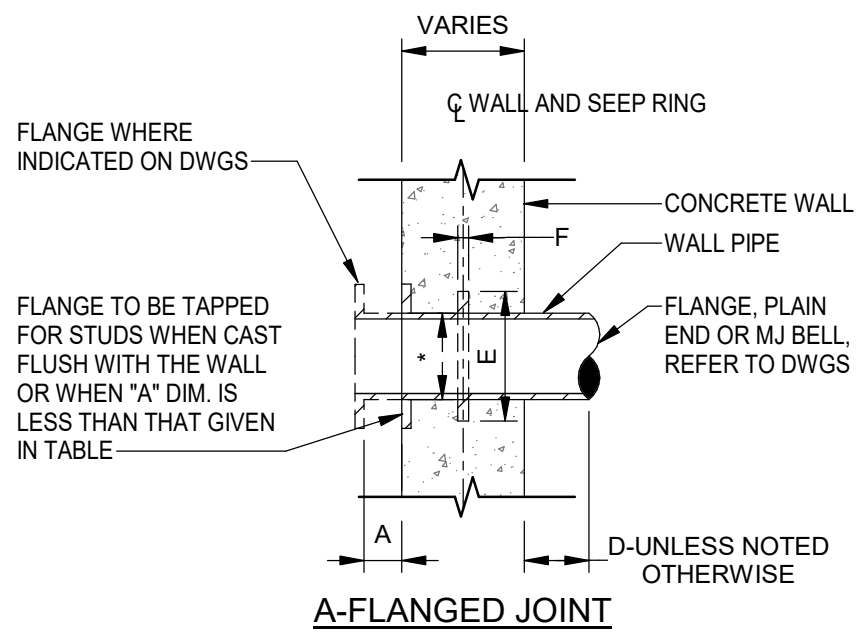


A-FLANGED JOINT

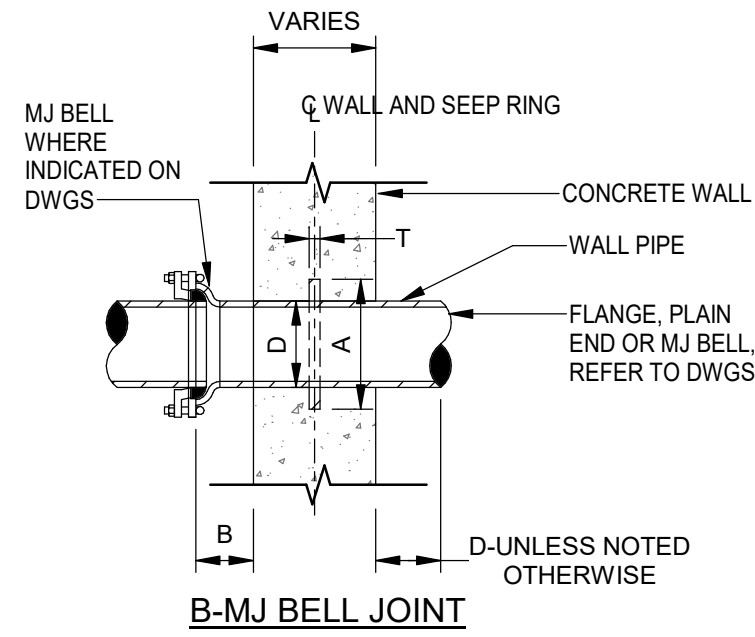


B-MJ BELL JOINT

TABLE 1						
* PIPE SIZE	JOINT TYPE			CLR. DIM.	WALL COLLAR	
NOMINAL	A	B	C	D(MIN)	E(MIN)	F
4	2.25	5.75	6	6	8	.5
6	2.75	5.75	6	8	10	.5
8	2.75	6.25	6.5	9	12.5	.5
10	3	6.5	6.5	9	14.5	.5
12	3	6.5	6.5	9	16.5	.5
14	3.5	7	7.75	9	19.5	.75
16	3.5	7.25	7.75	9	21.75	.75
18	3.75	7.5	7.75	9	23.75	.75
20	3.75	7.5	7.75	9	25.75	.75
24	4	8	8.25	12	30.25	.75
30	5	9.5	9.75	12	36.5	1.0
36	5.25	9.75	9.75	12	43	1.0
42	5.5	10	10	12	49.5	1.25
48	6	10	10	12	56.5	1.25
54	6.25	-	-	-	63	1.5
60	6.5	-	-	-	70.25	1.5
64	6.75	-	-	-	74.88	1.5



NOTE: ALL DIMENSIONS SHOWN ARE INCHES.

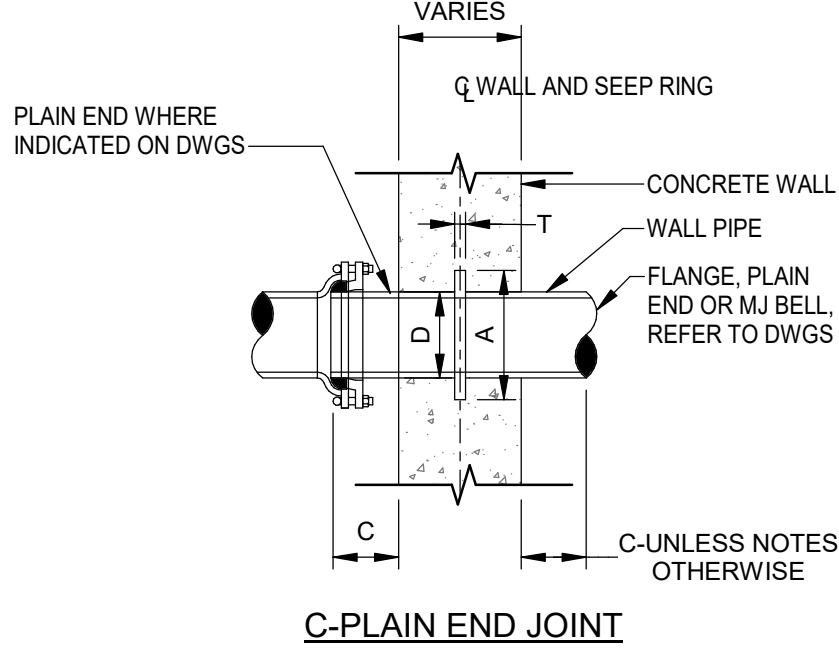

C-PLAIN END JOINT

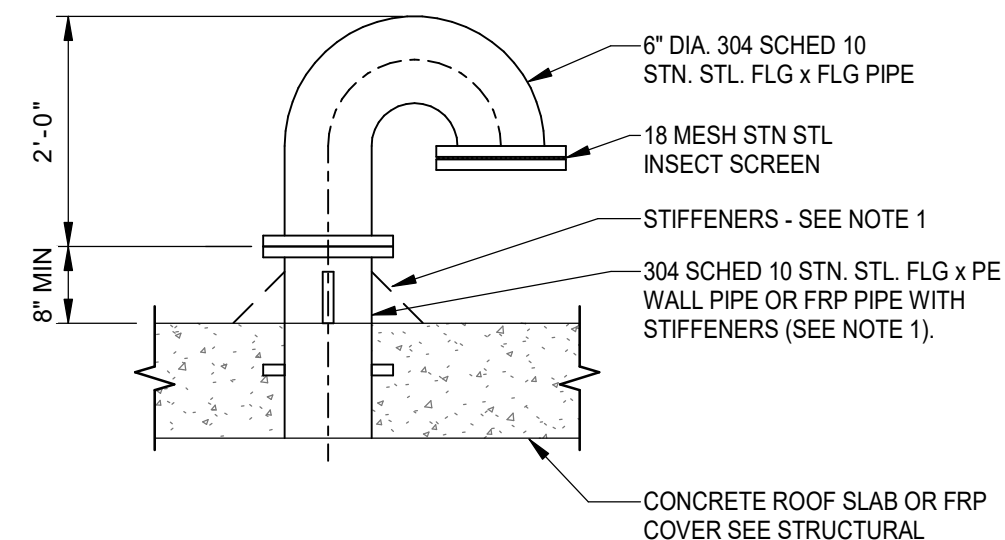

- NOTES:
1. FOR CONNECTION WITH FRP COVERS ONLY, COVER MANUFACTURER SHALL PROVIDE FLANGED FRP CONNECTION INSTEAD OF STN STL. WALL PIPE SHOWN. CONNECTION SHALL BE DESIGNED BY COVER MANUFACTURER AND REINFORCED WITH FRP STIFFENERS.

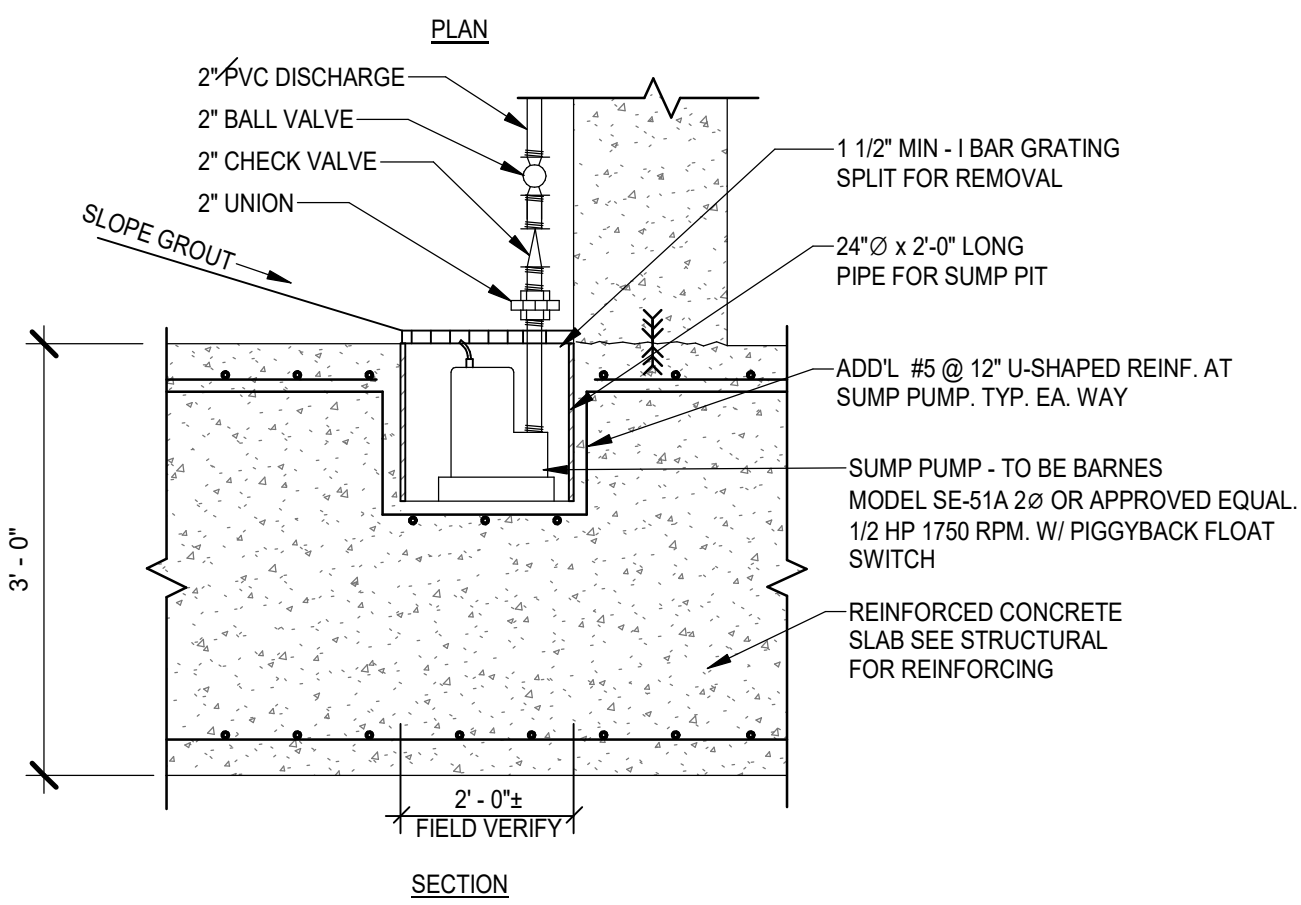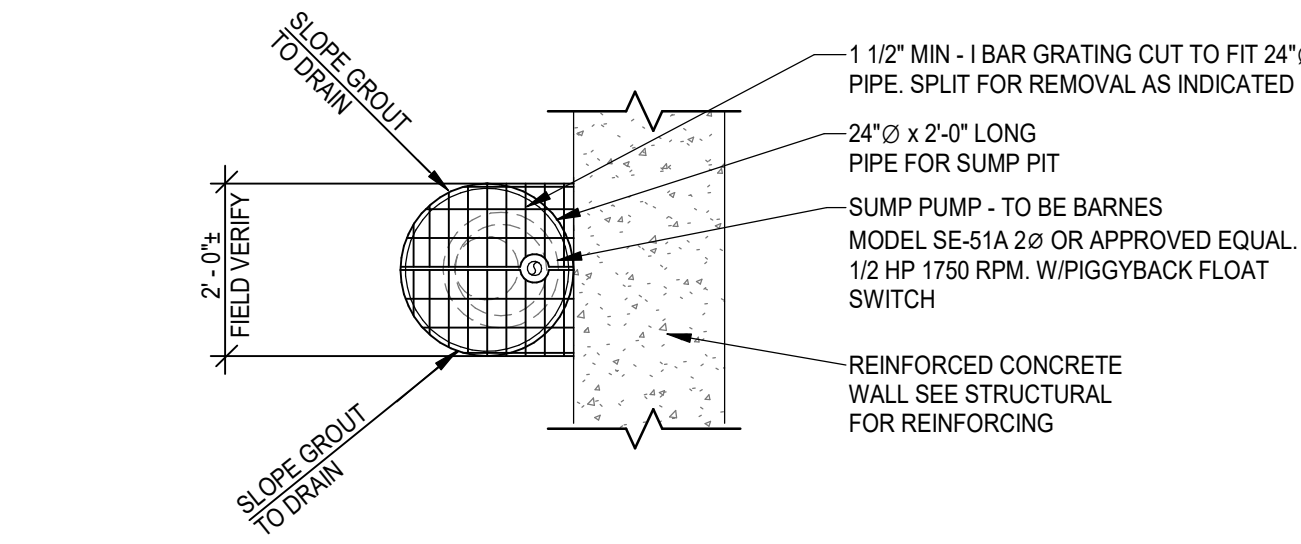

SECTION

NOTE: 110V ELECTRICAL RECEPTACLE FOR SUMP PUMP NOT SHOWN, SEE ELECTRICAL.

1 PIPE PENETRATION DETAIL - "LINK SEAL"

P104 NOT TO SCALE

2 PIPE PENETRATION DETAIL D.I. WALL OR FLOOR PIPE


P104 NOT TO SCALE

3 GOOSAENECK VENT PIPE DETAIL

P104 NOT TO SCALE

4 SUMP PUMP DETAIL - ITEM 16

P104 NOT TO SCALE

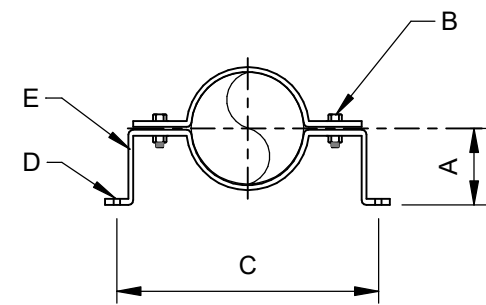


OFFSET CLAMP					
* PIPE SIZE	OFFSET DISTANCE	BOLT SIZE	ANCHOR HOLES		STEEL SIZE
NOMINAL	A	B	C	DØ	E
1/2	2 1/2	3/8-16 x 1 1/2	6	7/16	3/16 x 1 1/4
3/4	2 1/2	3/8-16 x 1 1/2	7 5/16	7/16	3/16 x 1 1/4
1	2 5/8	3/8-16 x 1 1/2	7 9/16	7/16	3/16 x 1 1/4
1 1/4	2 13/16	3/8-16 x 1 1/2	7 7/8	7/16	3/16 x 1 1/4
1 1/2	2 15/16	3/8-16 x 1 1/2	8 1/4	7/16	3/16 x 1 1/4
2	3 3/16	3/8-16 x 1 3/4	9 1/8	7/16	1/4 x 1 1/4
2 1/2	3 7/16	3/8-16 x 1 1/2	10 1/2	7/16	1/4 x 1 1/4
3	3 3/4	3/8-16 x 1 1/2	11 1/8	7/16	1/4 x 1 1/4
4	4 1/4	1/2-13 x 2	12 1/2	9/16	1/4 x 1 1/2
5	4 3/4	1/2-13 x 2 1/4	13 3/4	9/16	1/4 x 1 1/2
6	5 5/16	1/2-13 x 2 1/4	16 1/2	9/16	3/8 x 1 1/2
8	6 5/16	1/2-13 x 2 1/2	18 5/8	9/16	3/8 x 1 1/2
10	7 3/4	3/4-10 x 3	23	13/16	3/8 x 3
12	8 3/4	3/4-10 x 3	25	13/16	3/8 x 3


NOTE: ALL DIMENSIONS SHOWN ARE INCHES.

5 OFFSET PIPE CLAMP

P104 NOT TO SCALE

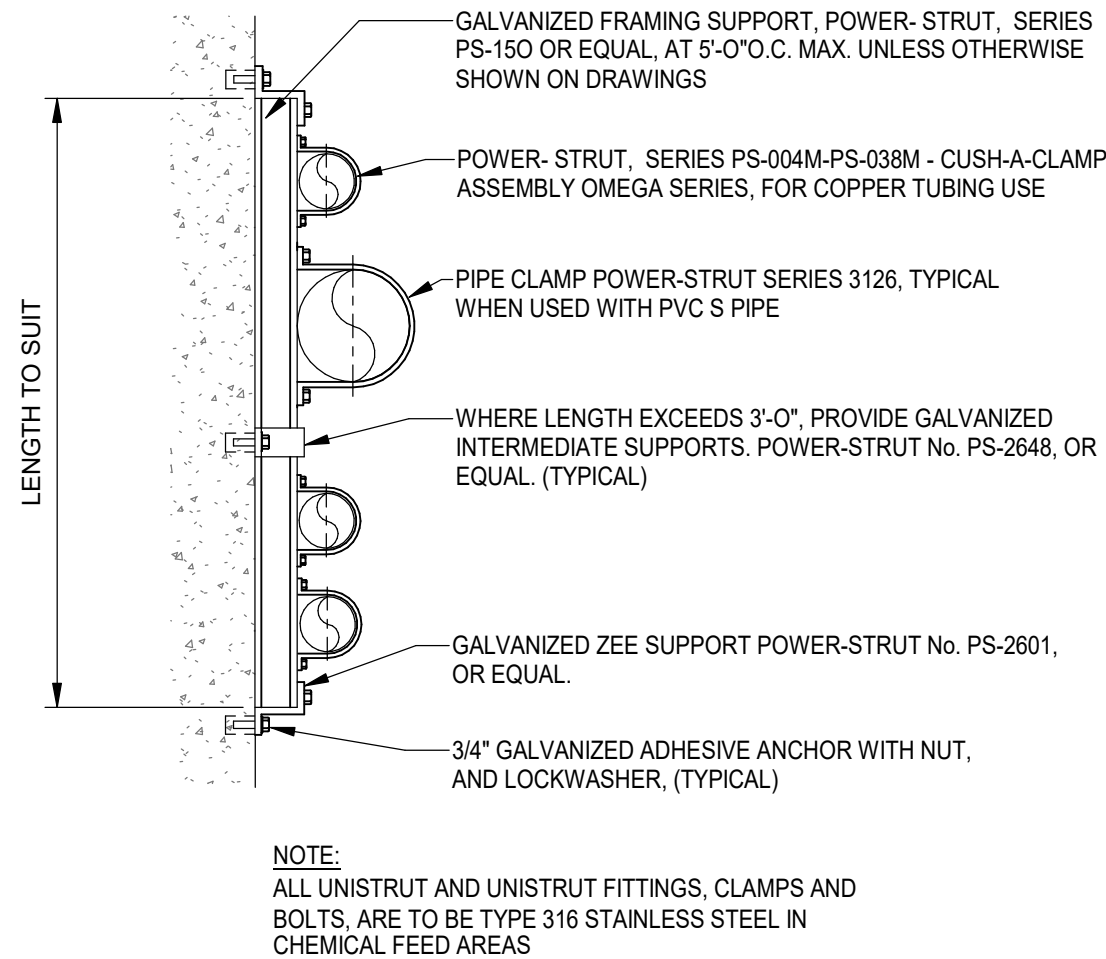

TYPE "A" - FLUSH MOUNT
PIPE SUPPORT

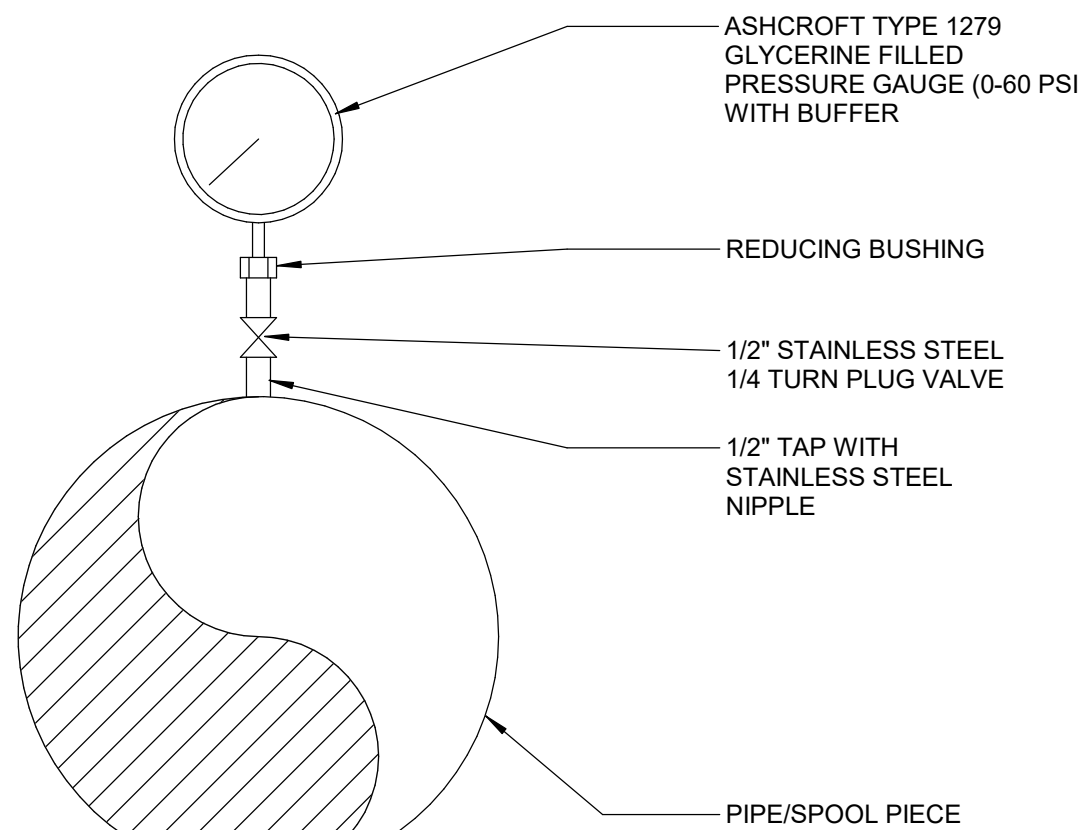

7 DETAIL PRESSURE GAUGE

P104 NOT TO SCALE

olsson

302 E. Millsap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

STATE OF ARKANSAS
REGISTERED PROFESSIONAL
ENGINEER
No. 14497
CHRIS DOUGHERTY

BY
REVISION DESCRIPTION
DATE
REV. NO.

REVISIONS
2020

PROCESS DETAILS


NEW WESTSIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

drawn by: K. ROWETT
checked by: C. DOUGHERTY
approved by: C. DOUGHERTY
QA/QC by: M. MILLIUS
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
P104

SHEET
M001

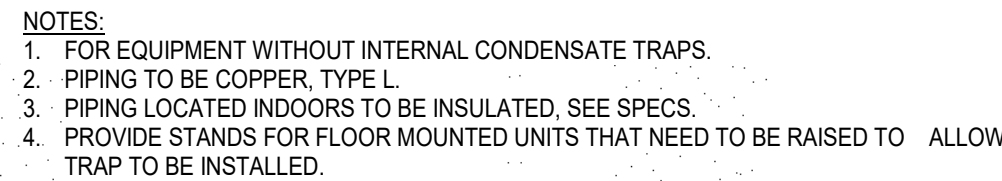

STANDARD SINGLE VANES
ADJUSTABLE FOR ELBOWS OR
UNIVERSAL AND OUTLET
DIMENSIONS

W₁ x D₂

W₁ x D₁

1/8 W

1/8 W

1/8 W

R


R SHALL EQUAL
OR BE GREATER
THAN 1/8 W

$W_2 \times D_2$
 $W_1 \times D_1$
 90°
 θ
 $W_1 \times D_1 = \text{UPSTREAM DUCT DIMENSION}$
 $W_2 \times D_2 = \text{DOWNSTREAM DUCT DIMENSION}$
 $\theta = 30^\circ \text{ MAX ONE SIDE REDUCTION}$



Diagram illustrating the geometry of a curved vane. The vane is shown in a cross-section, with dimensions labeled: $2\frac{1}{2}W$ (radius), $\frac{1}{2}W$ (width), and W (height). A note states: "R SHALL EQUAL OR BE GREATER THAN $\frac{1}{3}W$ ".

$W_2 \times D_2$
 $\theta = 45^\circ$ MAX DIVERGING
 $\theta = 60^\circ$ MAX CONVERGING
 TWO-SIDE REDUCTION
 $W_1 \times D_1$

Diagram illustrating the relationship between R and W for a quarter-circle fillet. The fillet has a radius R and a width W . The text indicates that R shall be equal to or greater than W .



SCALE: NOT TO SCALE



NOTE: NO "PULLED TEES" ALLOWED ON COPPER PIPING.

REMARKS:
1. PROVIDE MANUFACTURER'S MOUNTING CURB.



drawn by: _____ TS
checked by: _____ MM
approved by: _____ CW
QA/QC by: _____ MS
project no.: _____ 018-0054
drawing no.: _____
date _____ 01/02/2020

SHEET
M102

Olsson

302 E. Millsap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com



1. CONNECT TO INSTANTANEOUS WATER HEATER AND TO UTILITY TUB FAUCET.
2. ROUTE 2" DRAIN LINE TO SUMP SEE PROCESS DRAWINGS FOR EXACT LOCATION.
3. WATER SERVICE FROM CIVIL PLANS, COORDINATE EXACT LOCATION.
4. WATER SERVICE DOWN TO FLOOR BELOW.
5. DOMESTIC WATER UP FROM FLOOR BELOW.
6. FLOOR DRAIN AT LOW POINT OF FLOOR. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS.
7. LOCATE HOSE BIBB IN CENTER OF A BLOCK AND NOT ON A SEAM.
8. SUMP PUMP AND PIPING. SEE PROCESS DRAWINGS.

ELECTRICAL SYMBOL LEGEND	
POWER DEVICES	
DUPLEX RECEPTACLE; MOUNT AT 18" TO CENTER OF DEVICE AFF UNLESS OTHERWISE NOTED	FLOOR MOUNTED DUPLEX RECEPTACLE
SINGLE RECEPTACLE; MOUNT AT 18" TO CENTER OF DEVICE AFF UNLESS OTHERWISE NOTED	FLOOR MOUNTED FOUR PLEX RECEPTACLE
FOUR PLEX RECEPTACLE; MOUNT AT 18" TO CENTER OF DEVICE AFF UNLESS OTHERWISE NOTED.	CEILING MOUNTED DUPLEX RECEPTACLE
GFI GROUND FAULT INTERRUPTER DUPLEX RECEPTACLE	CEILING MOUNTED FOUR PLEX RECEPTACLE
DUPLEX RECEPTACLE, ON EMERGENCY CIRCUIT	ELECTRICAL DISTRIBUTION PANEL
FOUR PLEX RECEPTACLE, ON EMERGENCY CIRCUIT	RECESSED MOUNTED ELECTRICAL PANEL
WP WATERPROOF RECEPTACLE	SURFACE MOUNTED ELECTRICAL PANEL
IG ISOLATED GROUND RECEPTACLE	ELECTRICAL POWER TRANSFORMER
220V RECEPTACLE	FUSED DISCONNECT SWITCH
SPECIAL-PURPOSE OUTLET. LETTER DESIGNATES TYPE. SEE SPECIAL CONNECTION SCHEDULE FOR REQUIREMENTS	NON-FUSED DISCONNECT SWITCH
SURFACE RACEWAY WITH OUTLETS AS INDICATED ON PLANS.MOUNTED AT 18" TO CENTER OF DEVICE AFF UNLESS OTHERWISE NOTED	COMBINATION MAGNETIC STARTER AND DISCONNECT SWITCH
WALL MOUNTED JUNCTION BOX	STARTERMOTOR CONTROLLER
CEILING MOUNTED JUNCTION BOX	ELECTRICAL MOTOR - SINGLE PHASE
FLOOR MOUNTED JUNCTION BOX	ELECTRICAL MOTOR - THREE PHASE
	RELAY
	BATTERY PACK
	MOTORIZED DAMPER
LIGHTING	
CEILING MOUNTED OR RECESSED LIGHT FIXTURE; LABEL INDICATES FIXTURE TYPE	DOUBLE FACED CEILING OR WALL-MOUNTED, EXIT SIGN WITH EMERGENCY POWER BACK UP
PENDANT MOUNTED LIGHT FIXTURE; LABEL INDICATES FIXTURE TYPE	SINGLE FACED CEILING OR WALL MOUNTED, EXIT SIGN WITH EMERGENCY POWER BACK UP
WALL MOUNTED LIGHT FIXTURE; LABEL INDICATES FIXTURE TYPE	COMBINATION EXIT AND EMERGENCY LIGHT
2x4' LIGHT FIXTURE; LABEL INDICATES FIXTURE TYPE	DIRECTION ARROW FOR EMERGENCY LIGHT
2x2' FIXTURE; LABEL INDICATES FIXTURE TYPE	CEILING OR WALL MOUNTED, SELF-CONTAINED EMERGENCY LIGHT UNIT; FIXTURE SHALL MONITOR LIGHTING CIRCUIT IN AREA
1x4' TYPICAL CEILING MOUNTED FIXTURE; LABEL INDICATES FIXTURE TYPE	SINGLE-POLE SWITCH
1x4' TYPICAL PENDANT MOUNTED FIXTURE; LABEL INDICATES FIXTURE TYPE	DOUBLE-POLE SWITCH
1x4' TYPICAL WALL MOUNTED FIXTURE; LABEL INDICATES FIXTURE TYPE	3-WAY SWITCH
1x2' TYPICAL WALL MOUNTED FIXTURE; LABEL INDICATES FIXTURE TYPE	4-WAY SWITCH
INDUSTRIAL STRIP LIGHT FIXTURE; LABEL INDICATES FIXTURE TYPE	SINGLE-POLE SWITCH AND PILOT LIGHT
STRIP LIGHT FIXTURE; LABEL INDICATES FIXTURE TYPE	SINGLE POLE MANUAL MOTOR STARTER WITH THERMAL ELEMENT
UNDER CABINET FIXTURE; LABEL INDICATES FIXTURE TYPE	SINGLE-POLE DIMMER SWITCH
2x4' TYPICAL FIXTURE - NORMAL/EMERGENCY	SINGLE-POLE KEYED SWITCH
2x2' TYPICAL FIXTURE - NORMAL/EMERGENCY	LOW VOLTAGE SWITCH
1x4' TYPICAL CEILING MOUNTED FIXTURE - NORMAL/EMERGENCY	FAN SWITCH
CEILING MOUNTED OR RECESSED TYPICAL FIXTURE - NORMAL/EMERGENCY	MOMENTARY CONTACT SWITCH
BRANCH CIRCUIT WIRING CONCEALED IN WALLS OR CEILING	PUSHBUTTON SWITCH
BRANCH CIRCUIT WIRING EXPOSED	COMBINATION PUSHBUTTON SWITCH
CEILING OR WALL-MOUNTED OCCUPANCY SENSOR	MUSHROOM EMERGENCY SHUT-OFF SWITCH
CEILING OR WALL-MOUNTED PHOTO CELL	LIGHTING CONTACTOR
CEILING OR WALL-MOUNTED DAYLIGHT SENSOR	TIME CLOCK, AS INDICATED ON PLANS
	PHOTO CELL, AS INDICATED ON PLANS
SPECIAL SYSTEMS	
DATA/TELEPHONE OUTLET, FLOOR MOUNTED	MULTI-OUTLET FLOOR BOX, SEE FLOOR BOX SCHEDULE FOR REQUIREMENTS
COMBINATION DATA/TELEPHONE OUTLET	SPEAKER, WALL MOUNTED
TELEPHONE	SPEAKER, CEILING MOUNTED
DATA OUTLET; NUMBER INDICATES QUANTITY, BLANK INDICATES SINGLE OUTLET. MOUNTED AT 18" TO CENTER OF DEVICE AFF UNLESS OTHERWISE NOTED	ELECTRIC VALVE
DATA, CEILING MOUNTED	INSTRUMENT DEVICE
DATA, FLOOR MOUNTED	INTERIOR SIREN ALARM
TELEVISION OUTLET, CEILING MOUNTED	CLOCK, WALL MOUNTED
TELEVISION CABLE OUTLET; MOUNT AT 18" TO CENTER OF DEVICE AFF UNLESS OTHERWISE NOTED	CLOCK, CEILING MOUNTED
WIRELESS ACCESS POINT, CEILING MOUNTED	CABLE TRAY
	GROUND BAR
FIRE ALARM	
MAGNETIC DOOR HOLD DEVICE	FIRE ALARM VOICE CEILING MOUNT SPEAKER
SPRINKLER FLOW SWITCH	SMOKE DETECTOR
SPRINKLER TAMPER SWITCH	DUCT MOUNTED SMOKE DETECTOR
EXTERIOR REMOTE FLASHING STROBE LIGHT	THERMAL HEAT DETECTOR
MANUAL PULL STATION; MOUNT ACCORDING TO MOUNTING HEIGHT DETAIL AT 46" TO CENTER OF DEVICE AFF. ADA COMPLIANT	POST INDICATOR VALVE
HORN & STROBE; MOUNT SO BOTTOM OF DEVICE IS AT 80" AFF UNLESS OTHERWISE NOTED. ADA COMPLIANT	BELL
STROBE; MOUNT SO BOTTOM OF DEVICE IS AT 80" AFF UNLESS OTHERWISE NOTED. ADA COMPLIANT	SHUTDOWN RELAY WITH REMOTE TEST SWITCH
SPEAKER & STROBE; MOUNT SO BOTTOM OF DEVICE IS AT 80" AFF UNLESS OTHERWISE NOTED. ADA COMPLIANT	SHUTDOWN RELAY AND TEST SWITCH
FIRE ALARM VOICE WALL MOUNT SPEAKER	FIRE ALARM CONTROL PANEL
	REMOTE ANNUNCIATOR PANEL
	SMOKE DAMPER
	FIRE DAMPER
	COMBINATION FIRE AND SMOKE DAMPER
SECURITY DEVICES	
DOOR CONTROL MODULE	MOTION DETECTOR, CEILING MOUNTED
ACCESS CONTROL PANEL	MOTION DETECTOR, WALL MOUNTED
ELECTRIC DOOR STRIKER	EMERGENCY DOOR RELEASE BUTTON
VIDEO CAMERA, WITH MOUNTING HARDWARE	PANIC BUTTON
VIDEO MONITOR	SECURITY BUZZER HORN
VIDEO RECORDER	INTERCOM SUBSTATION
ELECTRIC MAGNETIC LOCK	INTERCOM SUBSTATION WITH CAMERA
ELECTRIC CYLINDER LOCK	INTERCOM MASTER STATION
CARD READER	GLASS BREAK SENSOR
REQUEST TO EXIT	
DOOR CONTACT - RECESSED	POWER TRANSFER HINGE
DOOR CONTACT - SURFACE MOUNT	

ABBREVIATIONS/MODIFIERS	
SHEET NOTE TAG, LABEL INDICATES NOTE NUMBER	
FEEDER TAG	
ABOVE COUNTER	
AMPERE	
AUTOMATIC DAMPER	
ABOVE FINISHED FLOOR	
ABOVE FINISHED GRADE	
AIR HANDLING UNIT	
ARC FAULT CIRCUIT INTERRUPTER	
AUTOMATIC TRANSFER SWITCH	
CONDUIT	
CIRCUIT BREAKER	
CIRCUIT	
CABINET UNIT HEATER	
EXISTING DEVICES TO REMAIN	
EXHAUST FAN	
ELECTRIC METALLIC TUBING	
NEW LOCATION OF EXISTING RELOCATED	
ELECTRIC WATER COOLER	
ELECTRIC WATER HEATER	
FIRE ALARM	
FLOOR BOX	
FLEXIBLE METALLIC TUBING	
GROUND FAULT INTERRUPTER	
HAND DRYER	
ISOLATED GROUND	
MAKE-UP AIR UNIT	
MOTORIZED DAMPER	
NON-FUSED	
NIGHT LIGHT	
NEW TO REPLACE EXISTING	
POLE	
PRIMARY ELECTRIC SERVICE	
ELECTRIC PAPER TOWEL DISPENSER	
POLYVINYL CHLORIDE CONDUIT	
REMOVE EXISTING	
ROOF EXHAUST FAN	
RELOCATE EXISTING	
RIGID METALLIC CONDUIT	
REMOVE AND REPLACE ON NEW SURFACE	
ROOFTOP UNIT	
SMOKE DAMPER	
SECONDARY ELECTRIC SERVICE	
SPACE AND PROVISION	
TELEPHONE SERVICE	
TEMPERATURE CONTROL PANEL	
TAMPER PROOF	
TELEVISION	
UNDERGROUND ELECTRICAL	
VARIABLE FREQUENCY CONTROLLER	
VARIABLE FREQUENCY DRIVE	
WIRE	
WIRE GUARD	
WEATHERPROOF	
WEATHER RESISTANT	
TRANSFORMER	

NEW & FUTURE LEGEND	
FUTURE DEVICES (LIGHT LINEWEIGHT)	
NEW DEVICES	
CONDUIT WIRE/BELOW GRADE OR HIDDEN (DARK LINEWEIGHT)	

GENERAL NOTES

- CIRCUITING SHOWN IS DIAGRAMMATIC ONLY. EXACT ROUTING MAY VARY AND MAY REQUIRE ADDITIONAL J-BOXES AND/OR SPECIAL FITTINGS.
- ALL EMPTY CONDUITS INDICATED SHALL BE FURNISHED AND INSTALLED WITH PULLWIRES, INSULATED BUSHINGS ON EACH END AND HAVE IDENTIFICATION FLAG AT EACH END LABELED FOR INTENDED USE.
- VERIFY ALL OUTLETS, J-BOXES, FLOOR BOXES, ETC. LOCATIONS WITH DRAWINGS OF OTHER TRADES PRIOR TO INSTALLATION. REFER TO SPECIFICATIONS AND ELECTRICAL DETAILS FOR DEFAULT DEVICE MOUNTING HEIGHTS.
- FIRE STOPPING REQUIRED AT ALL FIRE WALL PENETRATIONS. REFER TO ARCHITECTURAL DRAWINGS FOR FIRE RATINGS OF WALLS AND PROVIDE APPROPRIATE RATED SEALANT AS REQUIRED.
- ELECTRICAL CONTRACTOR SHALL COORDINATE PLACEMENT OF ALL DEVICES SHOWN ON ELECTRICAL CONSTRUCTION DOCUMENTS WITH ARCHITECTURAL, MECHANICAL, AND PLUMBING DRAWINGS PRIOR TO FINAL PLACEMENT.
- ALL ELECTRICAL PENETRATIONS THROUGH CONCRETE SHALL BE SPACED TO HAVE A MINIMUM OF 3" OF CONCRETE ON ALL SIDES.
- WHERE DEVICES OR POWER ROUGH-IN IS SHOWN TO BE INSTALLED IN A MASONRY WALL, PROVIDE MASONRY BOXES AND INSTALL CONDUIT WITHIN WALL.
- ALL ELECTRICAL WORK SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED EDITION OF THE NATIONAL ELECTRIC CODE BY THE CITY OF JONESBORO, AR. CURRENTLY 2017 NEC.
- COOPERATE CLOSELY WITH ALL OTHER TRADES TO EXPEDITE CONSTRUCTION AND AVOID INTERFERENCES AND CONFLICTS PRIOR TO ANY INSTALLATION. ELECTRICAL CONDUIT SHALL NOT BLOCK ACCESS TO OTHER EQUIPMENT REQUIRING REGULAR MAINTENANCE OR ACCESS.
- CONTRACTOR SHALL GUARANTEE ALL EQUIPMENT, ACCESSORIES, AND MATERIAL FURNISHED BY HIM FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE AGAINST ALL DEFECTS.
- ALL WIRING SHALL BE INSTALLED IN CONDUIT. REFERENCE SPECIFICATION SECTION 26 05 33 "RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS" FOR APPLICATION OF RACEWAY MATERIALS AND OTHER REQUIREMENTS.
- ALL CIRCUITS SHALL HAVE A SEPARATE GROUNDING CONDUCTOR.
- CONTRACTOR SHALL COORDINATE ALL SCHEDULING, ELEVATIONS, SIZES, QUANTITIES, AND ROUTING OF WORK WITH OTHER TRADES.
- SWITCHES AND RECEPTACLES SHALL BE GRAY WITH STAINLESS STEEL FACEPLATES UNLESS NOTED OTHERWISE. REFERENCE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- THE COVERS OF ALL BOXES SHALL BE LABELED PER ELECTRICAL IDENTIFICATION SPECIFICATION SECTION 260553. PROVIDE CIRCUIT # AND PANEL LABELING ON ALL FINAL DEVICES. ALL PANELBOARDS SHALL BE PROVIDED WITH AN UPDATED TYPED CIRCUIT DIRECTORY WITH CIRCUIT NUMBER AND EQUIPMENT SERVED. ALL LABELING TO BE STENCILED ADHESIVE ON RECEPTACLES, SWITCHES, OR EQUIPMENT TERMINATIONS.
- ALL DISCONNECT SWITCHES SHALL BE HEAVY DUTY RATED SAFETY SWITCHES.
- WHERE A BOX IS TO BE MOUNTED ON A BLOCK OR CONCRETE WALL, PROVIDE SURFACE MOUNTED BOX AND RACEWAY (UNLESS NOTED OTHERWISE).
- PROVIDE BACKBOX AND CONDUIT FOR LINE VOLTAGE AND/OR LOW VOLTAGE THERMOSTATS. COORDINATE ROUGH-IN LOCATION WITH MECHANICAL CONTRACTOR. COORDINATE INSTALLATION OF ASSOCIATED CONTROL WIRING WITH MECHANICAL CONTRACTOR.
- ALL CONDUCTORS SHALL BE #12 AWG MINIMUM COPPER THHN/THWN UNLESS NOTED OTHERWISE.
- ALL WIRING SHALL BE CONTINUOUS WITHOUT SPLICES UNLESS NOTED OTHERWISE.
- INTERIOR CONDUIT SHALL BE 3/4" MINIMUM. EMT CONDUIT CONNECTORS SHALL BE COMPRESSION TYPE.
- NO POWER AND CONTROL WIRING SHALL BE INSTALLED IN THE SAME CONDUIT.
- ALL LIGHT FIXTURES EQUIPPED WITH AN EMERGENCY BALLAST SHALL RECEIVE AND UNSWITCHED HOT TO SUPPLY RECHARGE AND POWER FAILURE INDICATION TO THE EMERGENCY BALLAST.
- MOUNT EXIT SIGNS AT 8" ABOVE DOOR HEADER WHERE SHOWN MOUNTED ON WALL.
- REFER TO MANUFACTURER WIRING DIAGRAMS FOR ALL LOW VOLTAGE AND LINE VOLTAGE OCCUPANCY SENSORS. ALL LINE OR LOW VOLTAGE OCCUPANCY SENSOR WIRING SHALL BE IN CONDUIT.
- PROVIDE GANGED FACEPLATES AS REQUIRED FOR LIGHTING, POWER, AND DATA DEVICES LOCATED NEXT TO EACH OTHER.

302 E. Millsp Road
Fayetteville, AR 72703

TEL 479.443.3404
FAX 479.443.4340

www.olsson.com

ELECTRICAL GENERAL INFORMATION		REVISIONS	
NEW WEST SIDE MAIN LIFT STATION CITY WATER & LIGHT	JONESBORO, ARKANSAS	REV. NO.	DATE
		BY	REVISION DESCRIPTION
			2020

drawn by: _____ TS

checked by: _____ MM

approved by: _____ CW

QA/QC by: _____ DB


project no.: _____ 018-0054

drawing no.: _____

date: _____ 01/02/2020

SHEET


GE001

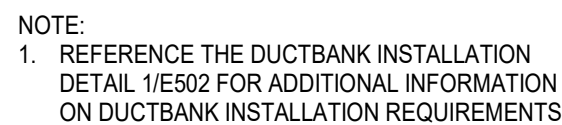

6
E10



E10

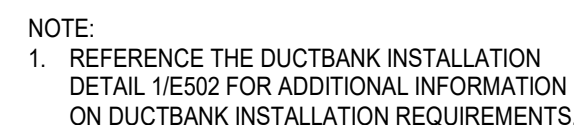


E1



(2)

SCALE: 1/8" = 1'-0"

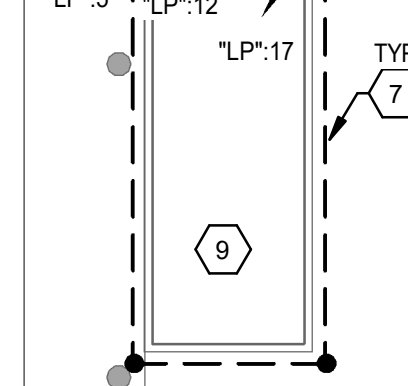

SHEET KEYNOTES

- A. INSTALL UTILITY TRANSFORMER PAD PER CWL REQUIREMENTS. CONTACT KEVAN INBODAN WITH CWL FOR TRANSFORMER PAD DESIGN. (KINBODOAN@JONESBORO.CW.COM).
- B. INSTALL 1/2" SCHEDULE 40 PVC CONDUITS FROM THE UTILITY TRANSFORMER, PRIMARY TO THE BASE OF OVERHEAD ELECTRIC POLES SHOWN. COORDINATE EXACT LOCATION OF PRIMARY POLE DROP WITH CWL. INSTALL LONG-SWEEP RADIUS 90 DEGREE BENDS AT THE TRANSFORMER PAD AND THE BASE OF THE OVERHEAD POLE.
- C. CONTRACTOR SHALL PROVIDE ALL SECONDARY CONDUIT, WIRE, AND CONNECTORS AND MAKE ALL SECONDARY CONNECTIONS. CWL WILL SET THE UTILITY TRANSFORMER ON THE PAD AND PROVIDE PRIMARY CONDUCTORS AND TERMINATE AT PRIMARY LUGS.
- D. CONTRACTOR SHALL INSTALL A 1" RIGID PVC CONDUIT FROM TRANSFORMER PAD TO METER LOCATION. INSTALL METER BASE (COORDINATE METER BASE REQUIREMENTS WITH CWL). CWL WILL INSTALL METER AND METER WIRE TO TRANSFORMER CTS. CWL WILL PROVIDE CTS AT TRANSFORMERS.
- E. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PERMIT FEES WITH THE CITY OF JONESBORO.
- F. REFERENCE I-LINE DIAGRAM ON DRAWING E401 FOR ALL EQUIPMENT, WIRE, AND CONDUIT SIZING.
- G. CONTRACT CRITICO CABLE AND FIRE, INC. FOR INSTALLATION AND TERMINATION OF FIBER BACK TO CWL COMMUNICATION HUB LOCATED AT ADMINISTRATION BUILDING. CRITICO SHALL PROVIDE, INSTALL, AND TERMINATE ALL SERVICE FIBER TO LIFT STATION. CRITICO SHALL COORDINATE ALL WORK WITH CWL.

1. PROVIDE (3) 2" SCHEDULE 40 PVC CONDUIT BELOW GRADE TO THIS POLE FOR POWER TO NEW LIFT STATION. PROVIDE LONG-SWEEP 90 DEGREE ELBOWS AT STUB UP LOCATIONS (POLE AND TRANSFORMER PAD). STUB UP AND CAP AT UTILITY POLE AND TRANSFORMER PADS. PRIMARY VOLTAGE CABLE AND TERMINATION BY CWL. CONFIRM EXACT UTILITY POLE LOCATION WITH CWL PRIOR TO ANY INSTALLATION.
2. PROVIDE 2" CONDUIT BELOW GRADE FROM UTILITY POLE TO FIBER PATCH PANEL TO BE INSTALLED WITHIN PUMP STATION BUILDING. STUB CONDUIT UP AT EXISTING POLE AND COORDINATE EXACT LOCATION OF STUB UP WITH CWL PRIOR TO ANY INSTALLATION. REFERENCE E201 FOR CONTINUATION OF CONDUIT INTO BUILDING.
3. INSTALL UTILITY TRANSFORMER PAD PER CWL REQUIREMENTS. CONTACT KEVIN INDEEN WITH CWL FOR TRANSFORMER PAD DESIGN (KINBODEN@JONESBORO.CWL.COM).
4. PROVIDE 120V CIRCUIT FOR 2500W GENERATOR BLOCK HEATER. CIRCUIT SHALL BE (2)#10 AND (1)#10 GROUND IN 3/4" CONDUIT.
5. PROVIDE (SPARE) 120V CIRCUIT FOR GENERATOR BATTERY CHARGER.
6. PROVIDE 120V CIRCUIT FOR GENERATOR LIGHTING AND RECEPTACLES.
7. PROVIDE CU BONDING JUMPER CONDUCTOR AT 30" MINIMUM BELOW GRADE.
8. PROVIDE 10x3/4" COPPER CLAD STEEL GROUND ROD TO FORM GROUNDING ELECTRODE. CAD WELD A COPPER BONDING JUMPER TO EACH ROD. INSTALL CONDUCTOR AT 30" MINIMUM BELOW GRADE. INSTALL A GROUND WELL AT THE NORTHEAST CORNER. REFERENCE DETAIL 25.02 FOR ADDITIONAL INFORMATION.
9. GENERATOR BASE AND SLAB REFERENCE DETAIL 5503 FOR ADDITIONAL INFORMATION. CONTRACTOR SHALL SUBMIT DIMENSIONED SHOP DRAWINGS OF GENERATOR INSTALLATION ONTO SLAB FOR REVIEW/APPROVAL.
10. INSTALL (3) 1" CONDUIT FROM GENERATOR TO ATS AND INTO BUILDING FOR CONTROL WIRING AND (1) 1" CONDUIT FOR 120V CIRCUITS IN ADDITION TO REFLECTED POWER WIRING. REFERENCE DRAWING 5401 ELECTRICAL LINE DIAGRAM AND INSTRUMENTATION AND CONTROL DRAWINGS 101-1103 FOR ADDITIONAL INFORMATION.
11. INSTALL (1) 1" CONDUIT FOR CONTROL WIRING AND (1) 1" CONDUIT SPARE FOR FUTURE 120V CIRCUIT TO POWER RELAY/MONITORING IN ADDITION TO POWER FEEDS INDICATE ON E4.01.
12. EXISTING 300KW GENERATOR OWNED BY CWL SHALL BE RELOCATED TO SITE AND SET IN PLACE BY CONTRACTOR. NEW PAD, CONDUIT, AND CONDUCTORS REFLECT FUTURE INSTALLATION OF 475KW GENERATOR. COORDINATE ALL RELOCATION REQUIREMENTS WITH CWL.

[illegible]

ELECTRICAL SITE PLAN

NEW WEST SIDE MAIN LIFT STATION
CITY WATER & LIGHT

IONESBODU ABKANISAS

2020

930

Y

REVISION DESCRIPTION

REV. NO.	DATE
-------------	------

111


3302 E. Millsap Road
TEL 479.443.3404

olsson

drawn by: _____ DI
checked by: _____ MM
approved by: _____ CW
QA/QC by: _____ DI
project no.: _____ 018-005
drawing no.: _____
date _____ 01/02/202

SHEET
E101


C:\Users\lsmead\Documents\WE_Jonesboro_Centrol_180054_lsmeadPS613.rvt
12/31/2019 10:17:33 AM

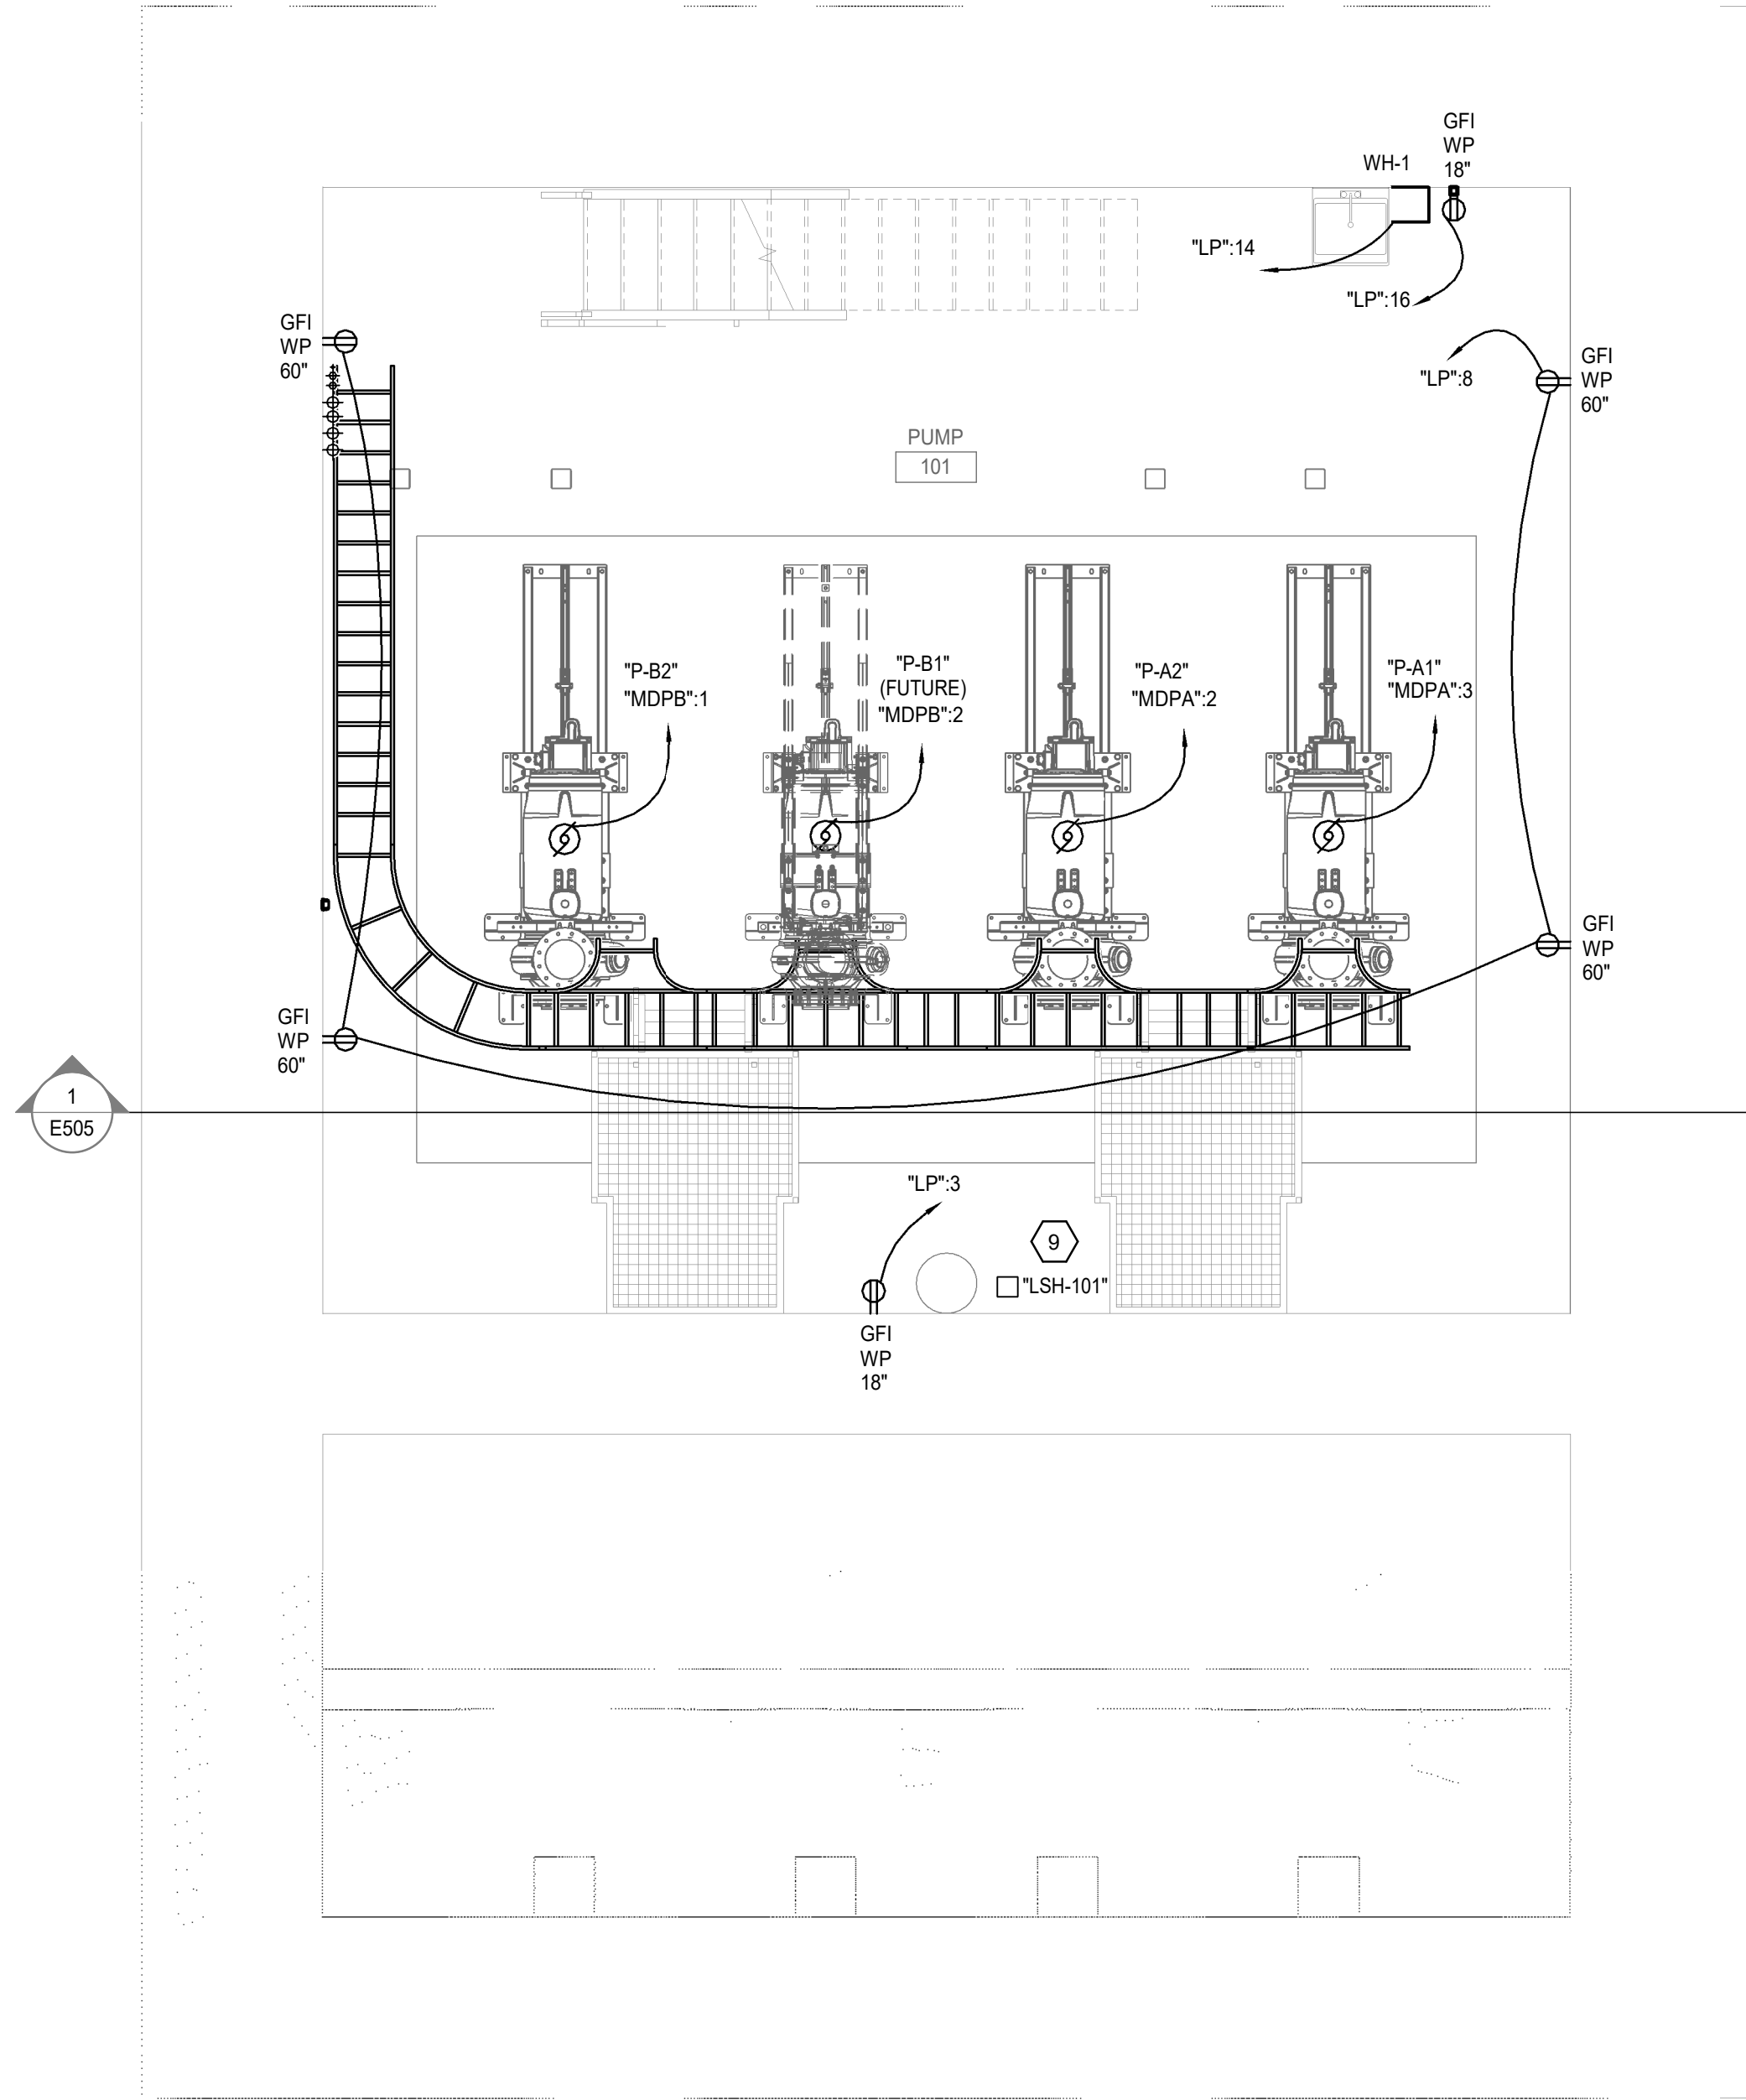

2

PUMP ROOM POWER PLAN

SCALE: 1/4" = 1'-0"

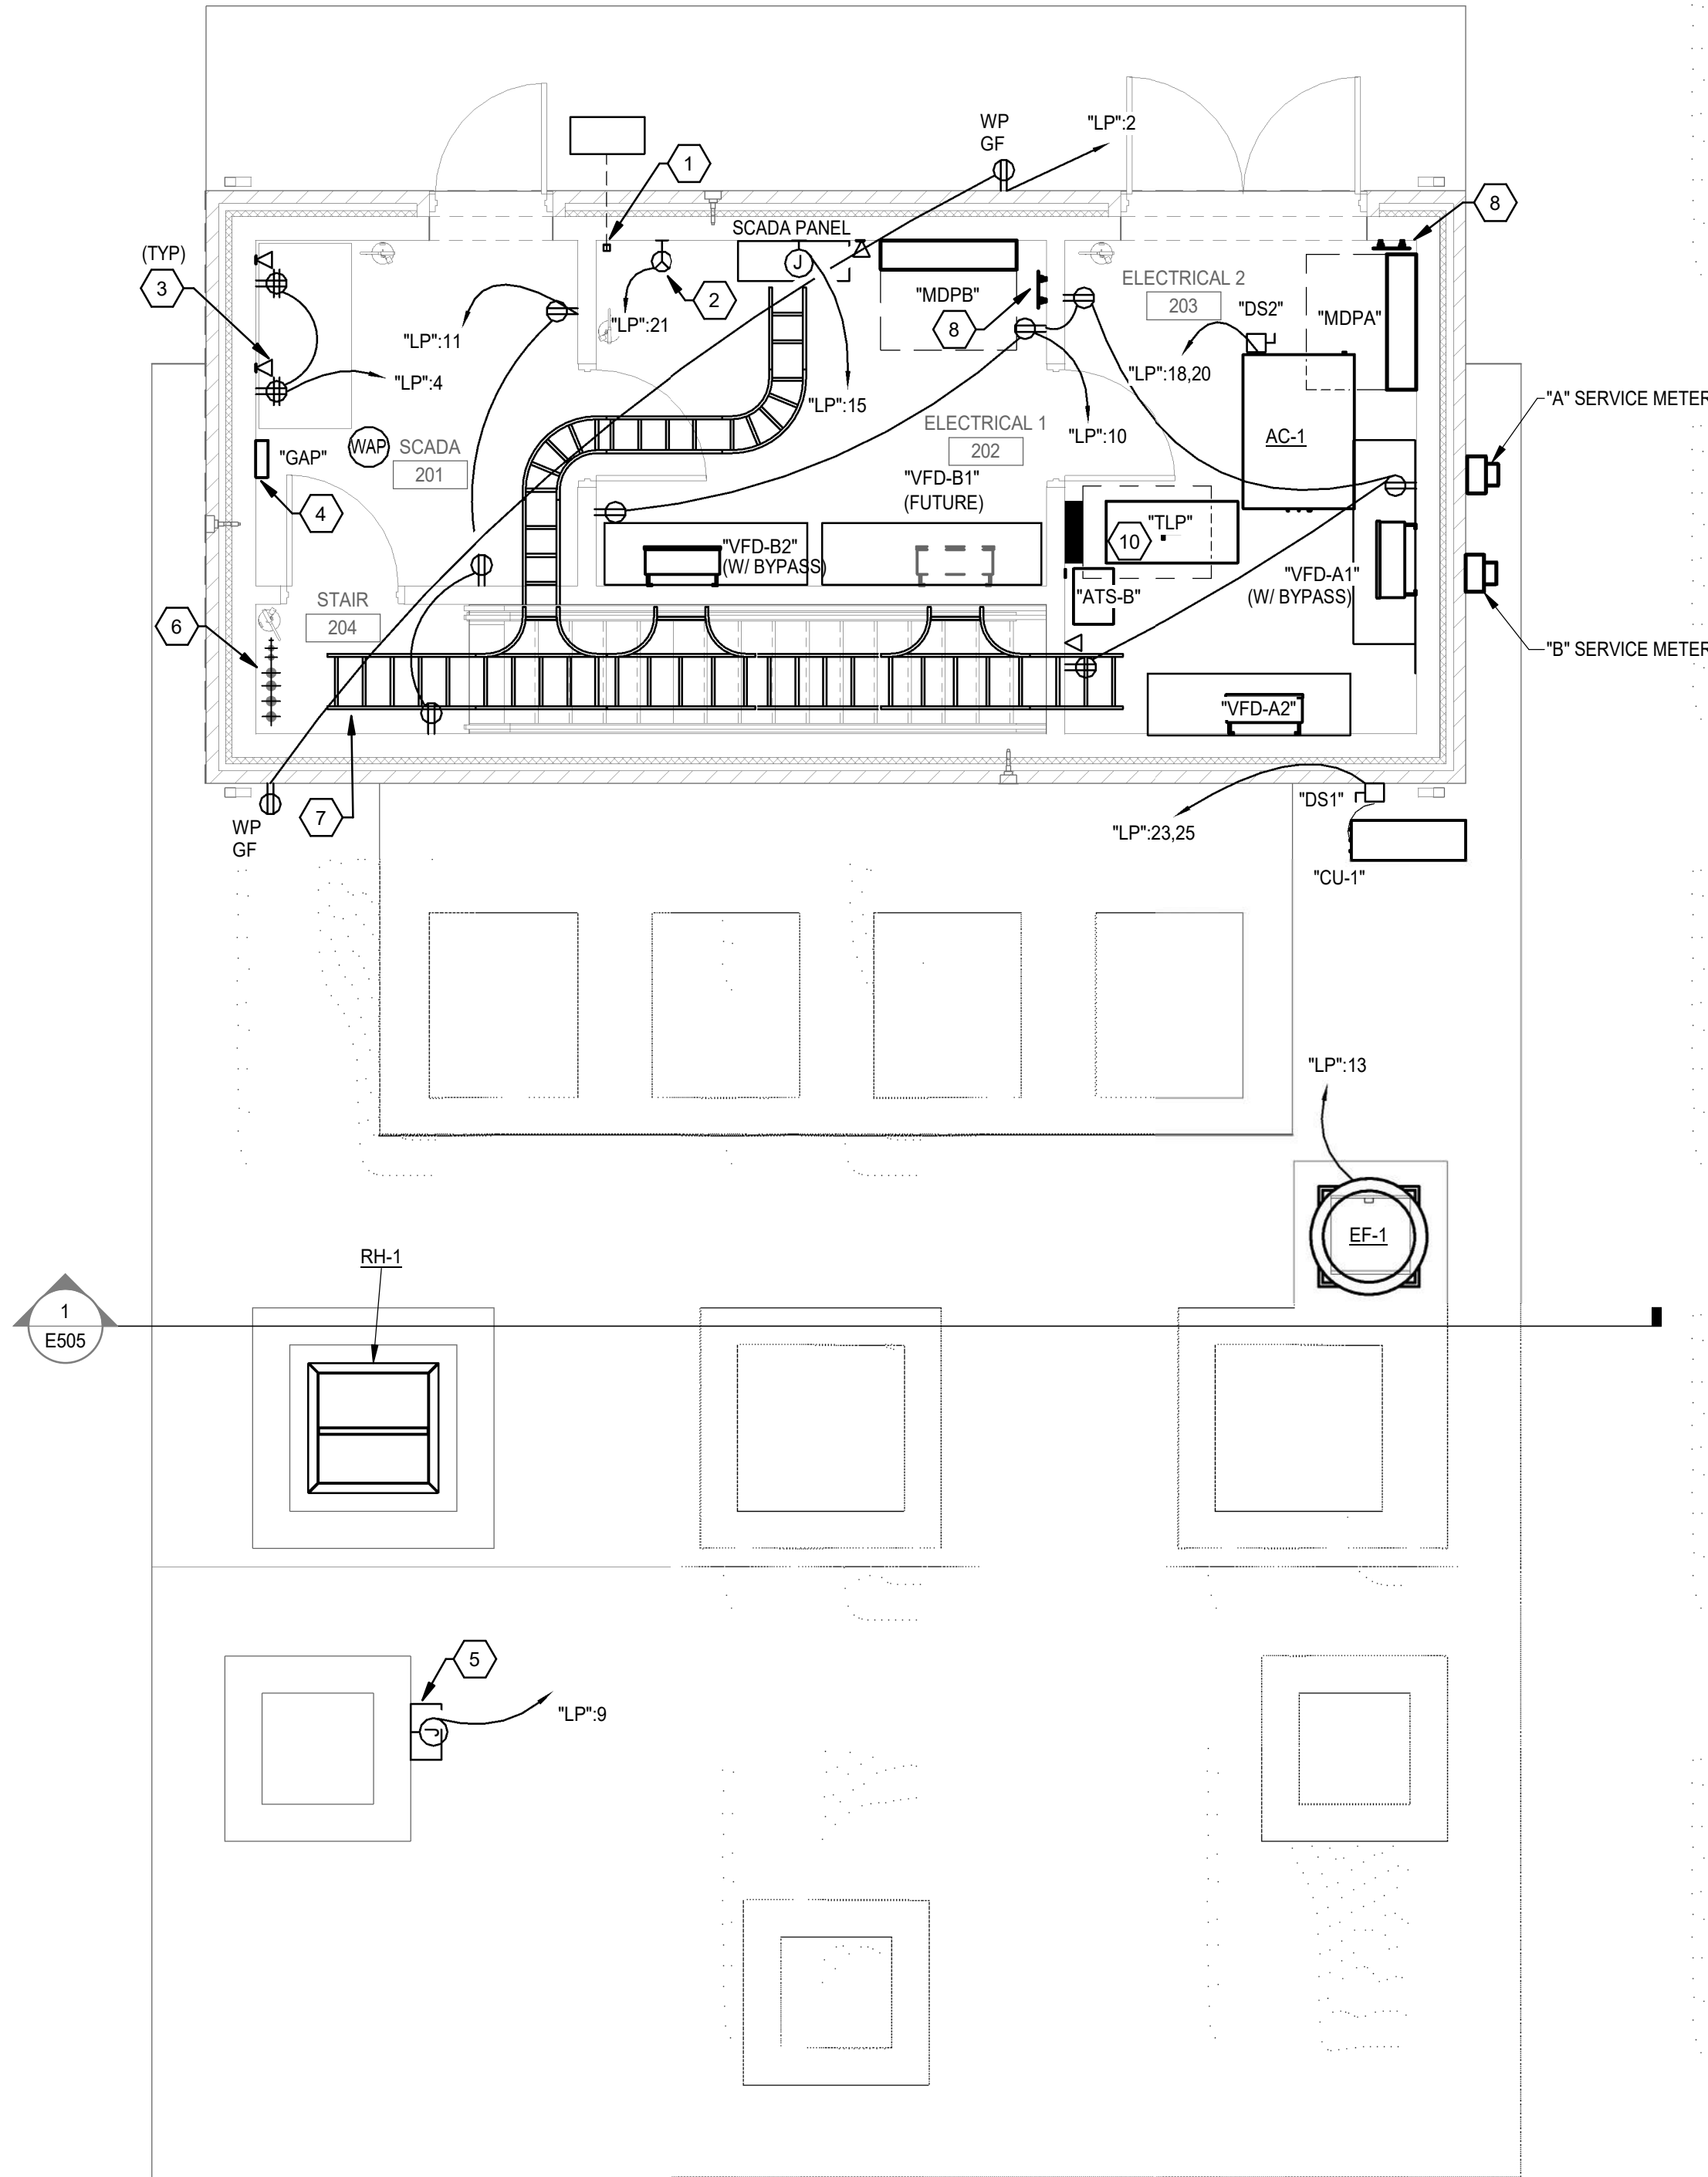

1

ELECTRICAL ROOMS POWER PLAN

SCALE: 1/4" = 1'-0"

SHEET KEYNOTES

- PROVIDE (2) 2" CONDUIT STUBBED UP IN ELECTRICAL 202 FOR COMMUNICATIONS. EXTEND CONDUIT TO HANDHOLE LOCATED 12" BEYOND BUILDING FOR INSTALLATION OF HANDHOLE IN SIDEWALK.
- PROVIDE 5-30R (120V, 30A) RECEPTACLE FOR SERVER POWER. SERVER IS BY OTHERS AND ANTICIPATED TO CONTAIN A 120V, 30A MULTI-OUTLET PDU FOR POWER TO SERVER EQUIPMENT.
- PROVIDE A 4"x4"x2-1/8" OUTLET BOX WITH SINGLE GANG COVERPLATE FOR DATA OUTLETS. INSTALL NYLON PULL STRING WITHIN WITH TAG AT EACH END OF THE CONDUIT.
- INSTALL GENERATOR ANNUNCIATOR PANEL PROVIDED WITH RELOCATED GENERATOR AT LOCATION SHOWN WITH NFPA 110 ALARMS (MINIMUM). INSTALL CONDUIT FROM PANEL TO GENERATOR FOR CONNECTION TO BATTERY POWER AND CONTROLLER SIGNAL(S).
- PROVIDE PRESSURE TRANSDUCER CONTROL PANEL MOUNTED ON UNI-STRUT RACK. REFERENCE DETAIL 21-102 SUBMERSIBLE PRESSURE TRANSDUCER FOR FURTHER INFORMATION.
- INSTALL (4) 3" CONDUIT AND (2) 2" CONDUIT THROUGH FLOOR TO BELOW FOR POWER AND CONTROLS TO PUMPS BELOW. CABLE SHALL RUN FROM (EACH) VFD AND SCADA PANEL ON CABLE TRAY. TRANSITION TO FLOOR BELOW IN CONDUIT AND LAND IN TRAY IN PUMP ROOM AT 12'-0" AFF FOR DISTRIBUTION TO PUMPS. PROVIDE (1) 3/4" CONDUIT FOR LEVEL SWITCH "LSH-101".
- INSTALL CABLE TRAY AS SHOWN AT 11'-0" TO BOTTOM OF TRAY. CABLE TRAY SHALL BE 18" WIDE FOR POWER WITH A DIVIDER FOR SCADA/LOW VOLTAGE CABLES. REFERENCE CABLE TRAY SPECIFICATIONS.
- INSTALL MAIN SERVICE GROUND BAR AND ASSOCIATED GROUNDING PER SERVICE GROUND DETAILS.
- PROVIDE LEVEL SWITCH. LEVEL SWITCH SHALL BE EQUAL TO CONTEGRA MODEL FS 202 OR AS INDICATED IN BOOK SPECIFICATIONS. INSTALL AS LOW AS POSSIBLE TO FLOOR.
- SUSPEND TRANSFORMER "TLP" FROM STRUCTURE PER DETAIL 1/ES.01.

LIFT STATION POWER PLANS


NEW WEST SIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

2020

REVISIONS

REV. NO.	DATE	REVISION DESCRIPTION	BY

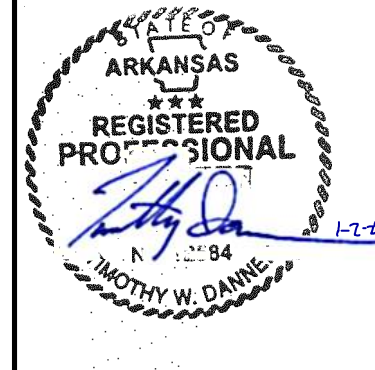

olsson

302 E. Millsp Road
Fayetteville, AR 72703

TEL 479.443.3404
FAX 479.443.4340

www.ollsson.com




















drawn by: DB
checked by: MM
approved by: CW
QA/QC by: DB
project no.: 018-00514
drawing no.:
date: 01/02/2020

SHEET
E201



A. ALL EMPTY CONDUITS SHALL BE PROVIDED WITH PULL STRING


1. PROVIDE STATIC TRIP ELECTRICALLY OPERATED CIRCUIT BREAKER WITH ELECTRONIC TRIP UNIT EQUAL TO POWERPAC P-FRAM, ET 6.0. WIRE BREAKER INTO SCADA SYSTEM FOR REMOTE CONTROL AND MONITORING (OPEN, CLOSE, BREAKER POSITION, TRIP ALARM).
2. CABLE FROM VFD TO PUMP MOTOR SHALL BE PROVIDED BY PUMP EQUIPMENT MANUFACTURER, INSTALLED BY EIC.
3. REFERENCE INSTRUMENTATION AND CONTROL (I-SERIES) DRAWINGS FOR ADDITIONAL INFORMATION.
4. REFER TO SERVICE GROUND DETAIL 6/E503 FOR ADDITIONAL INFORMATION.
5. PROVIDE SURGE PROTECTION DEVICE IN SERVICE EQUIPMENT PER SPECIFICATION 26 43 13. VERIFY RATING OF OVERCURRENT PROTECTION WITH EQUIPMENT MANUFACTURER.
6. INSTALL (FLYGT) SUBCAB CABLE FOR BUS COMMUNICATION BETWEEN BASE UNIT AND PUMP ELECTRIC MODULE PROVIDED BY PUMP MANUFACTURER. CABLE SHALL BE A SCREENED VERSION FOR VFD APPLICATIONS AND TOLERANT TO ELECTROMAGNETIC INTERFERENCE.
7. CONTRACTOR SHALL PROVIDE METER BASE AND CONDUIT. METER AND WIRE BY OTHERS. COORDINATE WITH CWL.
8. CONTRACTOR SHALL PROVIDE EMPTY CONDUITS WITH PULL STRING THESE CONDUITS ONLY.
9. UTILITY TRANSFORMERS FURNISHED AND INSTALLED BY OTHERS (CWL).
10. CONTRACTOR SHALL RELOCATE EXISTING GENERATOR OWNED BY CWL TO SITE. COORDINATE ALL REQUIREMENTS WITH CWL FOR RELOCATION. GENERATOR TO BE RELOCATED IS 300KW WITH AN 80% RATED, 600AT BREAKER. INSTALL OVERSIZED FEEDER(S) FOR FUTURE INSTALLATION OF 475KW GENERATOR.

ONE-LINE DIAGRAM SYMBOL LEGEND		
AMMETER		POTENTIAL TRANSFORMER
AMMETER SWITCH		POTHEAD
AUTOMATIC TRANSFER SWITCH		RELAY COIL
BUSPLUG CIRCUIT BREAKER		SINGLE THROW SWITCH
BUSPLUG FUSE & SWITCH		STRESSCONE
CIRCUIT BREAKER		SWITCHBOARD
CURRENT TRANSFORMER		THERMAL OVERLOAD
DRAW OUT CIRCUIT BREAKER		TRANSFORMER
MEDIUM VOLTAGE DRAW OUT CIRCUIT BREAKER		PADMOUNT TRANSFORMER
FUSE		VOLTMETER
FUSE & SWITCH		VOLTMETER SWITCH
FUSE CUTOUT		WATTHOUR DEMAND METER
GROUND		WATT METER
LIGHTNING ARRESTER		WATTHOUR METER
MOTOR		FEEDER TAG
GENERATOR		
N.C. CONTACT		
N.O. CONTACT		
PANELBOARD		

SHEET
E501

C:\Users\lsmead\Documents\WE_Jonesboro_Centrol_180054_lsmeadPS613.rvt
12/31/2019 9:56:54 AM

4 SERVICE ENTRANCE GROUND DETAIL

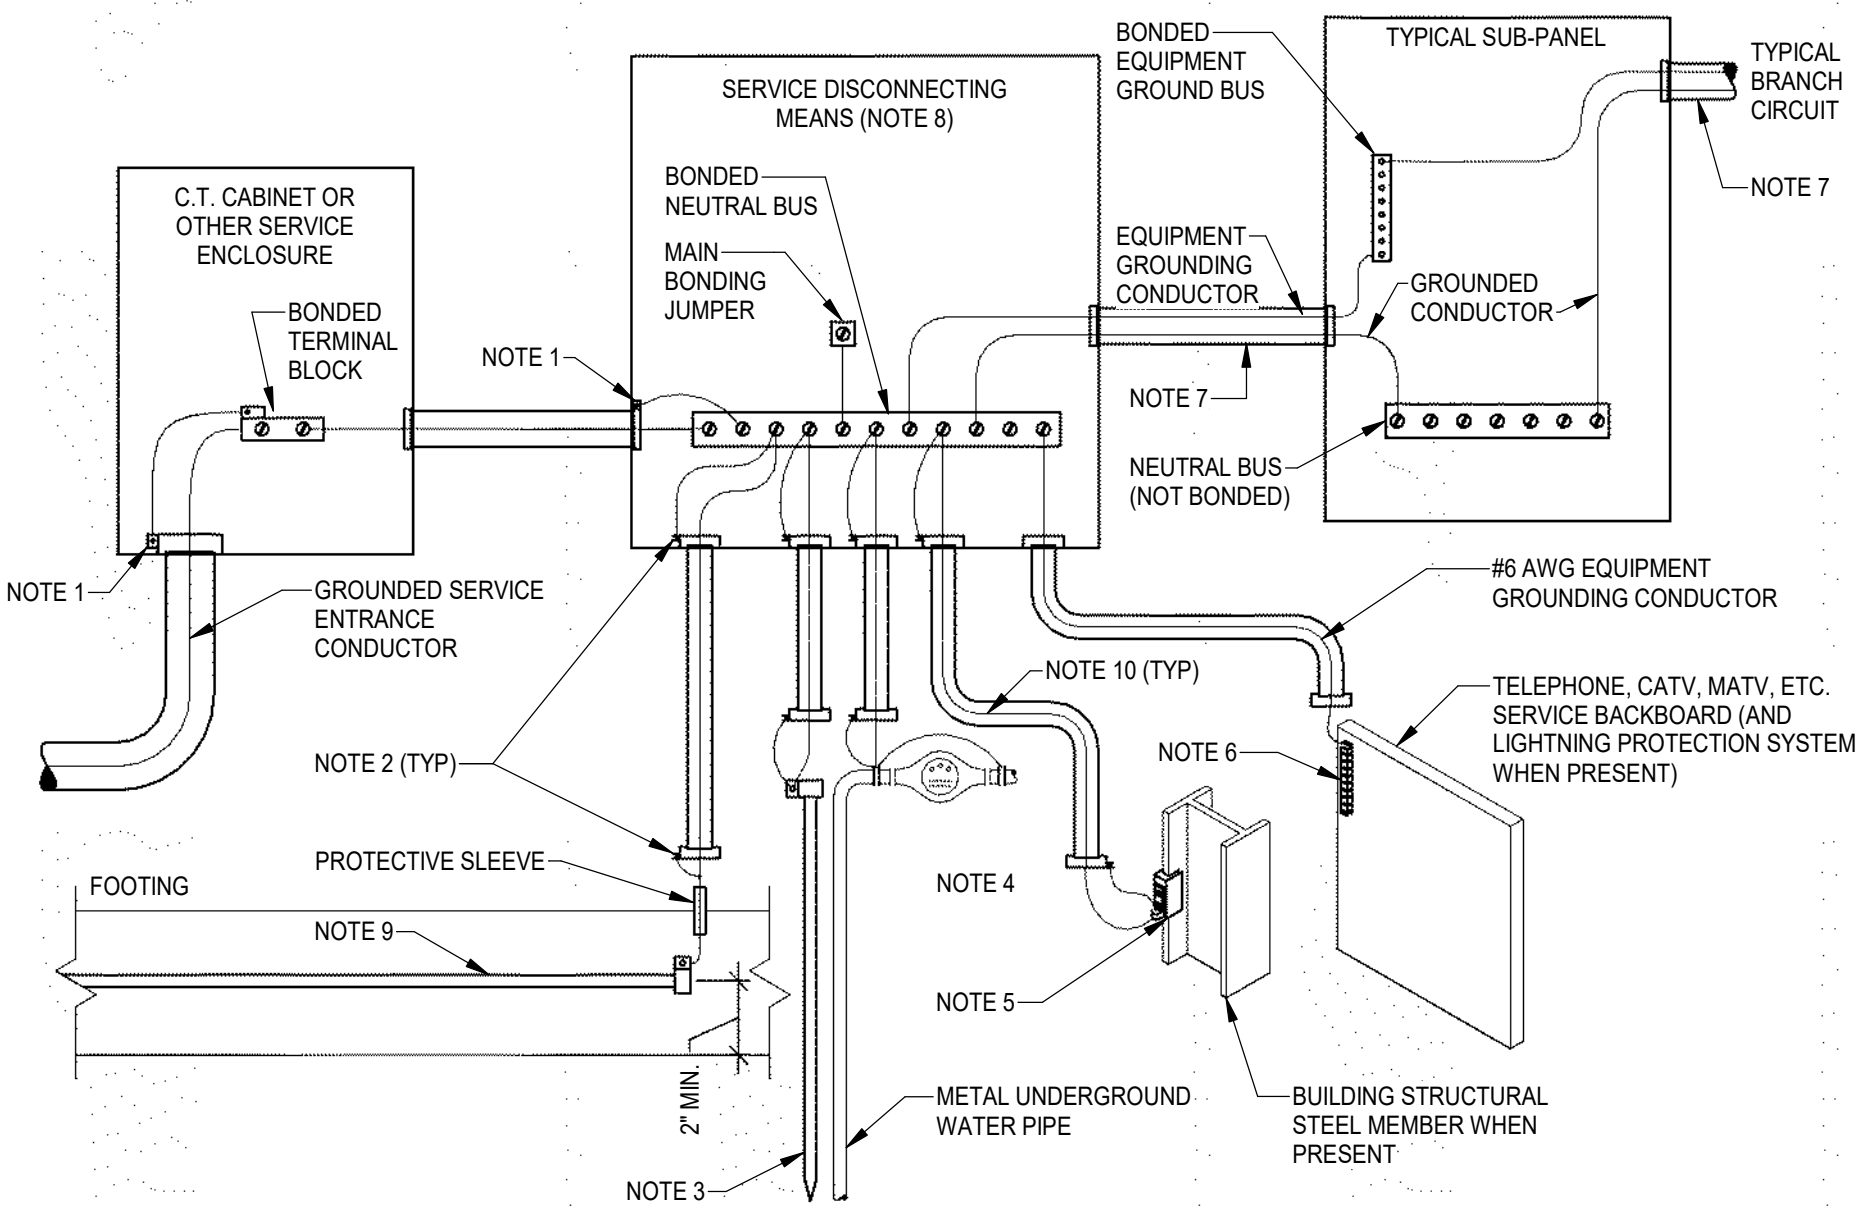

GENERAL NOTES APPLICABLE TO THIS DETAIL:
A. FOR CLARITY, PHASE CONDUCTORS ARE NOT SHOWN.


NOTES APPLICABLE TO THIS DETAIL:

1. ALL METAL CONDUITS ENCLOSING ANY SERVICE CONDUCTORS SHALL BE FITTED WITH A BONDING BUSHING. SIZE THE JUMPER PER NEC ARTICLE 250.
2. ALL METAL CONDUITS ENCLOSING ANY GROUNDING ELECTRODE CONDUCTOR SHALL BE FITTED WITH A BONDING BUSHING AT EACH END. SIZE THE JUMPER PER NEC ARTICLE 250.
3. PROVIDE AT LEAST ONE SUPPLEMENTAL GROUNDING ELECTRODE PER NEC IN THE FORM OF A 10'-0" x 3/4" COPPER CLAD GROUND ROD INSTALLED PER CURRENT NEC ARTICLE 250 REQUIREMENTS.
4. CONNECT TO THE BUILDING'S METAL UNDERGROUND WATER PIPE WITHIN 5' - 0" OF ITS ENTRANCE IN TO THE BUILDING AND JUMPER ANY WATER METER PER NEC REQUIREMENTS.
5. IF STRUCTURAL STEEL MEMBER IS AVAILABLE, BOND IT TO THE SERVICE USING A UL LISTED IRREVERSIBLE CLAMP OR WELDED LUG.
6. PROVIDE AN EQUIPMENT GROUND BAR AND ATTACH IT TO THE PHONE BOARD.
7. ALL BRANCH CIRCUIT AND FEEDER CONDUITS ARE TO HAVE AN INSULATED EQUIPMENT GROUNDING CONDUCTOR REGARDLESS OF THE CONDUIT MATERIAL.
8. WHEN THE SERVICE CONSISTS OF MULTIPLE DISCONNECTING MEANS IN SEPARATE ENCLOSURES, CONNECT A TAP CONDUCTOR FROM THE MAIN GROUNDING ELECTRODE CONDUCTOR TO EACH DISCONNECTING MEANS. SIZE THIS TAP BASED ON THE LARGEST SERVICE CONDUCTOR IN THAT SERVICE DISCONNECTED ENCLOSURE.
9. PROVIDE A GROUNDING ELECTRODE ENCASED IN AT LEAST 2" OF CONCRETE AND LOCATED NEAR THE BOTTOM OF A CONCRETE FOUNDATION OR FOOTING THAT IS INDIRECT CONTACT WITH EARTH. GROUNDING ELECTRODE SHALL CONSIST OF AT LEAST 20' - 0" OF ONE OR MORE BARE OR ZINC GALVANIZED OR OTHER ELECTRICALLY CONDUCTIVE COATED STEEL REINFORCING BARS OR RODS OF NOT LESS THAN 1/2" IN DIAMETER OR AT LEAST 20' - 0" OF #4 AWG BARE COPPER CONDUCTOR. THIS CONCRETE ENCASED GROUNDING ELECTRODE IS ALSO KNOWN AS A "UFER" GROUND.
10. WHERE A GROUNDING ELECTRODE CONDUCTOR IS SPECIFIED ELSEWHERE IN THE DRAWINGS, THAT SIZE SHALL APPLY TO ALL GROUNDING ELECTRODE CONDUCTORS SHOWN ON THIS DETAIL.


NOT TO SCALE

2 GROUNDING BUS DETAIL


NOT TO SCALE

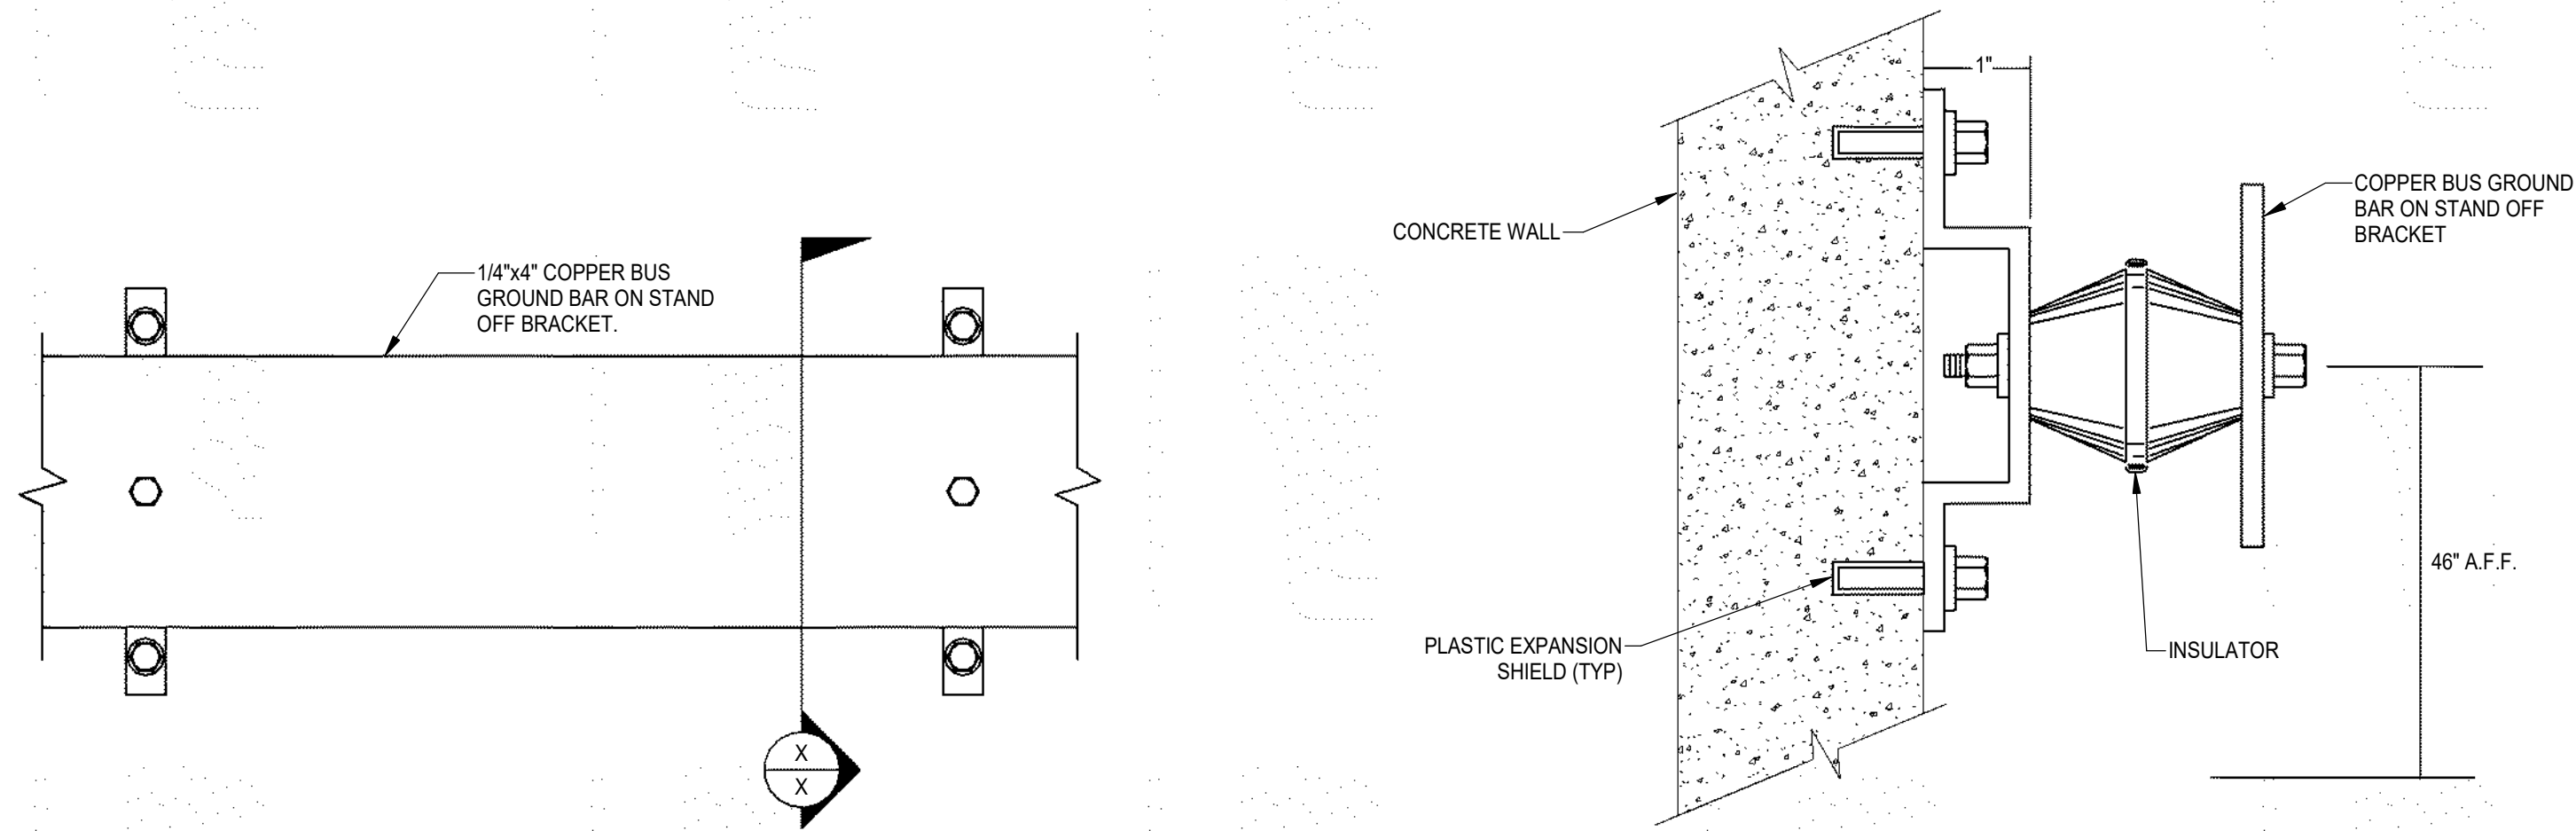


COPPER SPLICE PLATE

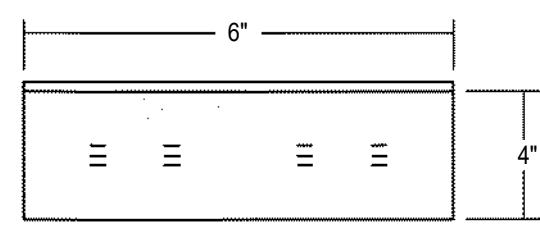

90° COPPER ELBOW

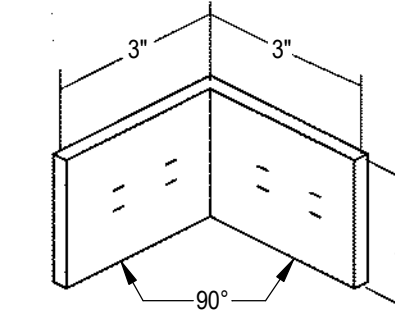


BRACKET AND INSULATOR

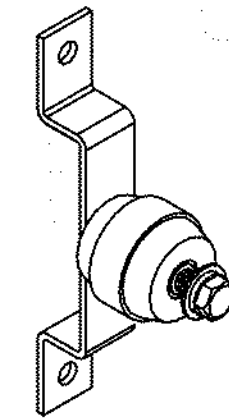


5 GENERATOR SUB-BASE FUEL TANK DIMENSIONS

SCALE: NOT TO SCALE

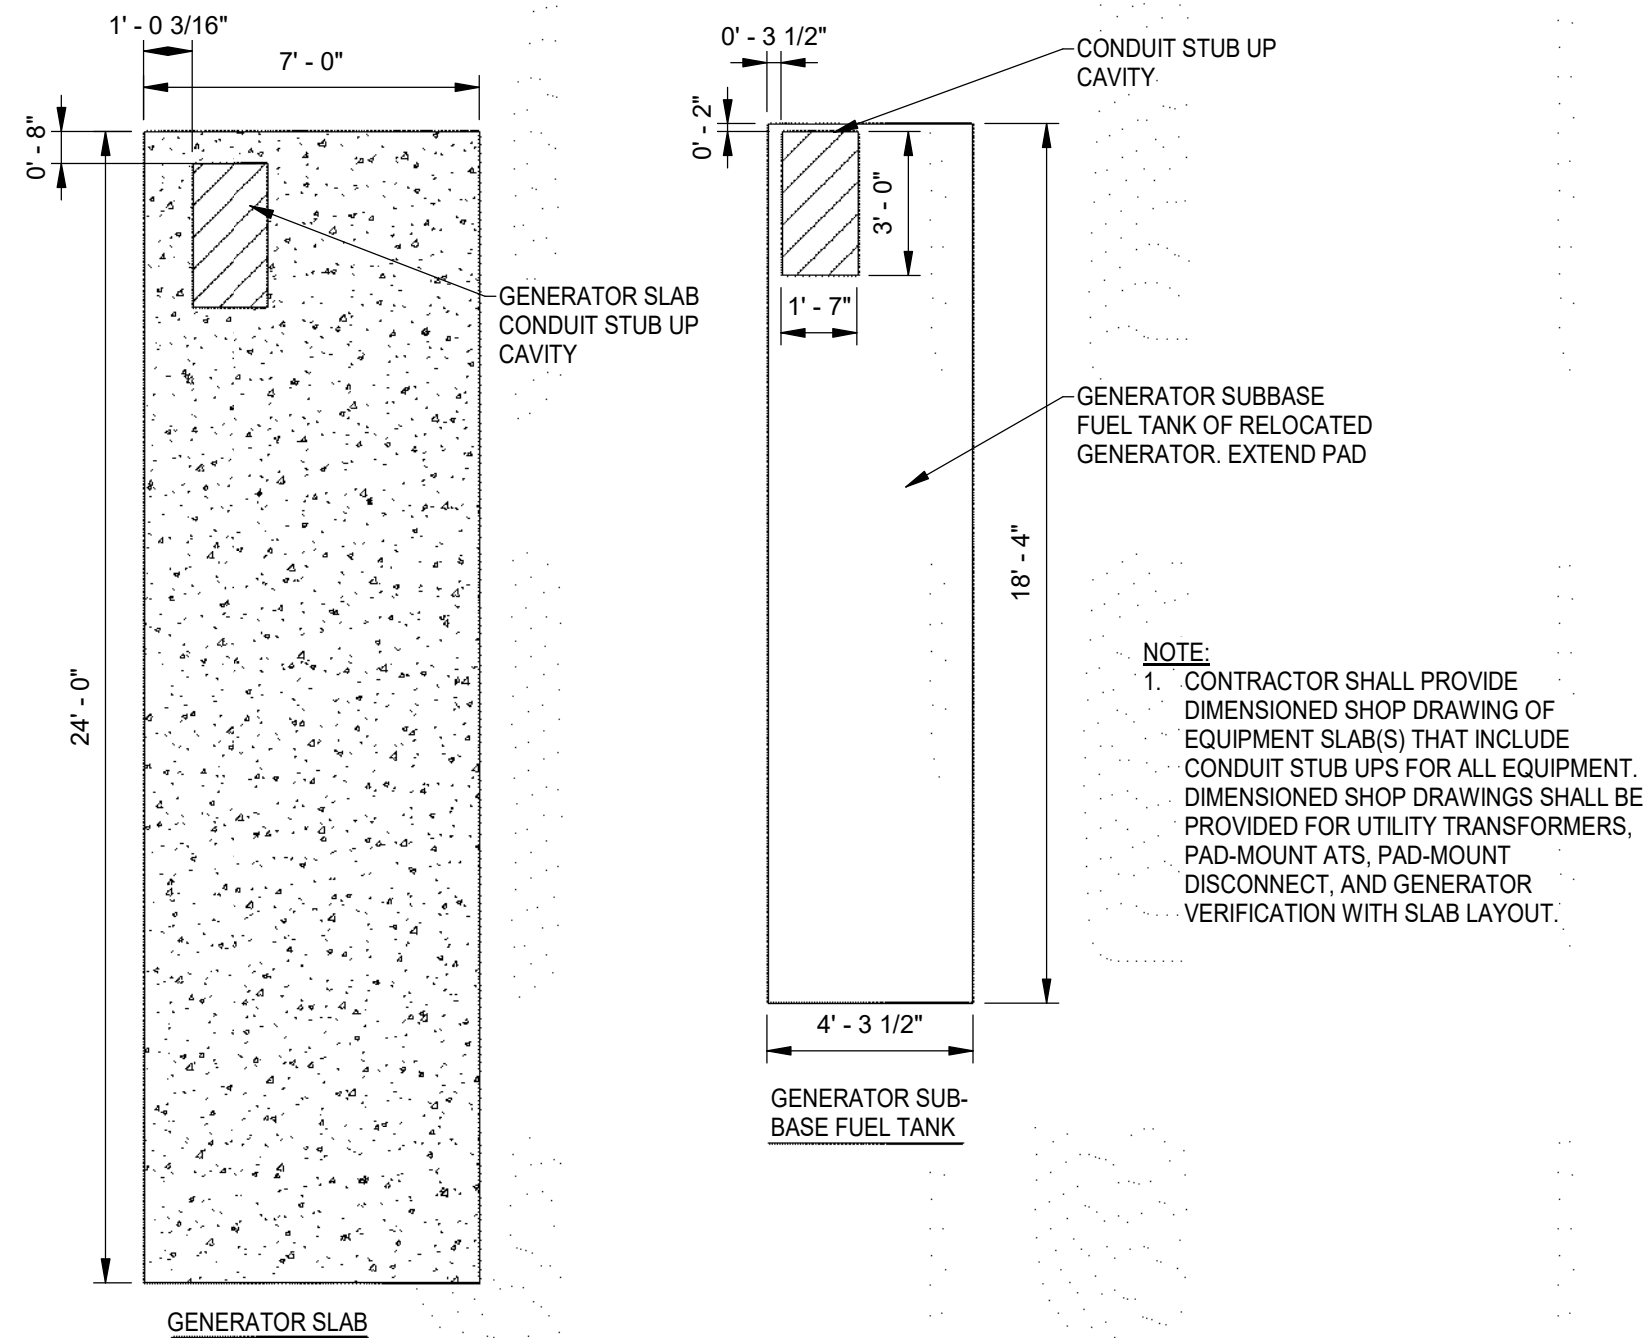

NOTE:
1. CONTRACTOR SHALL PROVIDE DIMENSIONED SHOP DRAWING OF EQUIPMENT SLAB(S) THAT INCLUDE CONDUIT STUB UPS FOR ALL EQUIPMENT. DIMENSIONED SHOP DRAWINGS SHALL BE PROVIDED FOR UTILITY TRANSFORMERS, PAD-MOUNT ATS, PAD-MOUNT DISCONNECT, AND GENERATOR VERIFICATION WITH SLAB LAYOUT.

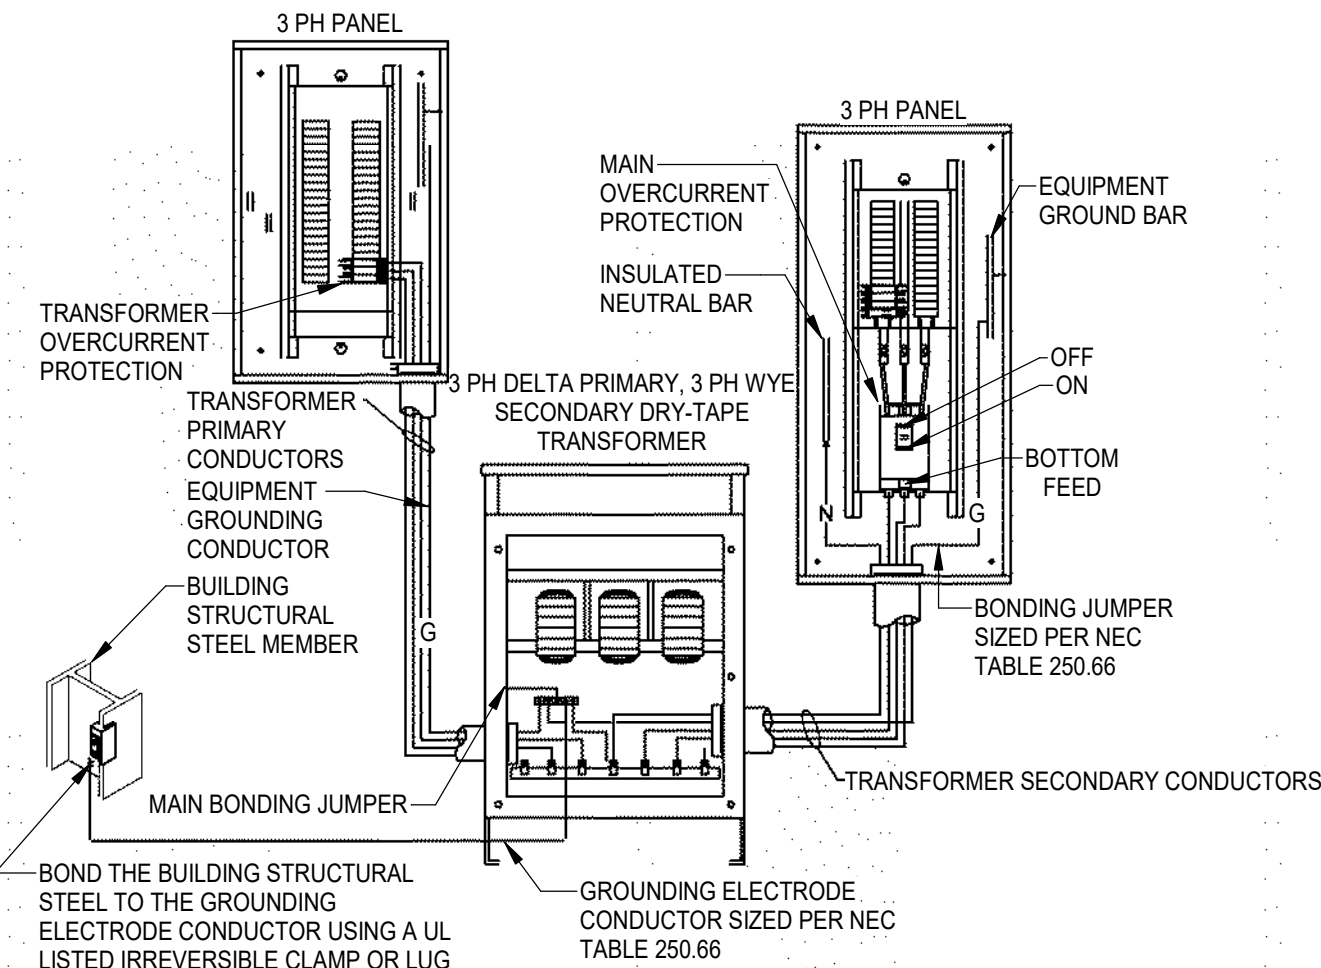


3 DRY-TYPE TRANSFORMER GROUND DETAIL


NOT TO SCALE

1 EMERGENCY AND NIGHT LIGHT WIRING DIAGRAMS


NOT TO SCALE

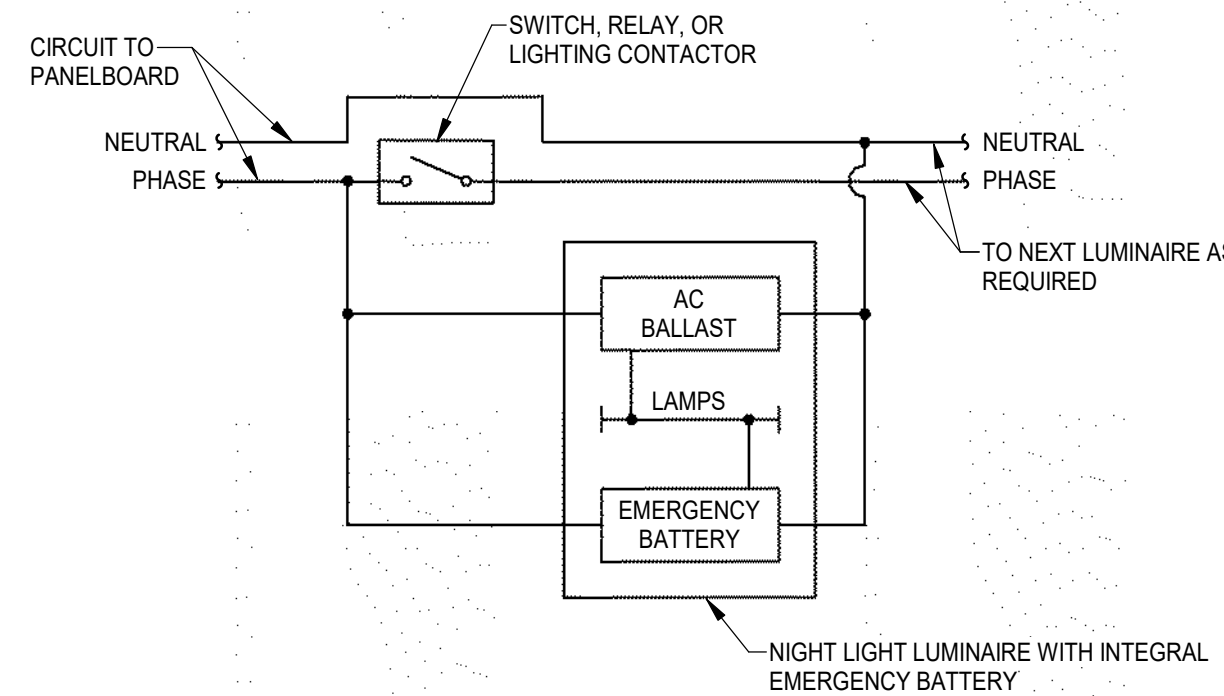

EMERGENCY AND NIGHT LIGHT

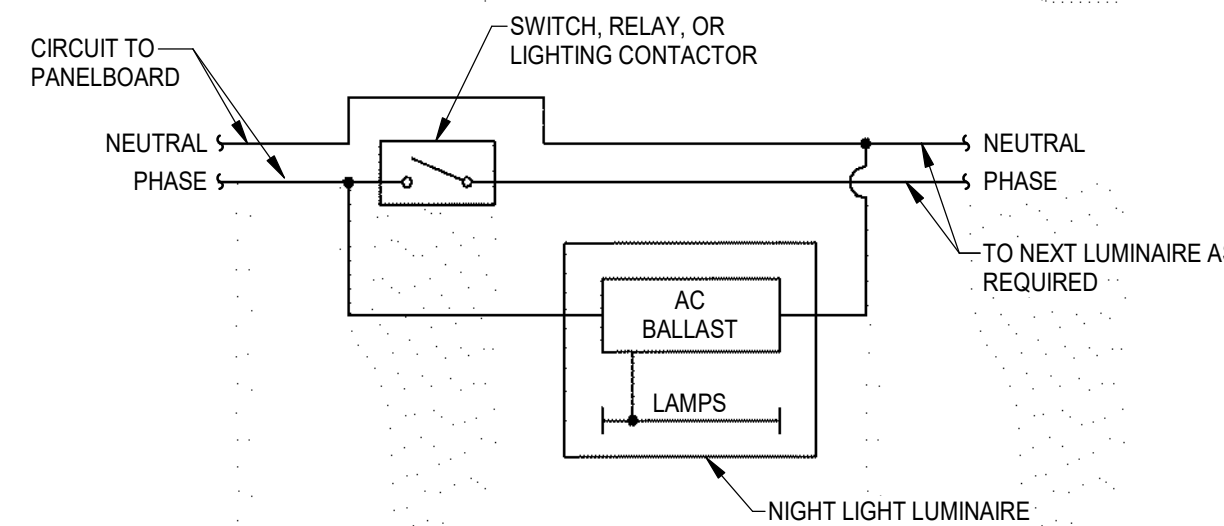

NIGHT LIGHT ONLY

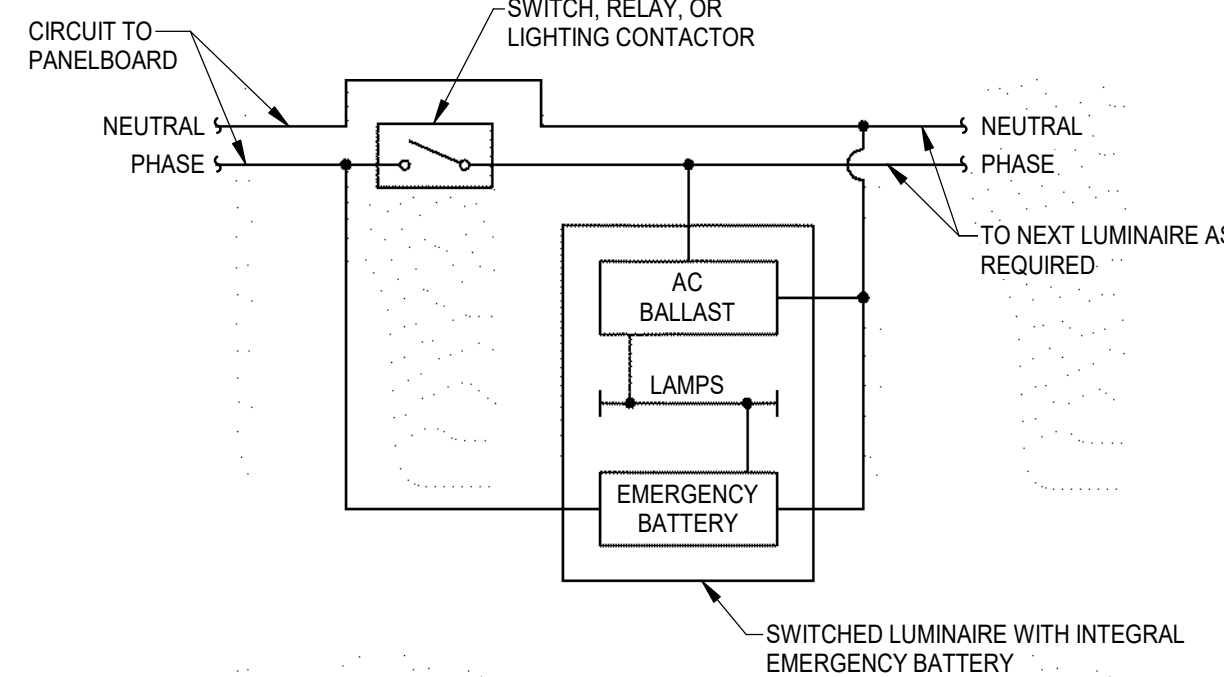

EMERGENCY LIGHT ONLY

ELECTRICAL DETAILS


NEW WEST SIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

2020

REVISIONS

REV. NO.	DATE	REVISION DESCRIPTION	BY

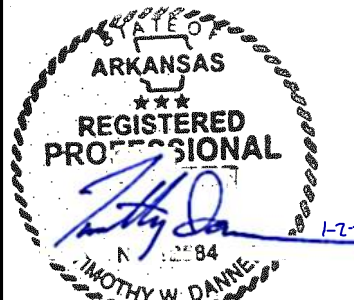


olsson

302 E. Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

drawn by: DB
checked by: MM
approved by: CW
QA/QC by: DB
project no.: 018-0054
drawing no.:
date: 01/02/2020

SHEET
E503

C:\Users\lsmeed\Documents\WE_Jonesboro_Centrol_180054_lsmeedPS6L3.rvt
12/31/2019 9:56:56 AM

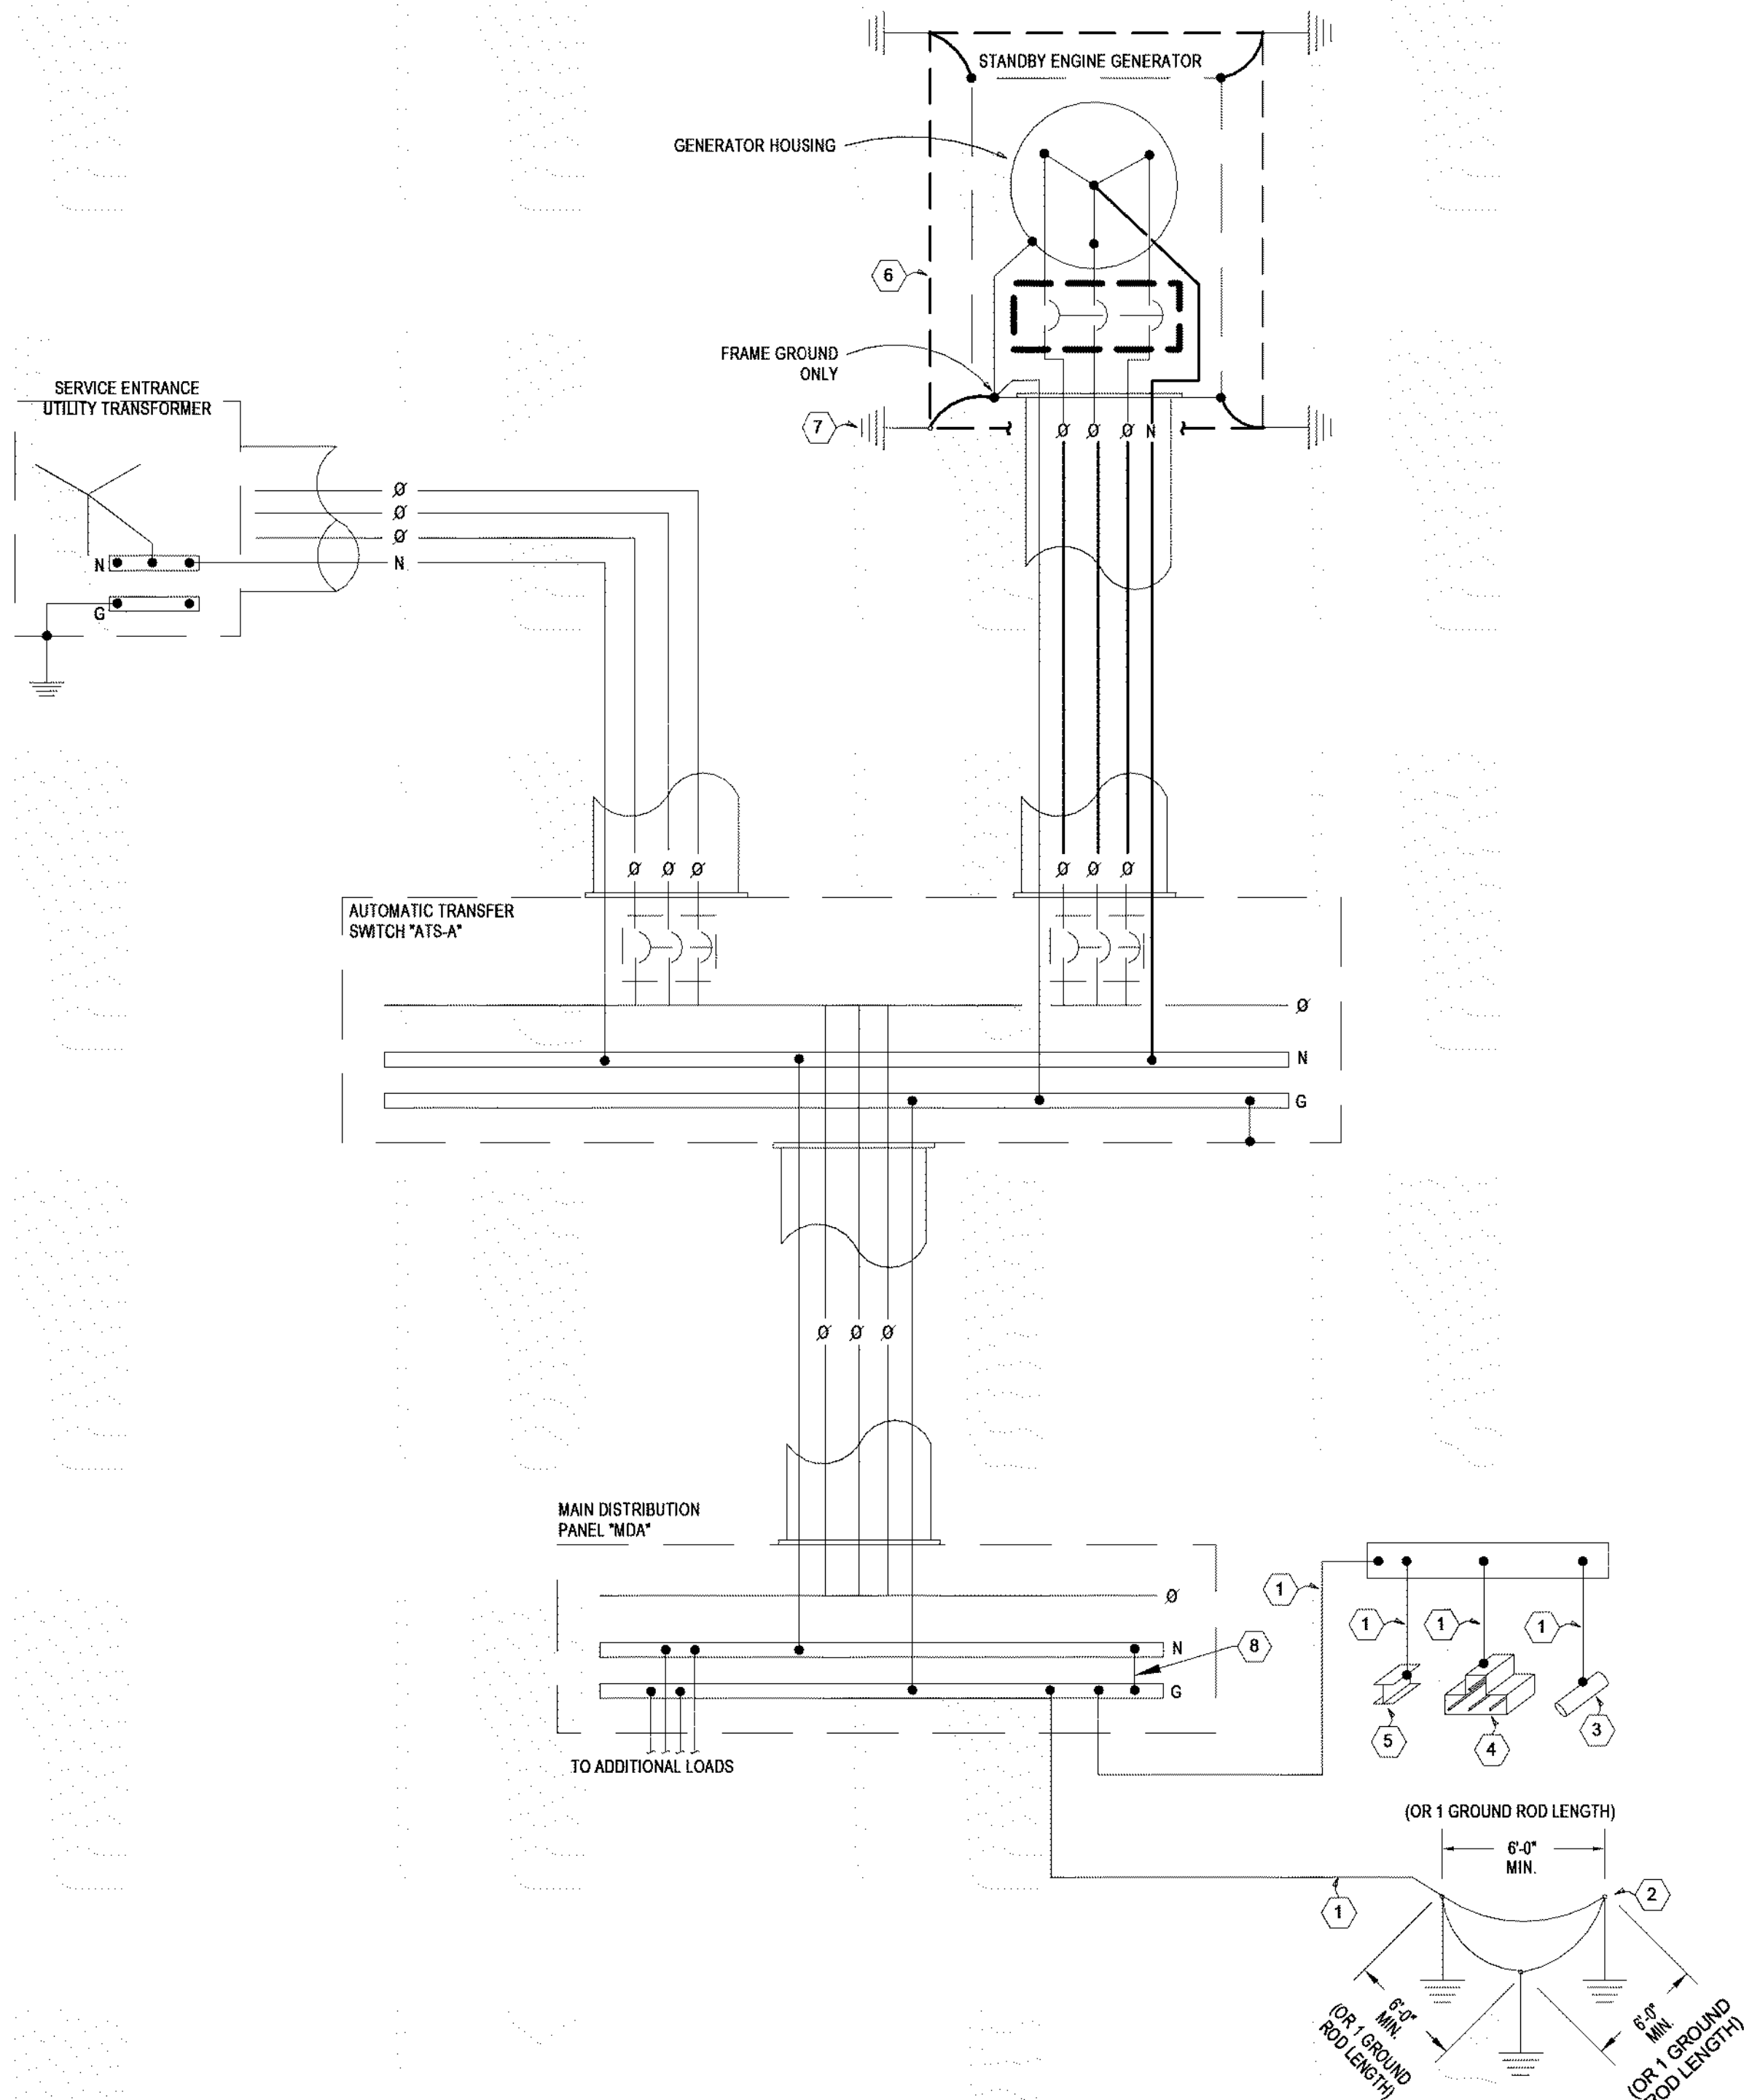


GROUNDING NOTES

1. INSTALL GROUNDING ELECTRODE CONDUCTOR SIZED PER NEC 250.66. GROUNDING ELECTRODE CONDUCTOR SIZE FOR GENERATOR AND UTILITY SERVICE IS #3/0.
2. INSTALL 10" X 5/8" COPPER CLAD STEEL GROUNDING RODS SPACED A MINIMUM OF 6'-0" APART. CONNECT GROUNDING RODS WITH AN EQUIPMENT BONDING JUMPER SIZED THE SAME AS THE GROUNDING ELECTRODE CONDUCTOR (ACCORDING TO TABLE 250.66). REFERENCE NEC 250.53(B) AND 250.53(G) FOR GROUND ROD INSTALLATION REQUIREMENTS. REFERENCE NEC 250.53(C) FOR BONDING JUMPER REQUIREMENTS.
3. UTILIZE METAL UNDERGROUND WATER PIPE IN ACCORDANCE WITH NEC 250.52(A)(1) AS A GROUNDING ELECTRODE.
4. UTILIZE CONCRETE ENCASED ELECTRODE IN ACCORDANCE WITH NEC 250.52(A)(3) AS A GROUNDING ELECTRODE.
5. BOND TO BUILDING STEEL.
6. INSTALL GROUNDING ELECTRODE CONDUCTOR SIZED PER NEC 250.66. GROUNDING ELECTRODE CONDUCTOR SIZE FOR GENERATOR AND UTILITY SERVICE IS #3/0.
7. INSTALL 10" X 5/8" COPPER CLAD STEEL GROUNDING RODS AT EACH CORNER OF THE GENSET. CONNECT GROUNDING RODS WITH AN EQUIPMENT BONDING JUMPER SIZED THE SAME AS THE GROUNDING ELECTRODE CONDUCTOR (ACCORDING TO TABLE 250.66). REFERENCE NEC 250.53(B) AND 250.53(G) FOR GROUND ROD INSTALLATION REQUIREMENTS. REFERENCE NEC 250.53(C) FOR BONDING JUMPER REQUIREMENTS.
8. MAIN (SYSTEM) BONDING JUMPER SIZED ACCORDING TO NEC TABLE 250.66. INSTALL A SYSTEM BONDING JUMPER AT EACH MAIN DISTRIBUTION PANEL "MDPA" AND "MDPB". REFERENCE AND INSTALL IN ACCORDANCE WITH NEC 250.28(A-D).

4 GENERATOR GROUNDING DETAIL

NOT TO SCALE

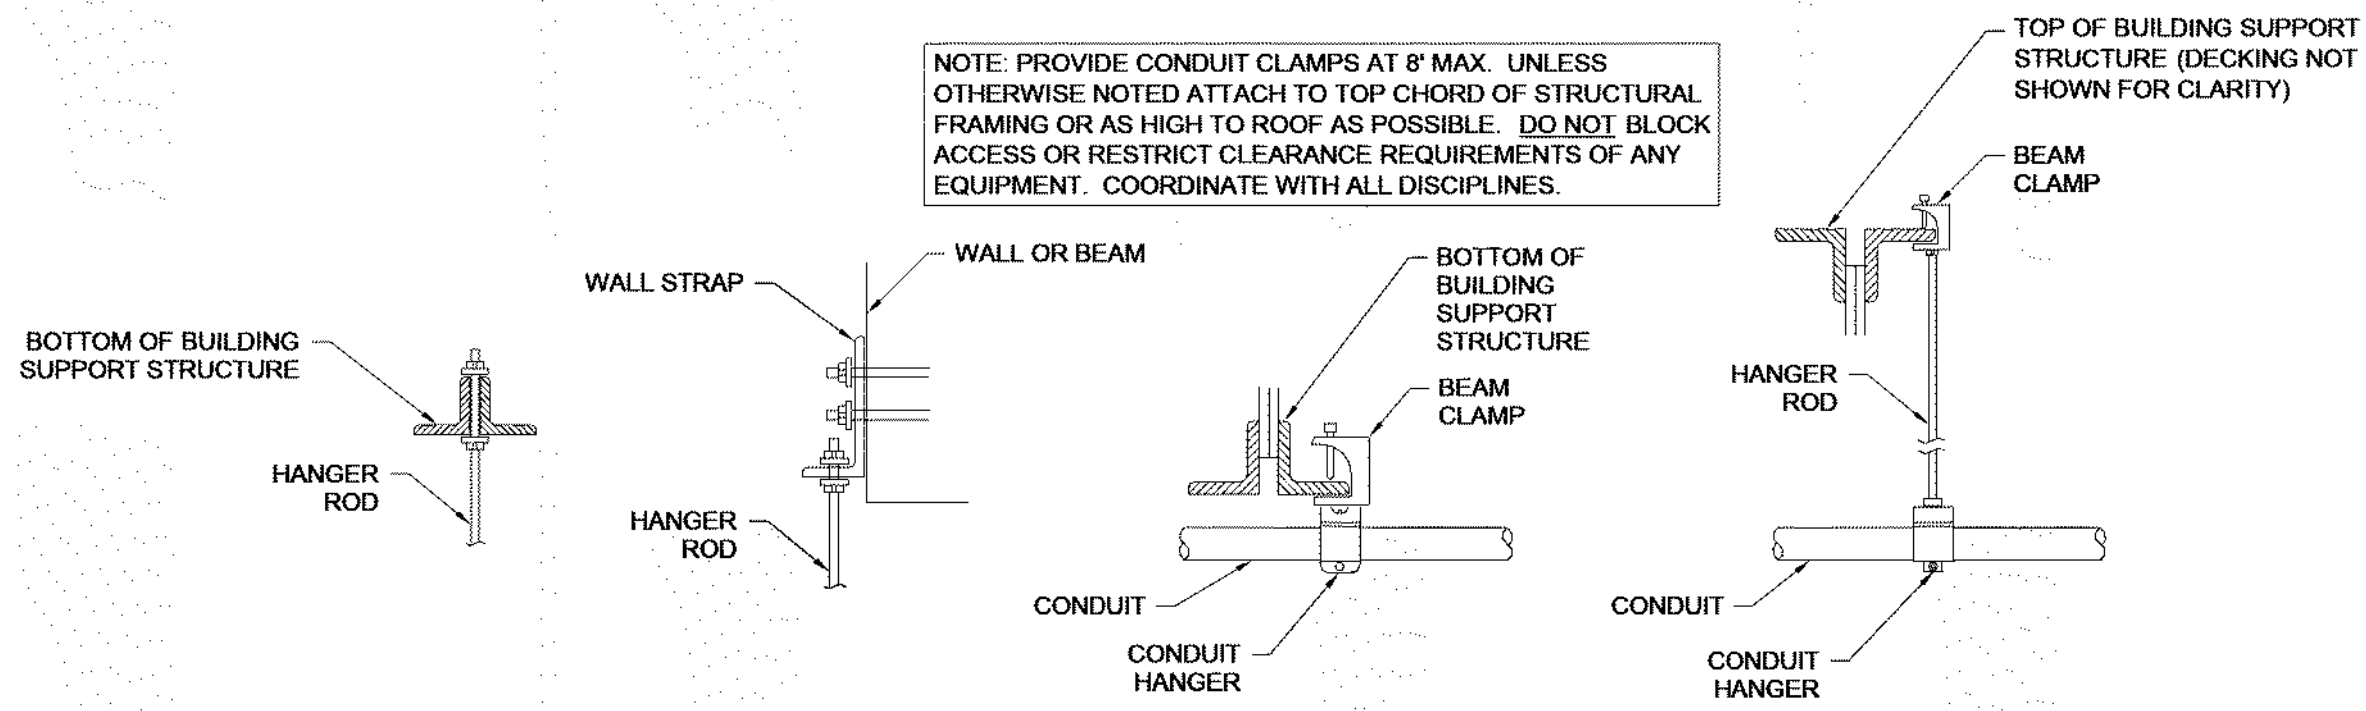


3 MISC ATTACHMENT DETAIL

NOT TO SCALE

MARK NO.	DESCRIPTION	VENDOR/CAT. NO. OR SERIES	
1	BRONZE GROUND CLAMP, CABLE TO FLAT WITH SILICON BRONZE HARDWARE	ANDERSON	
2	#4AWG CONDUCTOR-GREEN INSULATED, SOFT DRAWN COPPER GROUND CABLE	GC-141 ..	

.. OR APPROVED EQUAL
.. PER CABLE SIZE

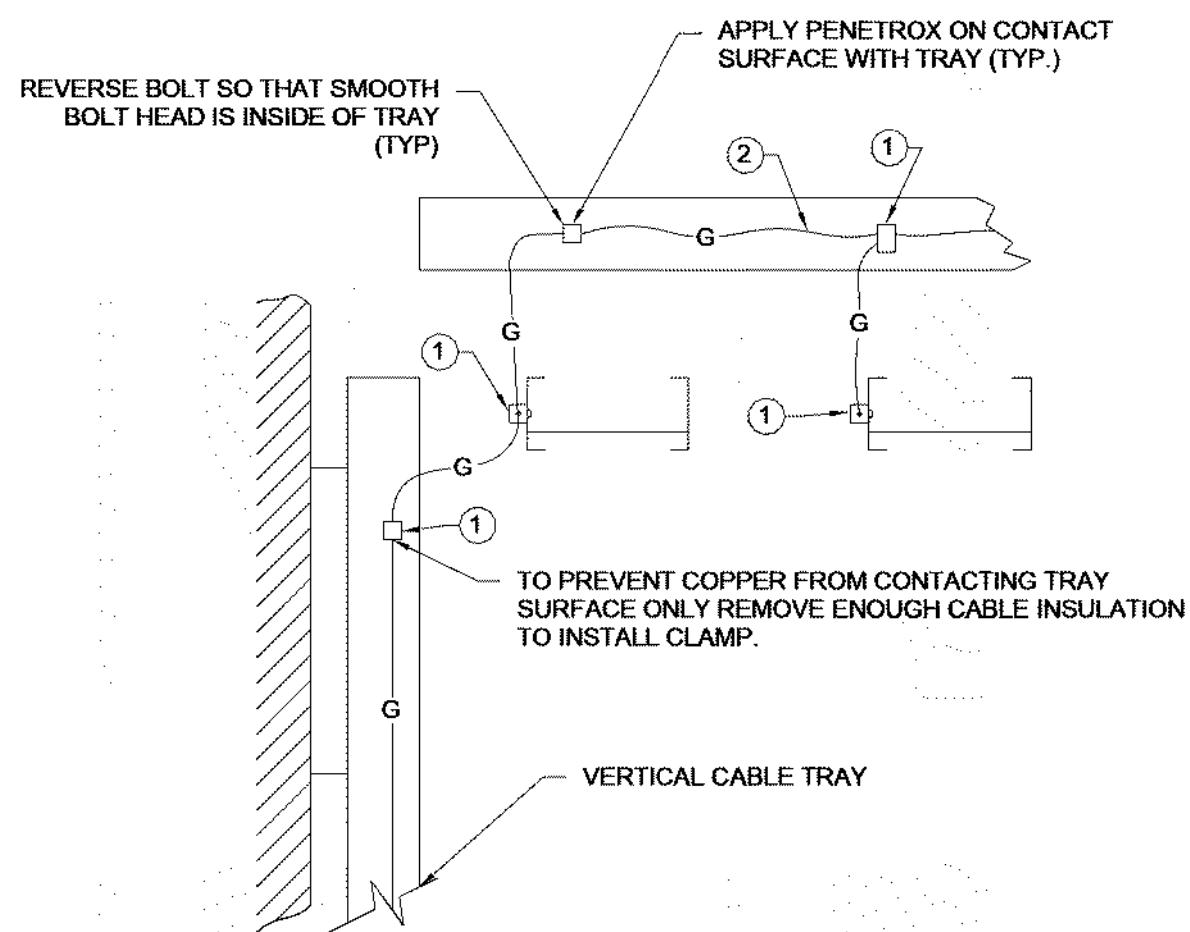


2 CABLE TRAY VERTICAL & HORIZONTAL TRANSITION GROUNDING DETAIL

NOT TO SCALE

MARK NO.	DESCRIPTION	VENDOR/CAT. NO. OR SERIES	
1	CONNECTOR-MECHANICAL TYPE CABLE TO FLAT BAR	BURNDY	
2	#4AWG CONDUCTOR-SOFT DRAWN BARE COPPER	"GB"	SEE CHART

OR APPROVED EQUAL

- NOTES:
1. GROUND CABLE SHOWN ROUTED NEAR SIDE & FAR SIDE OF TRAY, ONE OF TWO METHODS TO BE INSTALLED.
 2. GROUND CABLES ROUTED ON UNDERSIDE OF TRANSVERSE MEMBERS ARE TO BE SUPPORTED BY USING CABLE TIES #4AWG.

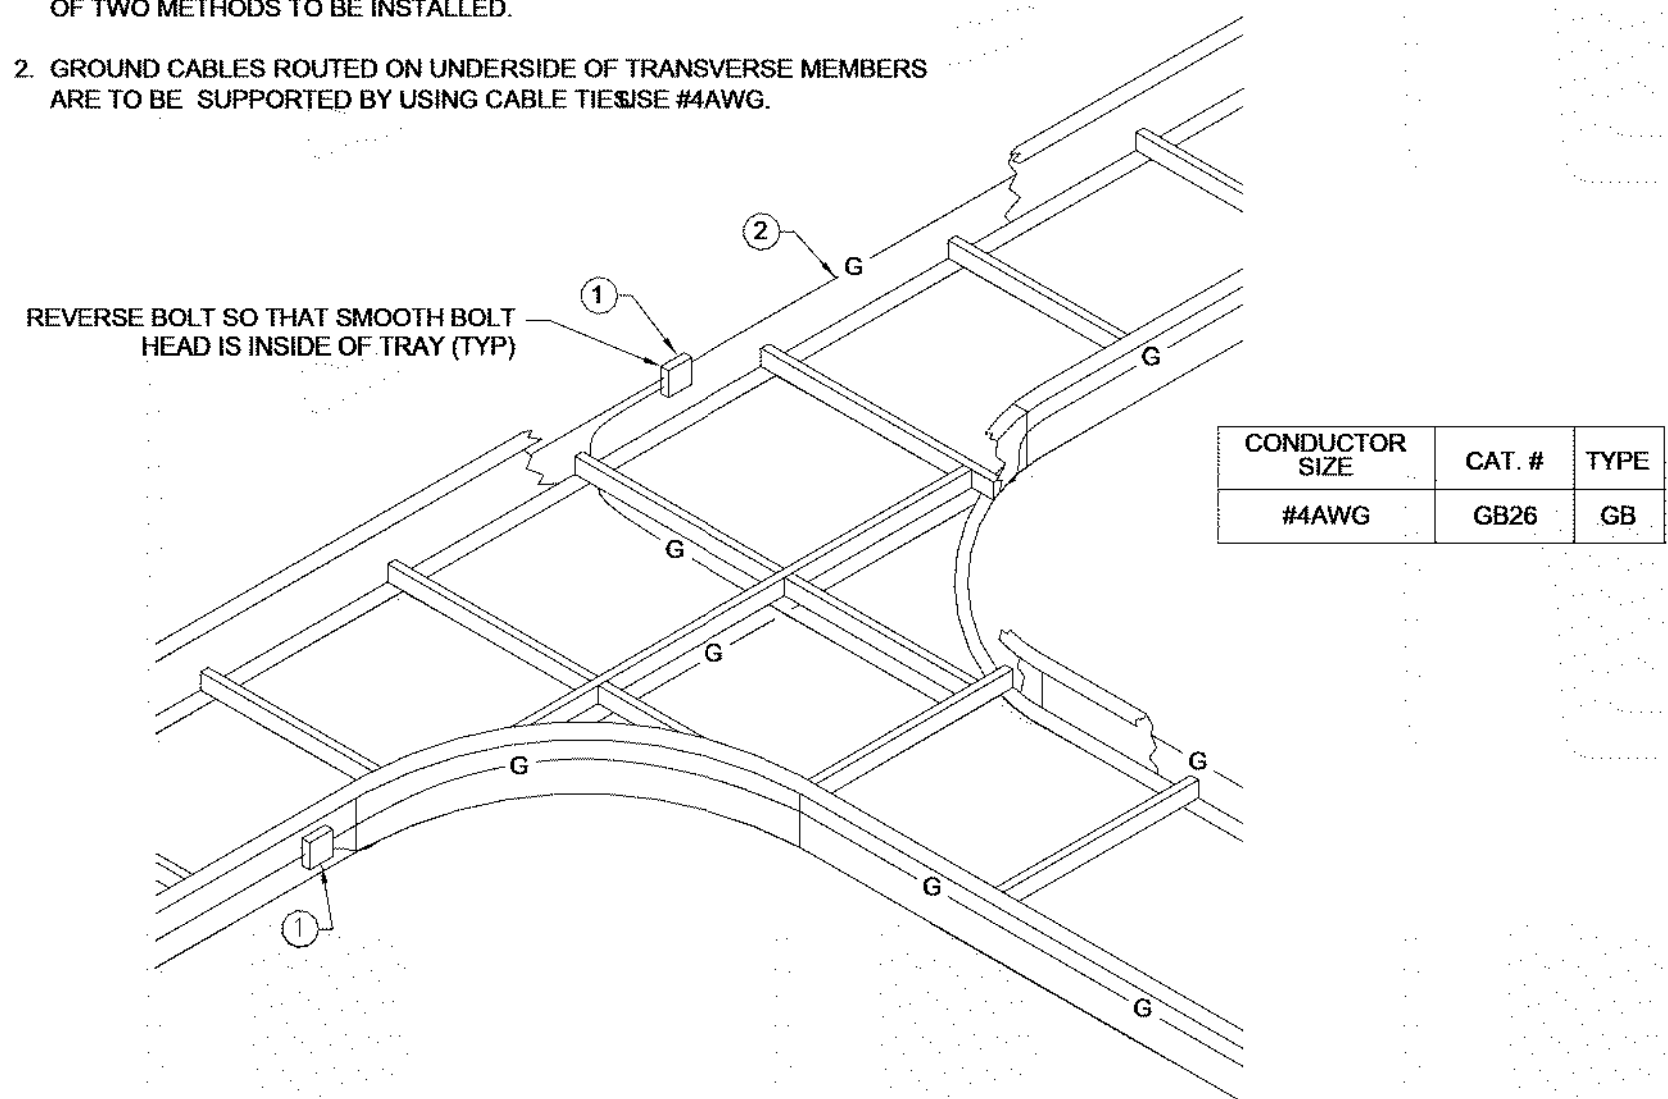

1 CABLE TRAY "T" FITTINGS INSTALLATION GROUNDING DETAIL

NOT TO SCALE


ELECTRICAL DETAILS
NEW WEST SIDE MAIN LIFT STATION
CITY WATER & LIGHT

JONESBORO, ARKANSAS

2020

REVISIONS

REV. NO.	DATE	REVISION DESCRIPTION	BY

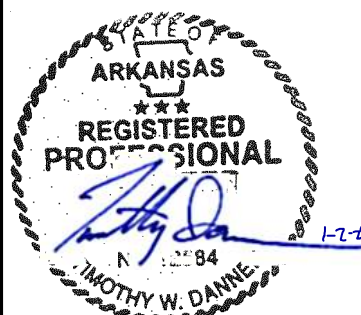


olsson

302 E. Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

drawn by: _____ Author
checked by: _____ Checker
approved by: _____ Approver
QA/QC by: _____ DB
project no.: 018-0054
drawing no.: _____
date: 01/02/2020


SHEET
E504

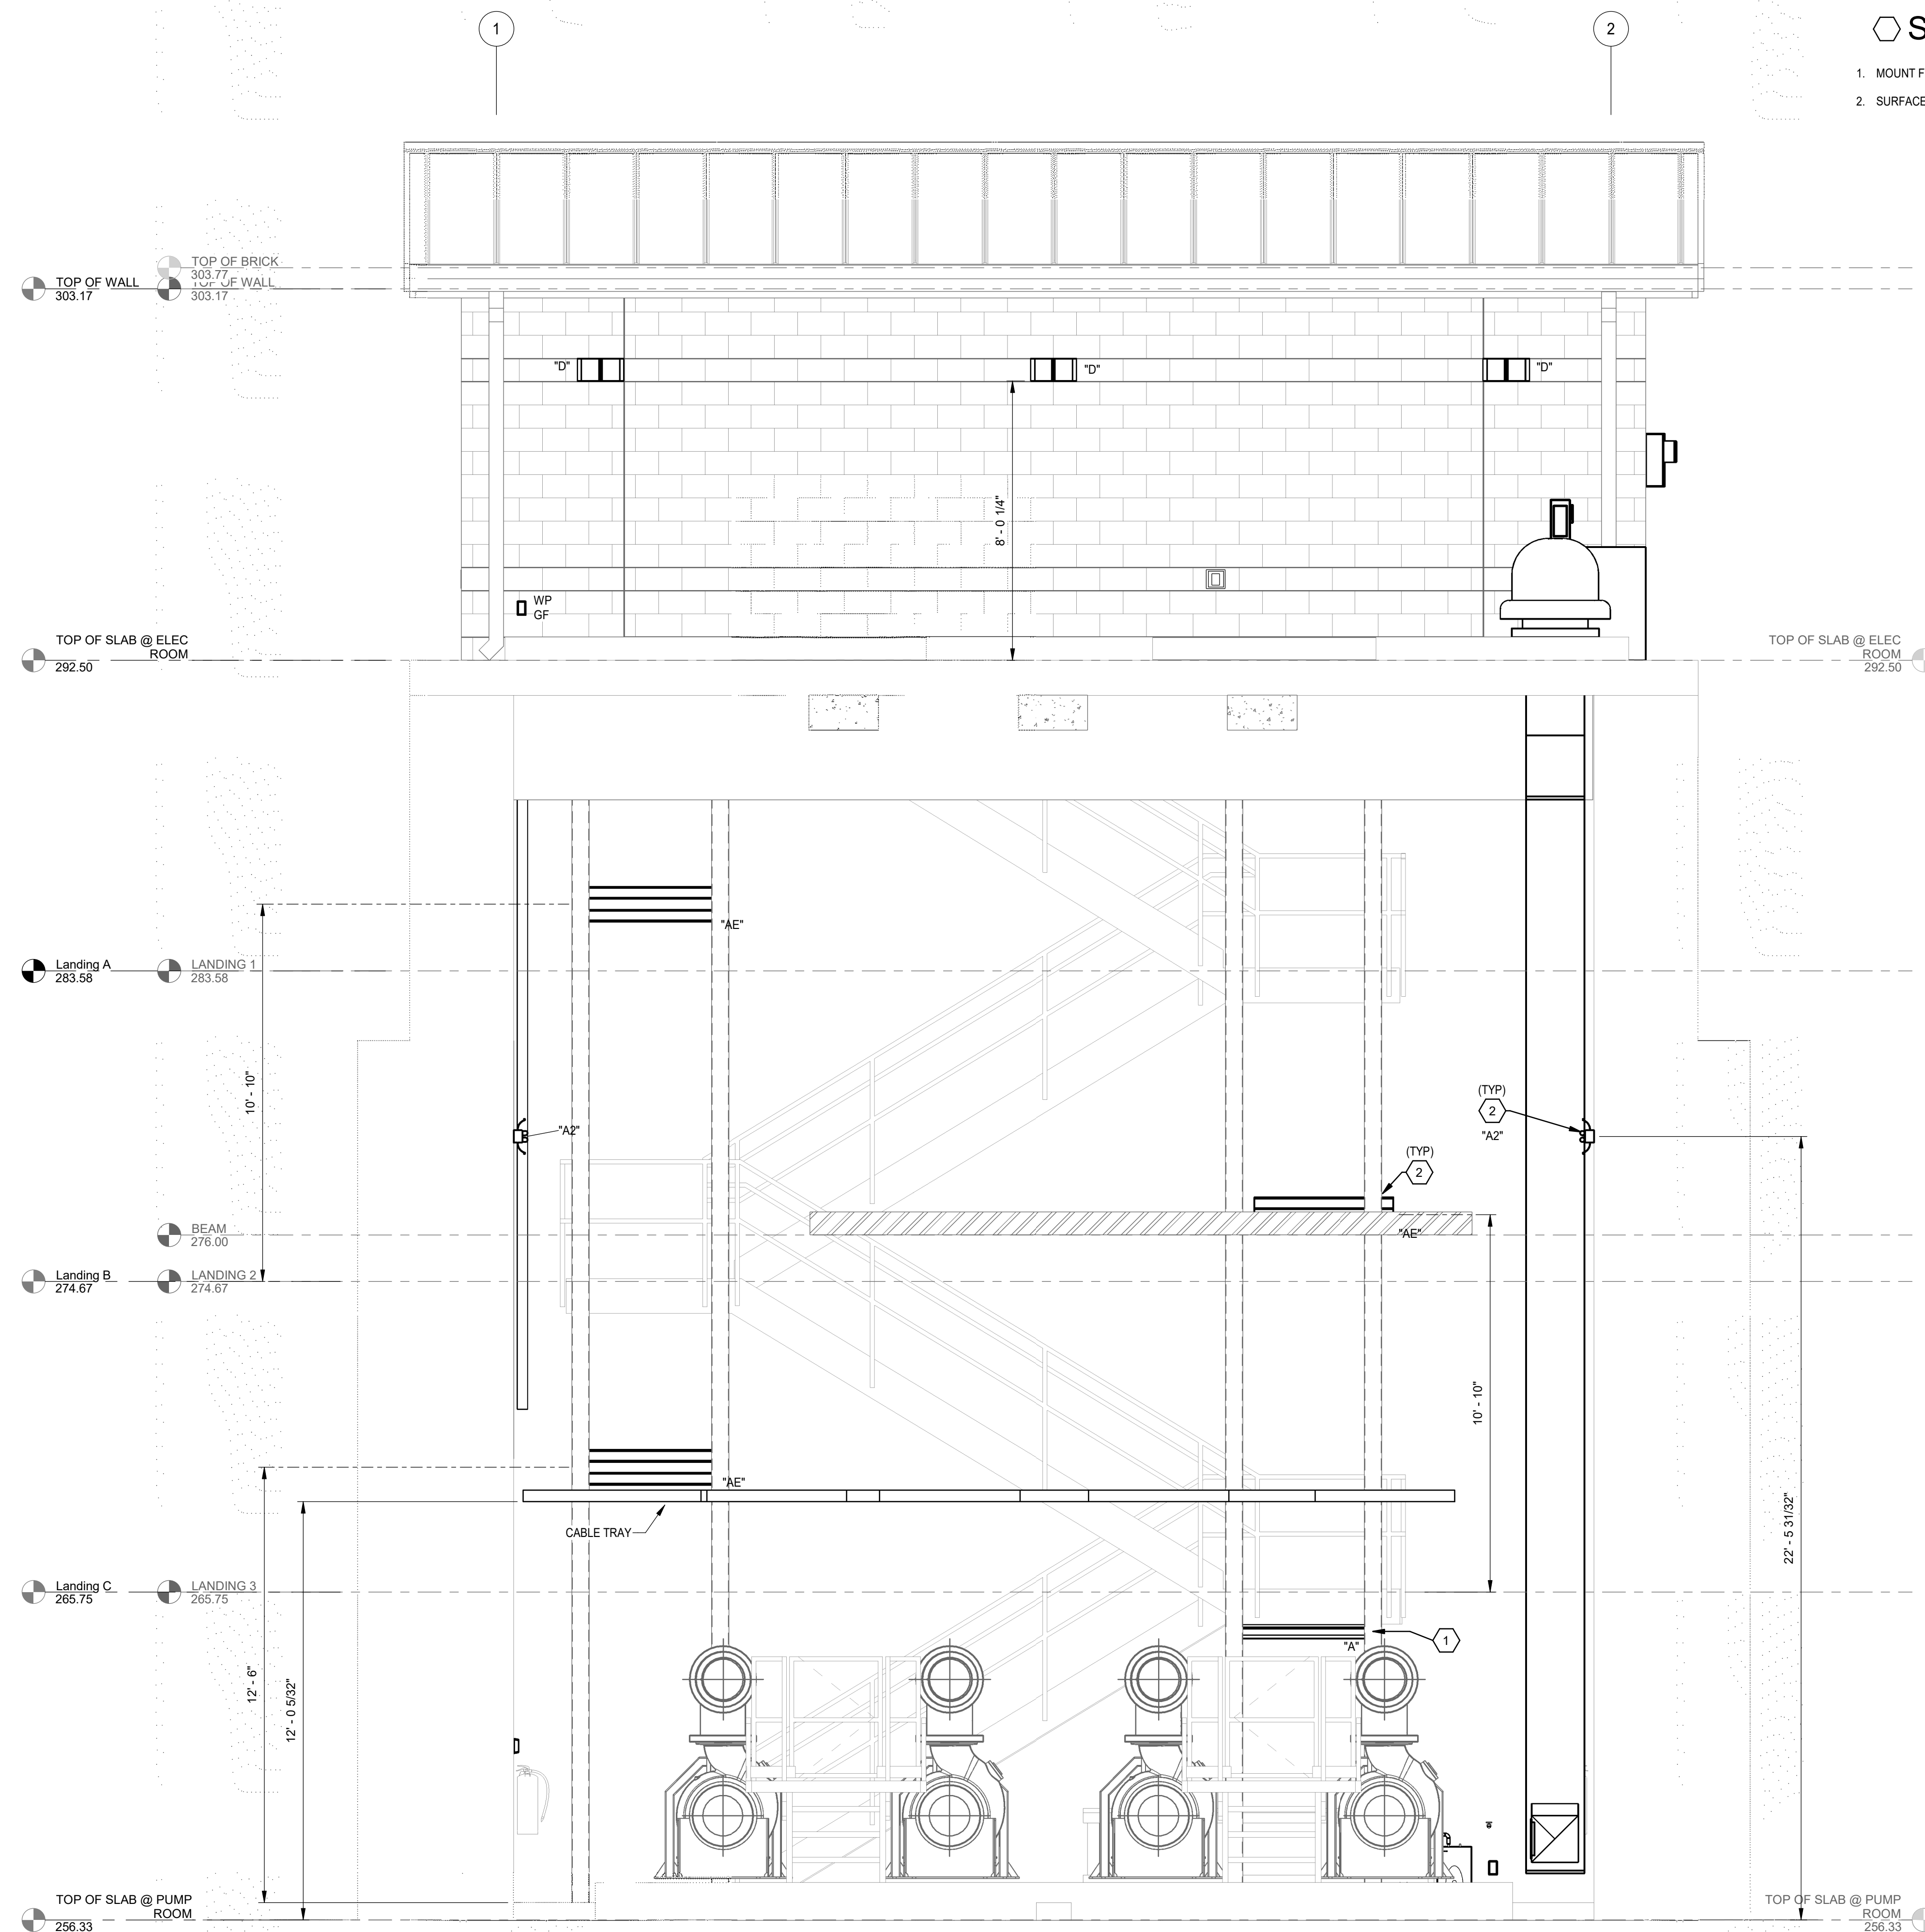

1 STAIRWELL LIGHTING SECTION

SHEET KEYNOTES

1. MOUNT FIXTURE BELOW STAIRWELL LANDING
2. SURFACE MOUNT FIXTURE TO WALL AT HEIGHT SHOWN.

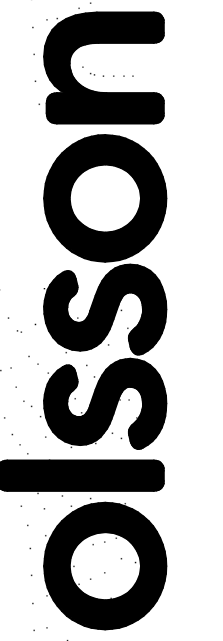

302 E. Millisap Road
Fayetteville, AR 72703
TEL 479.443.3404
FAX 479.443.4340
www.olsson.com

[illegible]

ELECTRICAL SECTIONS	
NEW WEST SIDE MAIN LIFT STATION CITY WATER & LIGHT	
JONESBORO, ARKANSAS	2020

Drawn by: _____ DB
 Checked by: _____ MM
 Approved by: _____ CW
 A/QC by: _____ DB
 Project no.: _____ 018-0054
 Drawing no.: _____
 Date: _____ 01/02/2020

SHEET
E505



1. PANEL LAYOUTS SHOWN ARE GENERAL ARRANGEMENTS ONLY. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL MEASUREMENTS, CLEARANCES, AND VERIFICATION OF EXISTING DEVICES.
2. PROVIDE PANOUIT OR EQUIVALENT CABLE MANAGEMENT SYSTEMS. WIREWAY CONTAINING FIELD WIRING SHALL BE 4" DEPTH MINIMUM. UTILIZE WIREWAY WHERE POSSIBLE.
3. INSTALL DEVICES AND WIREWAY ON BACKPANEL.



LEGEND


CAT 6 NETWORK CABLE ETHERNET

FIBER OPTIC (SINGLE MODE)



[illegible]

INSTRUMENTATION ARCHITECTURE	
NEW WEST SIDE MAIN LIFT STATION CITY WATER & LIGHT	
JONESBORO, ARKANSAS	2020

drawn by:	TS
checked by:	MM
approved by:	CW
QA/QC by:	DB
project no.:	018-0054
drawing no.:	
date	01/02/2020



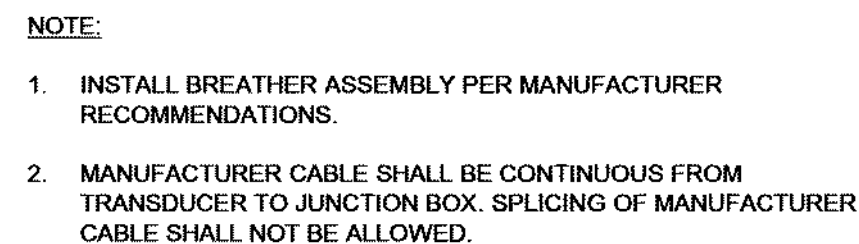


SCALE: 12" = 1'-0"



01 ALL LOW VOLTAGE CABLE SHALL BE INSTALLED IN SEPARATE CONDUIT FROM 120V AC AND ABOVE. CONTRACTOR SHALL BE RESPONSIBLE FOR CONDUIT SIZING PER APPLICABLE CODES.

02 INSTALL ONLY CONDUIT TO FUTURE PUMP VFD LOCATION. STUB AND CAP.

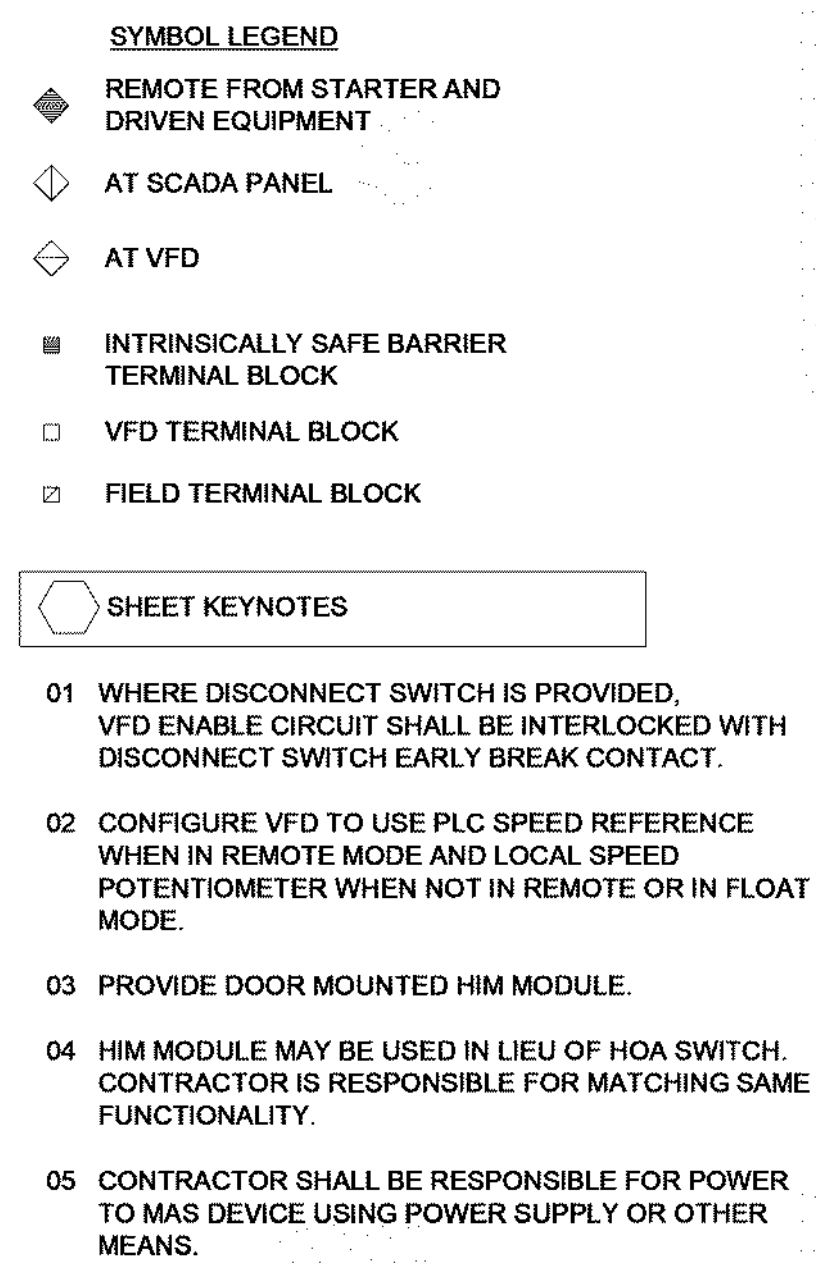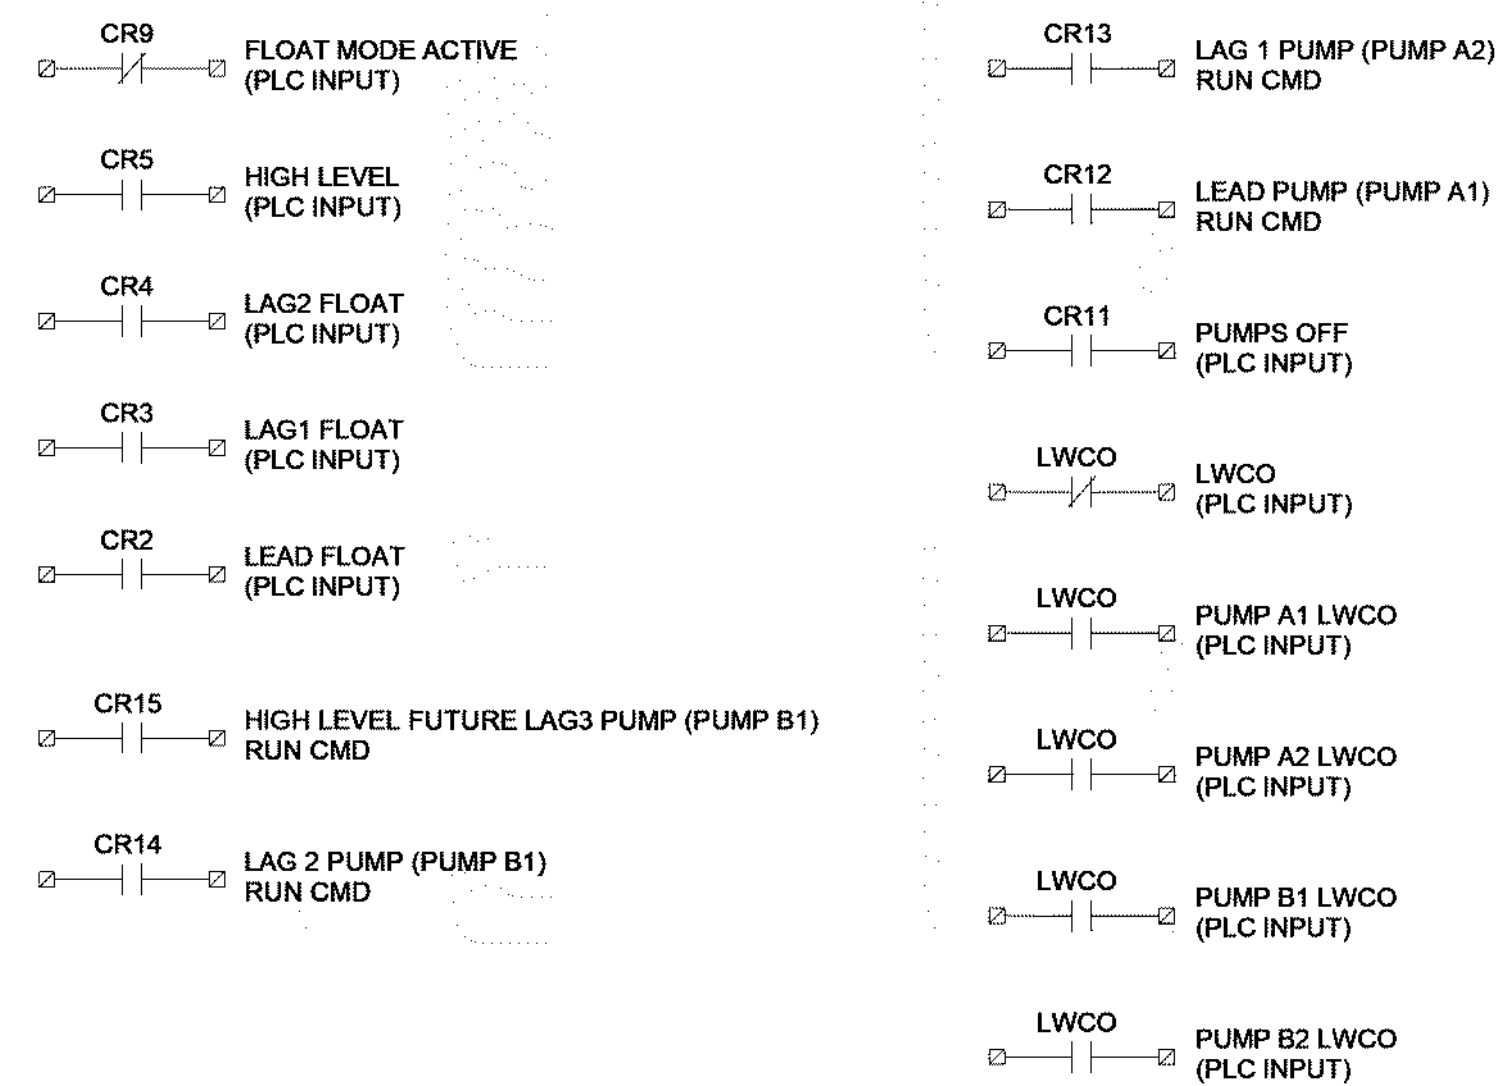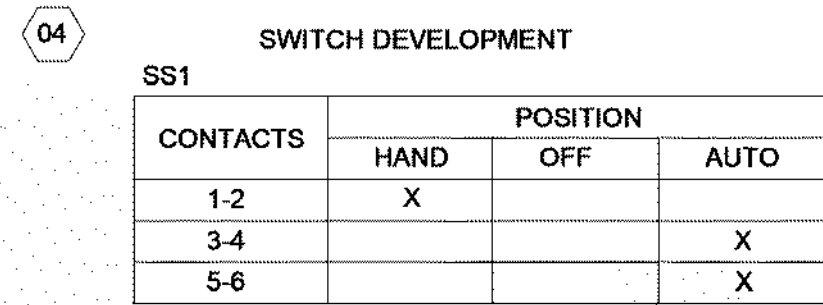

A VFD (T
SCALE: 1" = 20'-0"

B **FLOAT**
SCALE: 1" = 20'-0"